

Casement Window Specification

All frame sizes are given as a guide only. Systems may vary subject to manufacturer

### Security

To be independently tested and accredited to BS 7950 meeting the requirements of Secured by Design.

## Frames

General requirements; clear-faced sashes and components, defect-free and manufactured from materials to match existing window systems.

## Glazing

Windows to incorporate 28mm Softcoat 'Low E', argon filled, double glazed units (4/20/4).

#### Ironmongery

Hinges
Side Hung or top hung. Refer to drawings for individual requirements

Specification to meet the requirements of BS7950-


#### enhanced security for windows.

#### Finish


Materials, colour and finish to faithfully match existing

# WT.A




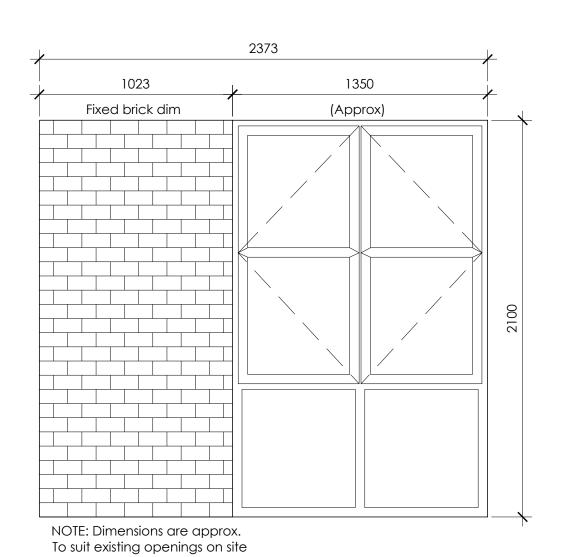

WT.A - WG.03

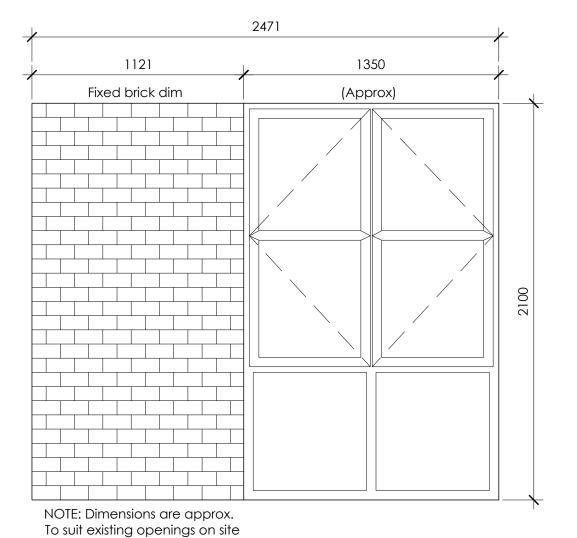

WT.A - WG.05 / WG.08

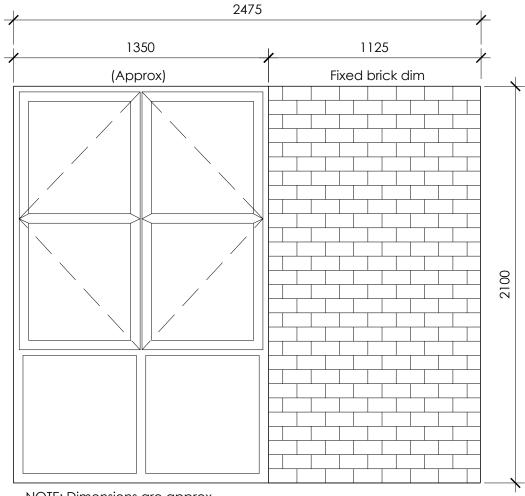

NOTE: Dimensions are approx.
To suit existing openings on site

WT.A - WG.04 / WG.07

2 WINDOW TYPE A AND PROPOSED BRICK INFILL DETAILS

NOTES

ALL DIMENSIONS ARE TO BE CHECKED ON SITE

ANY DISCREPANCIES ARE TO BE REPORTED TO THE ARCHITECT BEFORE ANY WORK COMMENCES

THIS DRAWING SHALL NOT BE SCALED TO ASCERTAIN ANY DIMENSIONS WORK TO FIGURED DIMS ONLY

THIS DRAWING SHALL NOT BE REPRODUCED WITHOUT EXPRESS WRITTEN PERMISSION FROM THE CREATOR.

READ IN CONJUNCTION WITH ALL RELEVANT DETAILS, SPECIFICATIONS, CONSULTANTS, SPECIALISTS AND SUBCONTRACTORS DRAWINGS / SPECIFICATIONS

P1 29.05.20 First Issue

STATUS BUILDING REGS

unit3 design studio, 22a Jordan Street, Liverpool L1 0BP

Client: Watts Group Ltd.

Project: 207004 Lord Street

Location: 1-7 Lord Street,

Fleetwood, FY7 6SR

Dwg No: AA-31-001

Dwg EXTERNAL WINDOW

Name: SCHEDULE

SCHEDULL

Revision: P1

Scale: 1:20 @ A1

Date: May 2020

Drawn: SM Checked: MS