

150mm full stone indent  
Ashlar faced

150mm full stone indent  
Rubble faced

Full-stone tracery /  
moulded / mullion indent

Area requiring repointing  
6mm Rubble joints  
NHL 3.5 - 1:2

Area requiring repointing  
6mm+ Rubble joints  
NHL 3.5 - 1:2.5

Area requiring repointing  
3mm ashlar joint  
NHL 3.5

Area requiring repointing  
3mm ashlar joint  
NHL 5

Dress back with hand tools

Window mesh installed

Movement crack to be  
repaired

Zone where service penetrations  
are acceptable in principle, all new  
cores require CA and HES sign off


ALL GUTTERS TO EXISTING  
BUILDINGS TO BE  
REPLACED

EXISTING SLATE ROOF  
REPAIRS AS PER [PP]03 AND  
NBS H62

LEAD REPAIRS AS PER  
DETAIL SERIES 37 AND NBS  
H71

STONE INDENTS  
GENERALLY A MINIMUM OF  
150MM DEEP AND CARRIED  
OUT IN CORNCOCKLE  
SANDSTONE - SAMPLE TO  
BE APPROVED BY CA AND  
HES ON SITE

Full extent of stone repairs  
and repointing to be agreed  
on site once scaffold is  
erected. Stone repairs and  
repointing not to commence  
until sign off for scheme is  
received from HES.

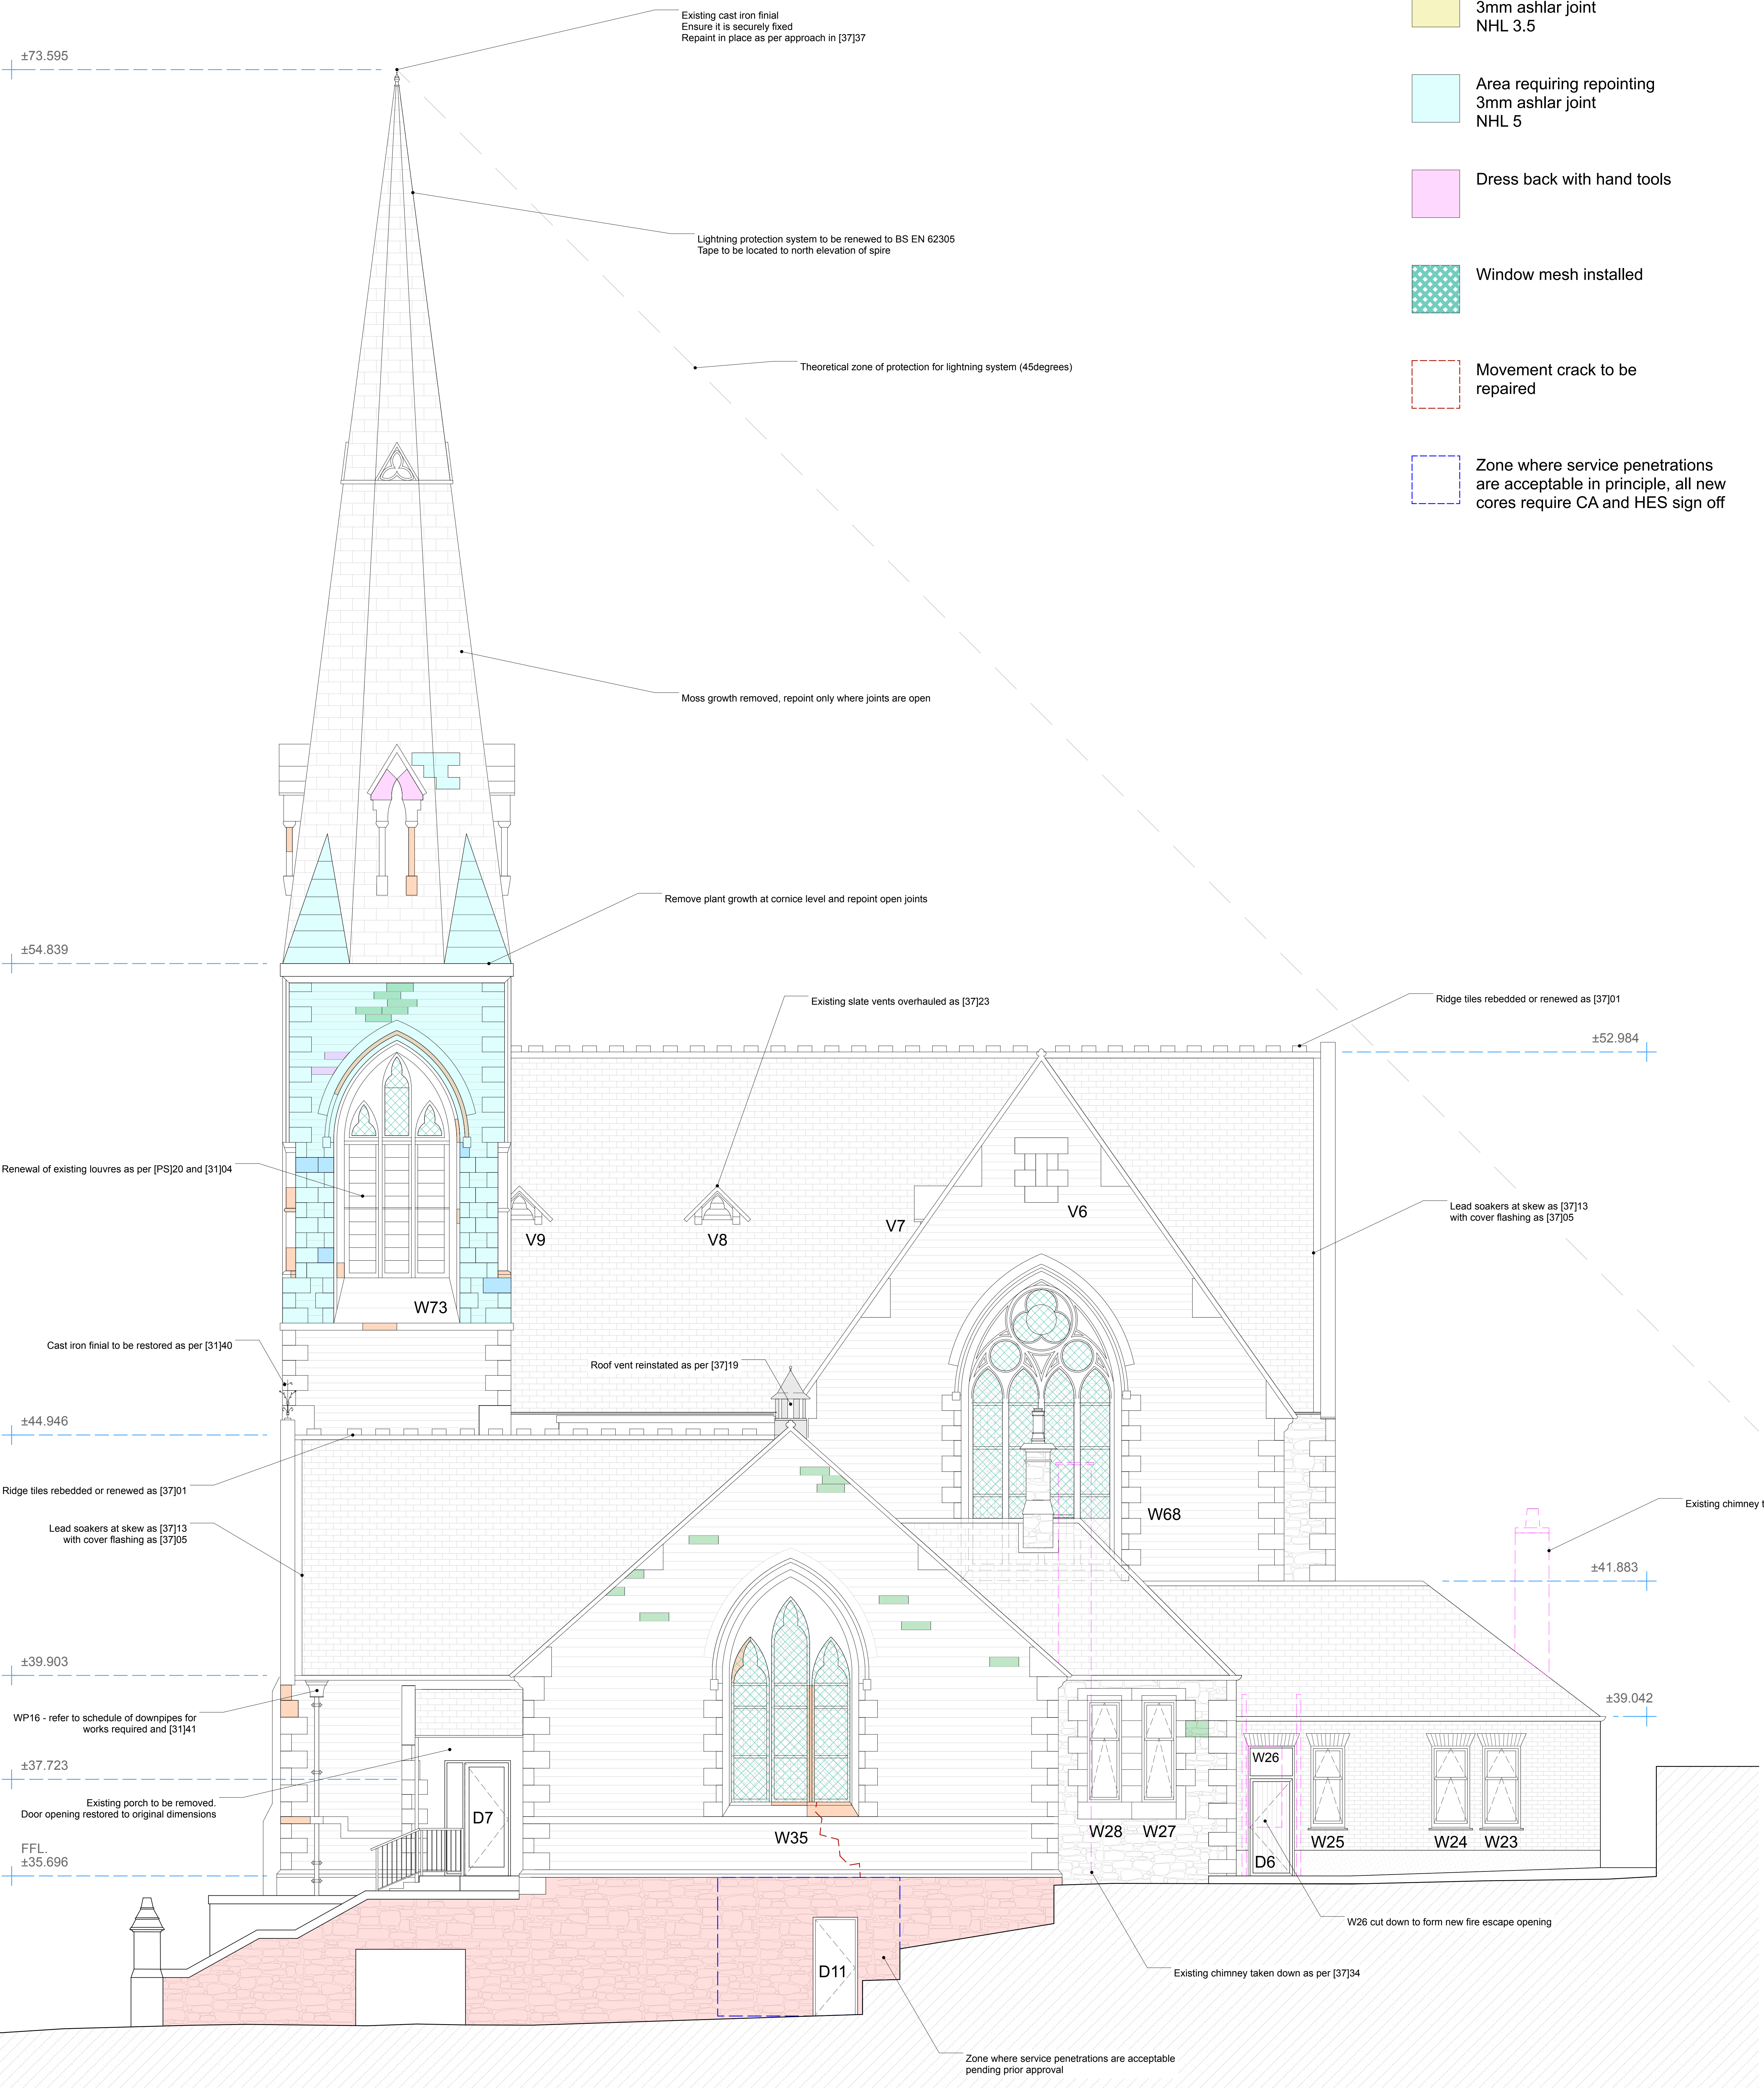

Do not scale from this drawing.  
If a drawing is used for the production of any other drawing, the user is responsible for ensuring that the drawing is used in the intended context and for any necessary modifications to the drawing.

This drawing is the copyright of John Gilbert Architects Ltd. No copying or distribution of this drawing or any part thereof is permitted without prior written permission.

**John Gilbert ARCHITECTS**

3rd White Street, 41 Temple Street, Glasgow, G4 0DA  
Tel: +44 (0)141 202 1000  
Web: www.jga.co.uk

Client  
**ABOVE ADVENTURE**  
**WOODSTOCK STREET CHURCH**

Title  
**PROPOSED EAST ELEVATIONS**

Project Status  
**CONTRACT**

Job No. **03749** Scale of Job **1:50**

Drawn by **SRA** Date of Issue **06/01/21**

Rev. **D**