




PIPES PASSING THROUGH
WALL (LINTEL)
(Scale 1:10)

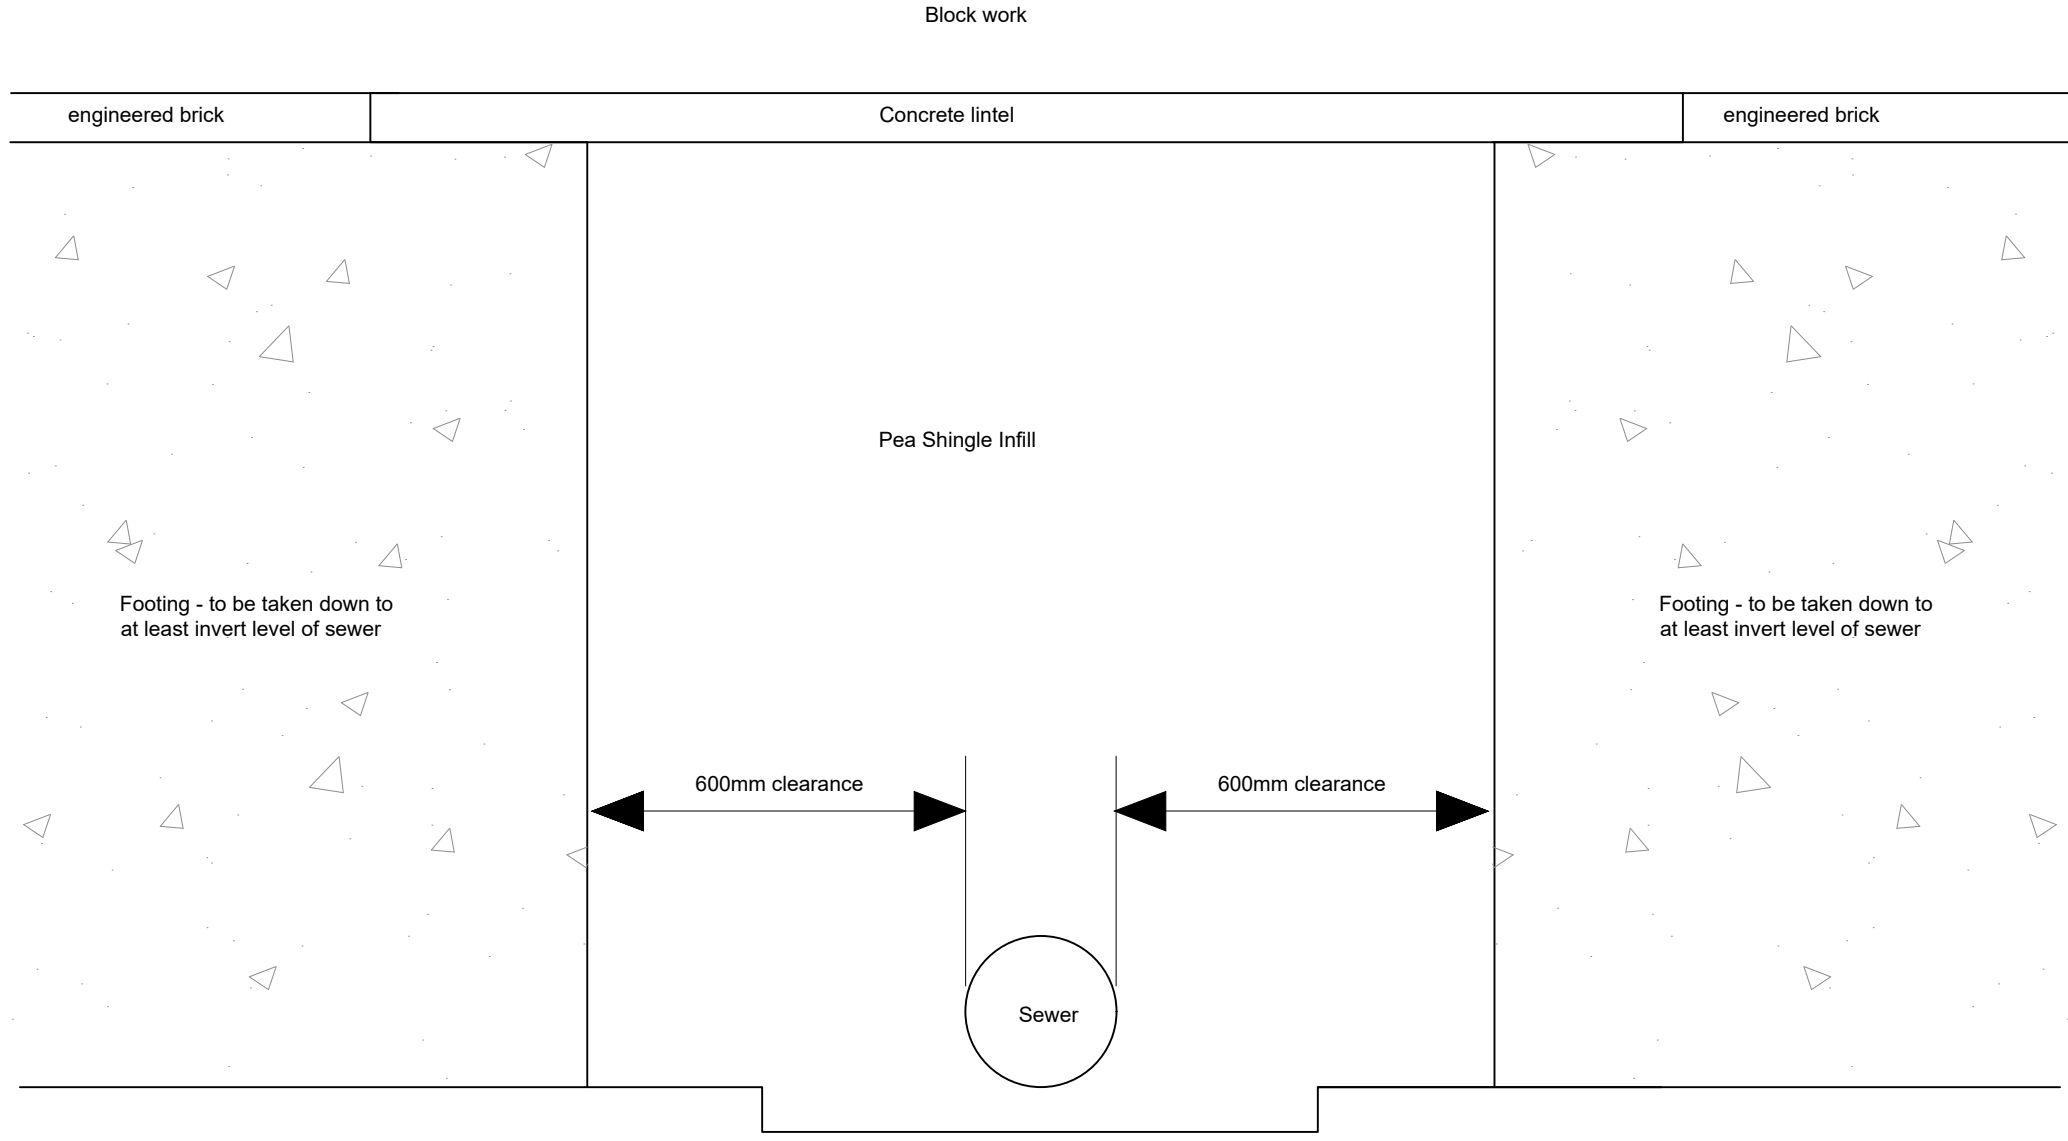


FOUNDATION/SEWER BRIDGE DETAIL

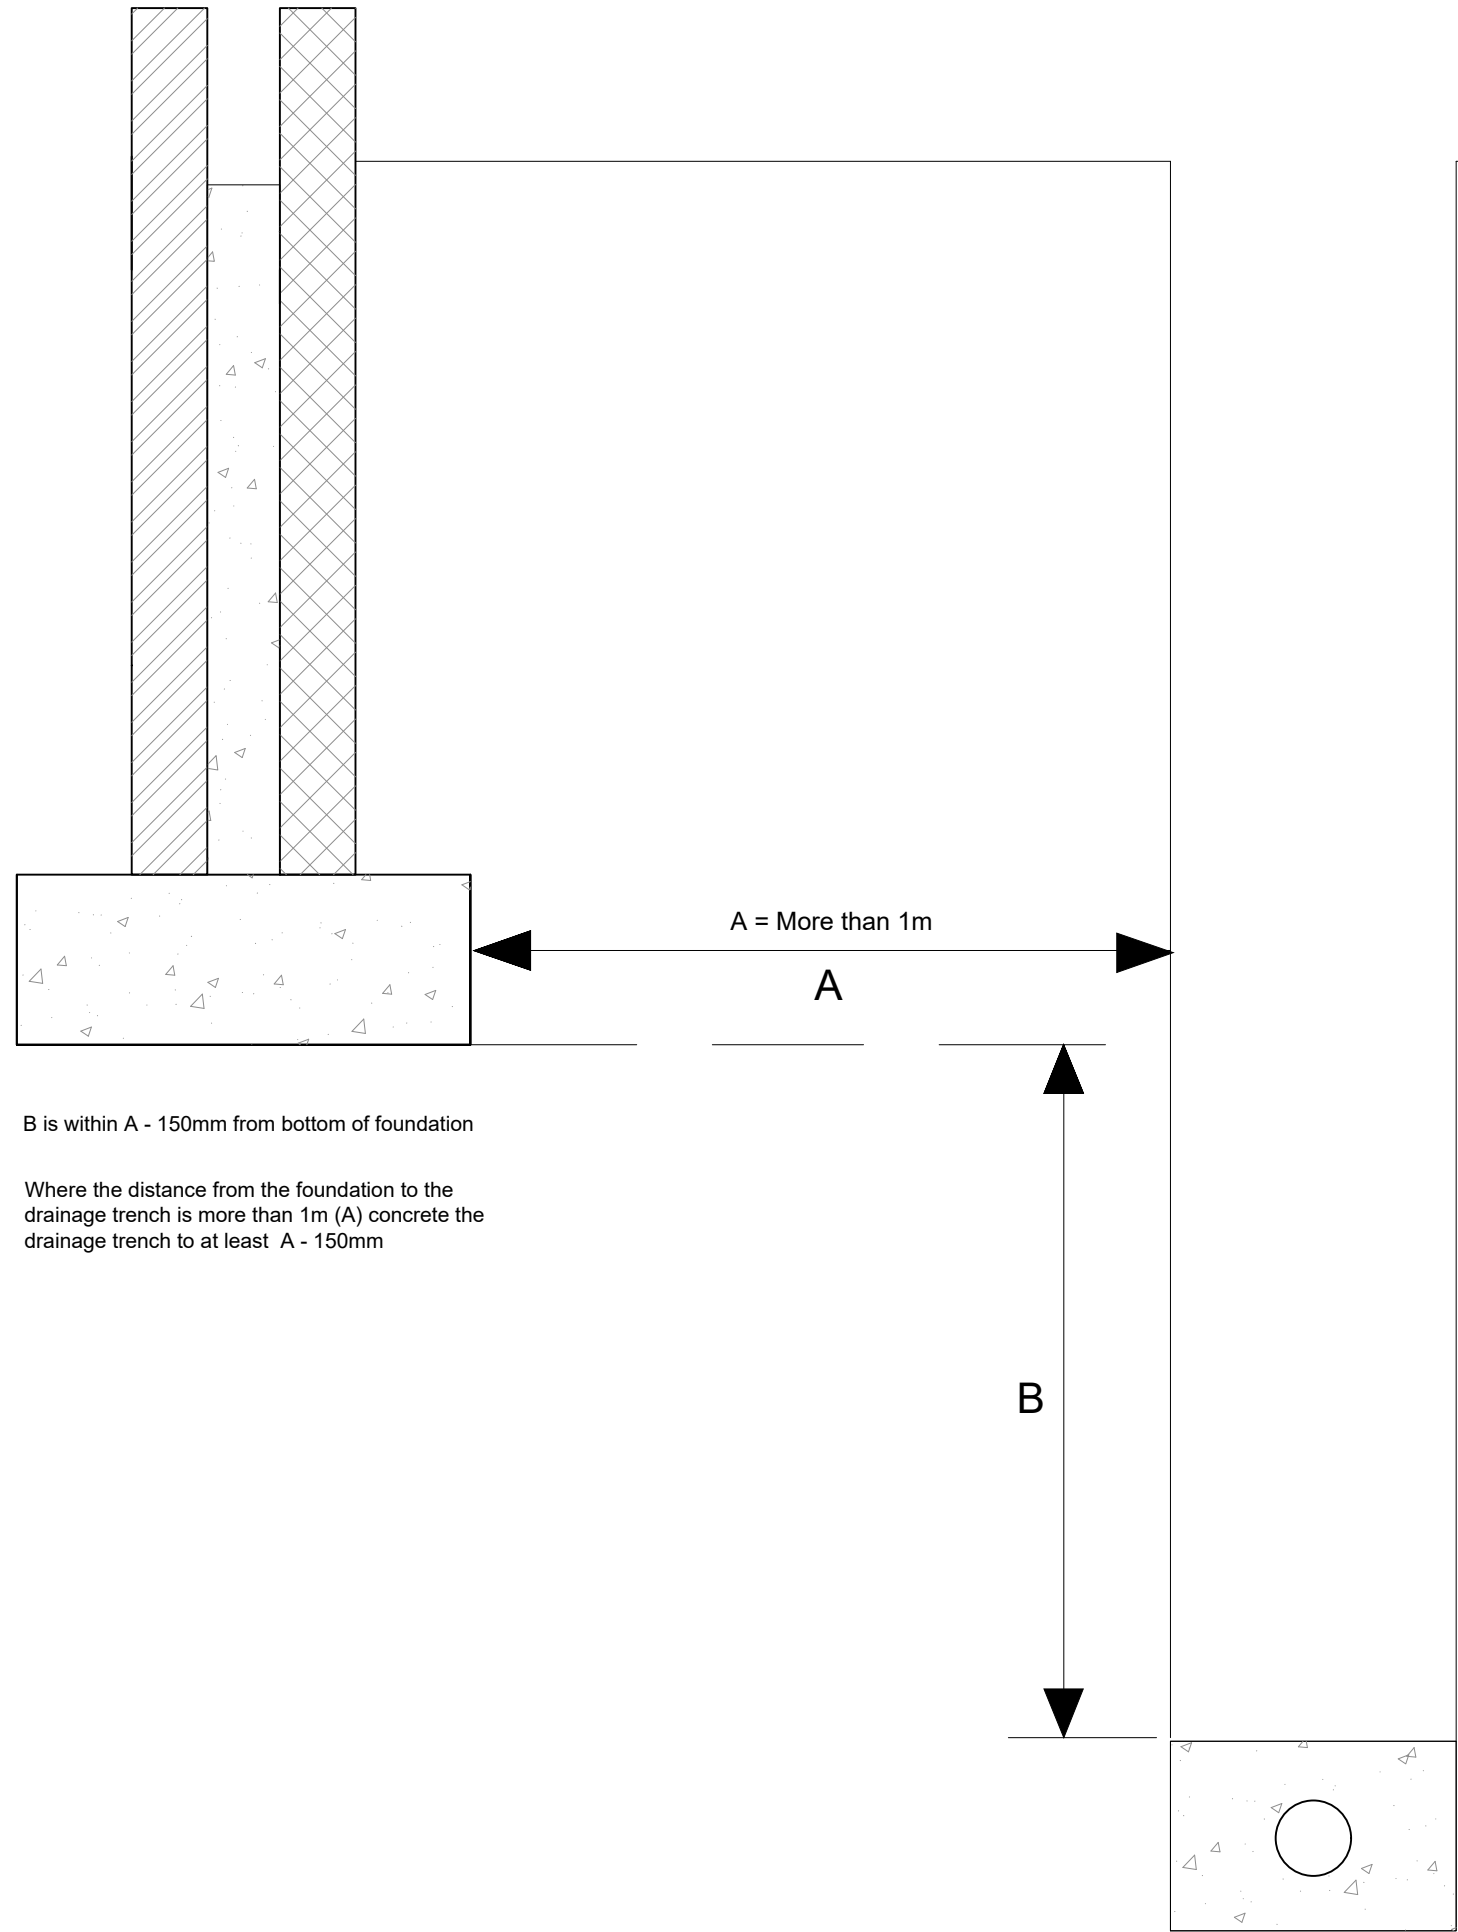

FOUNDATIONS NEAR DRAINS

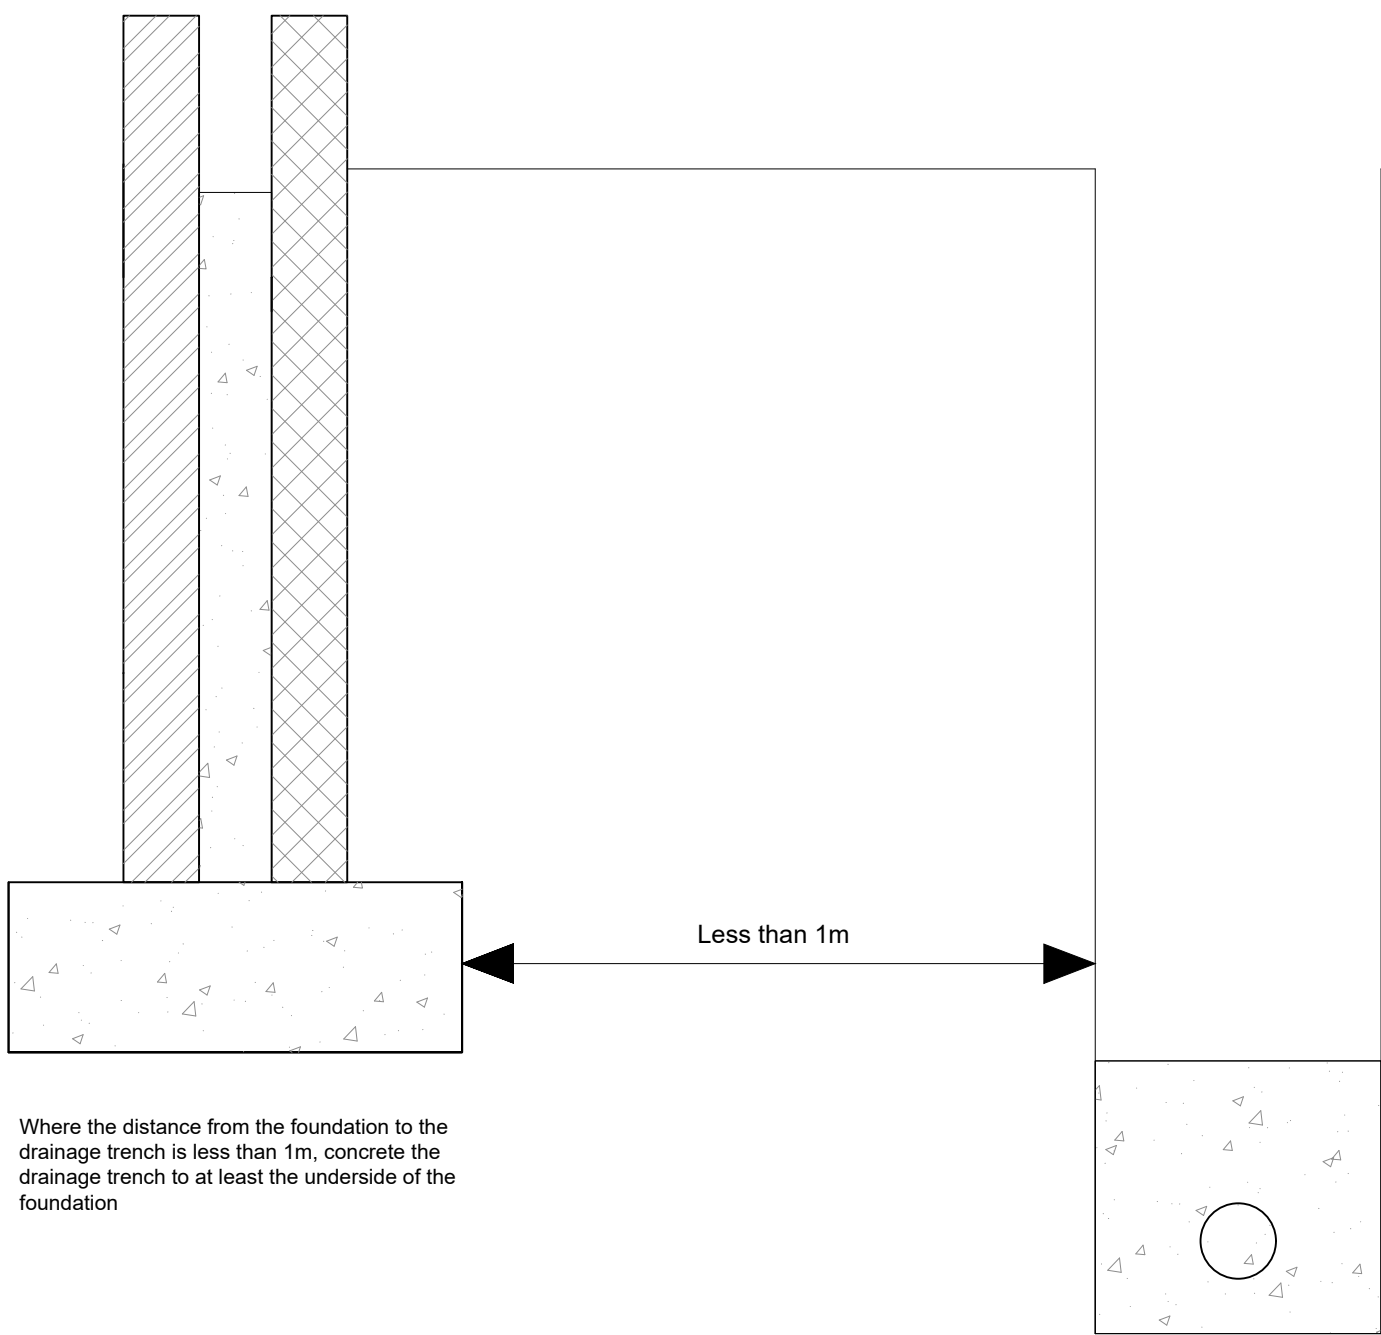

- Topsoil back fill to required depth
- Pipe to enter soakaway at least 100mm below top of membrane
- 100mm Ø pipe laid to max 1:100 fall to soakaway
- Geotextile membrane surround to coarse rubble infill to stop entrance of soil
- Soakaway depth to be at least 1.0m below 100mm Ø outlet pipe
- SOAKAWAY TO BE LOCATED AT LEAST 5.0m AWAY FROM ALL BUILDINGS

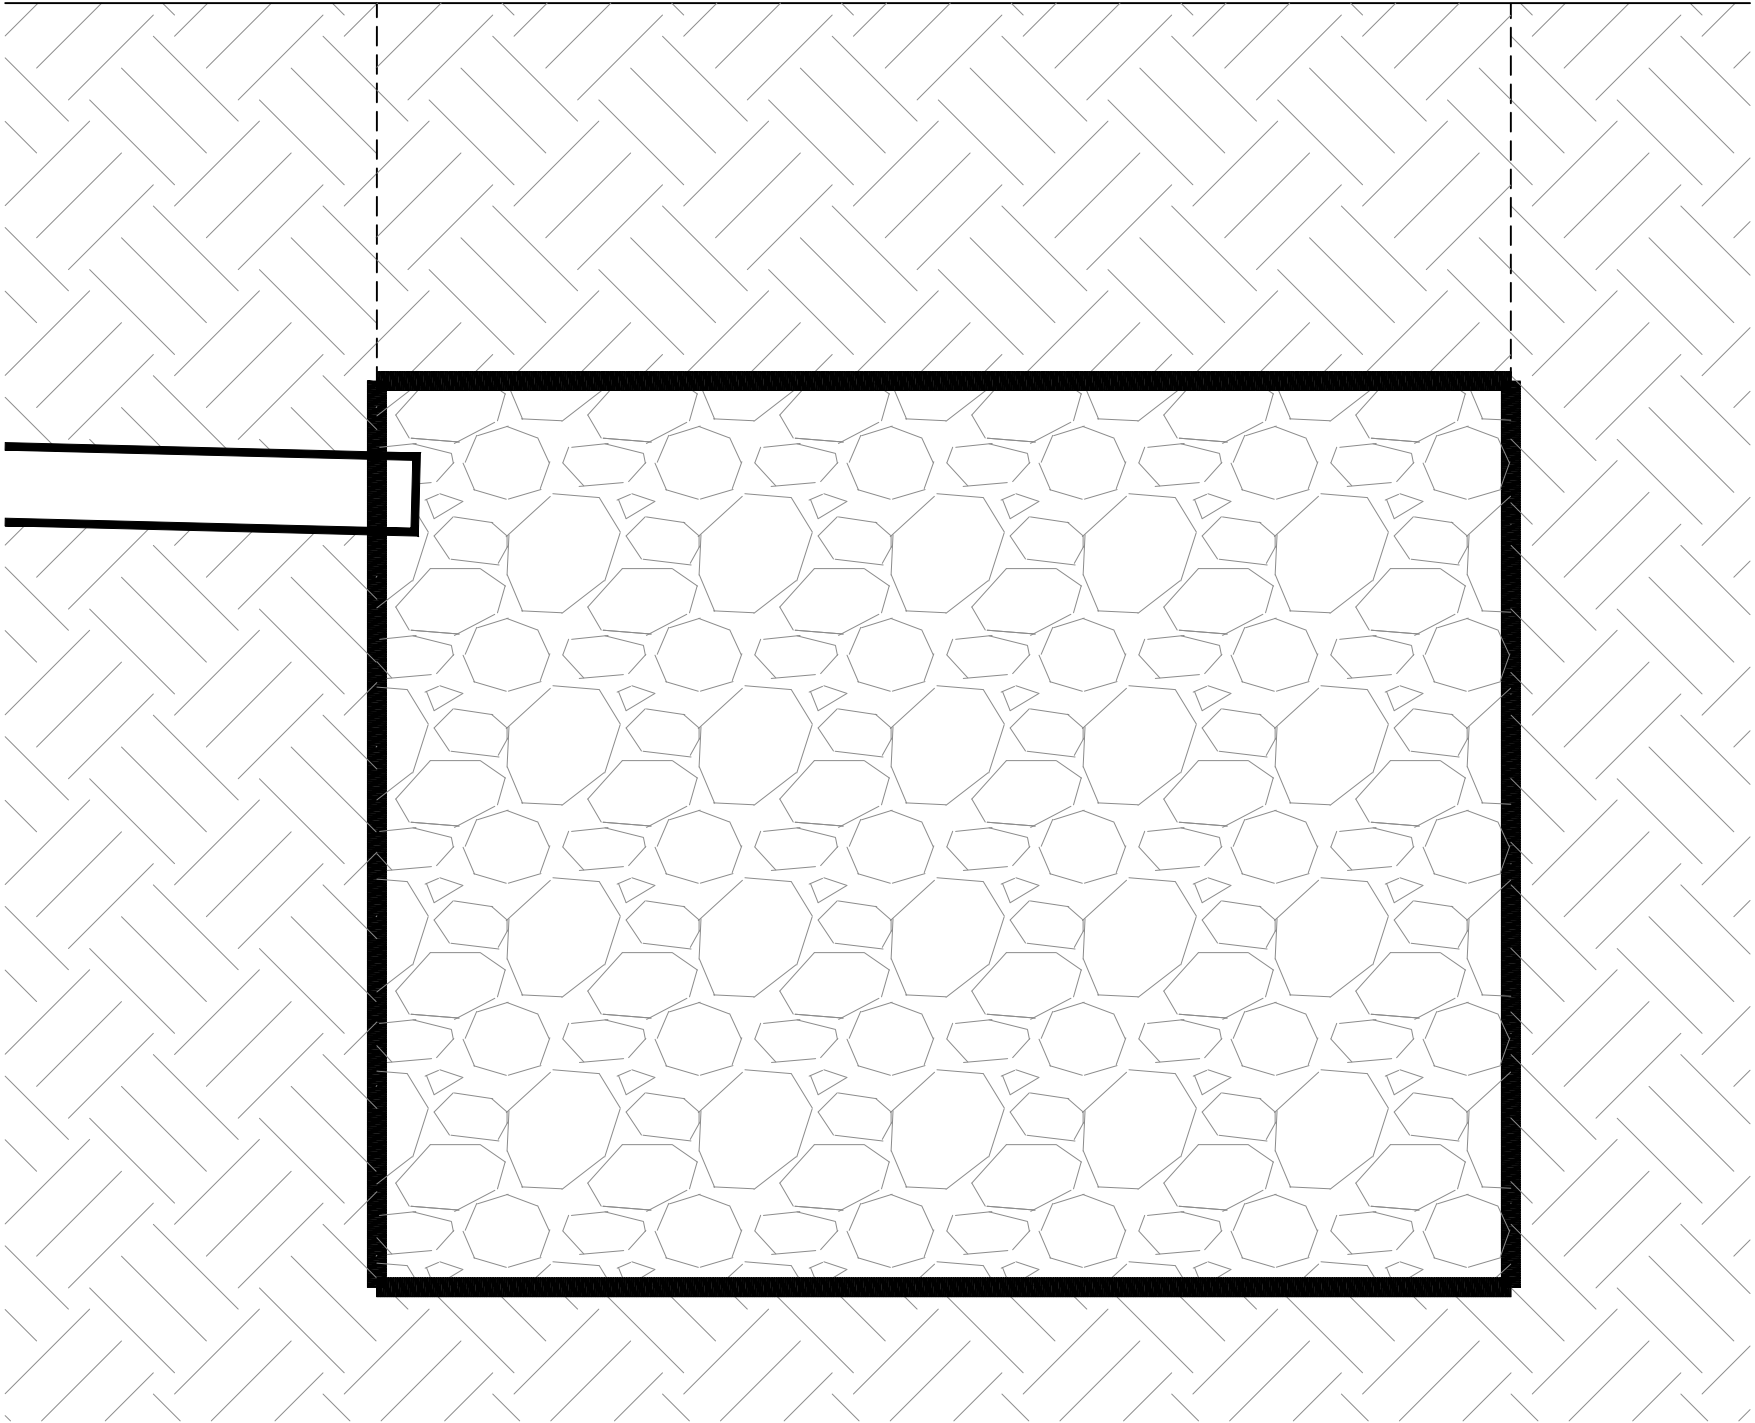

SOAKAWAY DETAIL
(SCALE 1:10)

10 PROPOSED DETAILS
SCALE AS SHOWN @ A1