

Date Requested: 08/03/2021
 Job Reference: 21510958
 Site Location: 463899 099351
 Requested by:
 Mrs Kimberley Piper
 Your Scheme/Reference:
 20/01493/FUL
 Scale: 1:1025 (When plotted at A3)

WARNING
 There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.
 WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

	Voltages (V)			
	LV (Low Voltage) and Services	Up to 1,000V	Over 1,000V to 11,000V	22,000V to 132,000V
HV (High Voltage)			275,000V and 400,000V	
EHV (Extra High Voltage)				
Transmission				

	NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend

- Service Cable
- LV Mains
- 2-3.3kV
- 6.6kV
- 11kV
- 22kV
- 33kV
- 66kV
- 132kV
- 275kV
- 400kV
- Fibre Optic
- Pilot Cable


Distribution Structures (Electric)

- Pole, Existing Location
- Pole Structure, Existing Location - Single
- Pole Structure, Existing Location - H
- Duct Route
- Cross Section Route

Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inveralmond House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

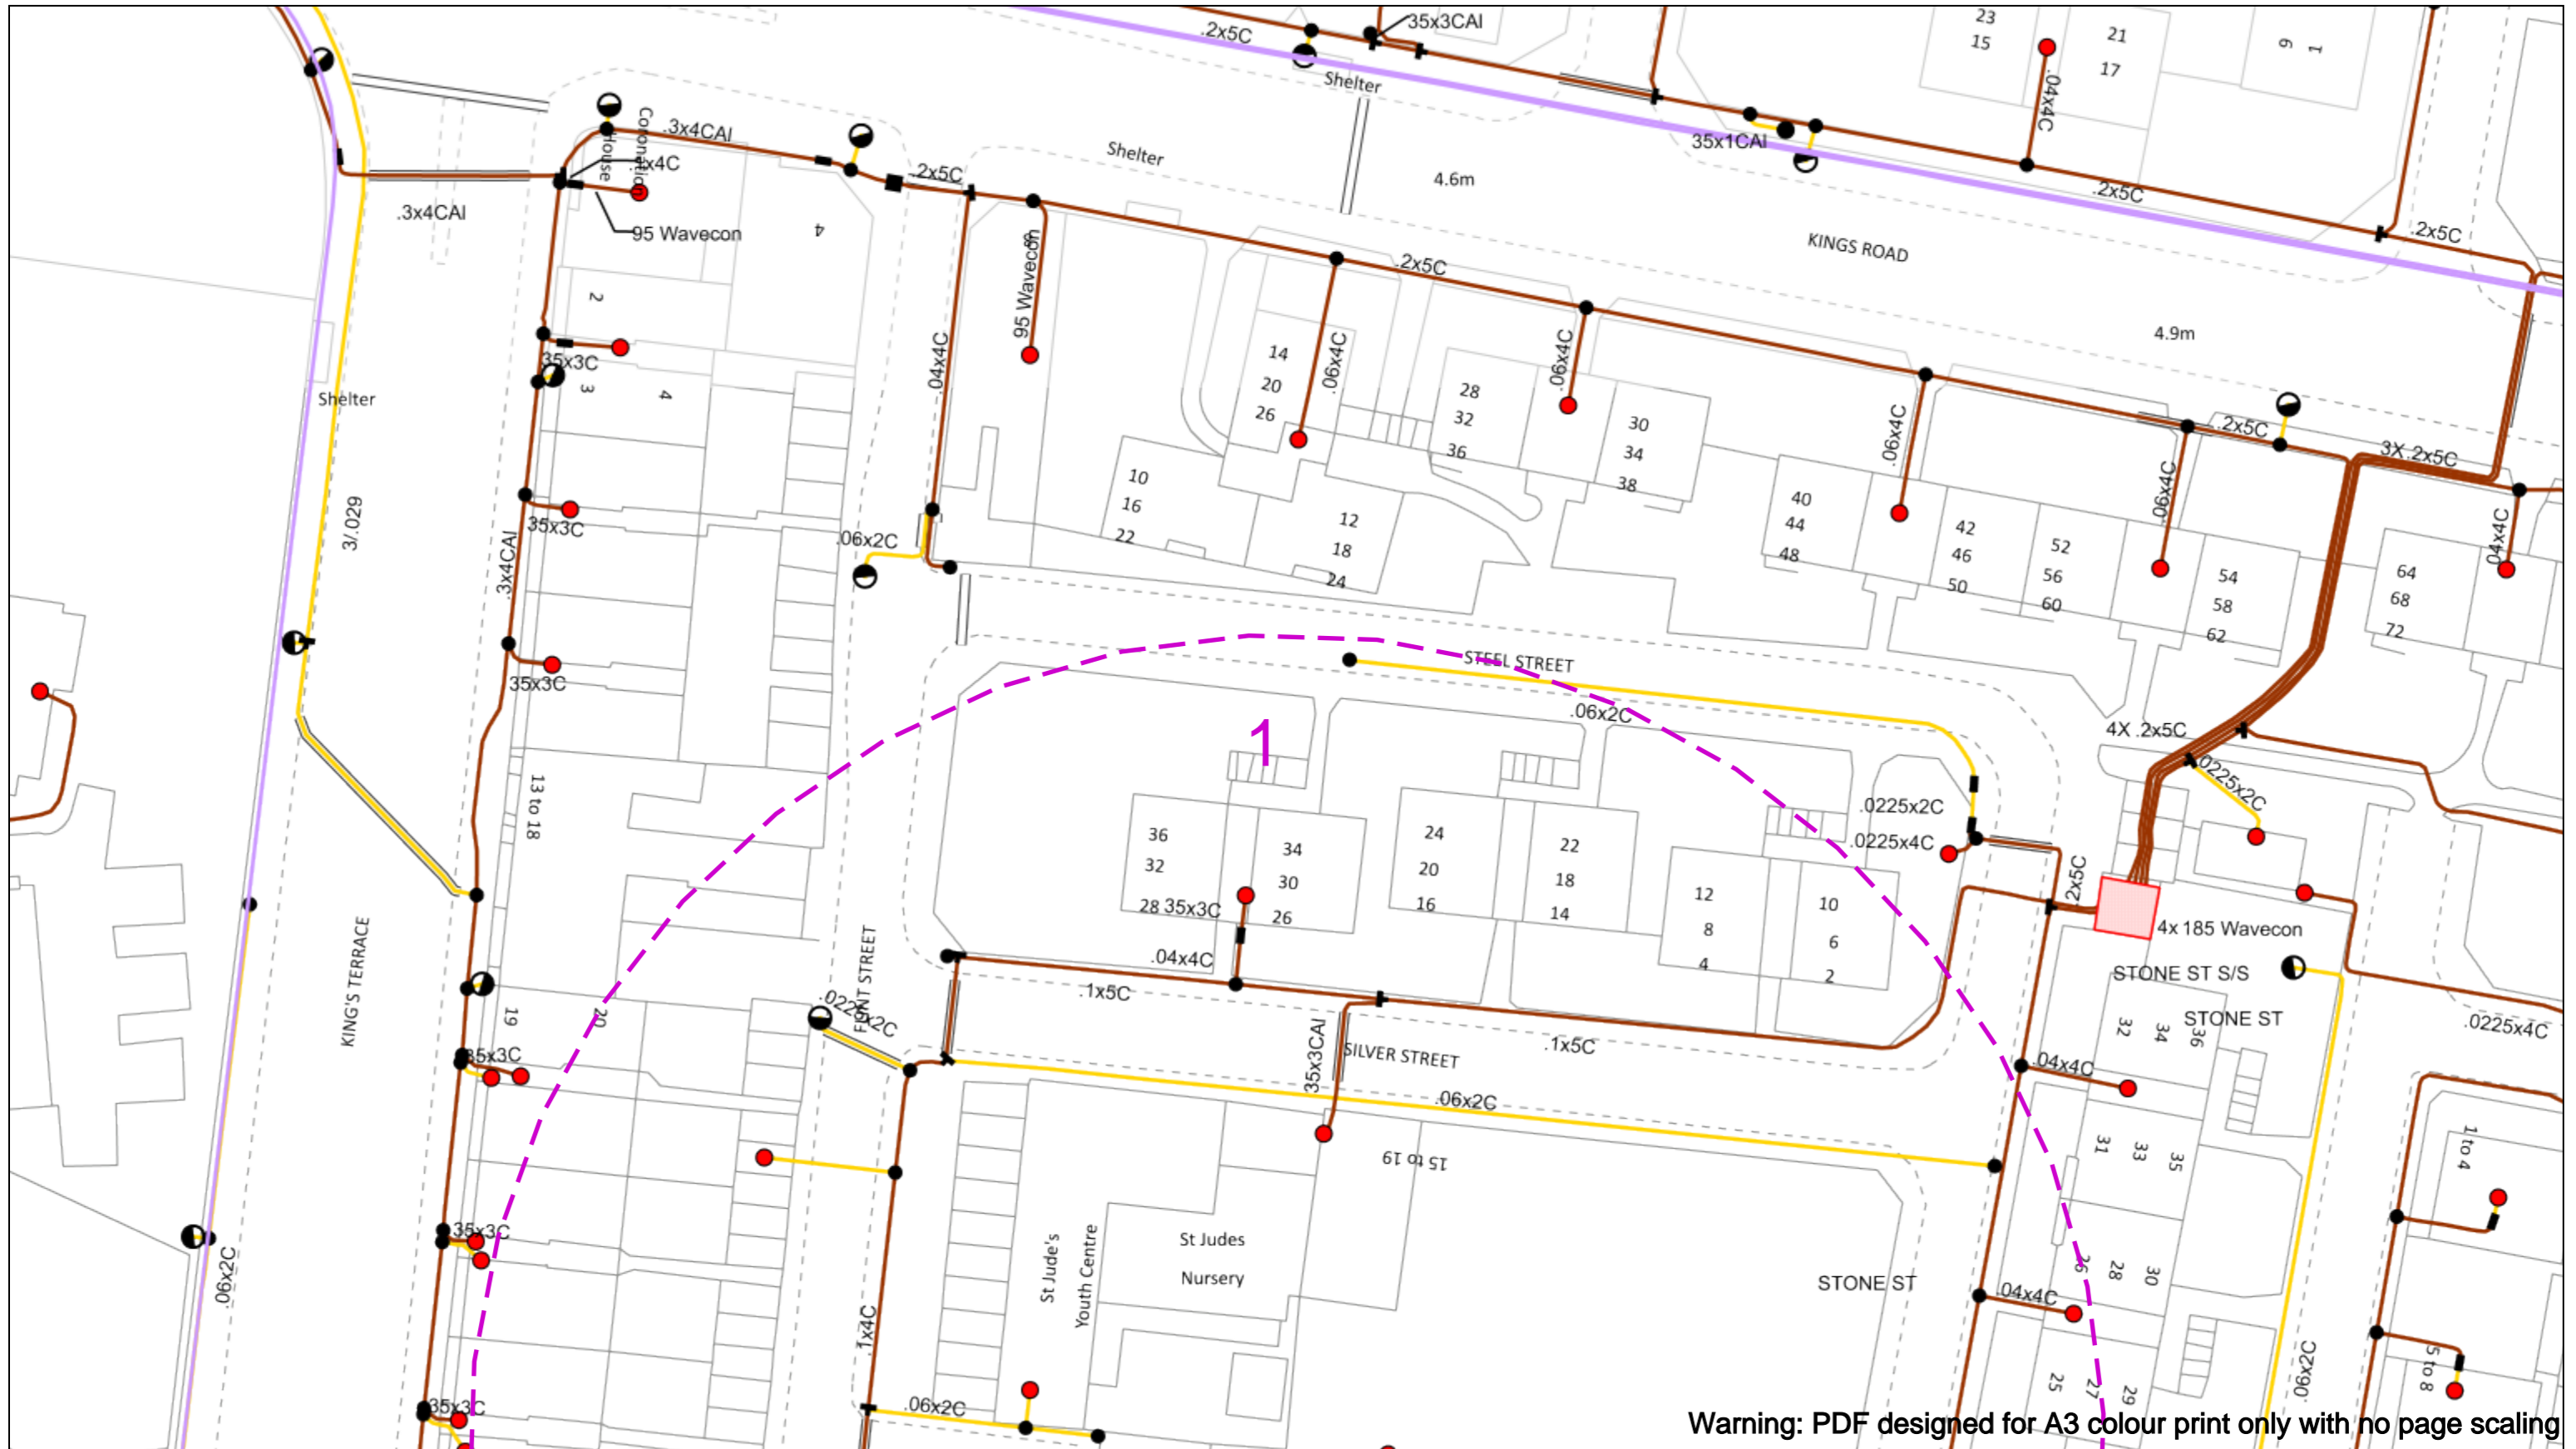

Warning: PDF designed for A3 colour print only with no page scaling



Dig Sites Area: Line:

Date Requested: 08/03/2021
 Job Reference: 21510958
 Site Location: 463899 099351
 Requested by:
 Mrs Kimberley Piper
 Your Scheme/Reference:
 20/01493/FUL
 Scale: 1:500 (When plotted at A3)

WARNING
 There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.
 WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

		Voltages (V)			
LV (Low Voltage) and Services		Up to 1,000V			
HV (High Voltage)		Over 1,000V to 11,000V			
EHV (Extra High Voltage)		22,000V to 132,000V			
Transmission		275,000V and 400,000V			
		NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
	Services	LV	HV	EHV	
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m	
Road Crossing	0.6m	0.6m	0.75m	0.9m	
Agricultural	1m	1m	1m	1.1m	

Legend


- Service Cable
- LV Mains
- 2-3.3kV
- 6.6kV
- 11kV
- 22kV
- 33kV
- 66kV
- 132kV
- 275kV
- 400kV
- Fibre Optic
- Pilot Cable

Distribution Structures (Electric)

- Pole, Existing Location
- Pole Structure, Existing Location - Single
- Pole Structure, Existing Location - H
- Duct Route
- Cross Section Route



Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inveralmond House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered in Scotland No. SC213459
 If you're unsure & need to seek advice before commencing excavations please contact:
 General Enquiries: 0800 048 3516
 Subject to revision – Master held by SSEN Asset Data Team:
AssetData@sse.com
 01256 337 294

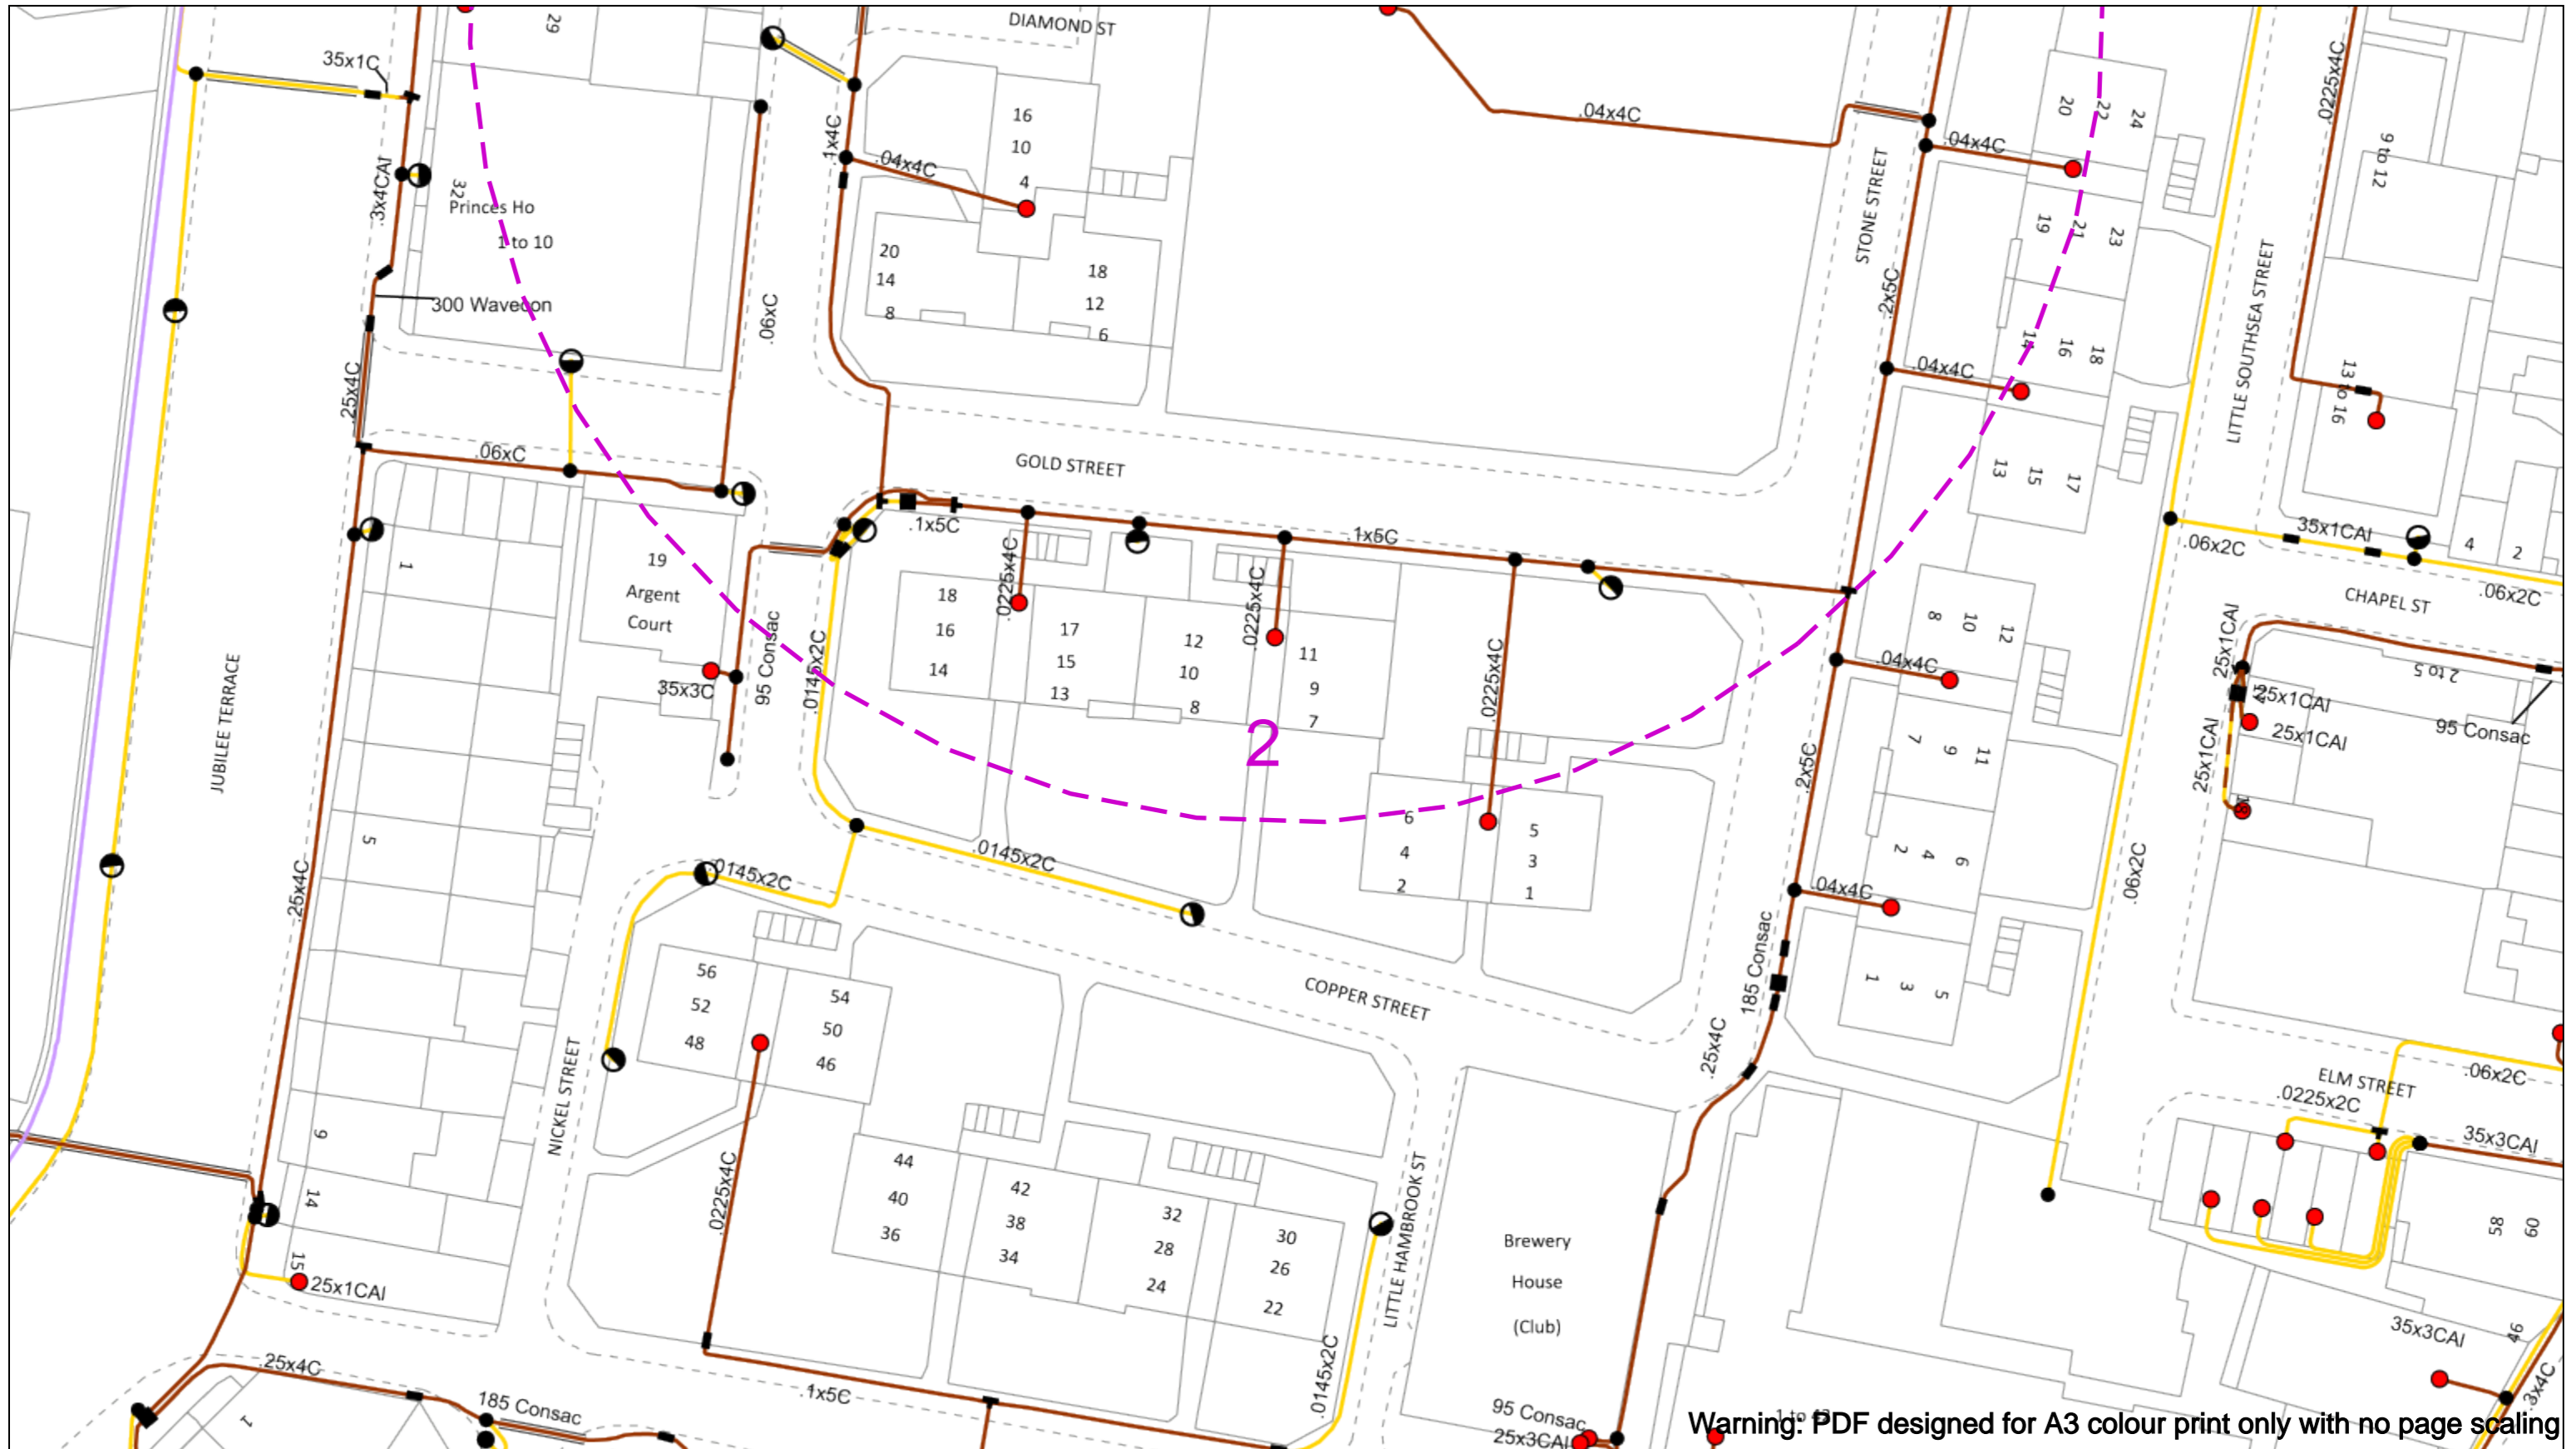

Warning: PDF designed for A3 colour print only with no page scaling



Dig Sites Area: Line:

Date Requested: 08/03/2021
 Job Reference: 21510958
 Site Location: 463899 099351
 Requested by:
 Mrs Kimberley Piper
 Your Scheme/Reference:
 20/01493/FUL

Scale: 1:500 (When plotted at A3)

WARNING
 There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.
 WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

		Voltages (V)			
LV (Low Voltage) and Services		Up to 1,000V			
HV (High Voltage)		Over 1,000V to 11,000V			
EHV (Extra High Voltage)		22,000V to 132,000V			
Transmission		275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID					
	Services	LV	HV	EHV	
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m	
Road Crossing	0.6m	0.6m	0.75m	0.9m	
Agricultural	1m	1m	1m	1.1m	

Legend

- Service Cable
- LV Mains
- 2-3.3kV
- 6.6kV
- 11kV
- 22kV
- 33kV
- 66kV
- 132kV
- 275kV
- 400kV
- Fibre Optic
- Pilot Cable

Distribution Structures (Electric)


- Pole, Existing Location
- Pole Structure, Existing Location - Single
- Pole Structure, Existing Location - H
- Duct Route
- Cross Section Route



Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inveralmond House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

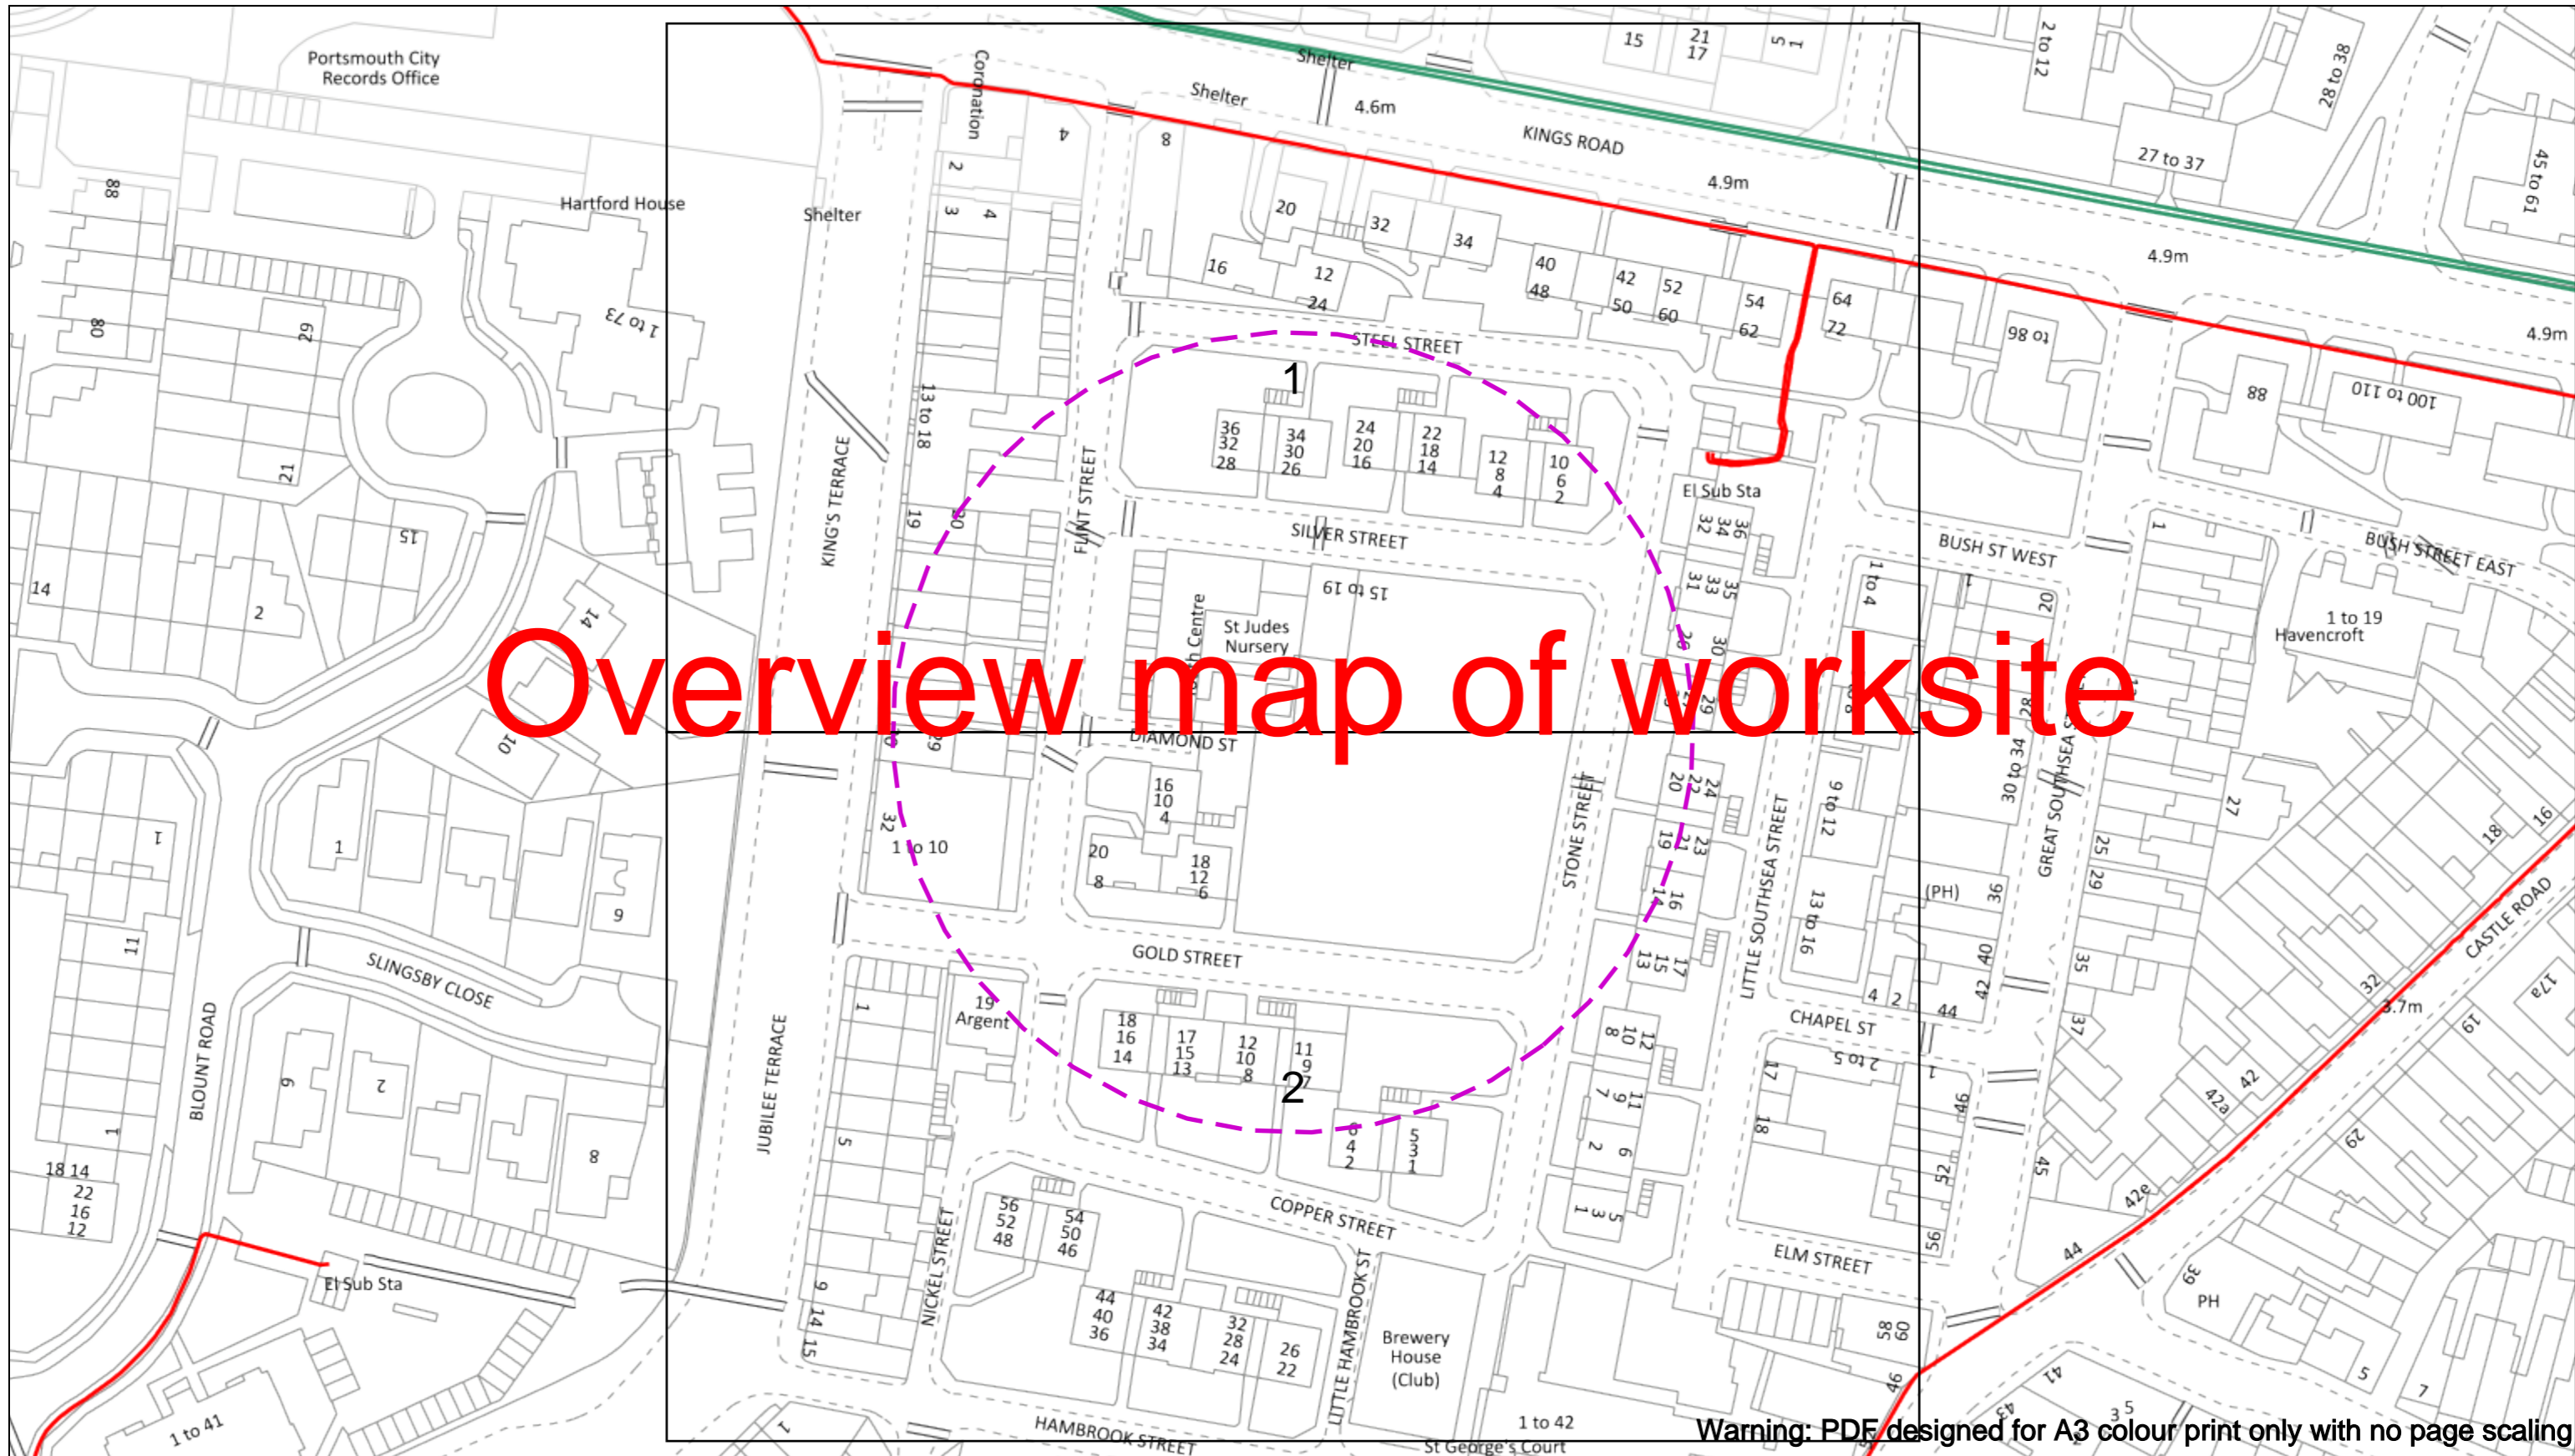

Overview map of worksite

Warning: PDF designed for A3 colour print only with no page scaling

Dig Sites Area: Line:

Extra High Voltage cables in vicinity




Date Requested: 08/03/2021
 Job Reference: 21510958
 Site Location: 463899 099351
 Requested by:
 Mrs Kimberley Piper
 Your Scheme/Reference:
 20/01493/FUL
 Scale: 1:1025 (When plotted at A3)

WARNING
 There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.
 WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)


		Voltages (V)		
LV (Low Voltage) and Services		Up to 1,000V		
HV (High Voltage)		Over 1,000V to 11,000V		
EHV (Extra High Voltage)		22,000V to 132,000V		
Transmission		275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend		Distribution Structures (Electric)	
	Service Cable		Pole, Existing Location
	LV Mains		Pole Structure, Existing Location - Single
	2 - 33kV		Pole Structure, Existing Location - H
	66kV		Duct Route
	11kV		Cross Section Route
	22kV		
	33kV		
	66kV		
	132kV		
	275kV		
	400kV		
	Fibre Optic		
	Pilot Cable		

Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inveralmond House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered in Scotland No. SC213459
 If you're unsure & need to seek advice before commencing excavations please contact:
 General Enquiries: 0800 048 3516
 Subject to revision - Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

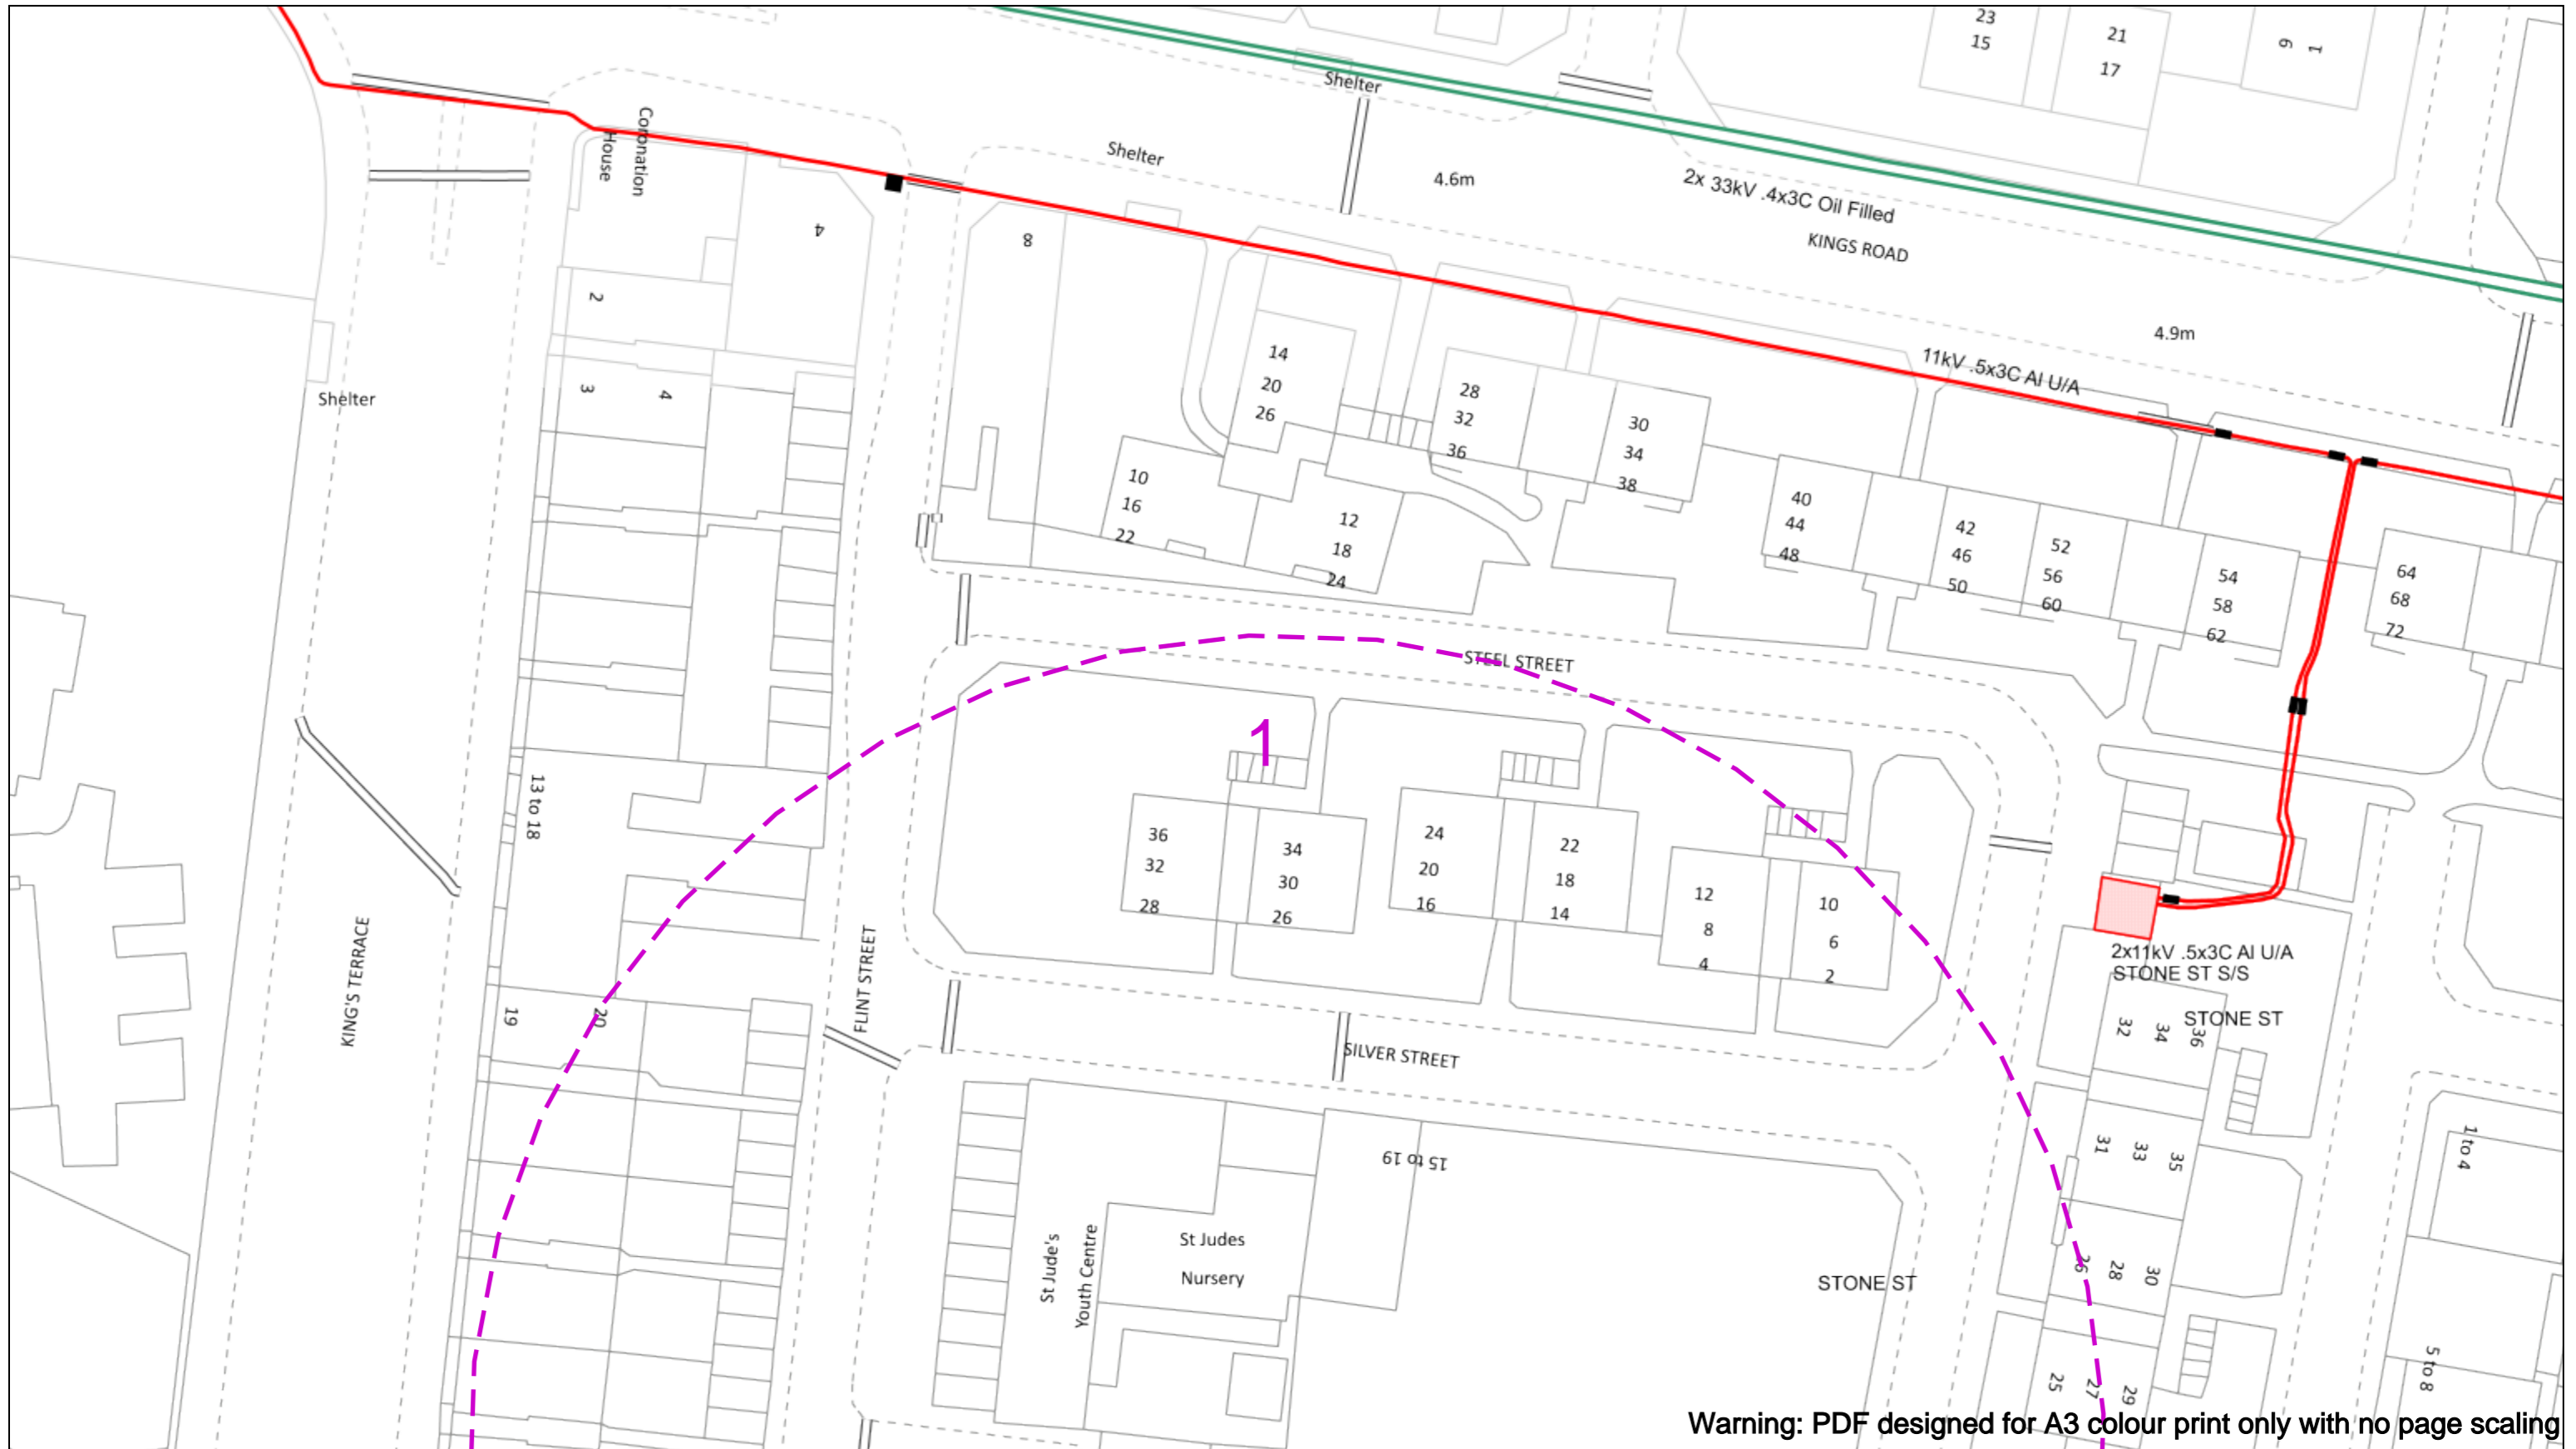

Warning: PDF designed for A3 colour print only with no page scaling



Dig Sites Area: Line:

Extra High Voltage cables in vicinity



Date Requested: 08/03/2021
 Job Reference: 21510958
 Site Location: 463899 099351
 Requested by:
 Mrs Kimberley Piper
 Your Scheme/Reference:
 20/01493/FUL

WARNING
 There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.
 WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Voltages (V)	
LV (Low Voltage) and Services	Up to 1,000V
HV (High Voltage)	Over 1,000V to 11,000V
EHV (Extra High Voltage)	22,000V to 132,000V
Transmission	275,000V and 400,000V

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend

- Service Cable
- LV Mains
- 2 – 3.3kV
- 6.6kV
- 11kV
- 22kV
- 33kV
- 66kV
- 132kV
- 275kV
- 400kV
- Fibre Optic
- Pilot Cable



Distribution Structures (Electric)

- Pole, Existing Location
- Pole Structure, Existing Location - Single
- Pole Structure, Existing Location - H
- Duct Route
- Cross Section Route

Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inveralmond House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

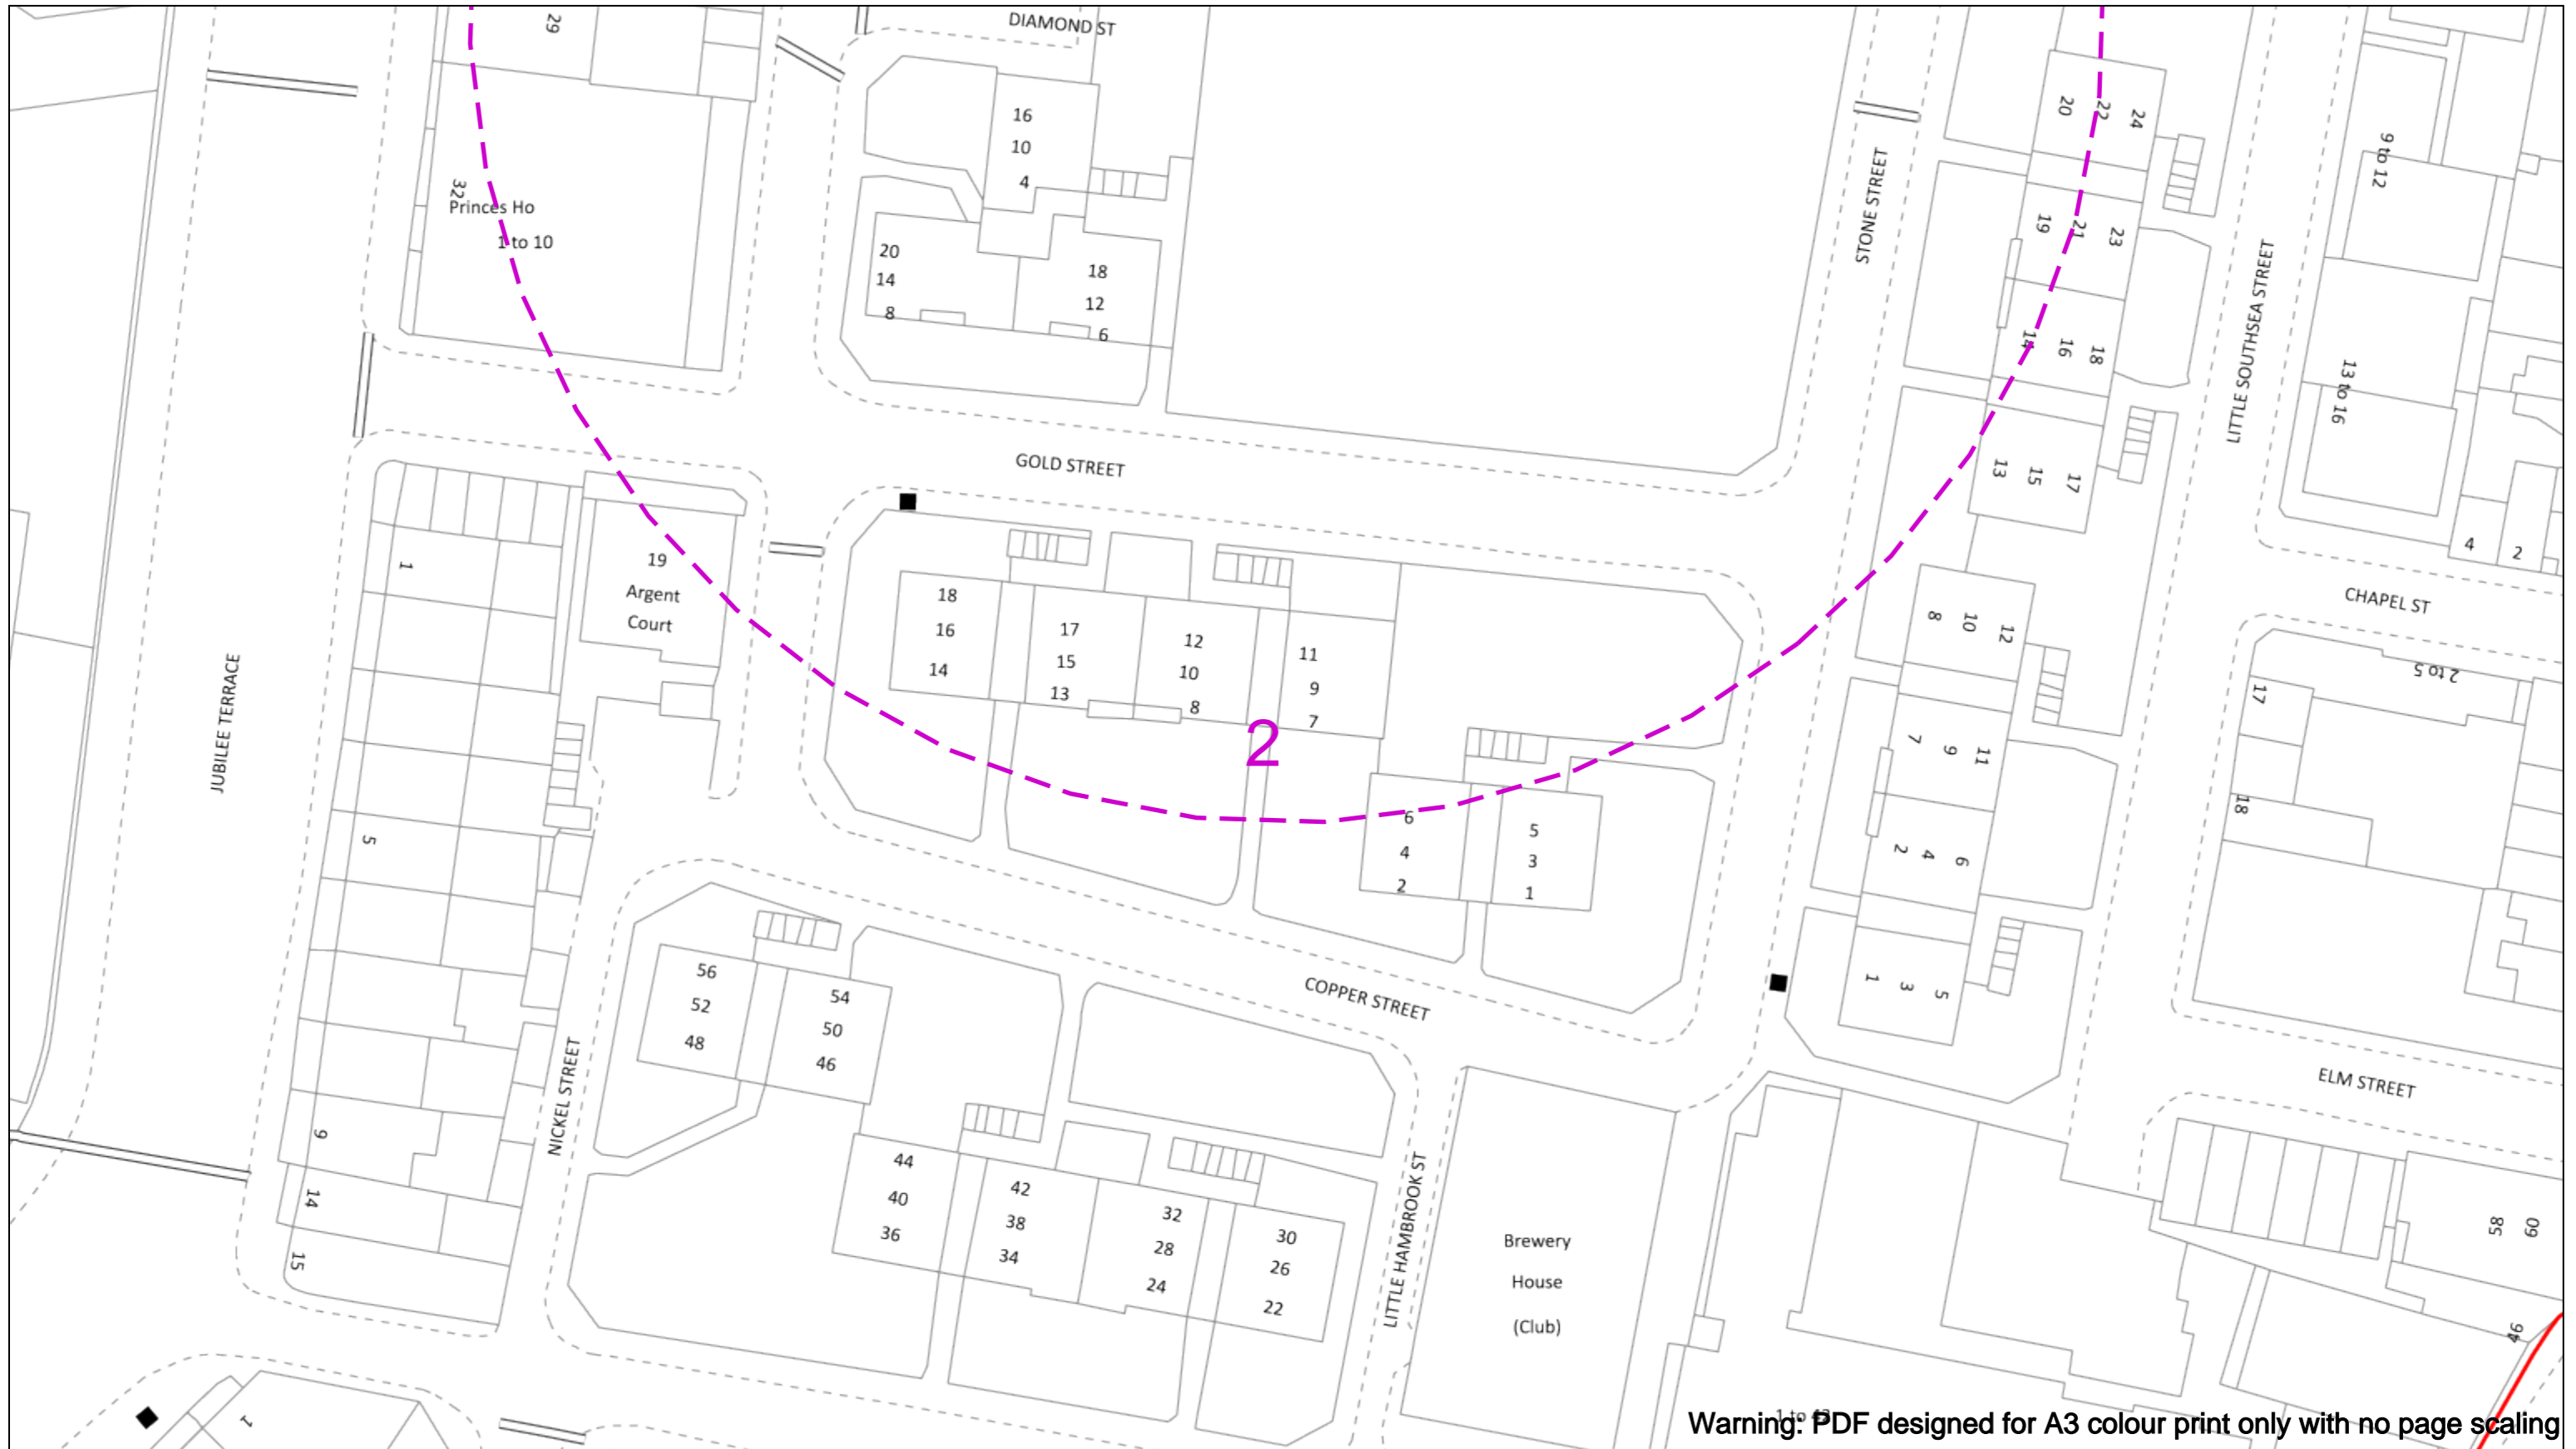

Dig Sites Area: Line:

Extra High Voltage cables in vicinity

Date Requested: 08/03/2021
 Job Reference: 21510958
 Site Location: 463899 099351
 Requested by:
 Mrs Kimberley Piper
 Your Scheme/Reference:
 20/01493/FUL

WARNING
 There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.
 WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

		Voltages (V)		
LV (Low Voltage) and Services		Up to 1,000V		
HV (High Voltage)		Over 1,000V to 11,000V		
EHV (Extra High Voltage)		22,000V to 132,000V		
Transmission		275,000V and 400,000V		
		NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID		
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend

- Service Cable
- LV Mains
- 2 – 3.3kV
- 6.6kV
- 11kV
- 22kV
- 33kV
- 66kV
- 132kV
- 275kV
- 400kV
- Fibre Optic
- Pilot Cable

Distribution Structures (Electric)

- Pole, Existing Location
- Pole Structure, Existing Location - Single
- Pole Structure, Existing Location - H
- Duct Route
- Cross Section Route

Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inveralmond House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered in Scotland No.SC213459

If you're unsure & need to seek advice before commencing excavations please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294