

**GENERAL**  
The design and construction of the buildings and services shall be in accordance with the latest Building Regulations and the recommendations of the Building Regulations, British Standards, Codes of Practice, I.E.E. Regulations and Utility Company Regulations.

**FOUNDATIONS**  
Generally concrete trench fill foundations 615mm wide. A minimum 100mm below finished ground level to all external walls and internal load bearing walls. Final depth and size may vary to suit site conditions and to be to the Local Authority Building Control. Refer to Structural Engineers specification and details.

**SUB STRUCTURE**  
Brickwork to be B.S. 5628 Category FL or 7N/mmsq dense concrete blockwork to BS 6073 1981 Class 2 from foundations to DPC level. Areas with brickwork facings shall revert to facing brickwork 3 courses below finished ground floor level. Cavity walls to be filled with lean mix concrete struck towards outer leaf, 225mm below ground level. Provide min 65mm precast lintels over all services/drainage pipes passing through walls. Max opening in walls to be 250mm. Maintain 50mm gap around service pipes and mask with rigid sheet material to prevent ingress of vermin.

**GROUND FLOOR**  
75mm screed on 100mm concrete oversite on 100mm Celotex GA4000 on 2000 gauge dpm on 50mm sand blinding on 150mm crushed stone turn insulation up around perimeter.

**EXTERNAL WALLS**  
External walls to side extension - below ground level to be built in brickwork or dense concrete blockwork construction to engineer's design strengths with any cavities filled with lean mix concrete up to 150mm below DPC. Brickwork to extend two courses below ground level (FL or FN designation).

Cavity walls to be tied together with s/s butterfly ties to BS 1243: 1978 in accordance with BS 5628: Parts 1, 1992 and 3 1985. Spacing of wall ties to be 450mm vertically and 750mm horizontally; and 225mm centres at openings and abutments and not more than 150mm from openings and abutments. Requirements applies to all areas of cavity wall, i.e below and above dpc.

**Strapping**  
Provide restraint straps 30mm x 5mm cranked galv ms straps at 1200mm crs over wall plate and at 2000mm crs along gables allow to provide noggins at right angles to rafters and joists straps to be screwed into masonry.

**Supports and Beams**  
Beams: Provide new steel beams and bearings in accordance with Structural Engineers details.  
Lintels: Pre stressed lintels to be used over internal openings in brick/block walls installed in accordance with manufacturers recommendations. Lintels in external walls to be insulated pressed steel, Catniod or similar.  
All lintels to have minimum bearing of 150mm.

**HEATING AND HOT & COLD WATER SERVICES**  
Dwellings to be provided with gas fired fan assisted condensing boilers fitted with interlock with a minimum SEDBUK rating of 90%. System to be vented, gravity fed central heating system with water filled radiators and suitable hot water storage cylinder. Thermostatic radiator valves to be provided throughout and separate heating zones for ground and first floor. Heating zones to be no greater than 150m sq and to be controlled and timed separately. All pipework is to be insulated to comply with the requirements of Building Regulations Approved Document L1 and adequately sealed where it passes through ducts, hollow construction or voids.  
A set of operating and maintenance instructions for the heating and hot water systems are to be provided in an accessible format.  
Water installation to comply with current Water Authority Byelaws. Overflows or pressure relief pipes must discharge in accordance with system manufacturer's recommendations.

**BALANCE FLUES**  
Flue pipes to be terminate in accordance with distances maintained as B.Reg. Para. 2.9. Diagram 2.

**COMMISSIONING CERTIFICATE**  
Commissioning certificates for heating and hot water systems to be provided to the client and Building Control.

**ELECTRICAL INSTALLATION**  
Electrical installation to be to the current I.E.E regulations and British Standard.  
Low energy light fittings to be provided that only take lamps having a luminous efficiency of 40 lumens per circuit-watt three per four fixed light fittings.

Flush fitting downlighters to be half hour fire rated as manufactured by Electro Technik Ltd.

External lights not exceeding 150W per fitting are to have P.I.R detectors to extinguish light when there is enough daylight or when light is not required at night. Lantern lights are to be controlled by Photo Electric Cell (PEC).

Switches and socket outlets to be positioned between 450mm and 1200mm above finished floor level.

All electrical work is to be carried out in strict accordance with BS 7671- the IEE current wiring Regulations for the design construction, inspection, testing and certification of the installation.

Electrical work to be carried out by a competent person registered with a Building Regulations Approved Document P self certification scheme. A competent person is to be registered with one of the following full competence schemes.

BRE Certification Ltd  
BSI  
ELECSA Ltd  
NAPIT Certification Ltd  
NICEIC Certification Services Ltd

Any contractor carrying out electrical work as an adjunct to their main trade i.e plumbing and heating contractor etc is to be registered with one of the following defined competence schemes.


GAS SAFE  
ELECSA Ltd  
NAPIT Certifications Ltd  
NICEIC Certification Services Ltd  
OFTEC

Upon completion of the project the contractor is to ensure that sufficient information is provided so that any persons operating, maintaining or altering the electrical installation can do so in a safe manner.

Prior to the completion of the works an appropriate BS 7671 electrical installation certificate is to be issued to the Local Authority Building Control by a person deemed competent to do so.

**PLUMBING**  
The internal plumbing is to comply with BS 552 utilising PVCu pipework comprising:  
110 mm dia soil and vent pipes, stub stacks.  
Minimum 100mm dia WC wastes.  
Minimum 40mm dia bath, shower and sink wastes (3.0m run max).  
Minimum 32mm dia basin and bidet waste (1.7 m run max).  
For basin and bidet wates over 1.7m run, but not exceeding 3.0m run, increase waste pipe to 40mm dia.  
For bath, shower or sink wastes over 3.0m run, but not exceeding 4.0m run, increase waste pipe to 50mm dia. For wastes in excess of the above lengths anti-siphon or branch ventilating pipes are to be incorporated.

100 x 50 mm sw stud wall with 100 mm rockwool insulation, with 12.5 mm water resistant plasterboard on bathroom facing wall.

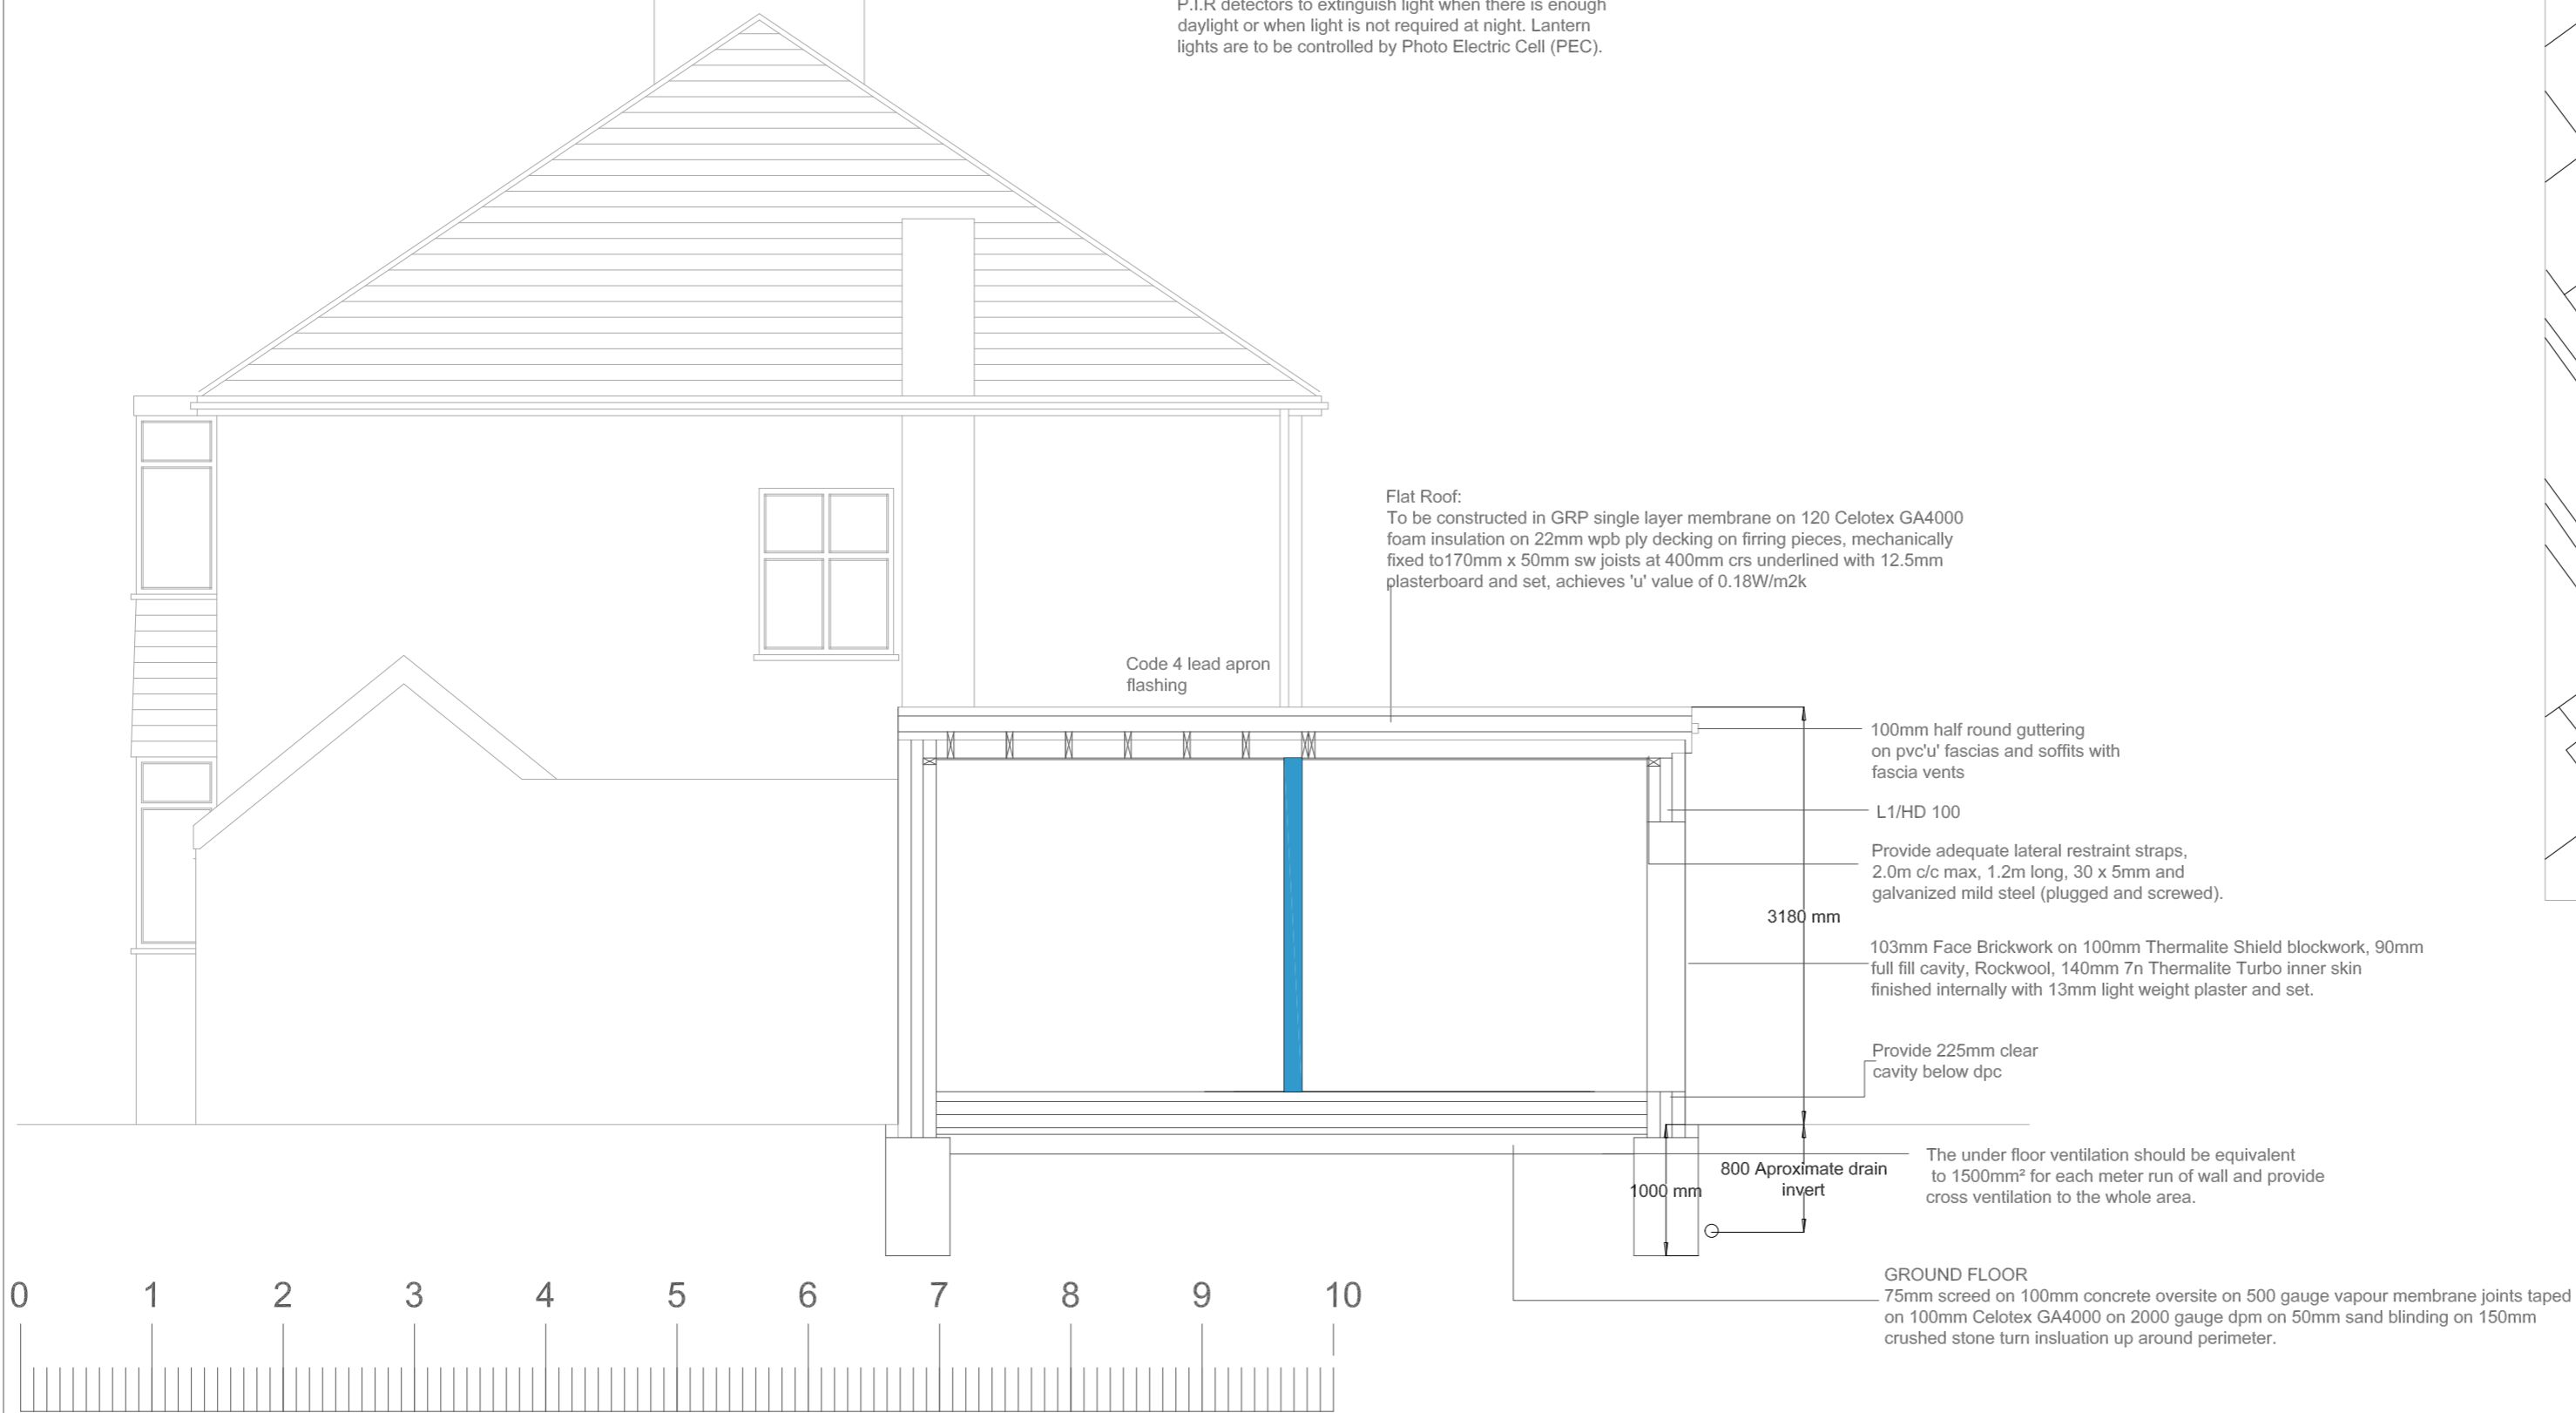

PROPOSED BLOCK PLAN 1:500

 <b>MBL ASSOCIATES LIMITED</b> ARCHITECTURAL & SURVEYING SERVICES	THIS DRAWING MUST NOT BE SCALED PRIOR TO THE COMMENCEMENT OF ANY WORKS THE BUILDER IS TO CHECK AND/OR DETERMINE ALL CONSTRUCTION DETAILS INCLUDING CHECKING EXISTING SITE LEVELS AND DIMENSIONS. THE DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER PROJECT DRAWINGS, CONSTRUCTION NOTES AND/OR PROJECT SPECIFICATION. ALL DISCREPANCIES SHOULD BE REPORTED IMMEDIATELY.	PLANNING CLIENTS & CONTRACTORS ARE REMINDED THAT IF THE PROJECT REQUIRES AN APPLICATION FOR PLANNING, THIS APPLIES TO PRIOR APPROVAL, LAWFUL DEVELOPMENT APPROVAL, PERMITTED DEVELOPMENT RIGHTS TO RECENTLY BUILT PROPERTY'S AND HOUSES IN CONSERVATION AREAS. MBL ASSOCIATES Ltd WILL NOT BE RESPONSIBLE IF WORKS COMMENCE AGAINST THIS ADVICE AND ENFORCEMENT ACTION IS TAKEN AGAINST YOU. MBL ASSOCIATES Ltd ADVISED THAT ALL CERTIFICATION OF PLANNING APPROVAL HAS BEEN GRANTED BEFORE ANY BUILDING WORK COMMENCES.	<b>CLIENT</b>  <b>MR &amp; MRS HEALEY</b>	<b>ADDRESS</b>  <b>54 EWELL PARK WAY</b> <b>EPSOM</b> <b>KT17 2NW</b>	<b>DESCRIPTION</b>  SECTIONS & BLOCK PLANS
	Mobile: 07739849534 e-mail: mblangley82@googlemail.com	ALL STRUCTURAL INFORMATION TO BE IN CONNECTION WITH STRUCTURAL ENGINEERS CALCULATION AND DRAWINGS	CDM Regulations 2007. Party Wall Act 1996, Clients and contractors are reminded that the project is within the scope of these regulations MBL Associates Ltd engaged as designers will not accept any liability for failure of these parties to carryout their duties as required by these statutes.	<b>Scale:</b> 1:50 & 1:100 @A2	<b>Date:</b> 18/12/2020
				<b>Drawing No</b>	SA187/003