Environmental Services

SOIL ANALYSIS

for Subsidence Management Services

26 The Glade, Epsom, KT17 2HB

Client:	Subsidence Management Services
Claim Number:	10225003
Policy Holder:	Mr David Forge
Report Date:	03/02/2021
Our Ref:	L20498

Compiled By:

Name	Position	Signature
Saira Dougan	Laboratory Technician	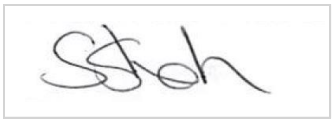

Checked By:

Name	Position	Signature
Bob Walker	Laboratory Manager	

Date samples received: 18-Jan-21
Water Content Test Date: 01-Feb-21

Oedometer Test Date: 02-Feb-21

UKAS TESTING
9265

Environmental Services

Notes relating to soils testing

Unless otherwise stated, all soil testing was undertaken by Environmental Services at unit 10H Maybrook Business Park, B76 1AL for SubsNetUK of Unit 4 Linnet Court, Cawledge Business Park, Alnwick, NE66 2GD

Soil samples have been prepared in accordance with BS1377:Part 1: 2016 Section 7

Descriptions of soil samples within the laboratory have been undertaken generally in accordance with BS5930:2015. Descriptions of soil samples fall outside of the scope of UKAS accreditation and may have been shortened to remove tertiary components for ease of reference.

The graphical representation of 40% of the LL and the numerical representation of the modified plasticity index (mod. PI) fall outside of the scope of UKAS accreditation.

Following the issue of this soil analysis report, samples will be retained for at least 28 days should additional testing, or referencing, be required. It should be noted that any tests undertaken on soils retained subsequent to the issue of this report may not give an accurate indication of the in-situ conditions of the sample.

This Soil Analysis Report may not be reproduced, in part or in full, without written approval of the laboratory.

The results contained herein relate only to items tested and no others. Additionally as the laboratory is not responsible for the sampling process it takes no responsibility for the condition of the samples and all samples are tested "as received".

Where samples of the same test type are not tested on the same day, or the testing spans multiple days, the test date states the day of the final test or the test date of the final sample.

All information above the laboratory reference on the cover page of this report are as provided by the customer and the laboratory is not responsible for any errors or omissions therein.

Water Content Tests are undertaken in accordance with ISO 17892:Part 1:2014

The Oedometer swell/strain test method is based upon BS1377:Part 5:1990 Section 4.4 ‘Determination of swelling and collapse characteristics’ and unless otherwise stated is undertaken on a remoulded, disturbed, sample.

The Oedometer Swell/Strain Test is undertaken in a controlled environment within a temperature range of 16°C and 24°C

Environmental Services

Samples from BH3

Lab Ref	Depth (m)	MC (%)	LL (%)	PL (%)	PI (%)	.425 mm(%)	mod. PI (%)	Av. Suc. (kPa)	Description
1	0.6	29.9							Firm to stiff brown CLAY with rare gravel. Gravel is fine
2	1.1	25.7							Firm to stiff brown CLAY
3	1.6	25.7							Firm to stiff brown slightly silty CLAY with rare sand
4	2.1	27.0							Firm to stiff brown slightly silty CLAY with rare sand
5	2.6	29.2							Firm to stiff brown slightly silty CLAY with rare sand
6	3.1	30.5							Firm to stiff brown slightly silty CLAY
7	3.6	30.1							Firm brown slightly silty CLAY

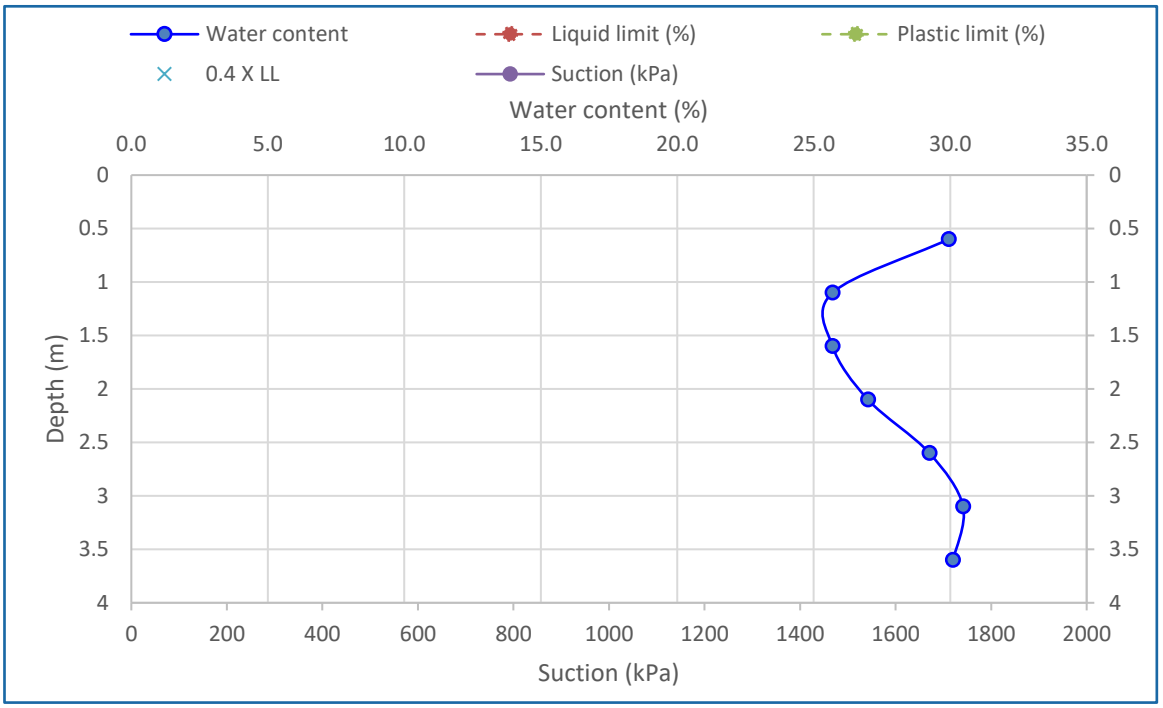

Plasticity Chart for Casagrande Classification

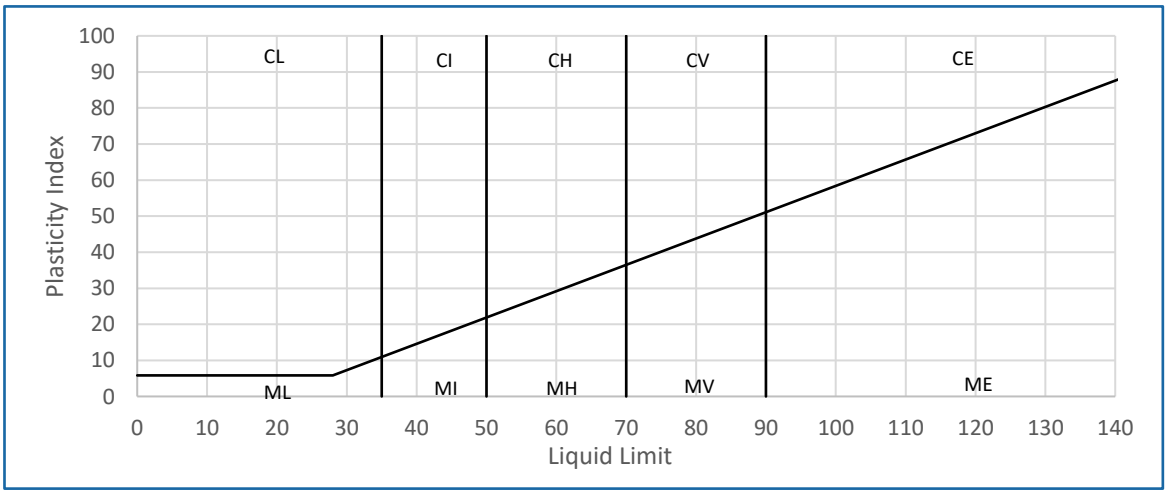

Environmental Services

Summary of Oedometer Testing

Lab Ref	Depth (m)	Strain	Heave (mm)	Remarks
1	0.6	0.0073	0	
2	1.1	0.0282	4.6	
3	1.6	0.0096	0	
4	2.1	0.0019	0	
5	2.6	0.0056	0	
6	3.1	0.0082	0	
7	3.6	0.0023	0	

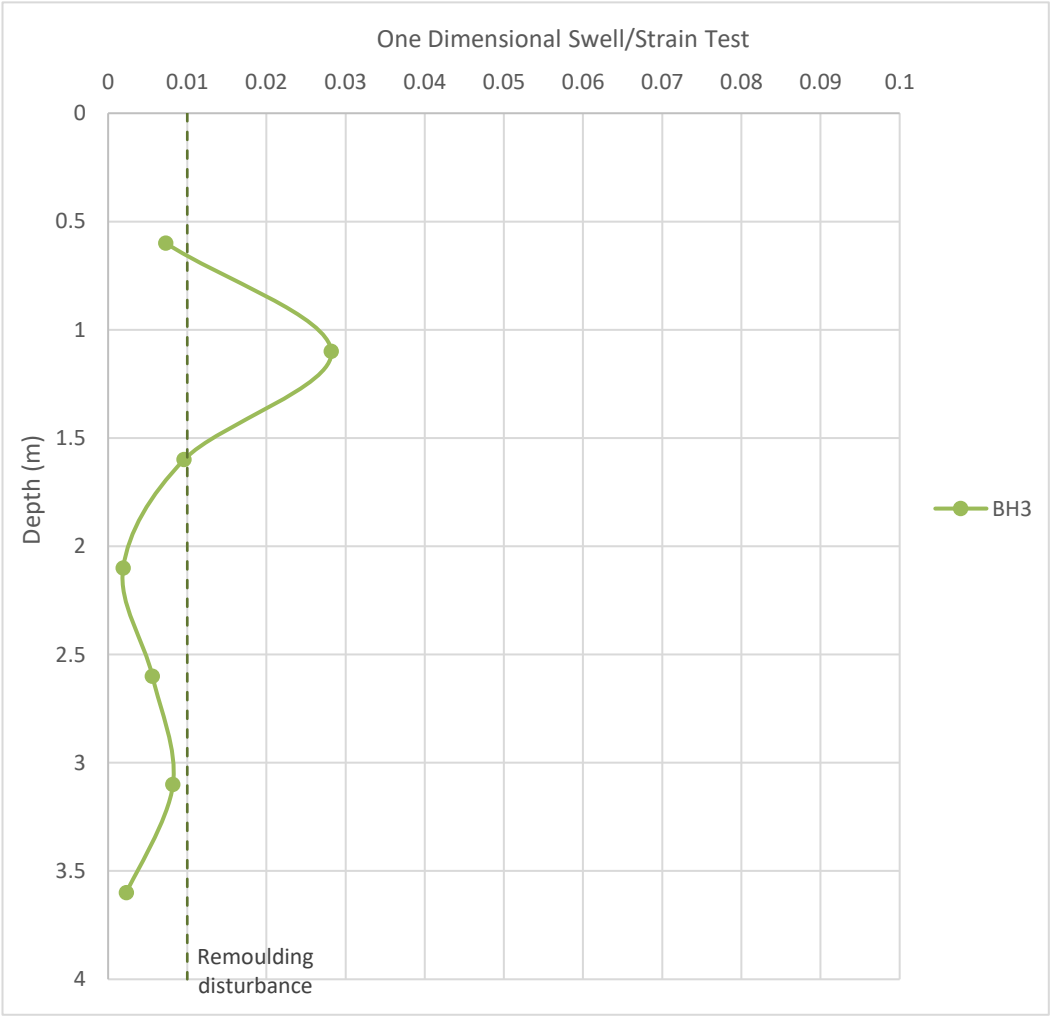

Deviating Samples

The table below details any samples deviating from laboratory procedure or deviating in condition to an extent whereby the validity of results may be affected. A test denoted "I" is likely to have had testing abandoned but where a test result has been provided a non-standard procedure may have been used, details of which will be provided upon request.

LAB REF	CONDITION	WC	ATT	SUC	OED
1					
2					
3					
4					
5					
6					
7					

Key

D	Delay in sample receipt
C	Contaminated sample
B	Sample not bagged correctly
S	Sample too sandy (unsuitable for testing)
G	Sample too gravelly (unsuitable for testing)
V	Sample too soft (unsuitable for preparation)
L	Sample too silty
I	Insufficient sample
O	Too much organic content (unsuitable for testing)
N	Non-standard procedure used

References

The following provides a brief interpretation of the test results by comparison of the results to published classifications. The Atterberg Limit test may be used to classify the plasticity of soils; the plasticity classes defined in BS5930:2015 "Code of Practice for Site Investigations" are as follows.

CL (ML)	CLAY and CLAY/SILT of Low plasticity
CI (MI)	CLAY and CLAY/SILT of Intermediate plasticity
CH (MH)	CLAY and CLAY/SILT of High plasticity
CV (MV)	CLAY and CLAY/SILT of Very High plasticity
CE (ME)	CLAY and CLAY/SILT of Extremely High plasticity
O	The letter O is added to prefixes to symbolise a significant proportion of organic matter.
NP	Non-plastic

The Plasticity Index (PI) Result obtained from the Atterberg Limit tests may also be used to classify the potential for volume change of fine soils, in accordance with the National House Building Council's standards - Chapter 4.2 (2003) "Building Near Trees", as summarised below.

Modified PI < 10	Non Classified.
Modified PI = 10 to <20	Low volume change potential.
Modified PI = 20 to <40	Medium volume change potential.
Modified PI = 40 or greater	High volume change potential.

The 2003 edition of Chapter 4.2 also permits use of the Plasticity Index without modification. The classifications for this are grouped by soil type (soils with similar visual soils description and using unmodified Plasticity Indices.