



Typical Vent to Trench - Scale 1:25

NOTE:
 All protective coating of steelwork to be in accordance with BS 5493 (1977).
 Steelwork shall be galvanized to Table 3 Part 1, and in accordance with BS 729 (minimum thickness of galvanizing to be 80µm) to achieve 30 years or more to first maintenance as specified in BS 5493.
 All steel to be grade 43 in accordance with BS 4360 and to comply with BS 5950 Part 1 (1985).

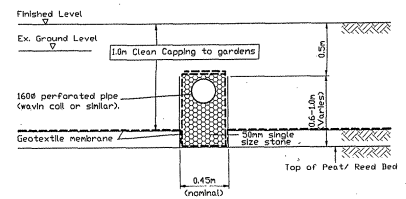

Typical Section Through Vent Trench - Scale 1:25



E	09.01.01	Layout updated to architect drawing P61.	AGH		
D	27.11.00	Phase 2 Updated to Architects Drg P41, Trenches/Vents added	CI		
C	04.08.00	Vent Pipes Reduced in Height Vent Positions moved	CI		
B	01.08.00	ADDITIONAL PHASE 1 TRENCHES AND VENTS SHOWN	CI		
A	27.07.00	PHASE 1 VENT TRENCHES SHOWN	CI		
Rev.	Date	Amendment	Drawn	CHKD	Appd

LAING HOMES
 Engineering Design Group

Premiere House, Estree Way, Borehamwood, Hertfordshire, England, WD6 1JF
 Tel: +44 (0)1828 3700 Fax: +44 (0)1828 3701

23 Waterloo Place, Warwick Street, Royal Leamington Spa, Warwickshire, England, CV32 5LA
 Tel: +44 (0)1926 331200 Fax: +44 (0)1926 331201

Project Title
**LAING HOMES THAMES VALLEY
 ARISTOTLE LANE
 OXFORD**

Drawing Title
**GAS VENT TRENCH
 DETAILS**

Drawn	Date	Checked	Date	Approved	Date
CI	25.07.00				
Project No.	Scale				
98456	1:500 / 1:25				
Drawing No.	Rev.				
E/40	E				