


1. RW to connect to ex surface water system if available or soakaway @ 5m away if no sw drain available (6m in clay soil) (100mm upvc u/ground drain @ 1:40 fall to soakaway min. 1m x 1m x 1m deep with hardcore backfill for adequate rainage of rainwater, & top soil over)
2. Sink waste 40mm w/pipe with 75mm deep seal trap with rodding eye at bends/changes of direction
3. D/glazed windows to achieve min U value of 1.6 W/m²K for timber or plastic frame
 4. Energy efficient lighting to be provided in acc. with AD 'L'
5. All new drainage in 100mm upvc bedded in 150mm pea shingle all around, 1:40 fall
6. Cavities to be closed with an insulated cavity closer (i.e. Thermabate)
7. Use 120mm Celotex floor insulation to achieve max. U value of 0.25W/m²K
8. All new glazing to comply with app. doc. 'L' with argon filled glazed units, 'K' glass
9. Ventilation to existing timber floor of house to be maintained with 150x225mm pvc air bricks in new extension ducted through new concrete floor to ex airbricks with min 100 sq. mm cross sectional area of ducting @ max 1.8 metre ctrs
10. SR cement to be used for all work below ground level & below DPC
11. DPC to be lapped into existing DPC of house & kept at 150mm above adjacent ground level
12. Foundation depths in accordance with current Zurich guide with 50mm claymaster on inner face of foundation where depth in excess of 1.5m
13. Foundation concrete to be min 1:2:4 mix with S.R. cement
15. New cavity wall to be connected to existing with Furfix wall connector
16. New roof to connect to cavity wall with 30x5mm m.s. restraint straps @ max. 1.8 mtr ctrs fixed to wall plate
17. Waste connections to kitchen appliances 40mm waste pipes with 75mm deep seal traps & rodding access to be provided at bends/changes of direction

N.B. FW drain run to be checked & agreed with L.A. building inspector
 Rainwater to drain into existing surface water system or into soak away if this is not possible.
 Soakaway to be min 1 cu.mtr at min 5m away from building or 6m in clay soils
 new soakaway 1m³ for every 20m² of roof area to be drained, therefore soakaway min 1m³
 (new soakaway in acc with A.D. H)

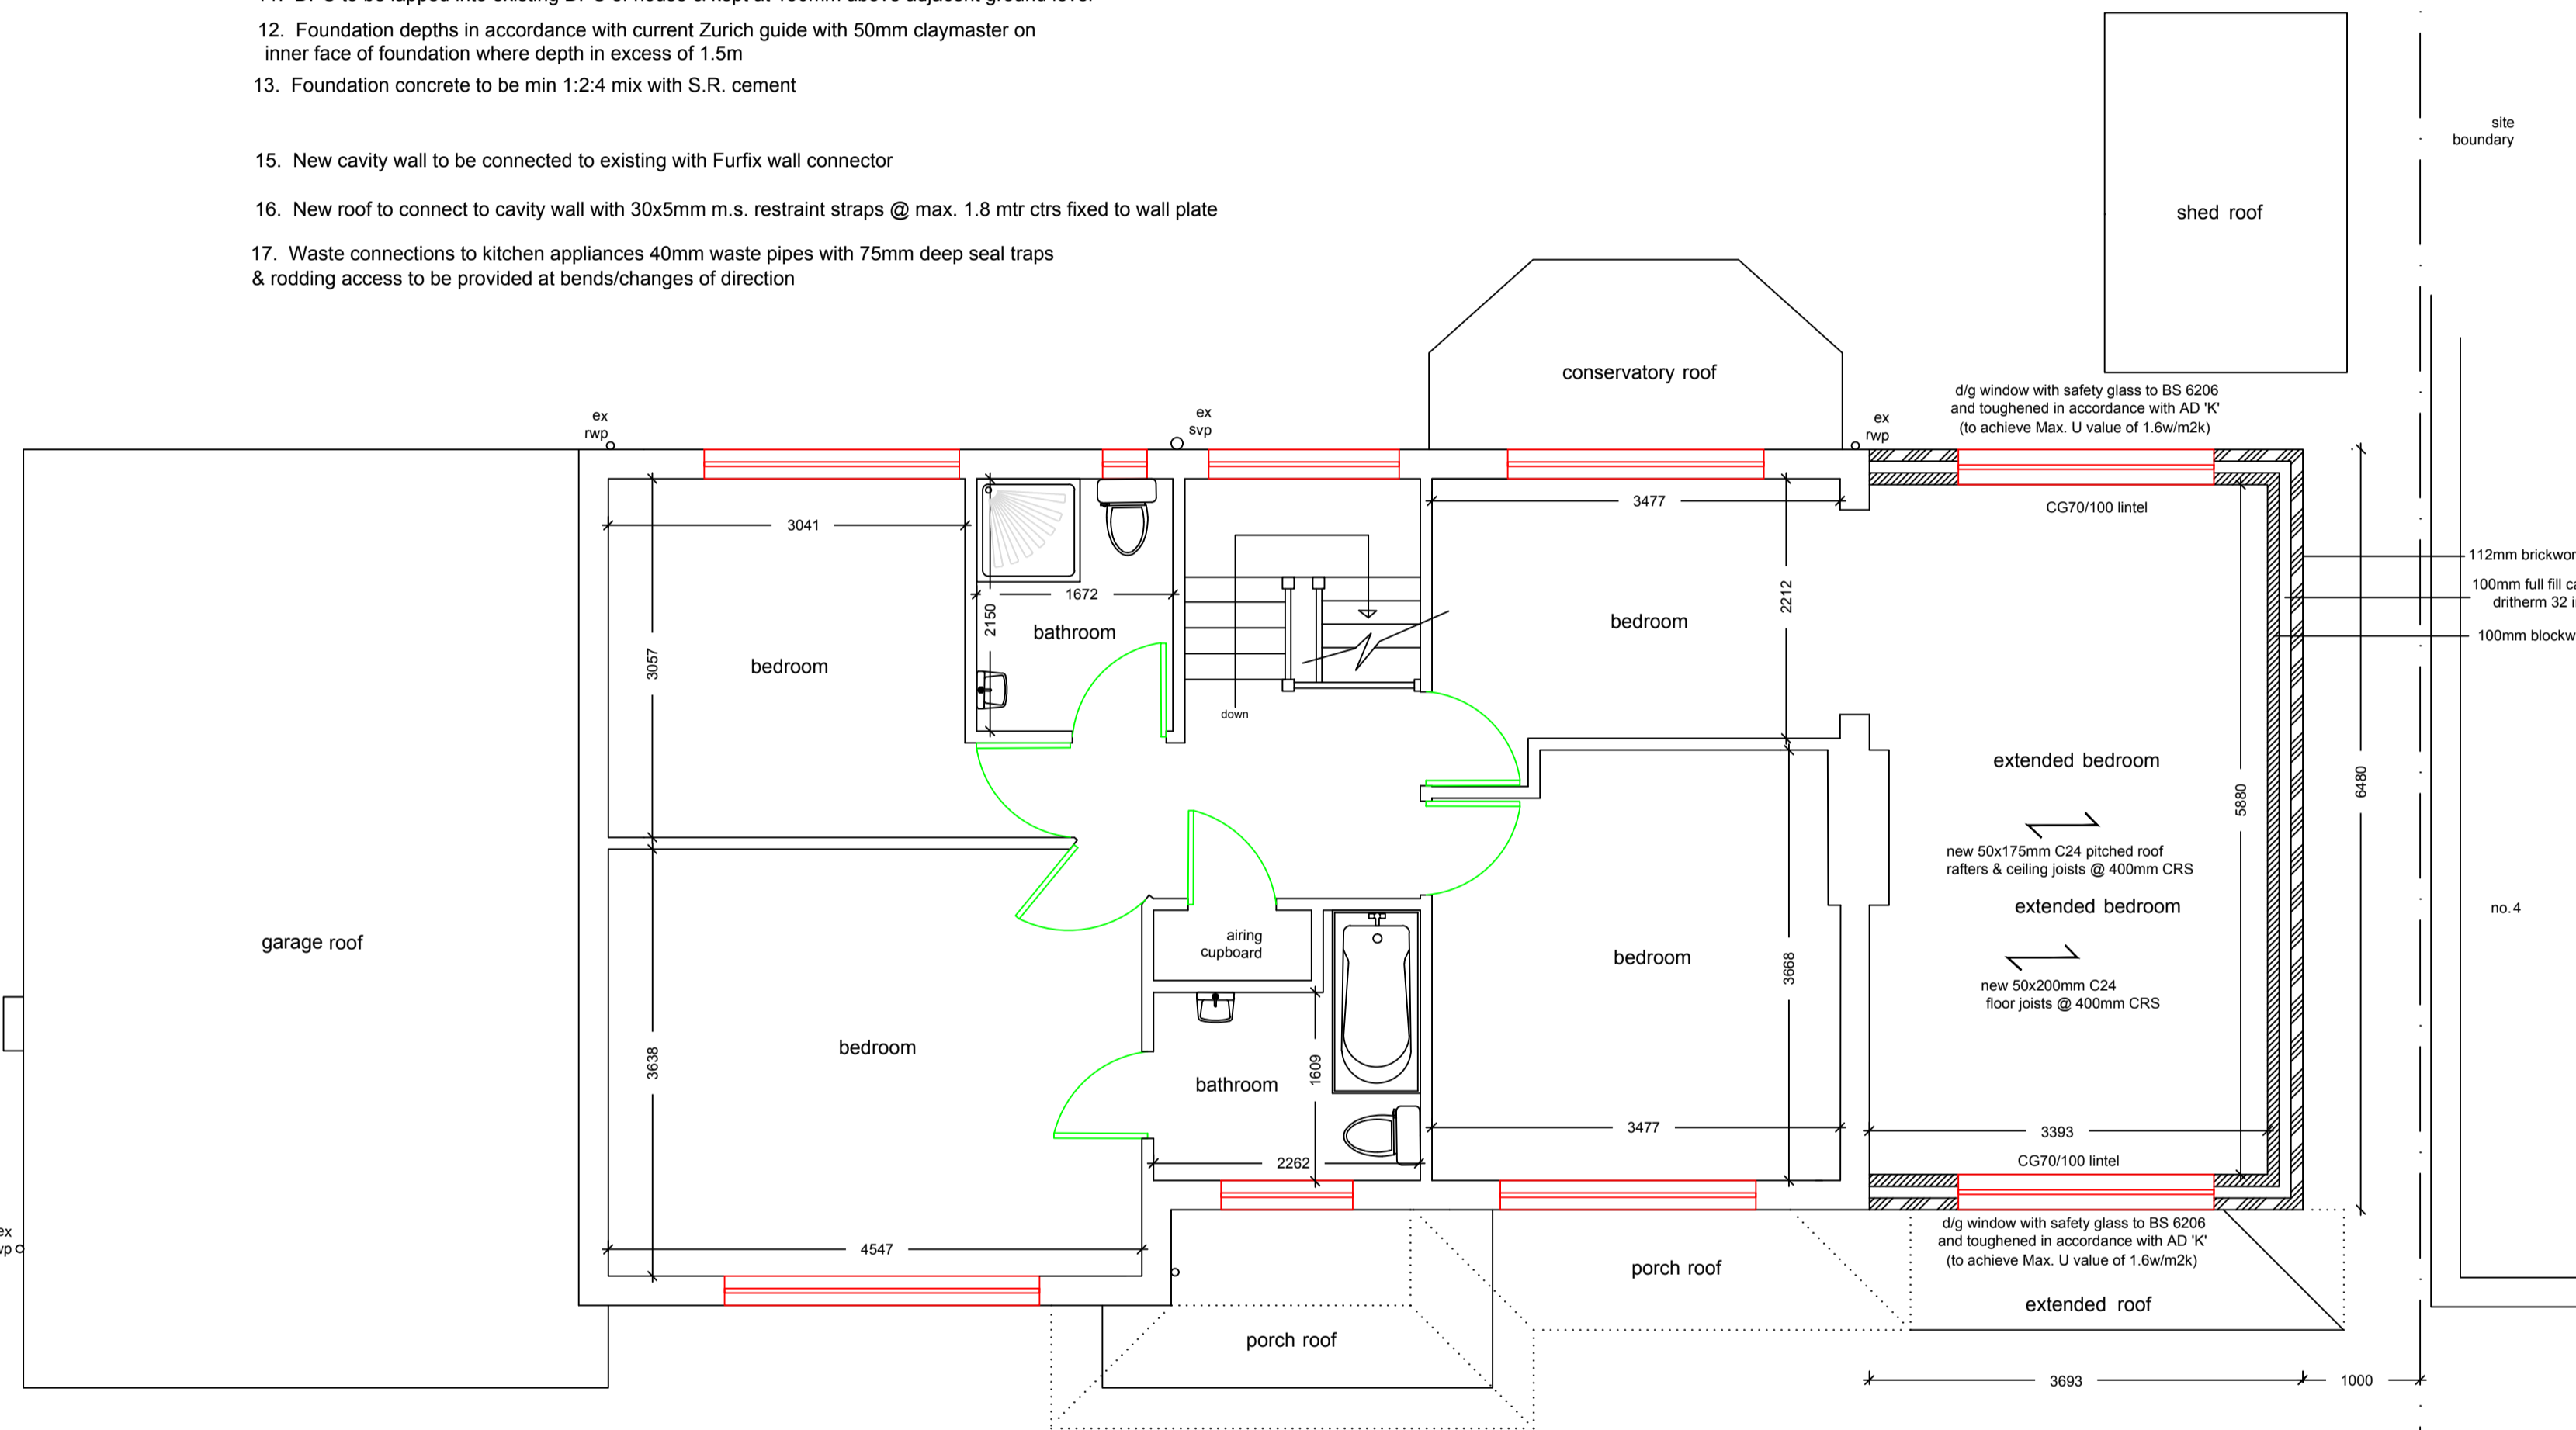

proposed first floor plan
 1:50

DRAINAGE; All new & existing drains to be encased in 150mm concrete and bridged by RC lintels where passing through walls/foundations. All new drains to be bedded in 150mm pea shingle.

EXTERNAL WALLS; 112mm brick external skin, 85mm Dritherm cavity batts and inner skin of 100mm thermalite turbo blocks (1:1:6 mortar). Insert galv. wall ties @ 450mm CRS vertically and 900mm CRS horizontally and at every block at reveals to all openings and at floor level @ min. of 150mm above g.l. and lapped into existing DPC.

FLOOR; Min. 150mm consolidated hardcore with 50mm sand blinding with 1200 gauge DPM over and min. 125mm concrete floor with A193 mesh, 1:2:4 mix. Finish floor with a 65mm screed with chicken wire mesh at mid depth on 120mm Celotex insulation on 500 gauge polythene. (Void below floor to be made up with hardcore backfill)

PITCHED ROOF; 50 x 175mm rafters @ 400mm CRS and 50 x 150mm ridge with 19 x 38mm tanalised roofing battens on roofing felt. Ceiling joists to be 50 x 175mm C24 timbers @ 400mm CRS with 12.5mm f/b plasterboard & skim. Provide 250mm glass fibre insulation between ceiling joists and provide continuous Glidevale strip vents in soffit for ventilation of new pitched roof.

VENTILATION; Provide min. ventilation opening to all rooms of 1/20th of floor area.

STEELWORK; Provide half hour fire protection to all new steel beams with 2 layers of 12.5mm

All electrical installations required to meet requirements of Part P (Electrical Safety) must be designed, installed inspected & tested by a person competent to do so.
 Prior to completion the council should be satisfied that Part P has been complied with.
 This may require an appropriate BS 7671 electrical installation certificate to be issued for the work by a person competent to do so
 new foundation stopped at min 150mm from outer edges of drain & bridged over with 2No. 65x100mm pc conc lintels to support the two 100mm walls
 Provide background ventilation of min. 8,000 sq.mm by trickle vents in window
 provide min. background ventilation of 1/20th floor area by means of trickle vent in window 8,000 sq. mm
 Holding down straps to wall plate 30x5mm ms restraint straps 1m long @ max 1.8mtr ctrs
 Provide mechanical ventilation to bathroom with min. 15 litres/sec extraction with 15 minute o/run
 Wall cavity to be 85mm with stainless steel wall ties
 Lintels over all new openings to be Catnic or similar
 All brickwork below DPC to be in semi engineering brick with SR cement
 Max U value for new windows 1.6 W/m²K

all bath, sink, shower wastes to be 38mm waste pipes with 38mm deep seal traps or 50mm waste pipes with 50mm traps where combined
 provide rodding access in wate pipes at bends/changes of direction
 bathrooms to have 4000mm² background ventilation & extractor fan with 15 litres per second with 15 minute over run
 Provide mechanical ventilation to kitchen area with min. 60 litres/sec extraction ducted to external air(30 l/s in cooker hood)

General Notes

Drg. No. MAC/2502		
No.	Revision/Issue	Date
Firm Name and Address		
Middlesex & Herts		
7 Elgin Drive		
Northwood		
Middlesex		
HA6 2YR		
01923 826280		
Project Name and Address		
Mr & Mrs Macfarslien		
6 Farm Way		
Northwood		
Middlesex		
HA6 3EF		
Project	Sheet	
two storey side extension	04	
Date	Scale	
07-03-21	1:50	