


First Floor / Roof

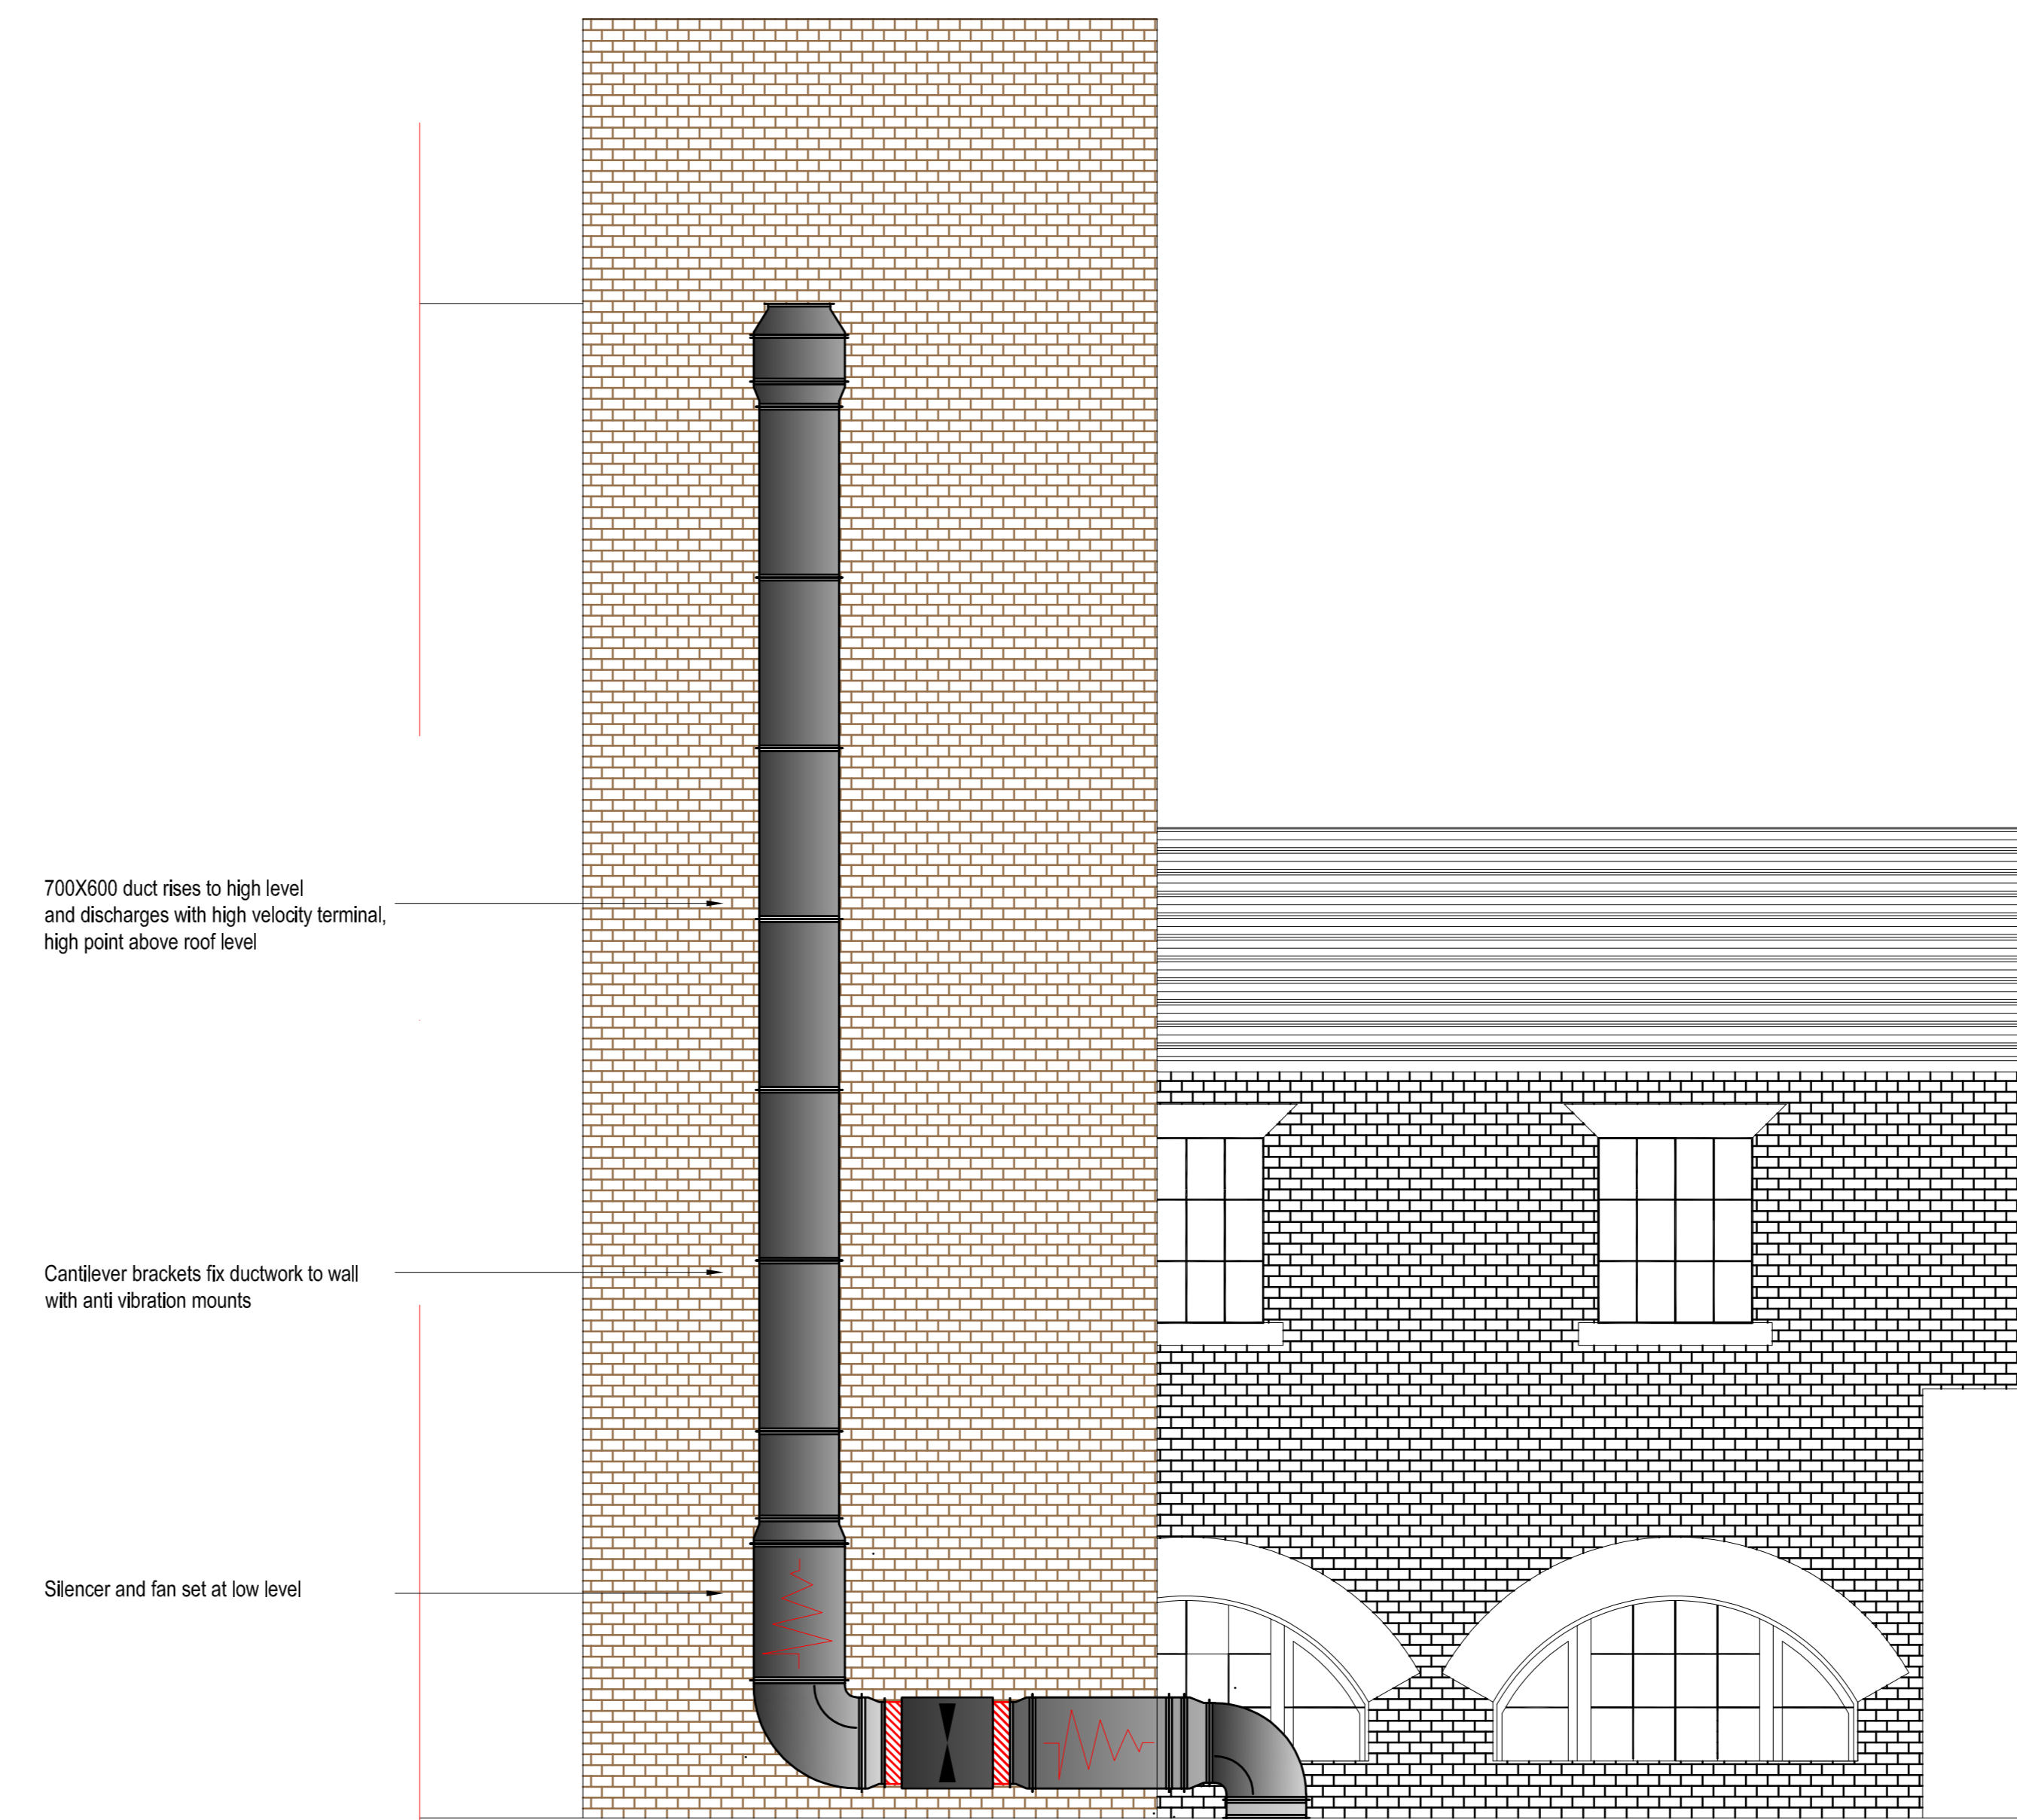

700X600 duct rises to high level and discharges with high velocity terminal, high point above roof level

Cantilever brackets fix ductwork to wall with anti vibration mounts

Silencer and fan set at low level

Internal elevation from plant deck roof AA
Exhaust duct

Rev.	Date	Amendment
A	06-04-21	Internal roof elevation added



Unit 9, Markfield Industrial Estate
Hill Lane Close, Markfield, Leicestershire, LE67 9PY
Tel: - 01530 245 777 Fax: - 01530 245 888
Email: - info@mcveigh-aircon.co.uk

Proposed Route for Kitchen Exhaust duct from GF to Exhaust location.
First Floor level & Front and Side External Elevations
11-17 High Street, Sheffield.
FOR DISCUSSION

Drawn By: - SP Checked By: -

Scale: - 1:100 & 1:50 Date: - 27/10/20

Drawing No: - E34720-2 Rev: - A

© 1999 This drawing is copyright of McVeigh Technical Solutions Ltd. It may not be reproduced in whole or in part without the prior written consent of the company. All dimensions to be checked on site before work commences. This drawing is only to be used in conjunction with drawing notes and specification and is in keeping with current CDM Regulations.