

**PROPOSED GROUND FLOOR PLAN**  
1 : 50

**NOTE:-**  
ALL DIMENSIONS ARE TO BE CHECKED ON SITE BY THE CONTRACTOR PRIOR TO CONSTRUCTION




**PROPOSED SIDE ELEVATION (FROM No. 42)**  
1 : 50

**PROPOSED SIDE ELEVATION**  
1 : 50



**EXISTING FRONT ELEVATION**  
1 : 50

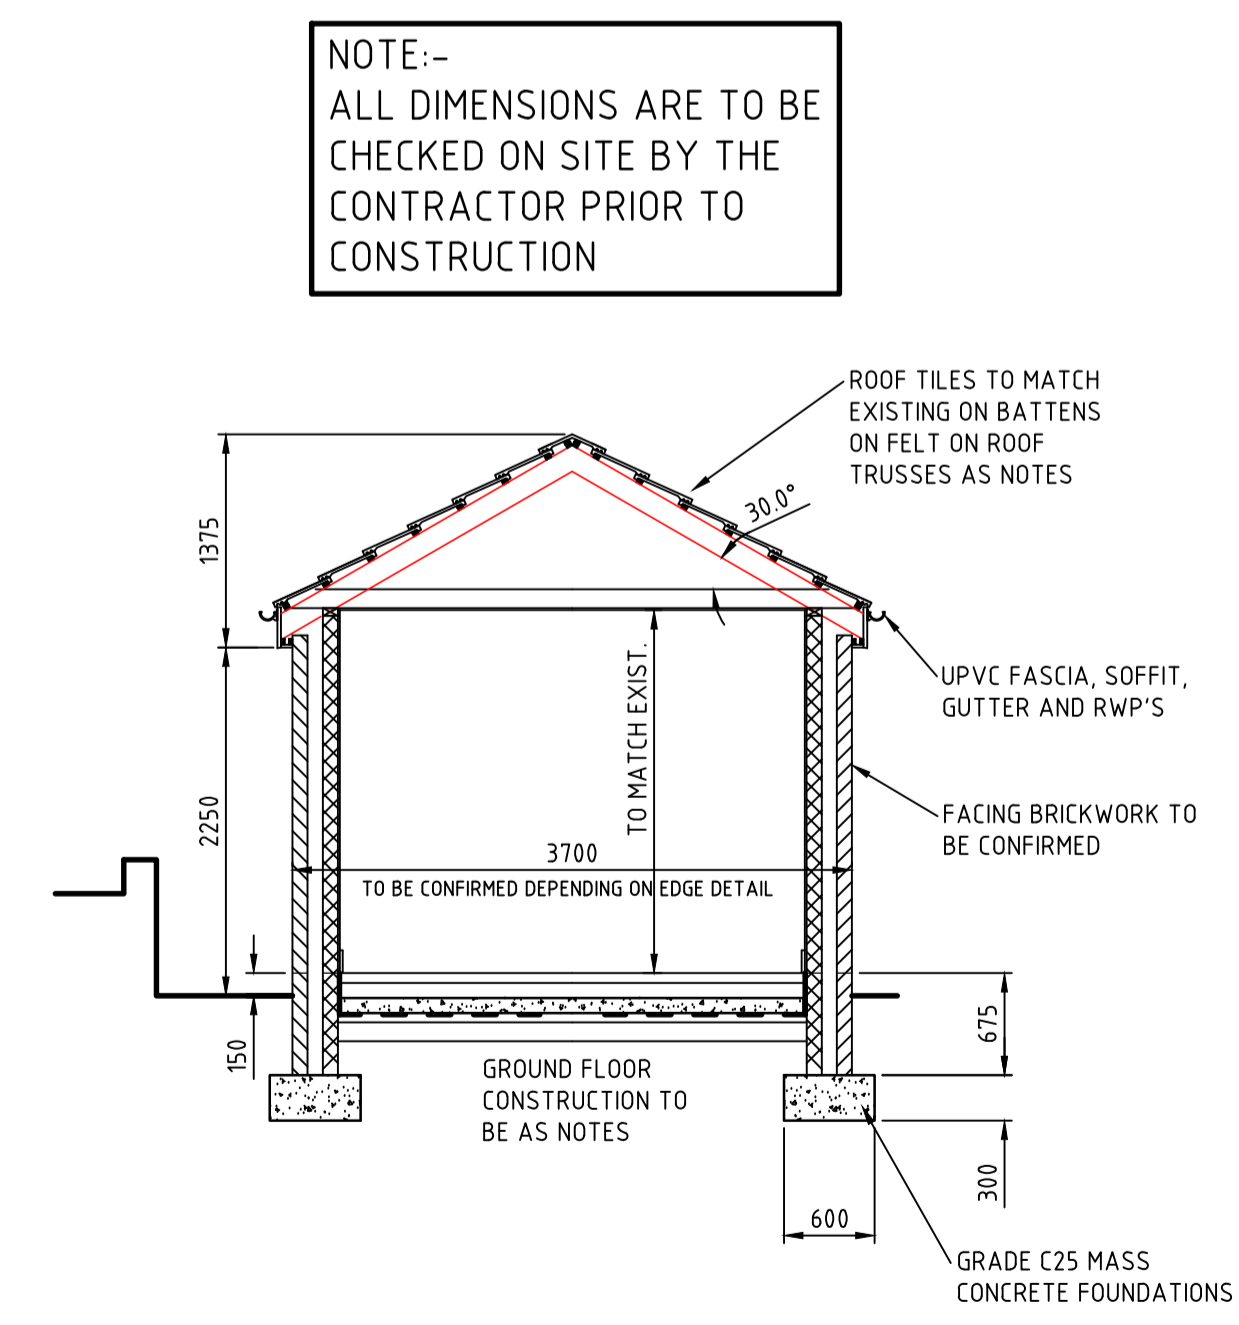

**TYPICAL SECTION THROUGH PORCH**  
1 : 50

**NOTE:-**  
ALL DIMENSIONS ARE TO BE CHECKED ON SITE BY THE CONTRACTOR PRIOR TO CONSTRUCTION

- NOTES:-**
- DO NOT SCALE FROM THIS DRAWING. USE FIGURED DIMENSIONS ONLY.
  - ALL DIMENSIONS IN MILLIMETERS UNLESS NOTED OTHERWISE.
  - ALL DIMENSIONS TO BE CHECKED ON SITE PRIOR TO CONSTRUCTION.
  - FOR PROPOSED PLAN, ELEVATIONS AND SECTIONS REFER TO DRAWING MAB/101.

**Foundations and Sub-structure**  
Foundations to be grade C25 ready-mixed concrete to reach a minimum strength of 28N/MPa s.q. at 28 days.  
Foundations to be built off solid original ground and to comply with Approved Document A1/2  
Type A concrete blockwork used below ground level and cavity backfilled with lean mix concrete up to external ground / path level.

**Ground Floor Construction**  
Solid floors to consist of 70MM 'chicken wire' reinforced sand cement screed on vapour control barrier on 100mm insulation on 150mm thick Grade C25 concrete slab on 1200 gauge visqueen D.P.M. on 150mm well compacted sand blinding hardcore to achieve minimum 'U' Value of 0.25W/m s.q.K.

**External Wall Construction**  
External walls to consist of 102mm facing brickwork with 100mm cavity partially filled with 'Celotex' CW2040 (50mm) with inner skin of 100mm dense Class A concrete blockwork with 12.5mm plasterboard internally to achieve a minimum 'U' Value of 0.35 W/m s.q. K.  
Wall ties to be stainless steel 250mm double triangular pattern at 750mm horizontal centres and 450mm vertical centres and staggered with ties every 225mm at corners and reveals.  
Where cavities close at window and door reveals 100mm insulation Plus Cavity Closure System to be installed as manufacturers instructions.  
'Hyflow' 10mm horizontal D.P.C. to be incorporated a minimum of 150mm above external ground / path level and to lap with D.P.M. 150mm vertical D.P.C. wherever cavity closes and below all window cills and door thresholds.  
12.5mm sheet Supalux cavity barrier to close tops of cavity walls including eaves and gable walls.  
Lintels unless otherwise indicated to be IG. type LVS100 with D.P.C. tray over as per manufacturers instructions and to have a minimum end bearing of 150mm.

**Roof Construction**  
Pitched roof to match existing (if possible) on 50x25mm softwood treated battens on 50x50mm treated counter battens on 'Tyvek' Super Plus breather membrane on Grade S.C.3 grade softwood rafters (with Grade c24 ceiling joists) or roof trusses to BS5268 part 3 : 1995.  
Wall plates to be 100x50mm treated softwood bedded on sand / cement mortar and secured to external walls with 1200mm long x 30x5mm galvanised steel vertical restraint straps at 2m maximum centres.  
Roof insulation to be 150mm 'Crown Wall' insulation laid between ceiling joists to butt up against cavity wall insulation without a gap with a second layer of 150mm 'Crown Wool' insulation laid over joists latched tightly up against breather membrane to underside of roof covering. Construction to achieve minimum 'U' Value of 0.16 W/m s.q. K.  
Ceiling of 12.5mm plasterboard and skim with 'Tyvek Vapour Control Layer VCL SD2 as vapour barrier over / above.

**Below Ground Drainage**  
New drains to be 100mm by 'Osma Drain' laid strictly to manufacturers instructions a minimum of 450mm below ground level with a minimum fall of 1:40 in 150mm Class B granular bed and surround. All drainage to comply with Approved Document H of the Building Regulations 1995.  
New inspection chambers to be by 'Osma Drain' and either 225mm diameter shallow inspection chamber, up to 600mm invert, or 450mm diameter universal inspection chamber up to 1m invert installed as per manufacturers instructions.

**Above Ground Drainage**  
Rainwater goods to be 'Osma' Roundline / square line fitted as per manufacturers instructions.  
Wastes to be 'Osma' 38mm to sink unit, shower and bath, 32mm to wash hand basin. All to be fitted with 75mm deepseal traps and all as manufacturers instructions.

**Ventilation**  
All habitable rooms to be provided with trickle ventilators to achieve 8,000 sq.m and to have an openable area of at least 1/20th of the floor area.  
All other rooms to have trickle ventilators to achieve 4,000 sq.m  
Kitchen / utility rooms to be provided with mechanical extract fans capable of extracting air at a rate of not less than 60 litres per second.  
Bathroom / shower room to be provided with a fan capable of extracting 15 litres per second.  
All fans to have a 15 minute over-run facility.

**Glazing, Windows and Doors**  
All windows to be constructed of either timber or u.P.V.C. and double glazed with draught seals to all openable elements with 5mm sealed glazing units with 'inner skin' of low E glass with low-E, EN615 to achieve minimum 'U' value of 2.0W/m.sq/K and to be provided/installed by FENSA approved manufacturer.  
All glazing to doors and side screens and any glazing pane to a window totally or partially lower than 800mm above finished floor level to be of toughened safety glass as per B.S. 6206:1981

**Electrical Switches**  
All light switches, power points etc. to be located between 450mm and 1200mm above finished floor level.

**FOR APPROVAL**

Applicant	Mr & Mrs OATES 44 RIDGEWAY, MACHEN, CAERPHILLY, CF83 8RD	
Project Title	PROPOSED PORCH	
Drawing Title	PROPOSED PLANS, ELEVATIONS AND SECTION	
Original Size	A1	Scale AS SHOWN
Date	MAR 2021	Drawing number OATES/101