


REFER TO DRAWING NO:  
664015-1275-PEV-FNC0011-ZZ-DR-C-0551

REFER TO DRAWING NO:  
664015-1275-PEV-FNC0011-ZZ-DR-C-0554

REFER TO DRAWING NO:  
664015-1275-PEV-FNC0011-ZZ-DR-C-0555

NO FOUL WATER  
DRAINAGE IN THIS AREA

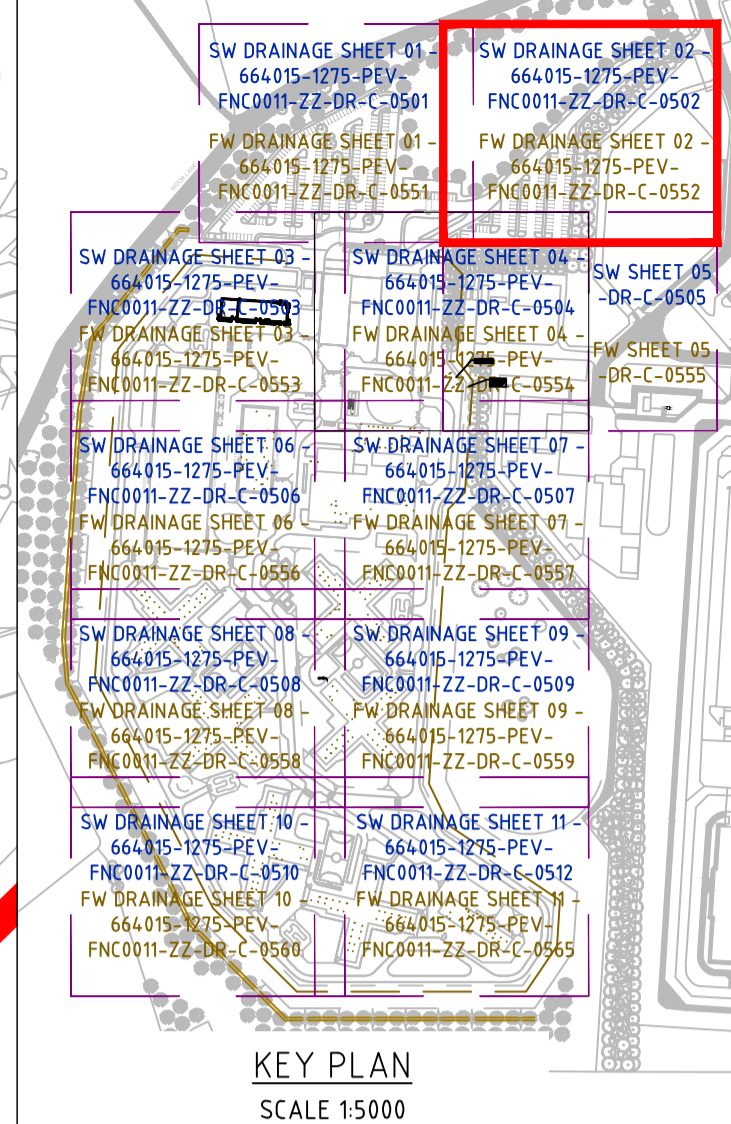

© Crown copyright 2018  
Do not scale from drawings. Verify all dimensions on site prior to construction. This drawing is to be read in conjunction with all relevant documents and drawings. Report all discrepancies to MoJ immediately.  
No unauthorised use, disclosure, storage or copying.

This symbol identifies a Residual Risk that is recorded on the Design Risk Register and is relevant to this drawing.  
This drawing must be read in conjunction with the following project CDM documents:  
664015-1275-PEV-FNC0011-XX-HS-C-0003\_Design Risk Assessment-Stage 3

This symbol identifies a Derogation that is recorded on the Derogation Schedule and is relevant to this drawing.  
This drawing must be read in conjunction with the following project Derogation documents:  
N/A

The above symbols can only be read when this drawing is in colour print

PRINT IN COLOUR

- NOTES:
- ALL DRAINAGE WORKS TO BE CONSTRUCTED TO DESIGN AND CONSTRUCTION GUIDANCE FOR FOUL AND SURFACE WATER SEWERS, BUILDING REGULATIONS PART H, MOJ TECHNICAL SPECIFICATION STD/X/SPEC/010 ISSUE 006 AND PICK EVERARD DRAINAGE SPECIFICATION.
  - ALL SEWERS AND DRAINS TO HAVE A CLASS Z BED AND SURROUND AT A DEPTH OF COVER TO PIPE SOFFIT OF LESS THAN 1.2m UNDER PAVED AREAS AND BUILDINGS AND 0.9m IN VERGE. IN ALL OTHER AREAS, ALL SEWERS AND DRAINS SHALL HAVE A CLASS S BED, UNLESS STATED OTHERWISE ON THE DRAWINGS.
  - ALL SEWERS TO BE BACKFILLED WITH TYPE 1 GRANULAR MATERIAL UNDER PAVED AREAS, ROADS AND HARDSTANDINGS OR AS-DUG MATERIAL IN VERGE AREAS.
  - MANHOLE COVERS AND FRAMES WITHIN VEHICULAR LOADED AREAS TO BE D400 RATED AND C250 IN ALL OTHER AREAS TO BS EN 124-1994. ALL COVERS TO BE DUCTILE IRON.
  - SVP LOCATIONS AND LATERALS ARE NOT SHOWN. TO BE CONFIRMED BY THE M&E ENGINEER AT THE DETAIL DESIGN STAGE.
  - DRAINAGE SYSTEM TO BE SUBJECT TO INSPECTION INTERIM AND FINAL TESTS IN ACCORDANCE WITH MOJ TECHNICAL SPECIFICATION STD/X/SPEC/010 ISSUE 6 AND BS EN 75
  - ALL PIPEWORK:
    - VITRIFIED CLAY UP TO 225mm DIAMETER
    - OVER 225mm - CONCRETE TO BS EN 1916 AND 1911
    - BELOW CONCRETE FLOOR SLABS - CAST IRON TO BS 43
    - OR DUCTILE IRON TO BS 598
  - SAMPLE CHAMBER TO BE BUILT DOWNSTREAM OF DOG KENNELS
  - ALL SOLID DOG FAECES TO BE REMOVED AND DISPOSED OF APPROPRIATELY BEFORE ENTERING INTO THE FOUL DRAINAGE SYSTEM
  - FOUL WATER STRATEGY IS SUBJECT TO YORKSHIRE WATER APPROVAL. FOR DETAILS REFER TO FOUL WATER DRAINAGE STRATEGY REPORT  
664015-1275-PEV-FNC0011-ZZ-RP-C-0553

- KEY:
- PROPOSED GRAVITY FOUL SEWER.
  - PROPOSED FW RISING MAIN.
  - MoJ PROPERTY LINE.
  - FW ACCESS CHAMBER.
  - EXISTING FW CHAMBER.
  - EXISTING YW FW SEWER.
  - EXISTING RISING MAIN FW SEWER.

Rev	Date	Description
P02	2021.06.03	SITE LAYOUT UPDATED.
P01	2021.03.16	FIRST ISSUE FOR RIBA STAGE 3 APPROVAL.

Project Status  
RIBA Stage 3

Client Ministry of Justice	Project New Prisons Programme
-------------------------------	----------------------------------

Ministry of Justice, 102 Petty France, London, SW1H 9AJ

Project Description / Site  
New Prisons Programme  
Full Sutton 2

Project Address  
Land at Moor Lane  
Full Sutton  
York, YO41 1PS

Building Type  
Site Infrastructure

Drawing Title  
Proposed Foul Water Drainage-Sheet 02

Originator Logo 	Drawn By NKN	Date 16.03.21
	Checked By PCA	Date 16.03.21
	Approved By PCA	Date 16.03.21

Drawing Number  
664015-1275-PEV-FNC0011-ZZ-DR-C-0552

Delref  
D0100

Sheet No.	Scale	Orig. Sheet Size	Rev.
02 of 11	1:250; 1:5000	@ A1	P02

Data Security Classification  
OFFICIAL

Suitability  
S3