

Hollybank  
Cottage

26.2m

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 01/04/2021  
Job Reference: 21733137  
Site Location: 475066 108092  
Requested by: Ms Christina Elliott  
  
Your Scheme/Reference: LM  
94628/HaK

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

**Legend**

- Service Cable
- LV Mains
- 2 - 3.3kV
- 6.6kV
- 11kV
- 22kV
- 33kV
- 66kV
- 132kV
- 275kV
- 400kV
- Fibre Optic
- Pilot Cable

**Distribution Structures [Electric]**

- Pole, Existing Location
- Pole Structure, Existing Location - Single
- Pole Structure, Existing Location - H
- Duct Route
- Cross Section Route

**WARNING**  
There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.  
WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)




**Scottish and Southern Energy Power Distribution Ltd.**  
Registered Office: Inverlmond House,  
200 Dunkeld Road, Perth, PH1 3AQ  
Registered In Scotland No.SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:  
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:  
[Asset.Data@sse.com](mailto:Asset.Data@sse.com)  
01256 337 294

Scale: 1:500 (When plotted at A4)

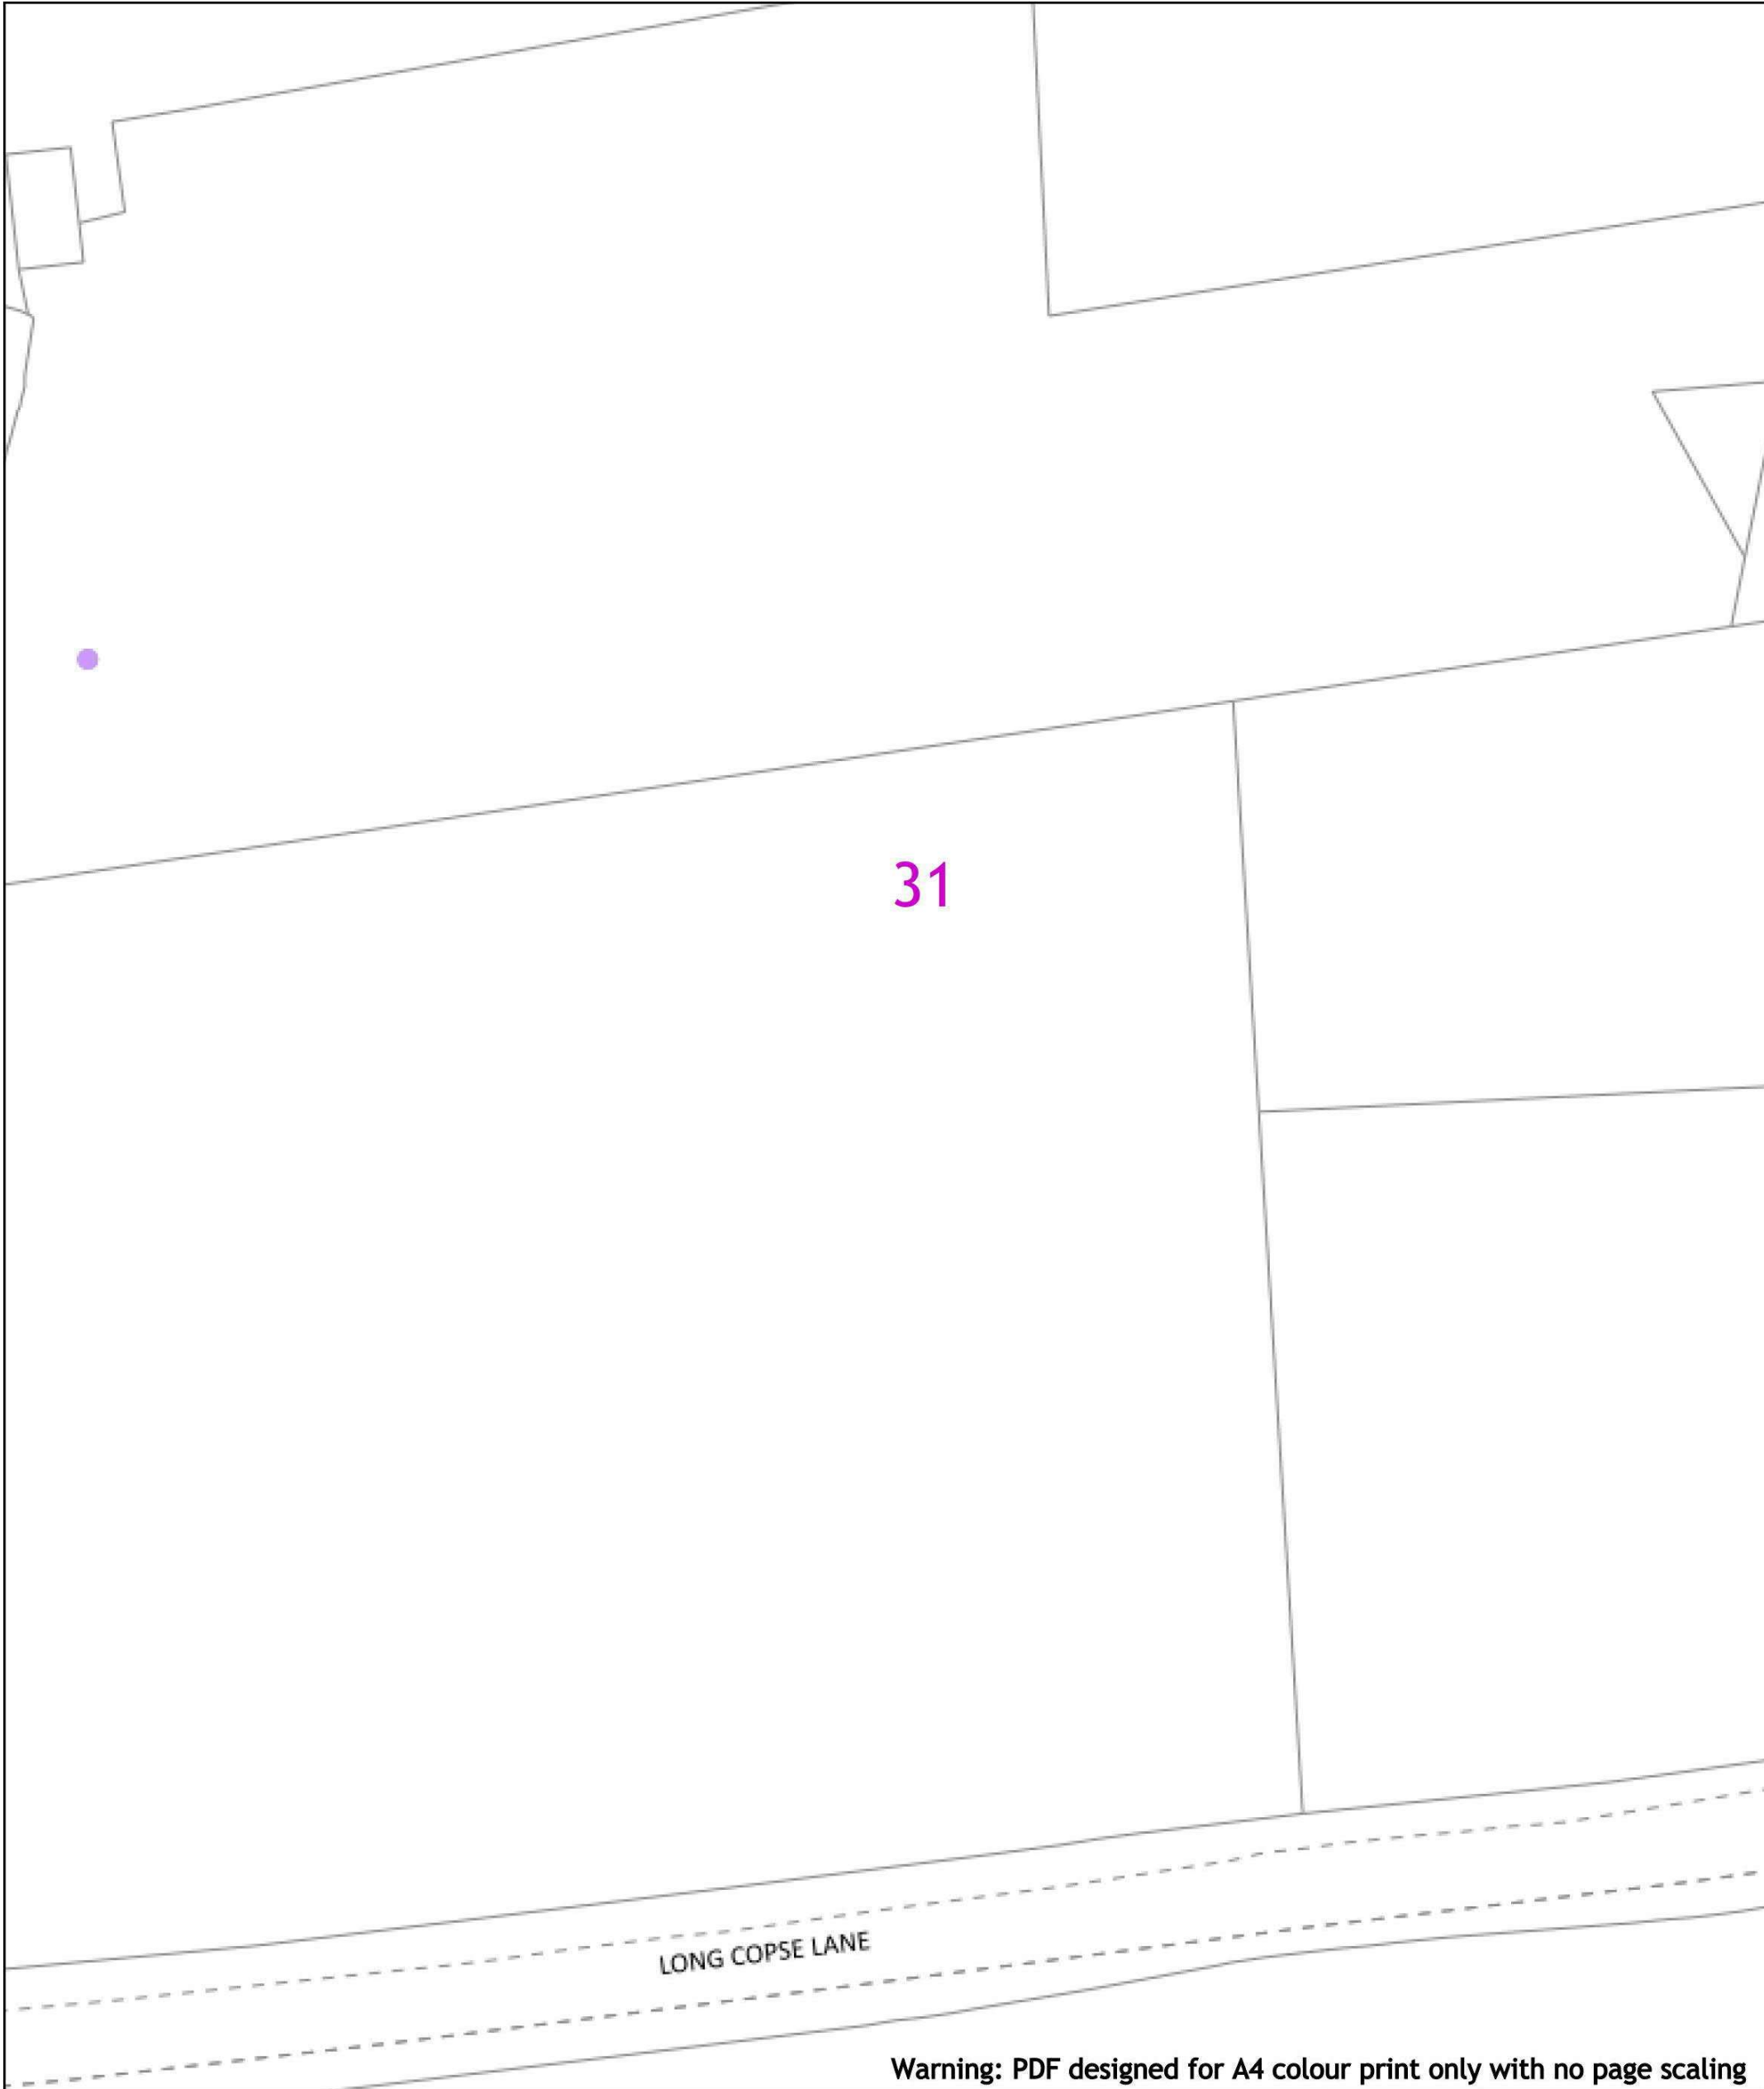

Warning: PDF designed for A4 colour print only with no page scaling

020m

Dig Sites

Area:

Line:

Date Requested: 01/04/2021

Job Reference: 21733137

Site Location: 475066 108092

Requested by: Ms Christina Elliott

Your Scheme/Reference: LM 94628/HaK

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend

Service Cable

LV Mains

2 - 3.3kV

6.6kV

11kV

22kV

33kV

66kV

132kV

275kV

400kV

Fibre Optic

Pilot Cable

Distribution Structures [Electric]

Pole, Existing Location

Pole Structure, Existing Location - Single

Pole Structure, Existing Location - H

Duct Route

Cross Section Route

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Scottish and Southern Energy Power Distribution Ltd.

Registered Office: Inverlmond House,  
200 Dunkeld Road, Perth, PH1 3AQ  
Registered In Scotland No.SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:  
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:  
[Asset.Data@sse.com](mailto:Asset.Data@sse.com)  
01256 337 294

Scale: 1:500 (When plotted at A4)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED.

This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ('The Act'). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by LinesearchbeforeUdig.



020m

Dig Sites

Area:

Line:

Date Requested: 01/04/2021

Job Reference: 21733137

Site Location: 475066 108092

Requested by: Ms Christina Elliott

Your Scheme/Reference: LM 94628/HaK

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend

Service Cable

LV Mains

2 – 3.3kV

6.6kV

11kV

22kV

33kV

66kV

132kV

275kV

400kV

Fibre Optic

Pilot Cable

Distribution Structures [Electric]

Pole, Existing Location

Pole Structure, Existing Location - Single

Pole Structure, Existing Location - H

Duct Route

Cross Section Route

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive – Avoiding Danger from Buried Cables – should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Scottish and Southern Energy Power Distribution Ltd.

Registered Office: Inverlmond House,  
200 Dunkeld Road, Perth, PH1 3AQ  
Registered In Scotland No.SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:  
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:  
[Asset.Data@sse.com](mailto:Asset.Data@sse.com)  
01256 337 294


Scale: 1:500 (When plotted at A4)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED.

This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by LinesearchbeforeUdig.



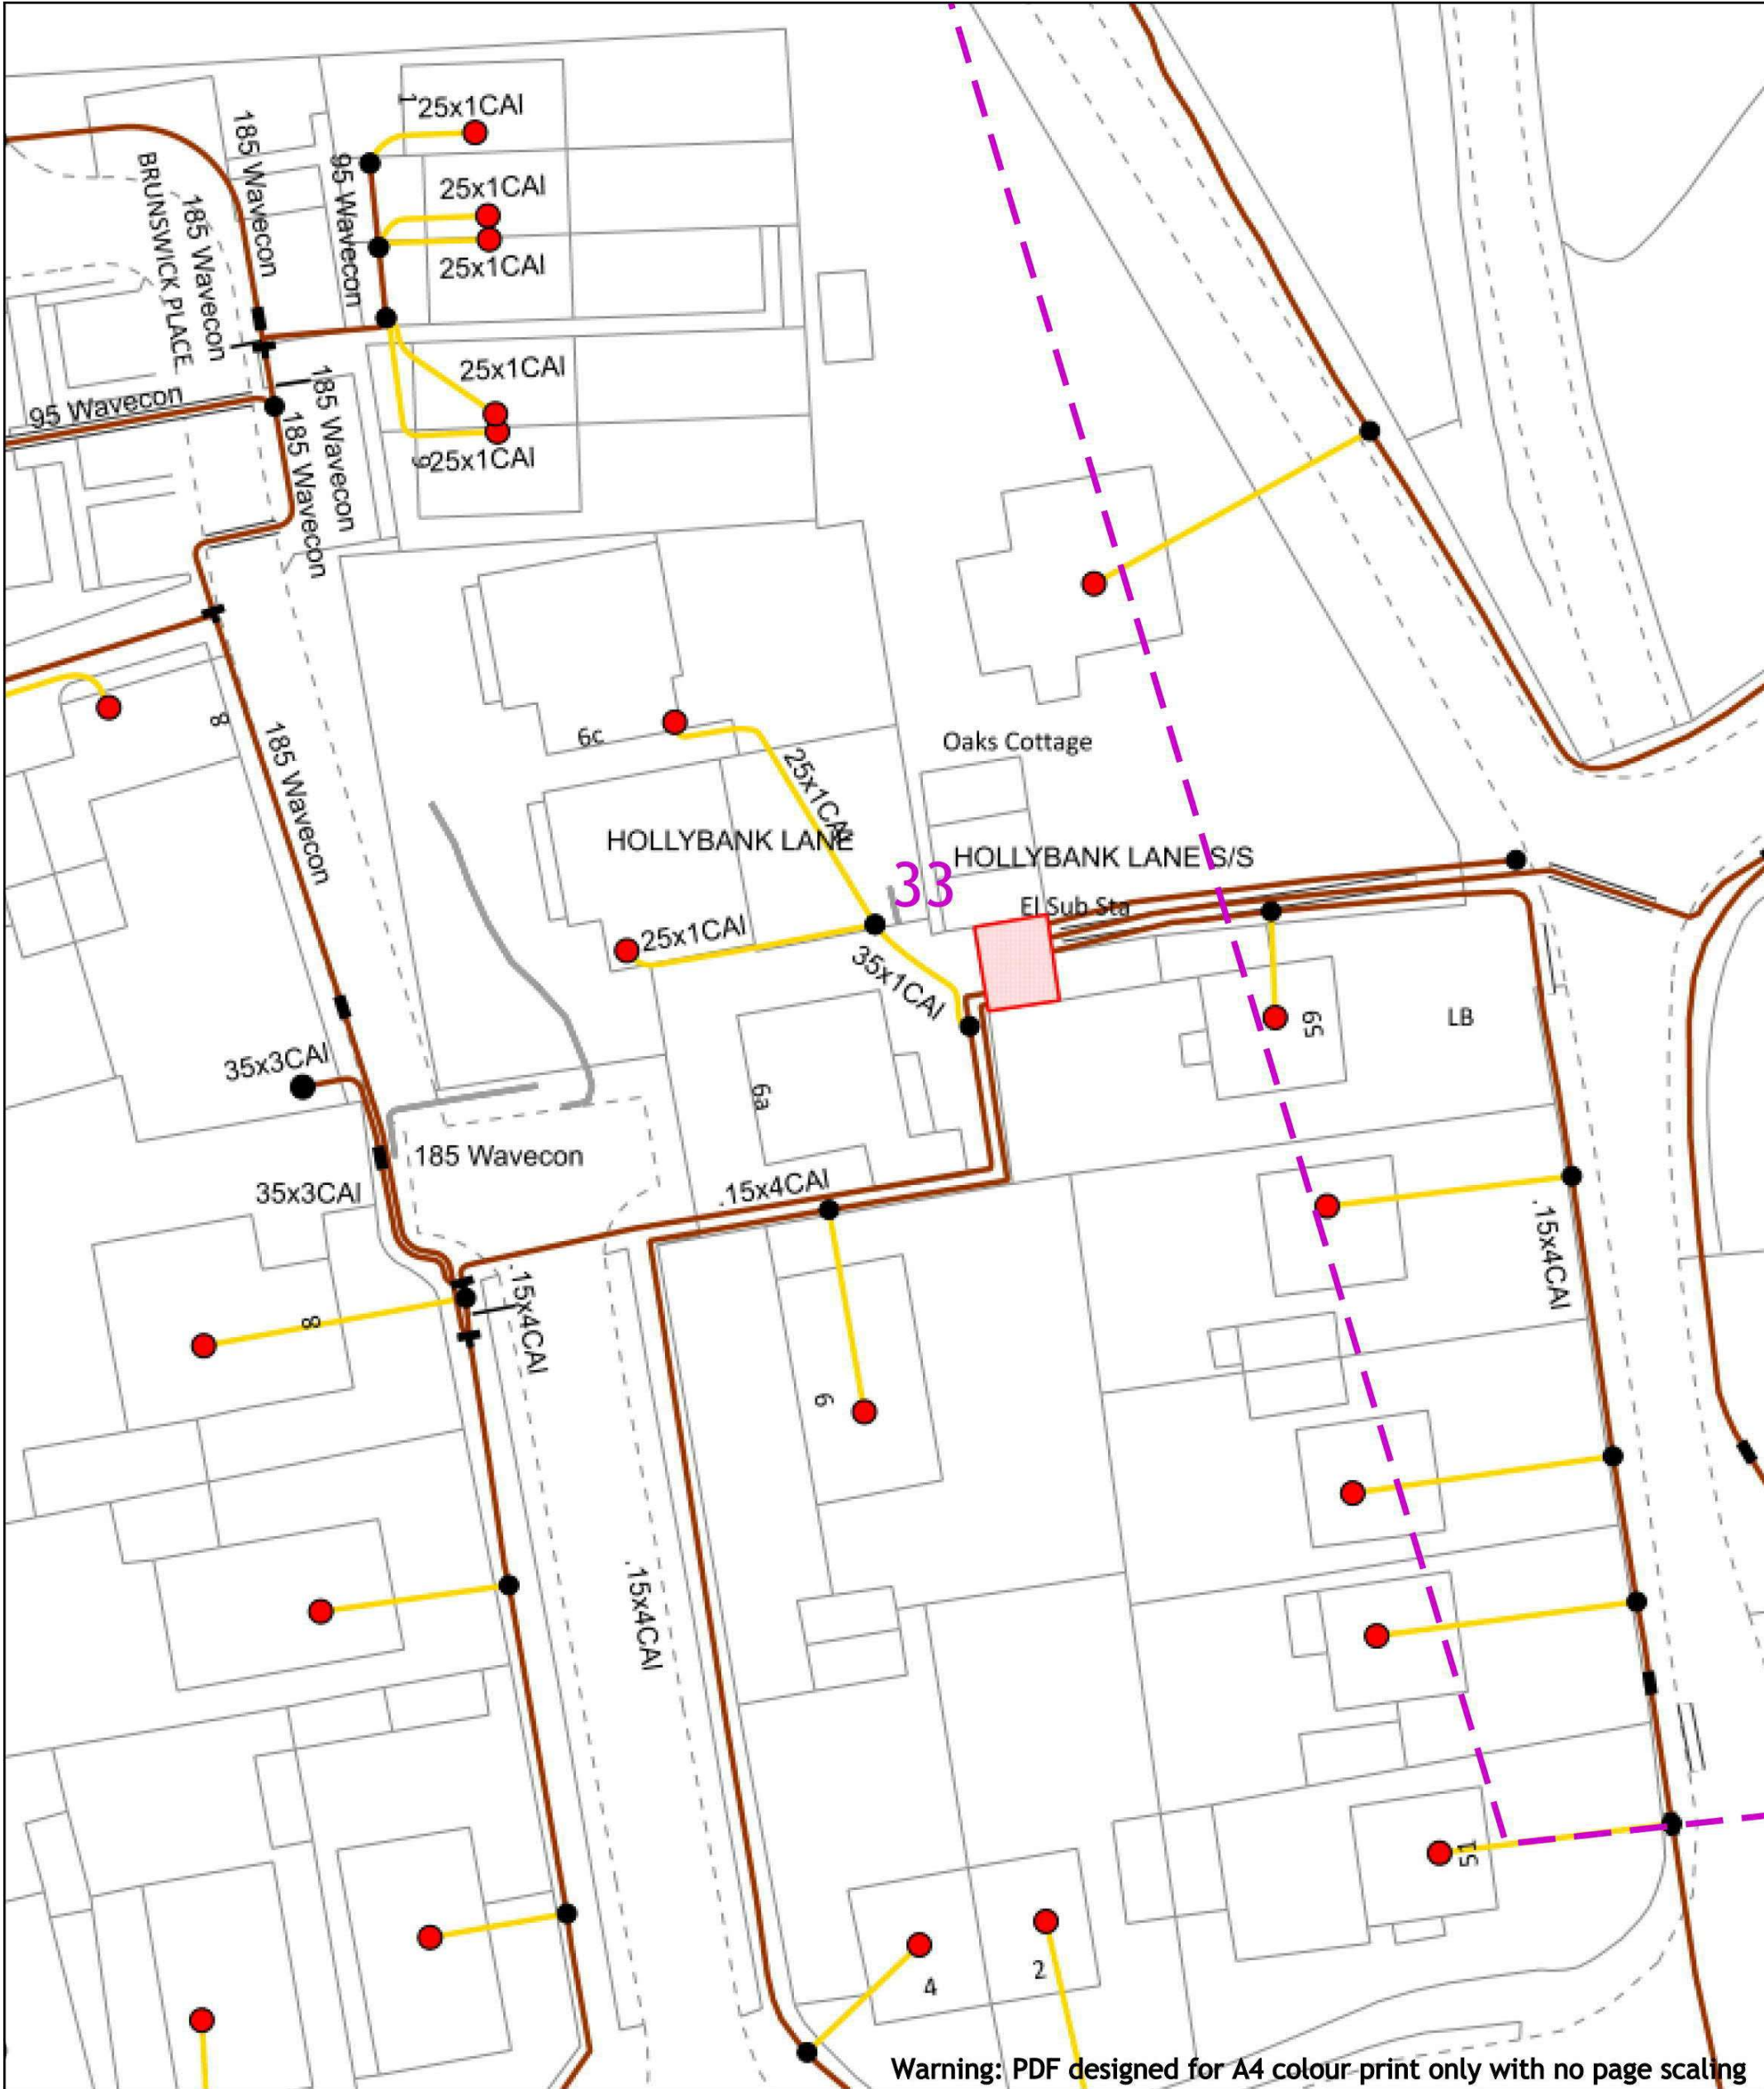

020m

Dig Sites

Area:

Line:

Date Requested: 01/04/2021

Job Reference: 21733137

Site Location: 475066 108092

Requested by: Ms Christina Elliott

Your Scheme/Reference: LM 94628/HaK

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
	Services	LV	HV
Footpath/Unmade	0.45m	0.45m	0.8m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

Legend

Service Cable

LV Mains

2 - 3.3kV

6.6kV

11kV

22kV

33kV

66kV

132kV

275kV

400kV

Fibre Optic

Pilot Cable

Distribution Structures [Electric]

Pole, Existing Location

Pole Structure, Existing Location - Single

Pole Structure, Existing Location - H

Duct Route

Cross Section Route

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Scottish and Southern Energy Power Distribution Ltd.

Registered Office: Inverlond House,  
200 Dunkeld Road, Perth, PH1 3AQ  
Registered In Scotland No.SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:  
General Enquiries: 0800 048 3516

Subject to revision - Master held by SSEN Asset Data Team:  
[Asset.Data@sse.com](mailto:Asset.Data@sse.com)  
01256 337 294

Scale: 1:500 (When plotted at A4)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED.

This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Linesearchbeforeyoudig.









020m

Dig Sites

Area:

Line:

Date Requested: 01/04/2021

Job Reference: 21733137

Site Location: 475066 108092

Requested by: Ms Christina Elliott

Your Scheme/Reference: LM 94628/HaK

	Voltages (V)			
	Up to 1,000V	Over 1,000V to 11,000V	22,000V to 132,000V	275,000V and 400,000V
LV (Low Voltage) and Services	Up to 1,000V	Over 1,000V to 11,000V	22,000V to 132,000V	275,000V and 400,000V
EHV (Extra High Voltage)				
Transmission				
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend

Service Cable

LV Mains

2 - 3.3kV

6.6kV

11kV

22kV

33kV

66kV

132kV

275kV

400kV

Fibre Optic

Pilot Cable

Distribution Structures [Electric]

Pole, Existing Location

Pole Structure, Existing Location - Single

Pole Structure, Existing Location - H

Duct Route

Cross Section Route

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Scottish and Southern Energy Power Distribution Ltd.

Registered Office: Inverlmond House,  
200 Dunkeld Road, Perth, PH1 3AQ  
Registered In Scotland No.SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:  
General Enquiries: 0800 048 3516

Subject to revision - Master held by SSEN Asset Data Team:  
[Asset.Data@sse.com](mailto:Asset.Data@sse.com)  
01256 337 294

Scale: 1:500 (When plotted at A4)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED.

This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ('The Act'). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Linesearchbeforeyoudig.





020m

Dig Sites

Area:

Line:

Date Requested: 01/04/2021

Job Reference: 21733137

Site Location: 475066 108092

Requested by: Ms Christina Elliott

Your Scheme/Reference: LM 94628/HaK

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
	Services	LV	HV
Footpath/Unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

Legend

Service Cable

LV Mains

2 - 3.3kV

6.6kV

11kV

22kV

33kV

66kV

132kV

275kV

400kV

Fibre Optic

Pilot Cable

Distribution Structures [Electric]

Pole, Existing Location

Pole Structure, Existing Location - Single

Pole Structure, Existing Location - H

Duct Route

Cross Section Route

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Scottish & Southern Electricity Networks

Scottish and Southern Energy Power Distribution Ltd.

Registered Office: Inverlmond House,  
200 Dunkeld Road, Perth, PH1 3AQ  
Registered In Scotland No.SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:  
General Enquiries: 0800 048 3516

Subject to revision - Master held by SSEN Asset Data Team:  
[Asset.Data@sse.com](mailto:Asset.Data@sse.com)  
01256 337 294

Scale: 1:500 (When plotted at A4)


BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED.  
This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ('The Act'). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.  
Plans generated by DigSAFE Pro™ software provided by Linesearchbeforeyoudig.









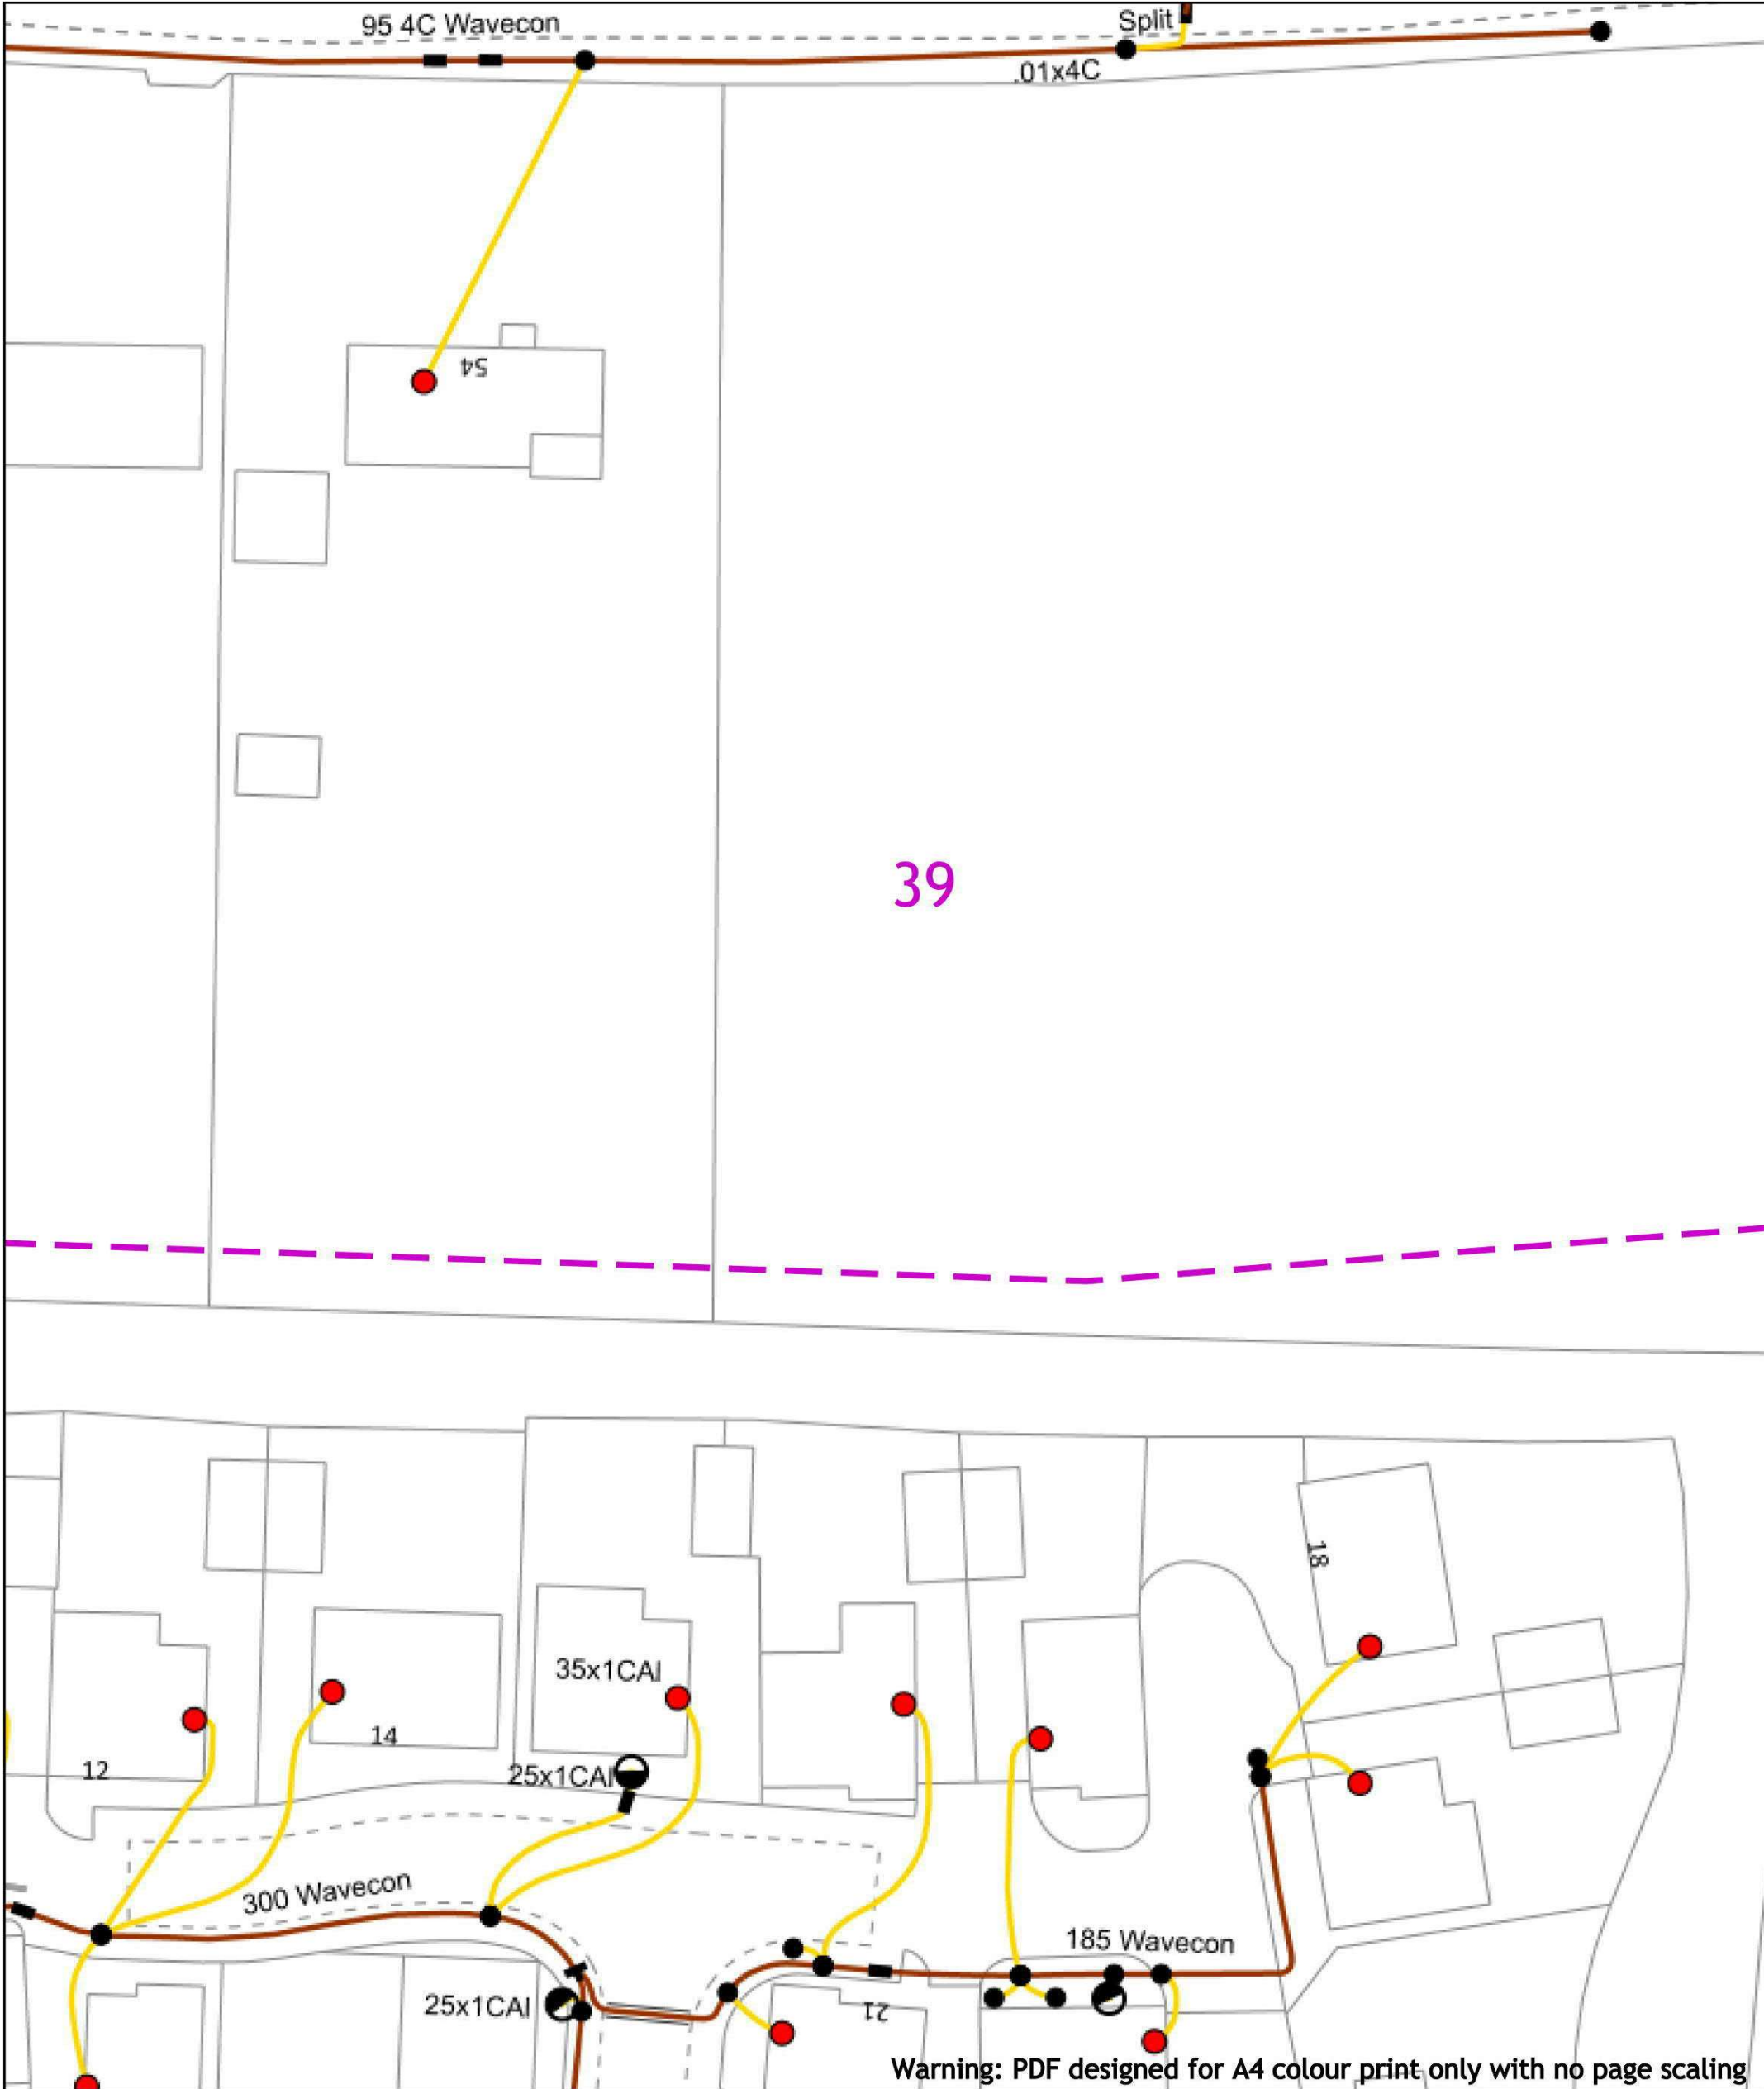

020m

Dig Sites

Area:

Line:

Date Requested: 01/04/2021

Job Reference: 21733137

Site Location: 475066 108092

Requested by: Ms Christina Elliott

Your Scheme/Reference: LM 94628/HaK

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
	Services	LV	HV
Footpath/Unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

Legend

Service Cable

LV Mains

2 - 3.3kV

6.6kV

11kV

22kV

33kV

66kV

132kV

275kV

400kV

Fibre Optic

Pilot Cable

Distribution Structures [Electric]

Pole, Existing Location

Pole Structure, Existing Location - Single

Pole Structure, Existing Location - H

Duct Route

Cross Section Route

WARNING

There may have been subsequent alteration to the surface levels. Trial holes must be undertaken to determine position and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work.

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTES GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)

Scottish and Southern Energy Power Distribution Ltd.

Registered Office: Inverlmond House,  
200 Dunkeld Road, Perth, PH1 3AQ  
Registered In Scotland No.SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:  
General Enquiries: 0800 048 3516

Subject to revision - Master held by SSEN Asset Data Team:  
[Asset.Data@sse.com](mailto:Asset.Data@sse.com)  
01256 337 294

Scale: 1:500 (When plotted at A4)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE CROWN COPYRIGHT RESERVED.

This copy has been made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ('The Act'). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by LinesearchbeforeUdig.