


DOOR TYPE 1

Structural opening: 810 x 2100mm
 WC turn/release, WC symbol, lever handle, rose & escutcheon, kickplate, door stop.
 Hinges to be fall open type.
 All WC doors to be undercut by 10mm to provide air transfer.
 Finish: Solid timber door stained/painted to match existing.

Applies to Doors: TH-D-02-03

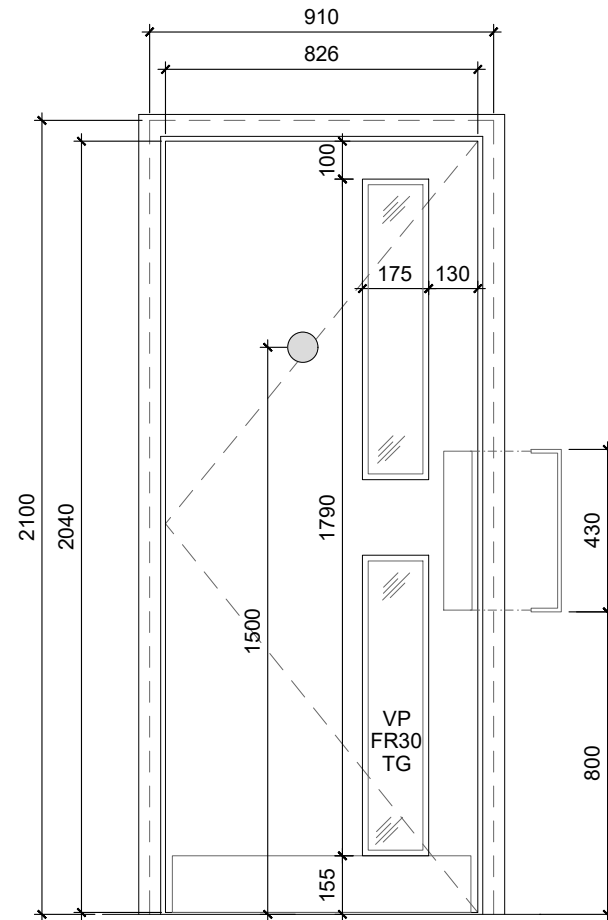

INTERNAL DOOR TYPE 2

Structural opening: 910 x 2100mm
 Vision panel 30min fire integrity, smoke seal, door closer, pull handle/push plate, kickplate, door stop, fire door signage.
 Fire Rating: FD30(S)sc
 Finish: Solid timber door stained/painted to match existing

Applies to Door: TH-D-02-01, TH-D-02-02

DOOR NOTES

- All dimensions to relate to nominal structural opening sizes. Manufacturer is responsible for checking structural opening sizes prior to component fabrication
- All new internal door widths/clear opening widths should if possible comply with Part M of the Building Regulations and have a minimum clear opening width of 800mm unless wider doors are specified elsewhere.
- All new doors to have new s/s coloured floor mounted door stops.

FIRE DOORS

- Doors to be FD30 or FD60 self closing fire doors where indicated on the YHA103 door schedule.
- New fire doors identified by their performance under test to BS476: Part 22, in terms of integrity for a period of minutes.
- All new fire doors to be fitted with smoke seals unless indicated otherwise.
- All fire doors must have the manufacturer's original fire rated mark or label intact. All doors without this official rating will be condemned and shall be replaced by the Contractor.
- All fire resisting doors are to be permanently marked on each side at eye level (1500mm from ffl) with a notice bearing the words 'Fire Door - Keep Shut' in letters not less than 5mm high. All Fire notice signage to doors is to be rigid plastic type with a self-adhesive backing, do not screw fix signage to doors.

VISION PANELS

- Doors as indicated are to have a vision panel towards the leading edge of the door whose vertical dimensions include a zone of visibility between 500mm and 1500mm from floor level with, if necessary, an interruption between 800mm and 1150mm for ironmongery.
- All vision panels and glazing in doors, to a height of 1500mm, and within 300mm of door openings, is to be of laminated or toughened safety glass to BS6206 Class A eg. Pilkington Pyrostop glazing, bedded in intumescent paste with hardwood beading.

IRONMONGREY

- New doors to have s/s door closers, lever handles or pull handles and push plates as indicated on the door schedule.
- Doors to have new SALTO door security system, as indicated on the door schedule, to incorporate new ironmongery as specified by SALTO and fitted in accordance with manufacturers details.
- All ironmongery is subject to the Clients approval.

TO BE READ IN CONJUNCTION WITH THE YHA105 SFW-DOOR SCHEDULE.

YHA (ENGLAND & WALES) LTD	client
YHA CHESTER TRAFFORD HALL INCE LANE, CHESTER, CH2 4JP	project
SECON FLOOR WORKS NEW INTERNAL DOOR DETAILS	title
YHA105	job No.
SFW-AD2.01	dwg No.
1:20 @ A3	scale
CT	drawn

