


**FRONT ELEVATION**  
(NTS)


FOUNDATION DEPTH SUBJECT TO GROUND CONDITIONS

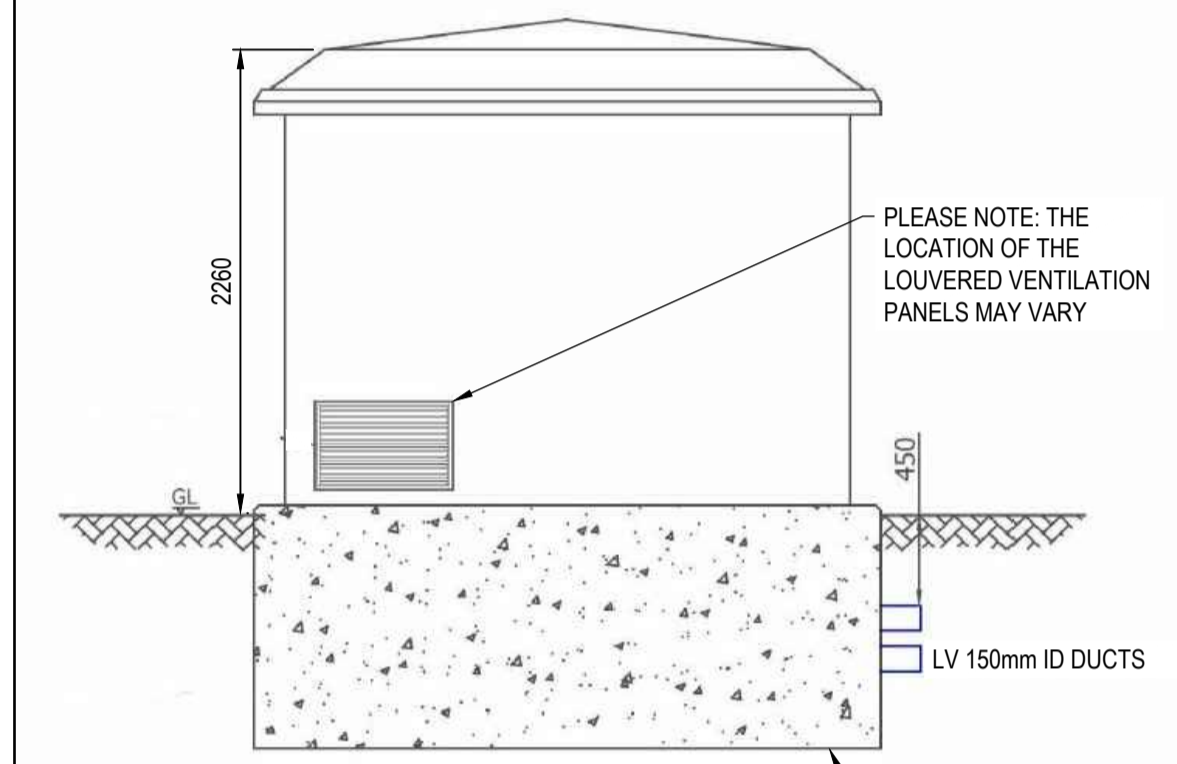


**SIDE ELEVATION**  
(NTS)

PLEASE NOTE: THE LOCATION OF THE LOUVERED VENTILATION PANELS MAY VARY

FOUNDATION DEPTH SUBJECT TO GROUND CONDITIONS

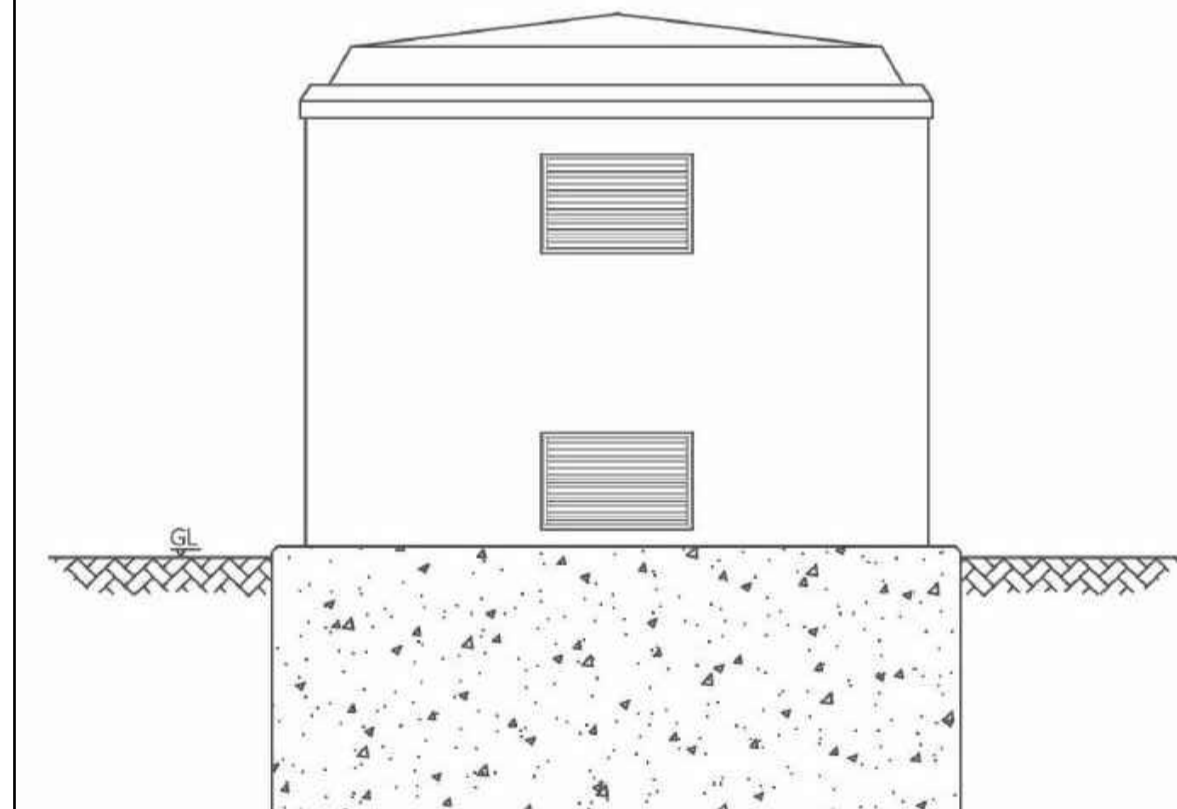


**REAR ELEVATION**  
(NTS)

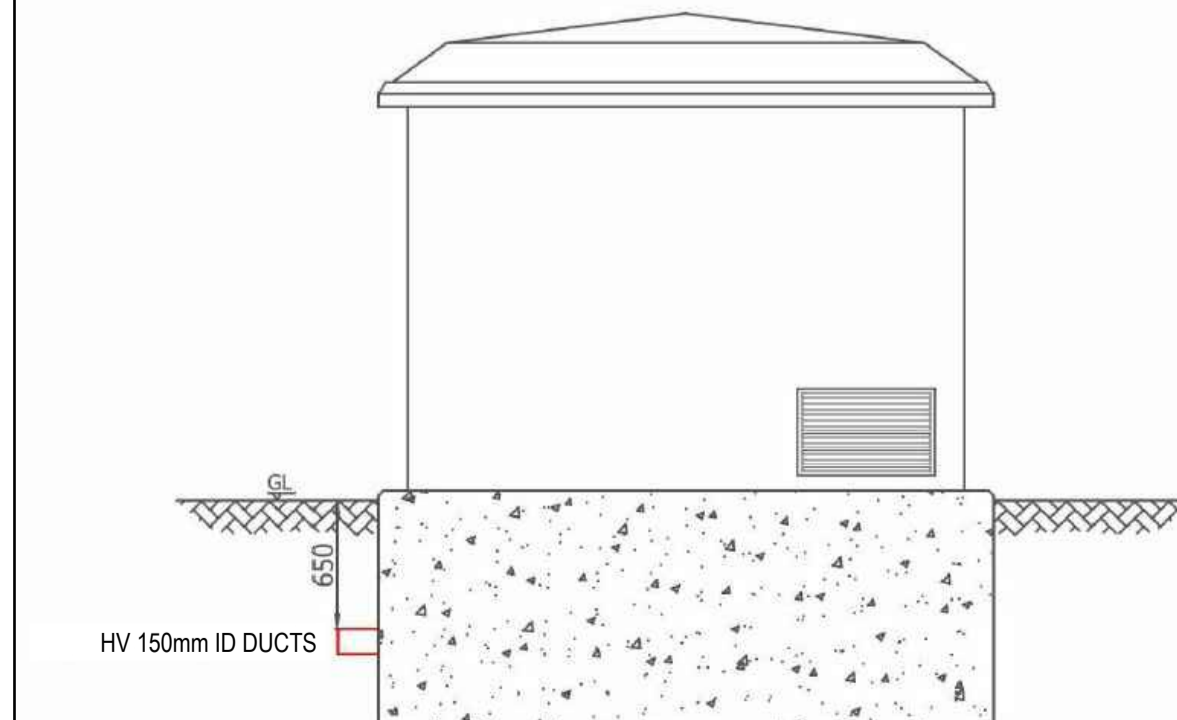

**SIDE ELEVATION**  
(NTS)

HV 150mm ID DUCTS

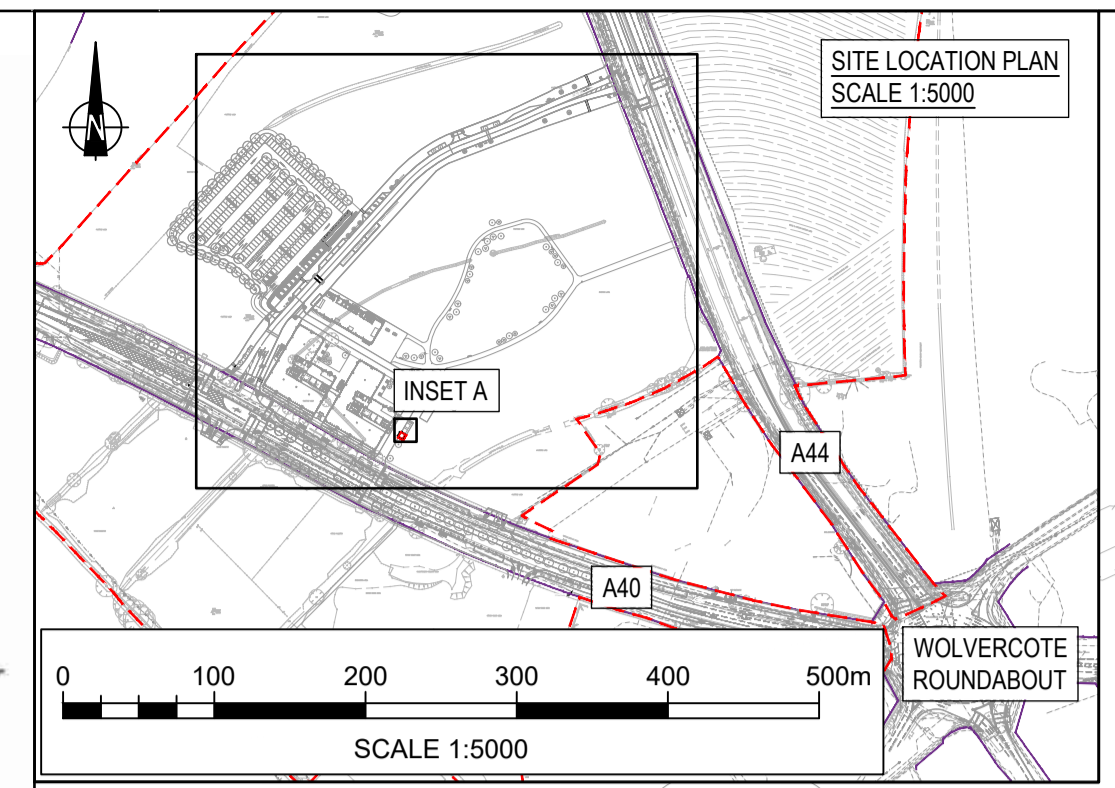

SCALE 1:5000



**KEY:**

- EXISTING OXFORDSHIRE COUNTY COUNCIL HIGHWAY BOUNDARY
- OVERALL SITE PLANNING APPLICATION BOUNDARY
- RESERVED MATTERS APPLICATION (RMA) BOUNDARY

**PROPOSED UTILITIES KEY:**

- HV 11kV ELECTRICITY CABLE ROUTE
- LV LOW VOLTAGE ELECTRICITY CABLE ROUTE
- 1MVA GRP SUBSTATION INCLUDING 1.0m MAINTENANCE STRIP 48201/LINK/S38/1300 FOR DETAILS
- STREETLIGHTING COLUMN - REFER TO STANTEC DRAWING NUMBER 48201/LINK/S38/1201-1202 FOR DETAILS
- TRAFFIC SIGN TO BE ILLUMINATED - REFER TO STANTEC DRAWING NUMBERS 48201/LINK/S38/1201-1202 FOR DETAILS

A	SCALE BARS ADDED	07.03.22	GM	ST	PK
Mark	Revision	Date	Drawn	Chkd	Appd

SCALING NOTE: Do not scale this drawing - any errors or omissions shall be reported to Stantec without delay.  
 UTILITIES NOTE: The position of any existing public or private sewers, utility services, plant or apparatus shown on this drawing is believed to be correct, but no warranty to this is expressed or implied. Other such plant or apparatus may also be present but not shown. The Contractor is therefore advised to undertake their own investigation where the presence of any existing sewers, services, plant or apparatus may affect their operations.

Drawing Issue Status  
**FOR PLANNING**

**OXFORD NORTH  
PHASE 1A  
RESERVED MATTERS APPLICATION  
PROPOSED GRP SUBSTATION PLAN**

Client  
**TWO**  
THOMAS WHITE OXFORD

stantec.com/uk

Date of 1st Issue: 15.12.2021  
Designed: ST  
Drawn: GM

A1 Scale: 1:500 @ A1  
Checked: ST  
Approved: PK

Drawing Number: 48201/LINK/UT/SK126  
Revision: A

Copyright reserved  
The copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorised by Stantec is forbidden.

OXFORD  
Tel: 01865 410 000

- GENERAL NOTES:**
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL SECTION 38 DRAWINGS WITHIN THE STANTEC DRAWING SERIES - '48201/LINK/S38 - A40 / A44 LINK ROAD'.
  - TOPOGRAPHICAL SURVEY BASED ON WOODS HARDWICK LTD SURVEY DATED JULY 2015.
  - ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
  - THE SERVICES INFORMATION GIVEN ON THIS PLAN IS GIVEN WITHOUT OBLIGATION, OR WARRANTY, THE ACCURACY THEREOF CANNOT BE GUARANTEED. EXCAVATION SHOULD BE CARRIED OUT IN ACCORDANCE WITH HS(G)47 AVOIDING DANGER FROM UNDERGROUND SERVICES.
- GRP SUBSTATION NOTES:**
- STANDARD EXTERIOR COLOUR TO BE MID-GREEN TO BS4800.
  - ROOF IS MOUNTED ON EXPLOSION RELIED FRAMEWORK WITH MOUNTINGS ENCAPSULATED AND BONDED INTO THE CORNERS OF THE ENCLOSURE. THE ROOF IS CAPABLE OF RISING 1m AND RETURNING TO THE NORMAL POSITION.
  - DOORS HUNG ON PAIRS OF STAINLESS STEEL BUTT HINGES.
  - THE THRESHOLD SECTION BELOW THE DOORS IS REMOVABLE TO FACILITATE PLANT MOVEMENT.
  - VENTILATION IS PROVIDED VIA LOUVERED PANELS IN SIDES AND REAR OF GRP ENCLOSURE. LOUVERS MUST NOT BE OBSTRUCTED AT ANY TIME.
  - REFER TO POWER ON DRAWING No. POC-SS-0001 FOR DETAILS

