


FRONT ELEVATION



SIDE ELEVATION

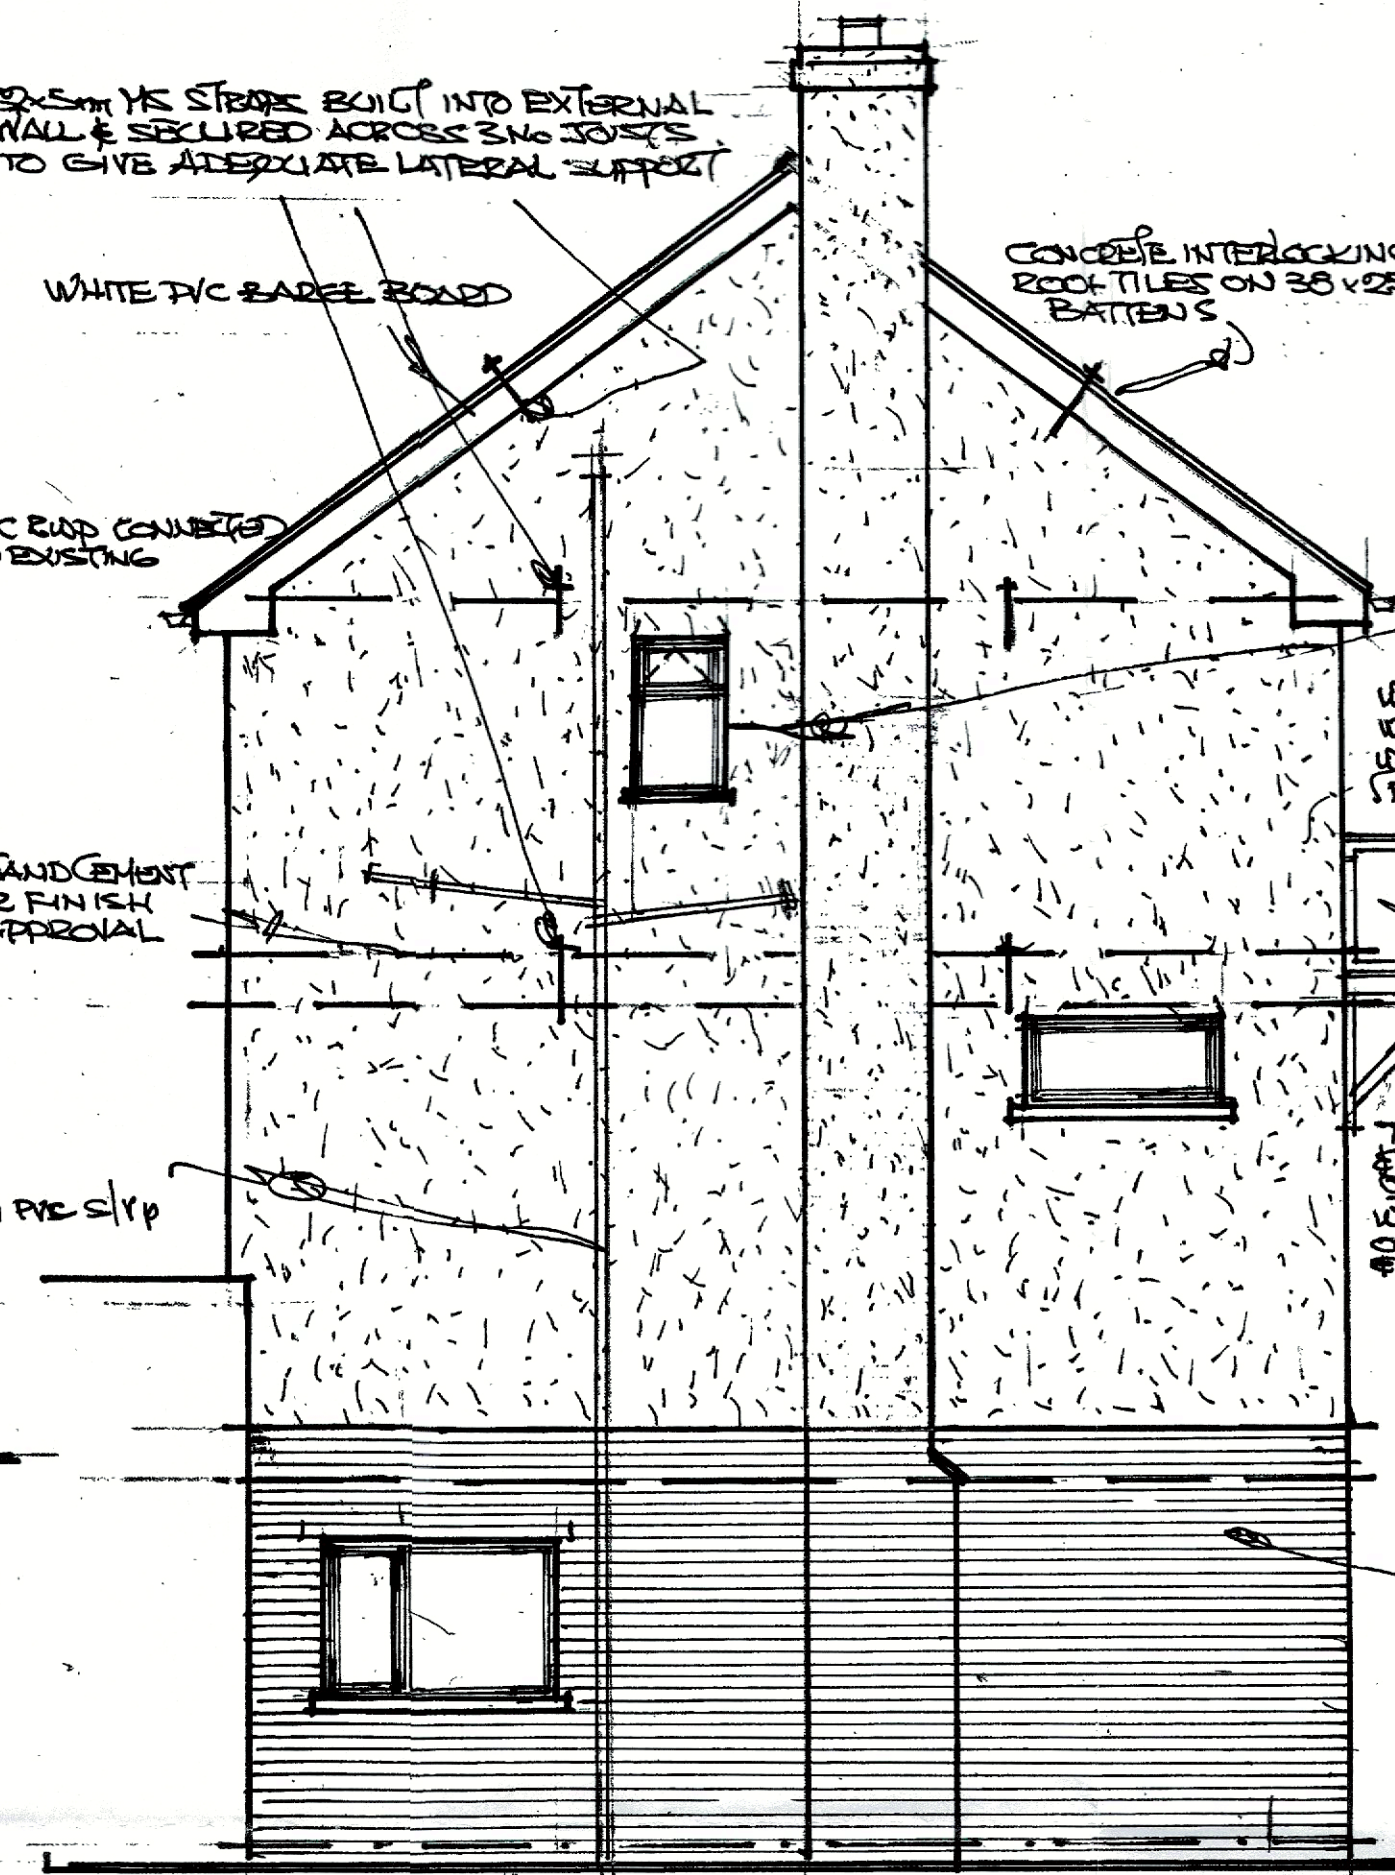


REAR ELEVATION


MANUAL FIRE ALARM SYSTEM TO BE INSTALLED IN 3 NO FLATS (TO INCLUDE SMOKE DETECTORS & SOUNDERS) ALL TO MANUFACTURERS DESIGN & INSTRUCTIONS ALL TO COMPLY WITH BS 5839.

PROVIDE MECHANICAL VENTILATION CAPABLE OF EXTRACTING AT A RATE OF NOT LESS THAN 50L/S PER SECOND WHICH MAY BE OPERATED INTERMITTENTLY TO THE OUTSIDE AIR WITH 15 MINUTE OVER-RUN.


Post Room
F.O.D.C
31 MAR 2022

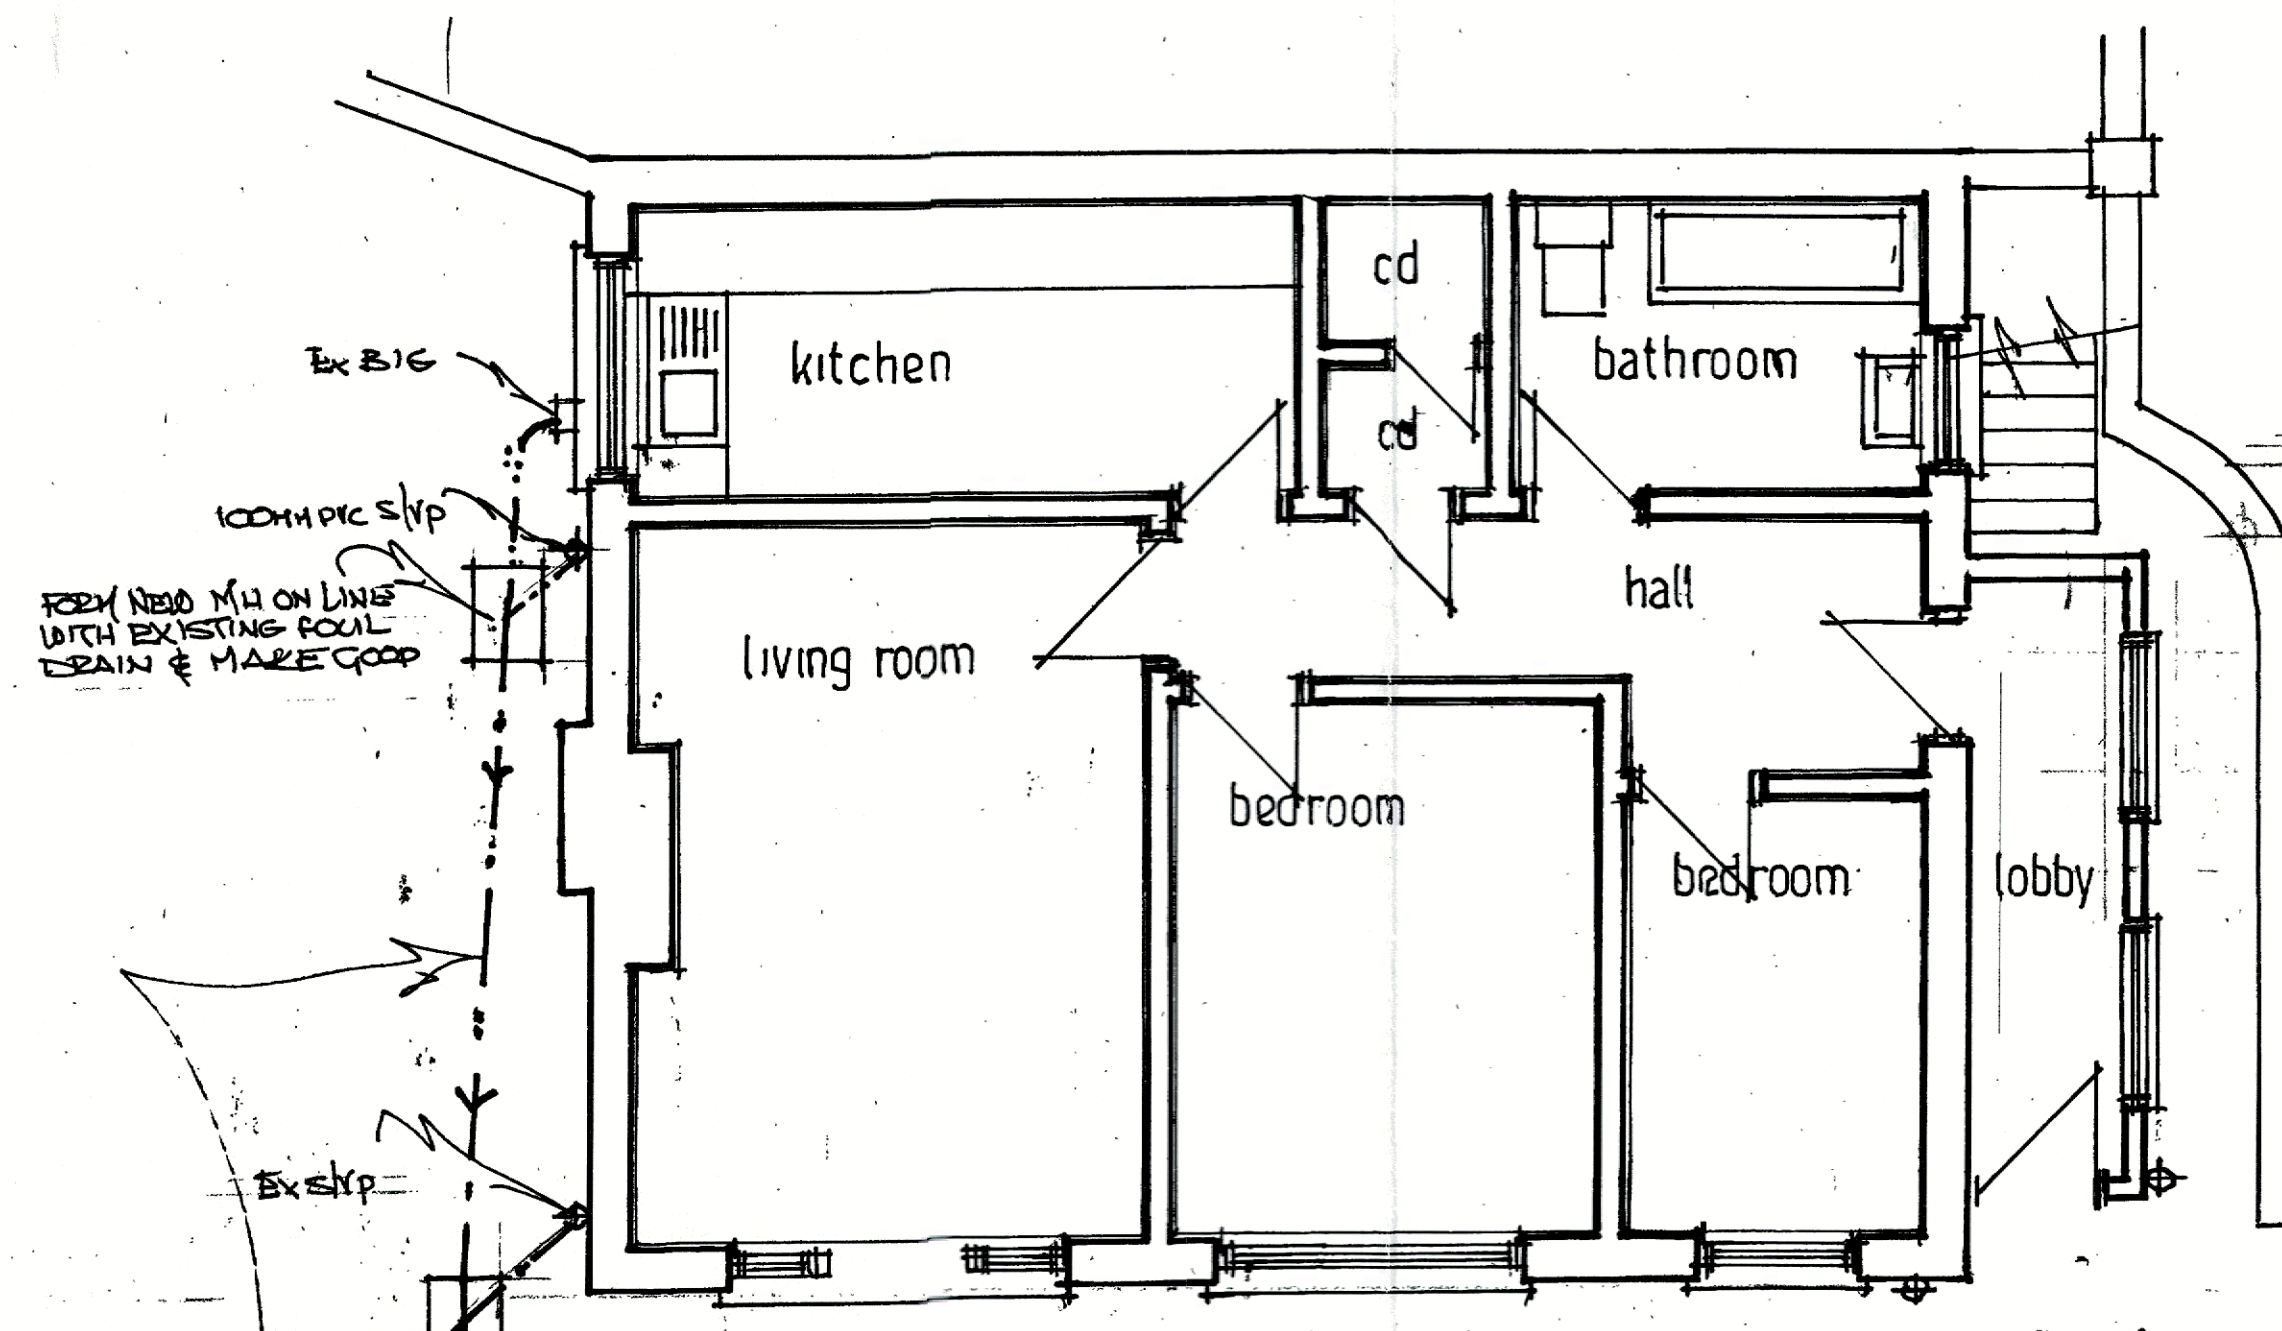

GROUND FLOOR PLAN

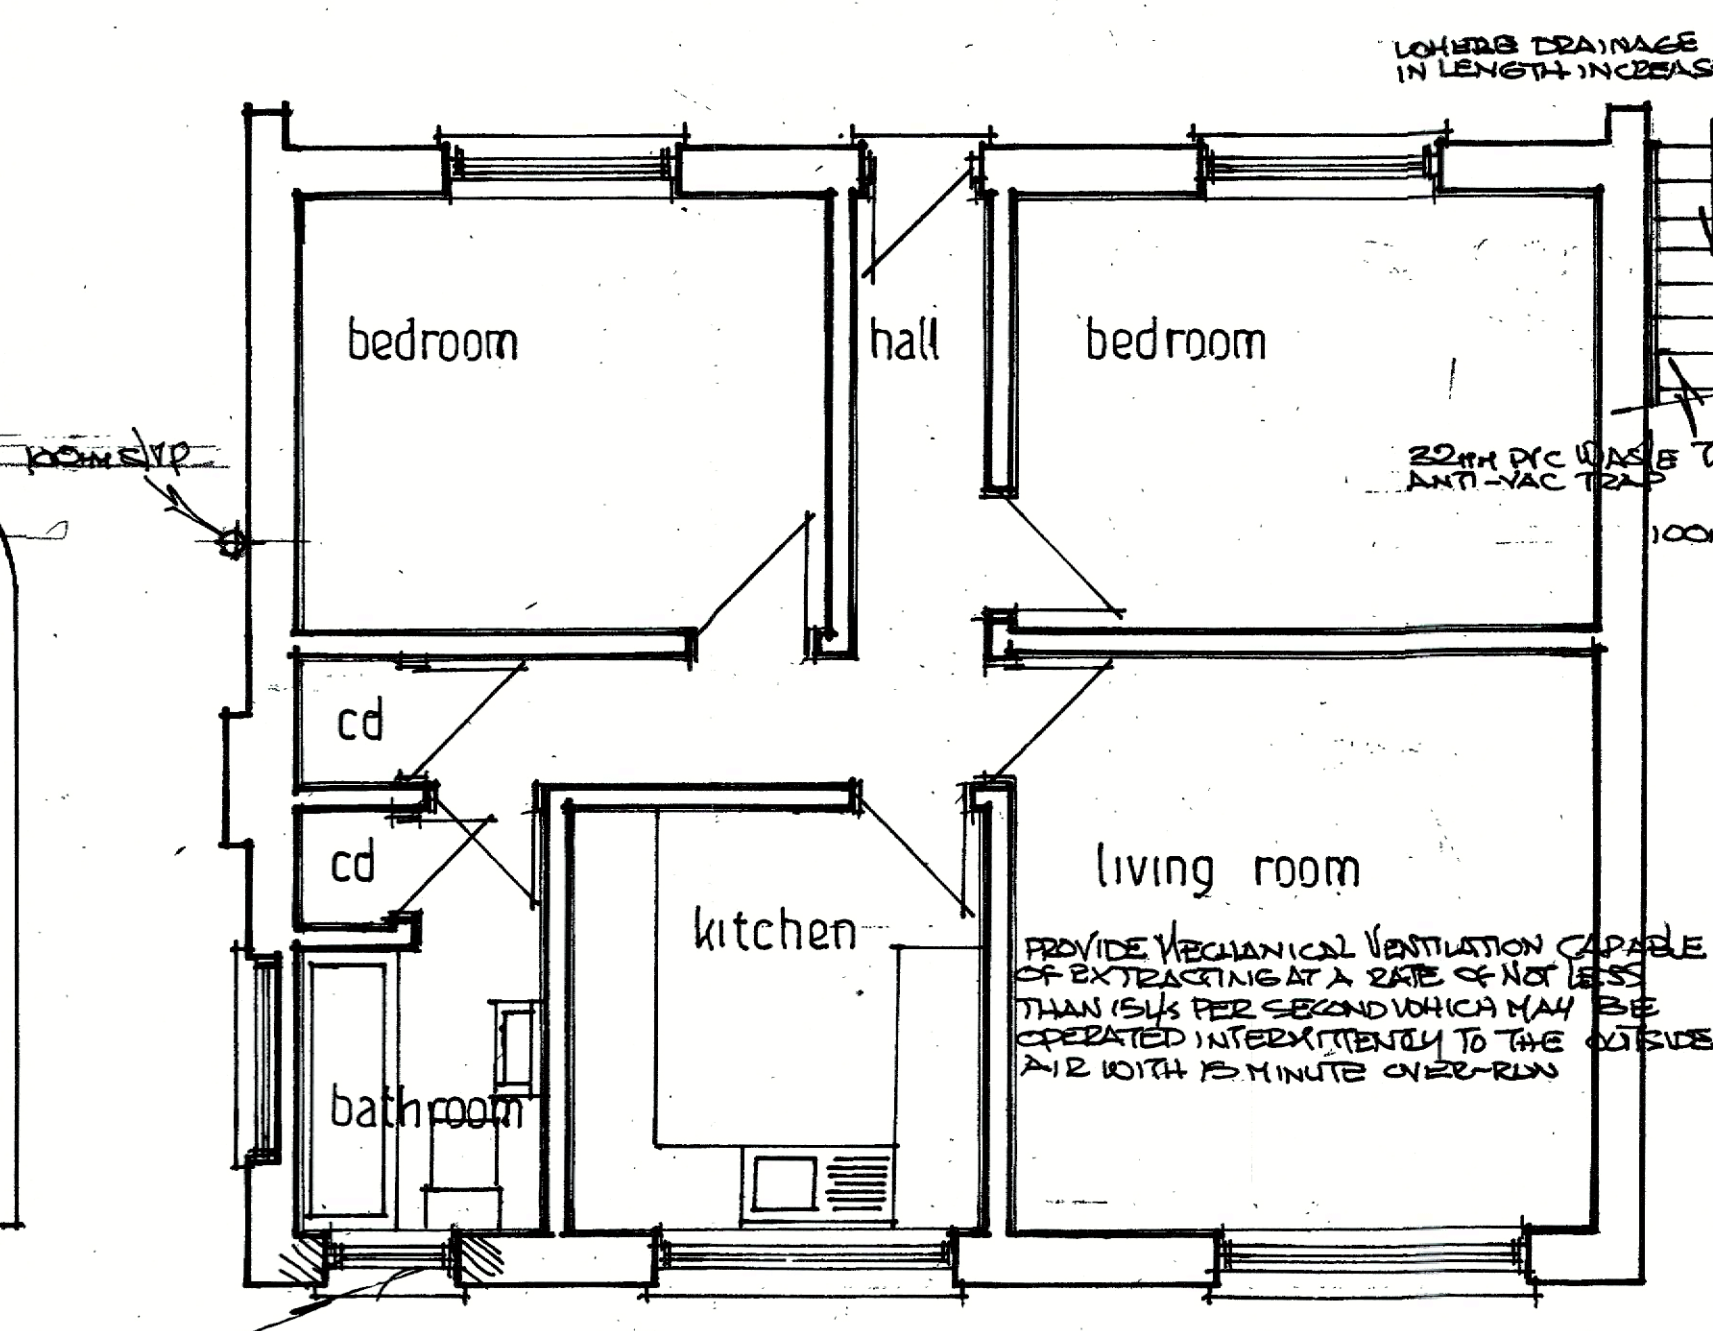

FIRST FLOOR PLAN

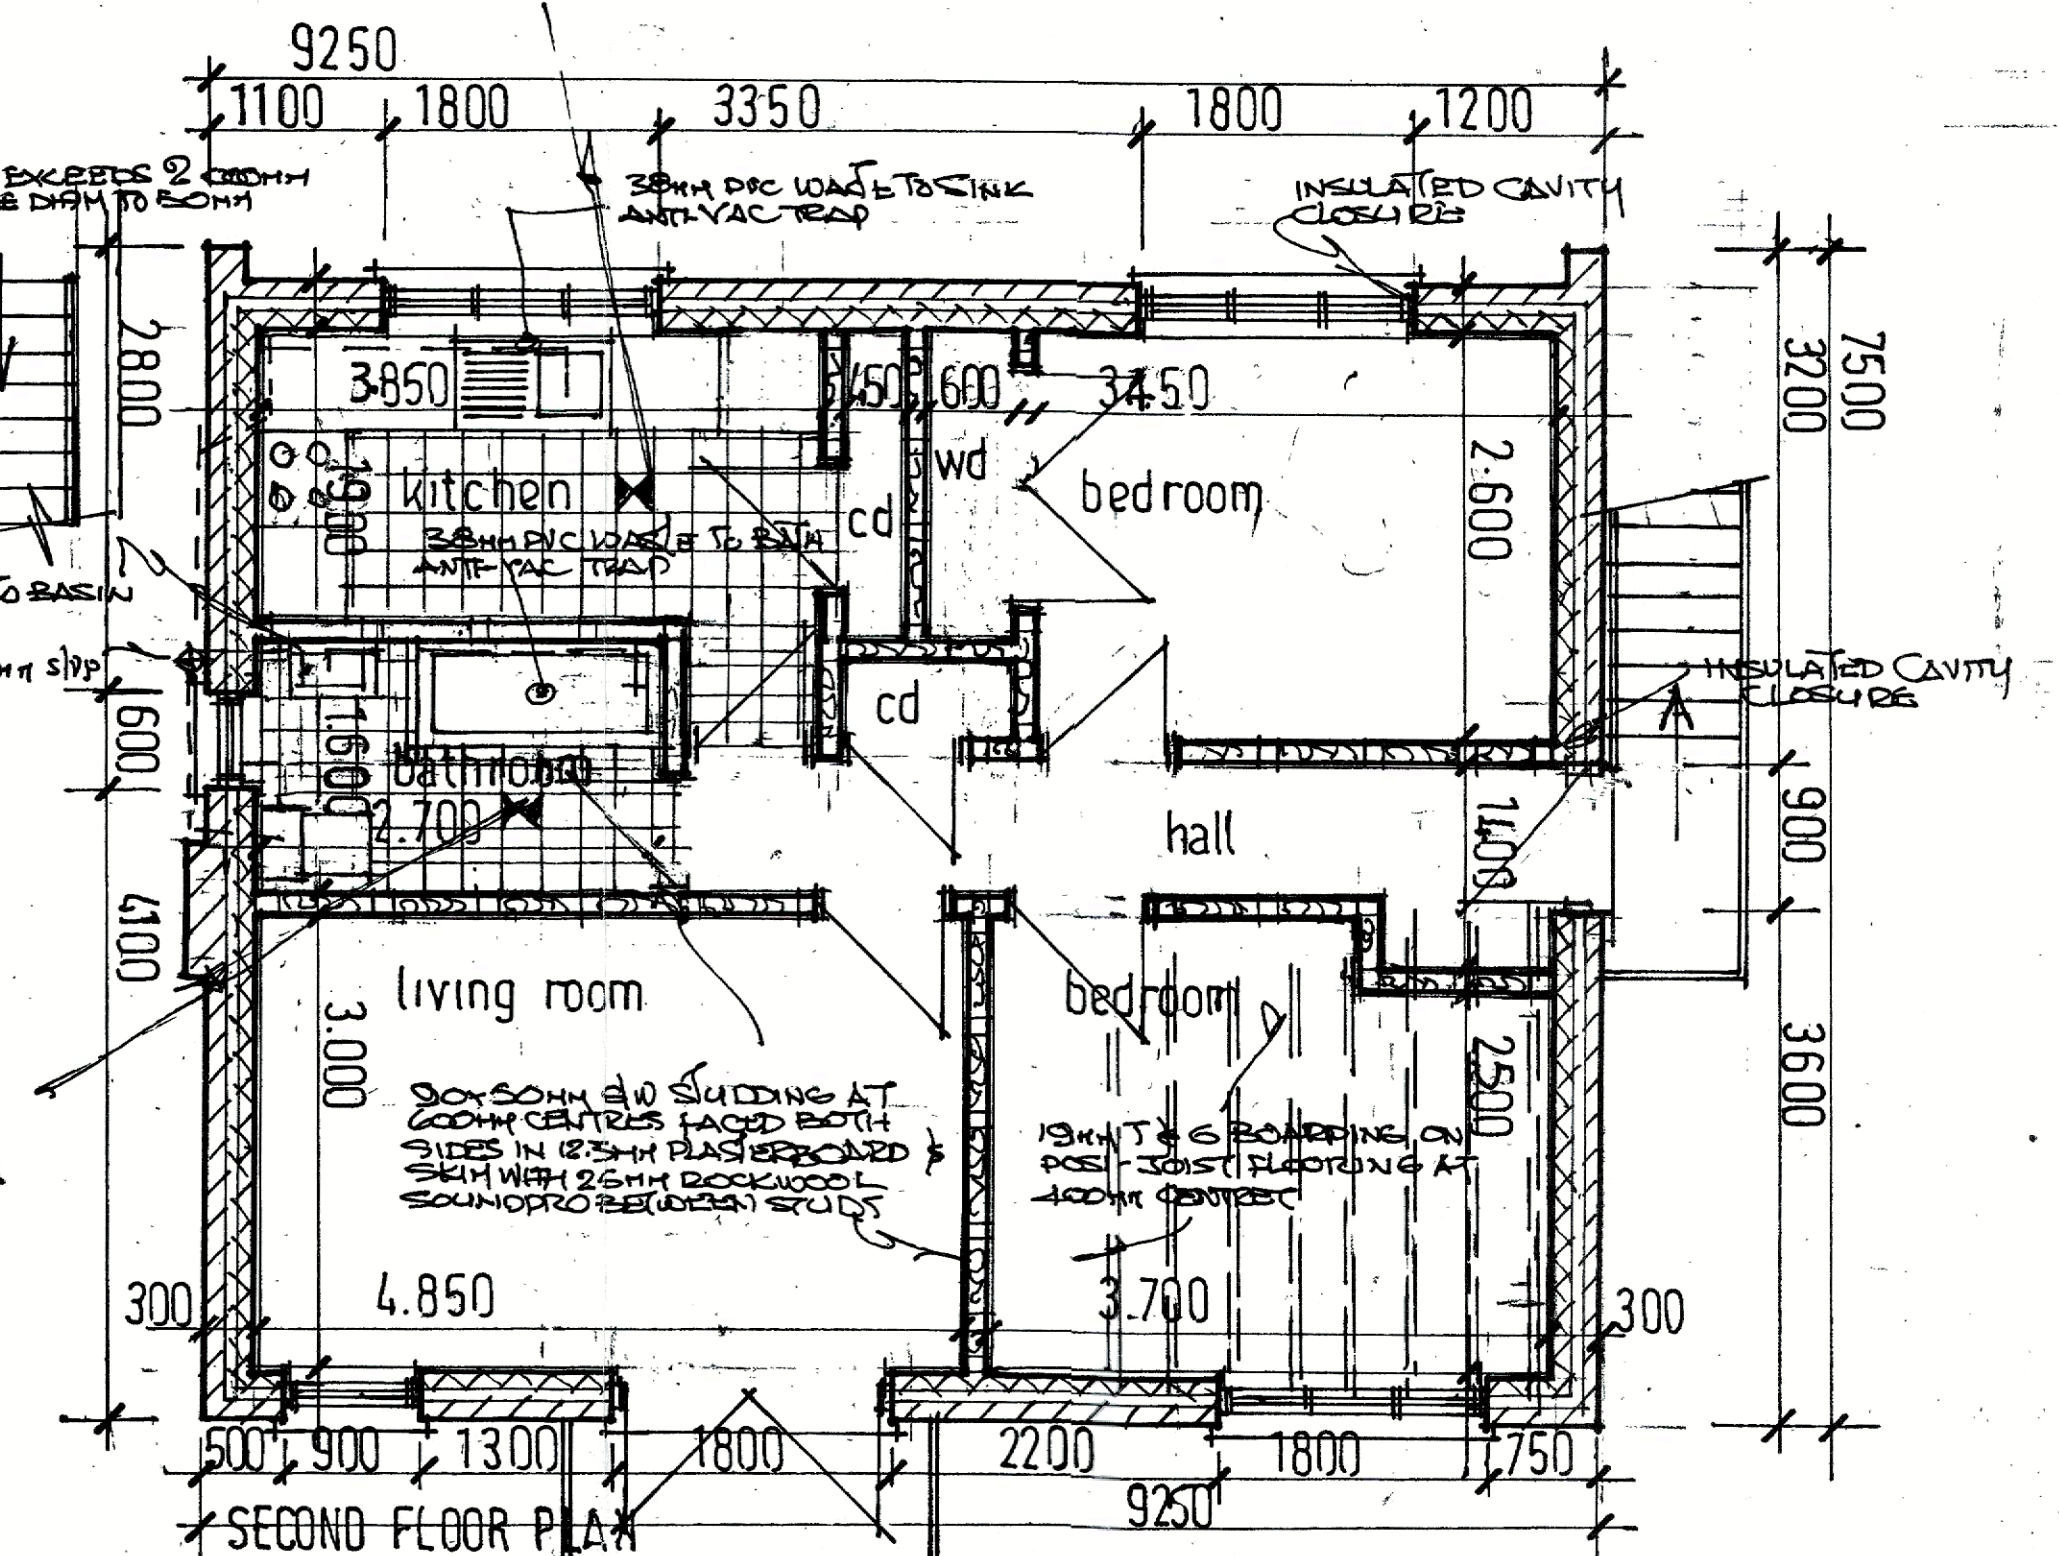

SECOND FLOOR PLAN