

**STANDARD TANK INSTALLATION DETAIL
LATITUDINAL CROSS SECTION - NTS**


DRAWING NOTES

COPYRIGHT ©
This drawing and the details herein are the copyright of MBH Design Studio Ltd. and must not be reproduced, altered or passed to any third party without prior written consent.
This drawing has been produced for the project listed below, is submitted in support of this application to the Local Planning Authority and is not intended for use by any other person or for any other purpose.
Every effort has been made to ensure the accuracy of these drawings, however MBH Design Studio Ltd. accept no responsibility for any discrepancies arising from the reuse of survey information and preliminary drawings commissioned by the Applicant from others.

NOTES

1. THE MAIN CONTRACTOR IS RESPONSIBLE FOR THE TEMPORARY WORKS.
2. TANK SIZE TO BE SITE SPECIFIC - TBC AND SIGNED OFF BY ARTELIA DESIGN MANAGER.
3. PRIOR TO COMPLETION OF FORECOURT SLAB CONSTRUCTION OVER TANKS, SHOULD THE POSSIBILITY OF GROUND OR SURFACE RAIN WATER BE AT RISK OF FLOODING TANK FARM, IT WILL BE NECESSARY TO CONSIDER WATER FILLING OF TANKS BY 50%.
4. THIS DRAWING TO BE READ IN CONJUNCTION WITH TANK SUPPLIER'S STANDARD DRAWINGS & DETAILS.
5. WHERE THE OPTION OF OMITTING A BOTTOM SUPPORT FRAME TO THE EXCAVATIONS TEMPORARY SUPPORT SHEETING (DESIGN / DETAIL BY OTHERS) IS TO BE ADOPTED, AN ALTERNATIVE SUPPORT CAN BE PROVIDED BY INSTALLING A 300MM. DEEP MASS CONCRETE BLINDING LAYER USING A C25 MASS CONCRETE FILL, HAVING a SELF COMPACTING SLUMP (TO SUPPLIERS SPECIFICATION).
6. A MINIMUM CONCRETE STRENGTH OF 20N/MM2. IS TO BE ACHIEVED PRIOR TO WORKS COMMENCING WITHIN THE TANK EXCAVATION, THEREFORE IT WILL BE NECESSARY FOR THE MAIN CONTRACTOR TO LIASE WITH THE CONCRETE SUPPLIER TO INCREASE THE MIX STRENGTH SO AS TO ACHIEVE THE 20N/MM2. STRENGTH AT THE TIME REQUIRED FOR WORKS TO PROGRESS WITHIN TANK EXCAVATION.
7. THIS DRAWING TO BE READ IN CONJUNCTION WITH UK SHELL STANDARDS DRAWING SSD-3.02-21 (STRUCTURAL ENGINEER DETAIL BASE SLAB CONSTRUCTION TO CRADLE TYPE TANK FARM EXCAVATION DETAIL).
8. WATER BALLASTING
PREFERRED DEFAULT IS NOT TO WATER BALLAST. HOWEVER, WHERE POOR GROUND CONDITIONS AND/OR HIGH WATER TABLE ARE EVIDENT, REFER TO STRUCTURAL ENGINEER FOR CHECKING AND CONFIRMATION WHETHER WATER BALLASTING IS REQUIRED.

**STANDARD TANK LID
POSITION SETTING OUT PLAN**

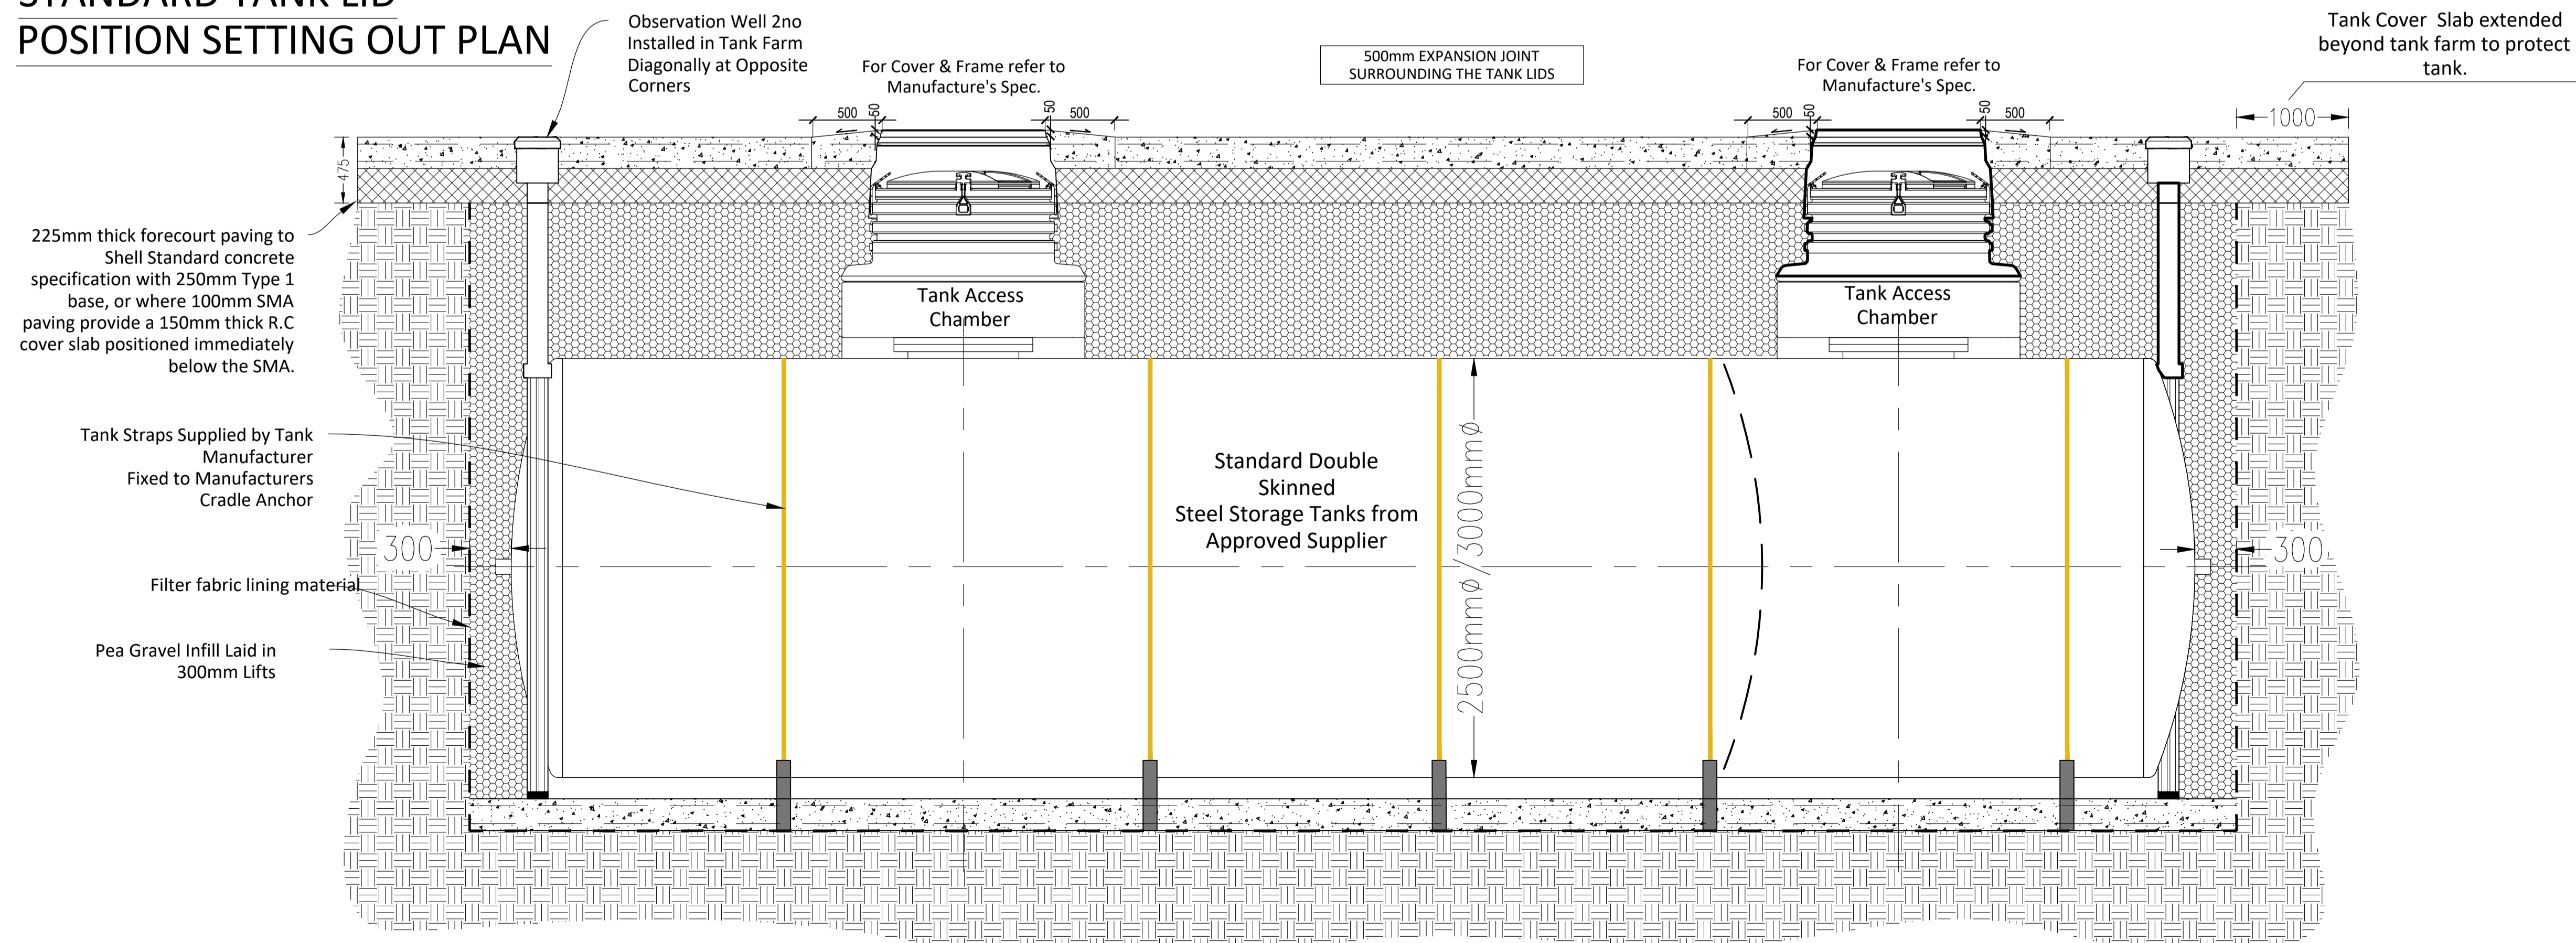

**STANDARD TANK INSTALLATION DETAIL
LONGITUDINAL CROSS SECTION - NTS**

| REV | DATE | DESCRIPTION | DRAWN/CHECKED |
|--|-----------------------|--------------|-------------------|
| REVISION NOTES | | | |
| PLANNING | | | |
| mbh | | | |
| <small>MBH Design Studio Ltd. Rosemount House, Rosemount Avenue, West Byfleet, Surrey, KT14 6LB www.mbhstd.com t: 01932 352 727 f: 01932 351 545</small> | | | |
| CLIENT | | | |
| mfg <small>motor fuel group</small> | | | |
| PROJECT | | | |
| FS931 OAKLANDS SIDMOUTH SIDMOUTH ROAD, ALYESBEARE, EXETER, DEVON EX5 2JJ | | | |
| DRAWING TITLE | | | |
| TANK INSTALLATION DETAIL | | | |
| DRAWN BY | DATE | SCALE | PAPER SIZE |
| DT | 14.04.2022 | nts | A1 |
| CHECKED BY | DRAWING NUMBER | REV. | |
| JN | 13614-205 | - | |