



# Fan Services

*Commercial Kitchen Extraction  
and Ventilation Experts*

**Email:** [info@fanservices.co.uk](mailto:info@fanservices.co.uk) |

**Website:** [www.fanservices.co.uk](http://www.fanservices.co.uk) |

**Office:** 0203 539 1475 | **After Hours:** 0759 500 3000 |

---

The Meeting Place

Kings Road,

Brighton

BN3 2WN

20/06/2022

## **KITCHEN EXTRACTION & ODOUR CONTROL SYSTEM PROPOSAL**

Fan Services was asked to carry out a site survey and put together a proposal for the extraction system at the above address:

After concluding the odour risk assessment under the DEFRA guidance, the total score was 40 which leads to very high level of odour filtration (please see attached Odour risk assessment). Our proposal as follows:

Above the electric cooking equipment, a stainless-steel extractor hood canopy, 4,000mm long x 1,500mm deep X 500mm High.

The canopy is manufactured in 304 grade with external dull polish grain and internal filter housing to removable/washable baffle type grease filters.

Baffle filters are (first stage filters) of a re-usable stainless-steel type design. There will be sufficient primary grease filters fitted to cover the complete length of the canopy face above the cooking ranges which are highly efficient at grease removal.

The ductwork from the canopy hood will be connected the second stage of filtration which is the 2X Electrostatic Precipitator (ESP) Kitchen Extract Grease and Smoke filtration such as Purified Air ESP300E. both units will be used as double pass to allow the odours to be completely filtered. (please see attached tech spec for the ESP).

The ESP will then connect to the third stage of filtration which consist of 3X12''X24''X24'' / 75KG of heavy duty activated carbon filtration unit which is accommodated in a housing box with G4 Pleated Panel pre-Filters (carbon filtration has a dwell time of around 0.3 to 0.4 seconds, please see attached tech spec for carbon and pre filter).

The filter housing unit will be designed to ensure ease of access for maintenance and to provide a good seal around the filters to prevent gases bypassing the filters

The odour systems is then connected to Helios Giga box GBW500 insulated box extractor fan with transformer speed controller and overheat protection. (please see attached fan technical specification).

The fan will be mounted on using anti vibration rubber mountings and connected to ducting using flexible connectors to eliminate vibration levels.

A sound attenuators would be installed after the fan (atmosphere outlet side) type Acustica CP03-C\*-0500-1D to achieve the insertion loss as per the acoustic engineer report. (please see attached Sound attenuator details).

The ductwork after the silencer will run horizontally to connect to an external weather louver.

Attenuation has been selected so as to provide a system rating level of at least 10 dB(A) below the lowest existing background noise level for the proposed operating hours and when extrapolated to the nearest noise sensitive neighbouring residential property.

The system will be designed and installed in accordance to DW172 and Defra Guidance.

#### **CLEANING AND MAINTAINCE SCHEDULE**

- 1- Extractor hood canopy and baffle filters to be cleaned weekly.
- 2- TR19 extractor system, ductwork cleaning to be scheduled every 3 months.
- 3- Carbon units to be replaced every 3 months.
- 4- ESP to be serviced and cleaned every 3 months.

We hope this is of assistance and await your further instruction.

Kind regards

Jay Zen

## Appendix 3: Risk Assessment for Odour

Odour control must be designed to prevent odour nuisance in a given situation. The following score methodology is suggested as a means of determining odour control requirements using a simple risk assessment approach. The odour control requirements considered here are consistent with the performance requirements listed in this report.

Impact Risk	Odour Control Requirement	Significance Score*
Low to Medium	Low level odour control	Less than 20
High	High level odour control	20 to 35
Very high	Very high level odour control	more than 35

\* based on the sum of contributions from dispersion, proximity of receptors, size of kitchen and cooking type:

Criteria	Score	Score	Details
Dispersion	Very poor	20	Low level discharge, discharge into courtyard or restriction on stack.
	Poor	15	Not low level but below eaves, or discharge at below 10 m/s.
	Moderate	10	Discharging 1m above eaves at 10 -15 m/s.
	Good	5	Discharging 1m above ridge at 15 m/s.
Proximity of receptors	Close	10	Closest sensitive receptor less than 20m from kitchen discharge.
	Medium	5	Closest sensitive receptor between 20 and 100m from kitchen discharge.
	Far	1	Closest sensitive receptor more than 100m from kitchen discharge <sup>1</sup> .
Size of kitchen	Large	5	More than 100 covers or large sized take away.
	Medium	3	Between 30 and 100 covers or medium sized take away.
	Small	1	Less than 30 covers or small take away <sup>1</sup> .
Cooking type (odour and grease loading)	Very high	10	Pub (high level of fried food), fried chicken, burgers or fish & chips. <i>Turkish, Middle Eastern or any premises cooking with solid fuel</i>
	High	7	<i>Vietnamese, Thai, Indian, Japanese, Chinese, steakhouse</i>
	Medium	4	<i>Cantonese, Italian, French, Pizza (gas fired),</i>
	Low	1	<i>Most pubs (no fried food, mainly reheating and sandwiches etc), Tea rooms<sup>1</sup></i>

**Note 1: A planner may take a pragmatic view when assessing whether certain low risk kitchens require any odour abatement to be fitted. In reaching this decision the Planner may consider the nature of the food being cooked and/or the size of kitchen and/or its location.**



# The Particulate Phase

## Our ESP Range



ESP 4500

- ESP 1500E which can handle up to 0.7m<sup>3</sup>/sec of air flow
- ESP 3000E which can handle up to 1.4m<sup>3</sup>/sec of air flow
- ESP 4500E which can handle up to 2.1m<sup>3</sup>/sec of air flow
- ESP 6000E which can handle up to 2.8m<sup>3</sup>/sec of air flow

Our ESP's have been specifically designed for kitchen extract systems; they have integral sumps to collect the oil, grease and smoke particles filtered out of the exhaust. This not only simplifies servicing but eradicates potentially dangerous spillage from the bottom of the units and greatly cuts down on build-ups of grease within the ducting.

The ionisation voltage has been designed to run at a negative potential which enhances the ionisation of particles and also produces more ozone which is helpful in reducing cooking odours.

Our ESP units fit in-line with the kitchen ducting and can be configured modularly to cope with all extract volume requirements.

# KEY FEATURES


- Eliminates up to 98% of oil, grease and smoke particles
- Filters particles down to sub-micron levels
- Produces Ozone to help reduce malodours
- Designed with an integral sump
- Modular in design
- Specifically designed for commercial kitchen application
- Energy efficient: - uses no more than 50W
- Greatly reduces grease build-up within the duct run

## Technical Specification

	ESP 1500E	ESP 3000E	ESP 4500E	ESP 6000E
Electrical Supply	220/240V 50Hz	220/240V 50Hz	220/240V 50Hz	220/240V 50Hz
Power Consumption	20 Watts	30 Watts	40 Watts	50 Watts
Max Air Volume	up to 0.7m <sup>3</sup> /sec	up to 1.4m <sup>3</sup> /sec	up to 2.1m <sup>3</sup> /sec	up to 2.8m <sup>3</sup> /sec
Dimensions W/H/D	450mm/630mm/ 640mm	900mm/630mm/ 640mm	1350mm/630mm/ 640mm	1800mm/630mm/ 640mm
Weight	55Kg	85Kg	118Kg	153Kg



1. Cooking particulates and odours
2. Canopy Grease Filter
3. ESP - Particulate Control Unit
4. Airflow

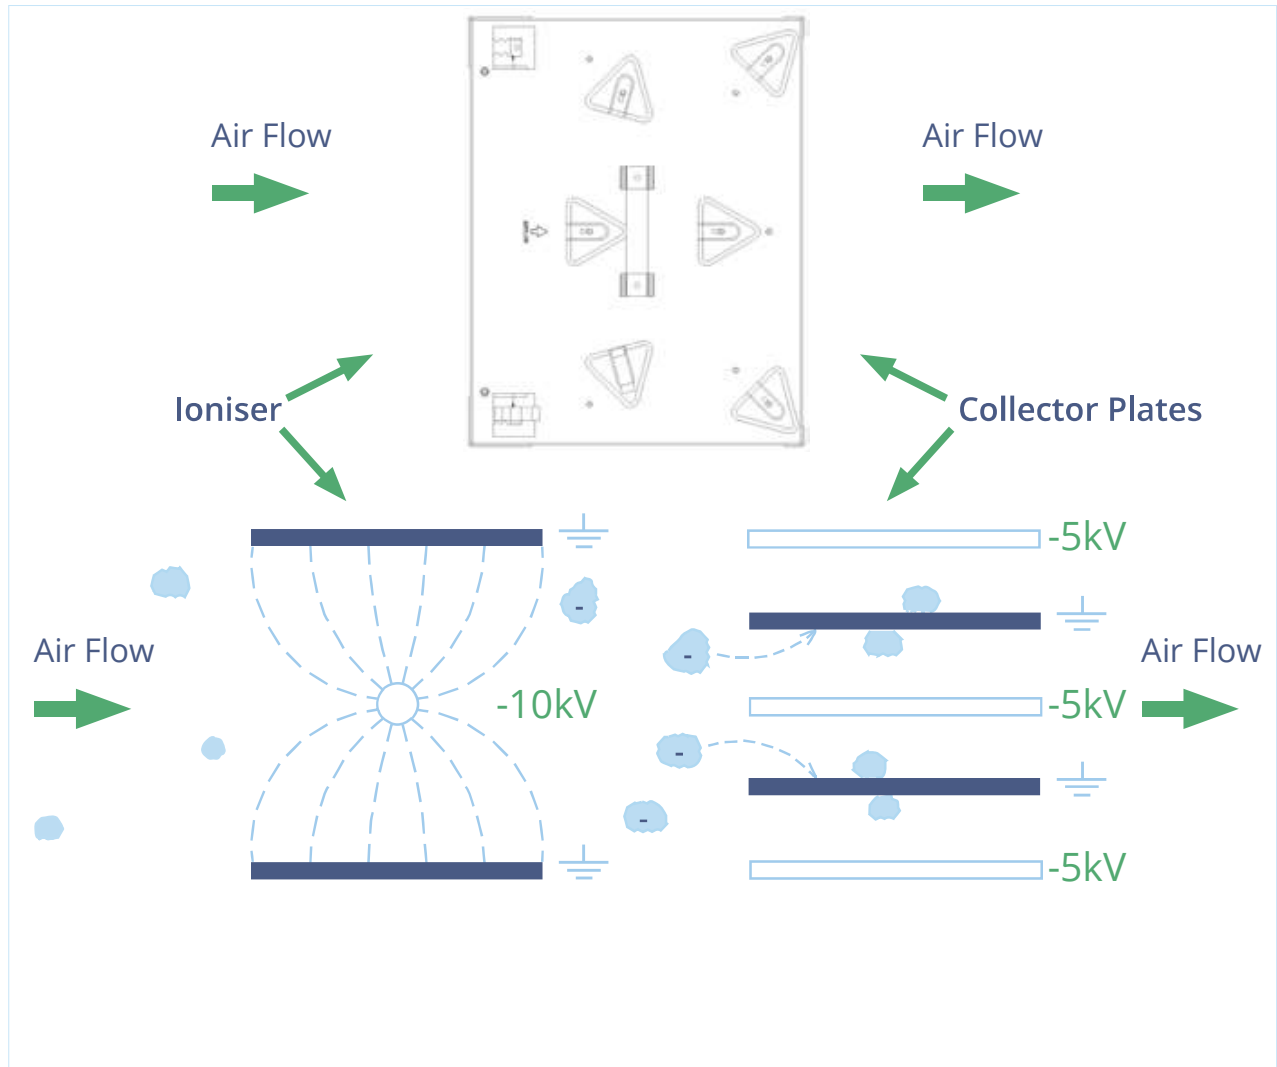

The above diagram shows, in a basic visual, how an electrostatic precipitator works. As air passes into the combined ioniser / collector cell, the particulates in the air stream are polarised to a negative potential. As they continue through the ioniser and between the collector cell plates, the polarised particulates are repelled away from the negatively charged plates and attracted to the earthed plates where they stick and so are filtered out of the air flow.

An Autowash option can be provided for our entire ESP range.

The autowash nozzle attachment sits inside our standard ESP units. Once connected to the control / wash station the collection cells can be automatically cleaned at regular frequency. The system is usually factory fitted but can also be retro fitted in existing installations, dependant on the generation of units installed.

Daily cleaning keeps the filters working at their optimum efficiency and will greatly reduce the number of service visits required through the year.

**For more information please contact our sales team.**





3 ESP Units Stacked in modular formation



4 ESP Units Stacked in modular formation with a double pass



# AIRCLEAN

YOUR AIR FILTER MANUFACTURER

P.O. BOX 147,  
MAIDSTONE, ME14 2LA.

TEL:01622 832777  
FAX:01622 832507

sales@airclean.co.uk www.airclean.co.uk

## Pleated Panel Filters

### Applications

The Pleated Panel is a medium efficiency disposable filter, suitable for ventilation and air conditioning systems which require a higher efficiency and greater dust holding capacity than can be achieved with glass or synthetic panels.

The Pleated Panel can be used where glass panels are undesirable, such as in the food industry and hospitals.

### Construction

Pleated filters consist of a dry non-woven fabric media, pleated to give an extended surface area, producing a low initial resistance for the same air volume.

The pleated assembly is contained within either a rigid all cardboard casing, or a cardboard frame with perforated cap-punch retaining grids.



### Technical

<b>Filter Classification:</b>	Grade G4 to EN779.
<b>Pleated Material Flamability :</b>	Fire Resistant to :- Underwriters Laboratories Standard 900 class 2
<b>Maximum operating temperature:</b>	100°C (212°F)
<b>Dust Holding Capacity:</b>	840 g/m <sup>2</sup> (2") and 1260 g/m <sup>2</sup> (4") to EN779

### Resistance to Airflow

m/s fpm	Face Velocity									
	1.25 250		1.50 300		2.0 400		2.5 500		3.0 600	
Pressure Drop	Pa	"wg	Pa	"wg	Pa	"wg	Pa	"wg	Pa	"wg
2" Panel	22	0.09	27	0.11	50	0.20	70	0.28	-	-
1" Panel	25	0.10	30	0.12	55	0.22	75	0.30	87	0.35

Recommended discard resistance is 125 Pa (0.5"wg) in excess of clean resistances shown above for a 2" panel and 150 Pa (0.6"wg) for 4" panel.

# AIRCLEAN

YOUR AIR FILTER MANUFACTURER

P.O. BOX 147,  
MAIDSTONE, ME14 2LA.

TEL:01622 832777  
FAX:01622 832507

sales@airclean.co.uk www.airclean.co.uk

## Capacity Chart (2" Pleated Panels)

Data based on Face Velocity of 2.5 m/s (500 fpm)

SIZE	SIZE	Flow Rate
OT Inches	Actual mm	m <sup>3</sup> /s
10 x 10	242 x 242	0.14
12 x 12	289 x 289	0.20
15 x 15	369 x 369	0.33
18 x 18	445 x 445	0.48
20 x 10	495 x 242	0.29
20 x 16	495 x 394	0.48
20 x 20	495 x 495	0.60
25 x 16	620 x 394	0.60
25 x 20	620 x 495	0.76
24 x 12	594 x 289	0.43
24 x 20	594 x 495	0.73
24 x 24	594 x 594	0.88

Actual Face Size = Nominal Size less 6mm (0.25")

## Capacity Chart (4" Pleated Panels)

Data based on Face Velocity of 3.0 m/s (600 fpm)

SIZE	SIZE	Flow Rate
OT Inches	Actual mm	m <sup>3</sup> /s
10 x 10	242 x 242	0.18
12 x 12	289 x 289	0.25
15 x 15	369 x 369	0.41
18 x 18	445 x 445	0.60
20 x 10	495 x 242	0.36
20 x 16	495 x 394	0.58
20 x 20	495 x 495	0.73
25 x 16	620 x 394	0.72
25 x 20	620 x 495	0.91
24 x 12	594 x 289	0.51
24 x 20	594 x 495	0.87
24 x 24	594 x 594	1.05

### Holding Frames and Casings

Holding frames and casings for Disposable Pleated Panels are available singularly or in multiples, and can be manufactured to suit non-standard sizes and special applications.

See leaflets (code AC8) for full technical information.

Code AC1/3b Ref 06/11

# AIRCLEAN

YOUR AIR FILTER MANUFACTURER

P.O. BOX 147,  
MAIDSTONE, ME14 2LA.

TEL:01622 832777  
FAX:01622 832507

sales@airclean.co.uk www.airclean.co.uk

## Metal Cased Discarbs

The metal cased 'Discarb' cells have the highest carbon loading in our range, and have standard or heavy-duty carbon panels permanently sealed into a galvanised sheet steel casing. This construction gives a very strong unit capable of handling large air volumes or where conditions dictate, increased contact time. The advantage of this unit is that with panels sealed in, there is no possibility of air leakage. Also, these units can be manufactured to almost any reasonable size, the limiting factors being the overall weight for handling purposes and the size of individual panels. When the unit has finished its useful life it is discarded and replaced with a complete new cell.



Standard Duty Cells							
Nominal Size	Actual Size mm	Number of	Carb.	Discarb	Airflow		Pressure
W x H x L	W x H x L	Panels	Weight	Weight	m <sup>3</sup> /s	cfm	Pa
12" x 12" x 12"	292 x 292 x 292	6	5 kg	9 kg	0.10	212	75
12" x 12" x 18"	292 x 292 x 445	6	8 kg	14 kg	0.15	318	95
12" x 12" x 24"	292 x 292 x 597	6	10 kg	18 kg	0.22	466	140
18" x 18" x 12"	445 x 445 x 292	8	10 kg	17 kg	0.21	445	55
18" x 18" x 18"	445 x 445 x 445	8	15 kg	25 kg	0.31	657	70
18" x 18" x 24"	445 x 445 x 597	8	21 kg	33 kg	0.41	868	105
24" x 24" x 12"	597 x 597 x 292	12	20 kg	31 kg	0.41	868	70
24" x 24" x 18"	597 x 597 x 445	12	31 kg	45 kg	0.61	1292	90
24" x 24" x 24"	597 x 597 x 597	12	42 kg	59 kg	0.81	1716	130
12" x 24" x 24"	298 x 597 x 597	6	21 kg	35 kg	0.40	847	130

Extra Duty Cells							
Nominal Size	Actual Size	No. of	Carb.	Discarb	Airflow		Pressure
W x H x L	W x H x L	Panels	weight	weight	m <sup>3</sup> /s	cfm	Pa
12" x 12" x 12"	292 x 292 x 292	6	6 kg	10 kg	0.13	275	125
12" x 12" x 18"	292 x 292 x 445	6	9 kg	15 kg	0.20	424	175
12" x 12" x 24"	292 x 292 x 597	6	12 kg	20 kg	0.27	572	250
18" x 18" x 12"	445 x 445 x 292	8	12 kg	19 kg	0.30	635	95
18" x 18" x 18"	445 x 445 x 445	8	19 kg	28 kg	0.41	868	125
18" x 18" x 24"	445 x 445 x 597	8	25 kg	37 kg	0.54	1144	185
24" x 24" x 12"	597 x 597 x 292	12	25 kg	35 kg	0.54	1144	125
24" x 24" x 18"	597 x 597 x 445	12	38 kg	52 kg	0.80	1694	150
24" x 24" x 24"	597 x 597 x 597	12	51 kg	68 kg	1.06	2245	225
12" x 24" x 24"	298 x 597 x 597	6	26 kg	46 kg	0.53	1122	225

The company reserves the right to change the specifications without notice. E & OE.

Code AC6/2a Ref 02/09

# AIRCLEAN

YOUR AIR FILTER MANUFACTURER

P.O. BOX 147,  
MAIDSTONE, ME14 2LA.

TEL:01622 832777  
FAX:01622 832507

[sales@airclean.co.uk](mailto:sales@airclean.co.uk) [www.airclean.co.uk](http://www.airclean.co.uk)

## Technical

The capacities shown are based on a dwell time of 0.1 seconds .

For contact times of 0.3 seconds, reduce rated airflow to 1/3rd, pressure drop will also reduce to 1/3rd.

Max Temperature 40 Deg C

Max Humidity 80% RH

## Non-standard sizes

Other sizes are available to suit individual requirements. Our Technical Department will be pleased to






**GB**

Arbitrary installation position and flexible assembly by five possible discharge directions.



**GB T120**

Designed for moving dirty, humid and hot air up to max. 120° C. Motor located outside the air flow.

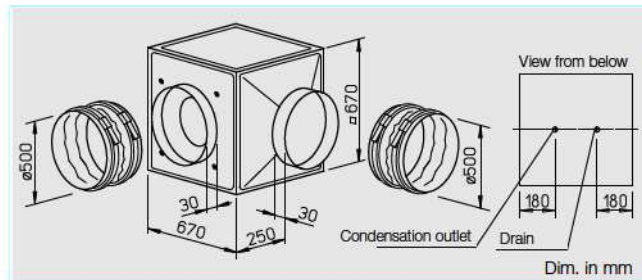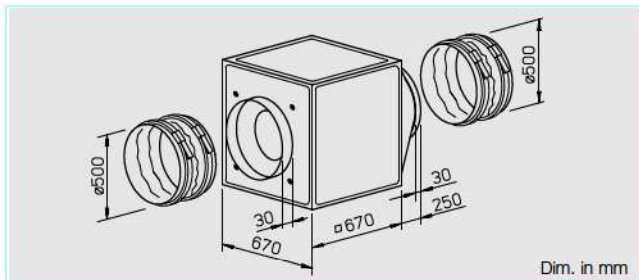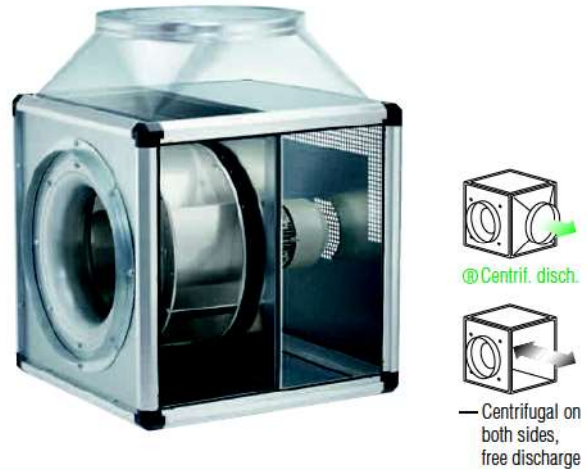

**Special features of types GB T120**

- Designed for moving dirty, humid and hot air volumes up to max. 120° C.
- Motor located outside of air flow.
- Temperature insulated partition panel between motor and impeller, lined with 20 mm thick, flame-retardant mineral wool.
- Easily accessible motor and impeller unit, removable without disassembling the system components.
- Inspection cover with handle, simply remove for cleaning and maintenance.
- Condensate collector with condensate spigot included in delivery. Drill hole for rain drainage (accessories) for outdoor installation is prepared.

**Assembly GB T120**

Installation must be carried out with condensation discharge showing downward. Flexible assembly by three possible centrifugal discharge directions via the discharge adapter. Outdoor installation is possible using outdoor cover hood and external weather louvers (accessories).

**Feature**

**Assembly of types GB**  
 Arbitrary installation position and flexible assembly by five possible discharge directions via the discharge adapter. For wall mounting the wall bracket (accessories) have to be used. Outdoor installation is possible using outdoor cover

hood and external weather louvers (accessories).

**Specification of both types**

**Casing**  
 Self-supporting frame construction from aluminium hollow profiles. Double-walled side panels from galvanised sheet steel, lined with 20 mm thick temperature insulating and flame-retardant mineral wool. Intake cone for ideal inflow as well as spigot and flexible sleeve (for the respective max. permissible air flow temperature) for duct connection. With discharge adapter (from square to circular) on the pressure side for low-loss discharge and flexible sleeve to reduce vibration transmission. Simple positioning by standard crane hooks.

**Impeller**

Smooth running backward curved aluminium centrifugal impeller highly efficient and direct driven. Energy efficient with a low noise development. Dynamically balanced together with the motor to DIN ISO 1940 Pt.1 – class 6.3.

**Motor**

Maintenance-free external rotor motor or IEC-standard motor protected to IP 54. With ball bearings and interference-free as standard.

**Electrical connection**


Standard terminal box (IP 54) fitted on the motor; with GB T120 fitted on the motor support plate.

Type	Ref. no.	Air flow volume (FID)	R.P.M.	Sound press. case breakout	Motor power (nominal)	Current full load	Current speed controlled	Wiring diagram	Maximum air flow temperature Full load controlled	Weight (net) kg	5 step transformer controller				Full motor protection unit using the thermal contacts		
		V m³/h	min⁻¹	dB(A) in 4 m	kW	A	A	No.	+°C	+°C	kg	Type	Ref. no.	Type	Ref. no.	Type	Ref. no.
<b>1 Phase motor, 230 V / 1 ph. / 50 Hz, capacitor motor, protection to IP 54</b>																	
GBW 500/4	5517	8321	1401	47	1.50	6.70	9.60	865	65	55	61	MWS 10	1946	TSW 10	1498	MW <sup>1)</sup>	1579
<b>2 speed motor, 3 Phase motor, 400 V / 3 ph. / 50 Hz, Y/Δ wiring, protection to IP 54</b>																	
GBD 500/4/4	5518	8000/9200	1075/1340	45	0.97/1.45	1.60/2.80	2.90	867	50	50	57	RDS 7	1578	TSD 5,5	1503	MD	5849
<b>1 Phase motor, 230 V / 1 ph. / 50 Hz, capacitor motor, protection to IP 54</b>																	
GBW 500/4 T120	5776	8345	1340	45	1.40	6.1	7.0	301	120	100	75	MWS 10	1946	—	—	—	—
<b>2 speed motor, 3 Phase motor, 400 V / 3 ph. / 50 Hz, Y/Δ wiring, protection to IP 54</b>																	
GBD 500/4/4 T120	5777	7320/8350	1120/1370	45	0.95/1.30	1.60/2.50	2.5	947	120	110	75	RDS 4	1316	TSD 3,0	1502	MD	5849


<sup>1)</sup> incl. operation switch




### GBW 500/4

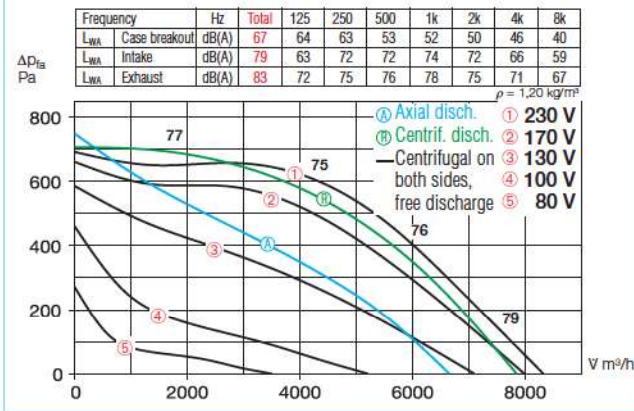


### GBD 500/4/4

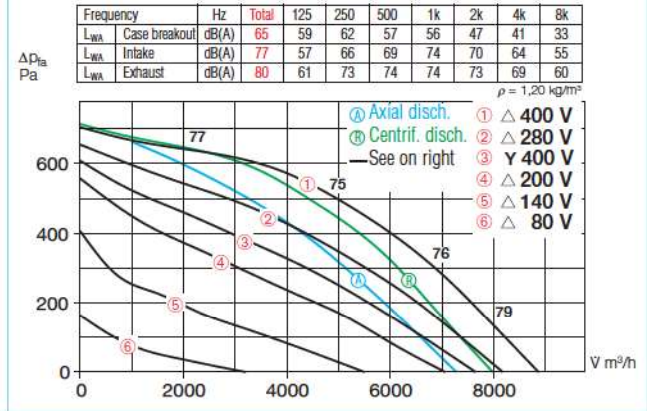

### GBW 500/4 T120

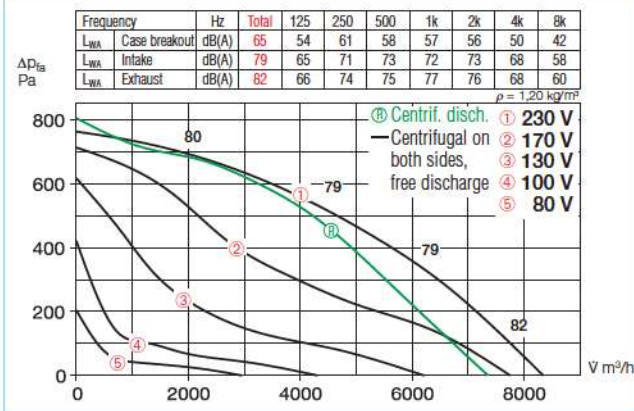

### GBD 500/4/4 T120

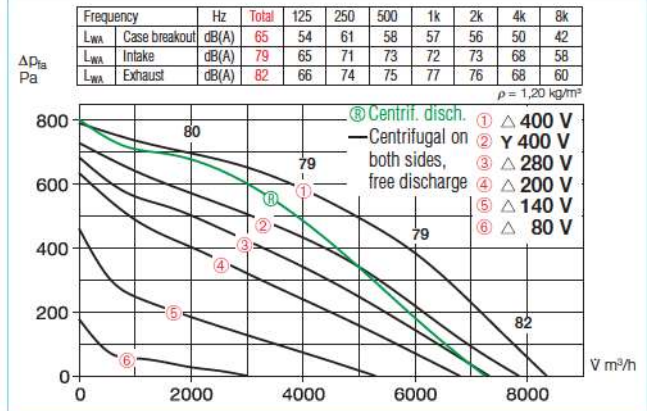

#### Motor protection

Motors have thermal contacts wired to the terminal block and must be connected to a motor protection unit.

#### Speed control

All types are speed controllable by voltage reduction using a transformer controller. The 3-phase models can also be 2 speed controlled by star/delta switch (accessories DS 2 or full motor protection unit M 4). The duties at different speeds are given in the performance curve.

#### Sound levels

Total sound power levels and the spectrum figures in dB(A) are given for:

- Sound level case breakout
- Sound level intake
- Sound level exhaust

In the table below as well as underneath the performance curve you can find additionally the sound pressure levels at 4 m (free field conditions).

#### Accessories of both types

**Anti vibration mounts** for installation indoors. Set of 4.

**SDD-U** Ref. no. 5627

**Wall bracket** for wall mounting.

**GB-WK 500** Ref. no. 5626

**External weather louvers** to cover exhaust opening.

**GB-WSG 500** Ref. no. 5639

**Outdoor cover hood** for outdoor installation.

**GB-WSD 500** Ref. no. 5748

**On/Off and 2-speed switch** for 3-phase Y/ $\Delta$  motors.

**Type DS 2<sup>2)</sup>** Ref. no. 1351

<sup>2)</sup> full motor protection unit recommended: MD Ref. No. 5849

#### Specific accessories

##### for types GB

**Condensate collector** with condensate spigot for pipe connection.

**GB-KW 500** Ref. no. 5644

(Condensate collector with condensate spigot included in delivery with GB T120).

##### for types GB T120

**Rain drainage** for outdoor installation (drill holes for rain drainage is already prepared).


**GB-RA** Ref. no. 9418

Information	Page
Information for planning	10 on
General techn. information, speed control	15 on
Accessory-Details	Page
Speed controller and full motor protection unit	525 on



## MK

Dimensions in mm

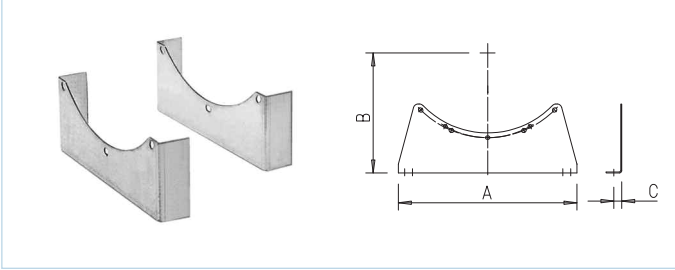

### Mounting feet

To fix Axial/VAR cased fans on ceiling, wall or floor. Made from galvanised sheet steel or hot dipped galvanised steel. Fixing holes fit casing flanges. Set includes a pair of feet, nuts and bolts.


### Note:

If motors of high weight are installed, an extension duct (VR...) is recommended to move the centre of gravity within the mounting feet. Mount feet on the outer flange.

Type	Ref. No.	A	B	C	Weight in kg
MK 200-225	1446	310	208/220	20	1.5
MK 250-280	1447	340	227/245	20	1.7
MK 315-355	1448	380	281/300	25	2.2
MK 400-450	1449	360	311/335	25	2.6
MK 500-560	1450	570	383/415	25	5.3
MK 630	1333	600	465	30	8.5
MK 710	1372	670	515	35	10.5
MK 800	1373	680	565	35	15.5
MK 900	1374	760	625	35	18.0
MK 1000	1375	840	690	35	19.5

## SDD-U

Dimensions in mm

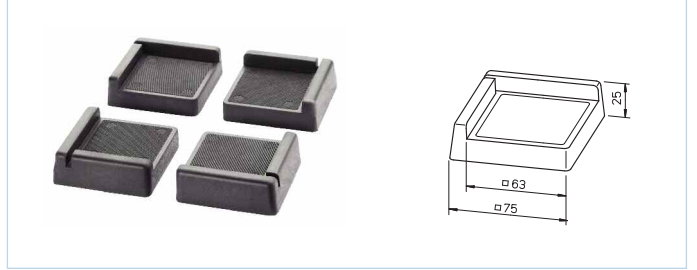

### Anti vibration pads


The rubber mounting pads SDD-U are suitable as a base for installation of fans on flat, horizontal surfaces. They reduce the direct noise and vibration transmission to the building structure.

One set consists of 4 elements, which are positioned individually under the corners of the fan unit. Maximum compression: 40 kg/pad = total 160 kg.

SDD-U Ref. No. 5627

## SDD

Dimensions in mm

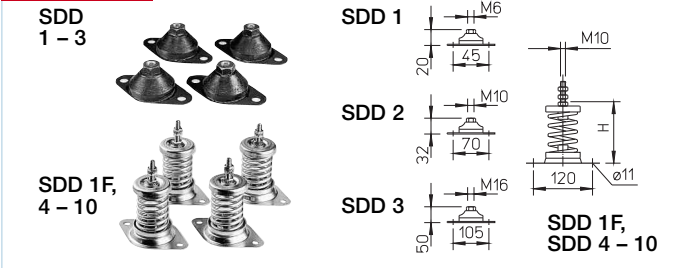

### Anti vibration mounts for compression

To reduce noise and vibration transmission of fans installed on horizontal surfaces. Simple installation in combination with feet MK (accessory). Select size according to fan weight (see table).


Rubber elements are suitable for small to middle weights and ambients up to +60 °C. Spring elements are suitable for higher temperatures above +60 °C (e.g. smoke extraction).

Type	Ref. No.	Maximum fan weight in kg	H Height in mm	Spring element	Contents 1 set = 4 pieces
SDD 1	1452	80	*		
SDD 1F	1942	70	112 – 82	●	
SDD 2	1453	180	*		
SDD 3	1367	750	*		
SDD 4	1944	130	112 – 86	●	
SDD 5	1924	210	112 – 86	●	
SDD 6	1926	400	112 – 80	●	
SDD 7	1928	580	112 – 82	●	
SDD 8	1930	900	112 – 82	●	
SDD 9	1934	1300	112 – 85	●	
SDD 10	1951	1800	112 – 88	●	

\* shown in dimensional drawing

## SDZ

Dimensions in mm

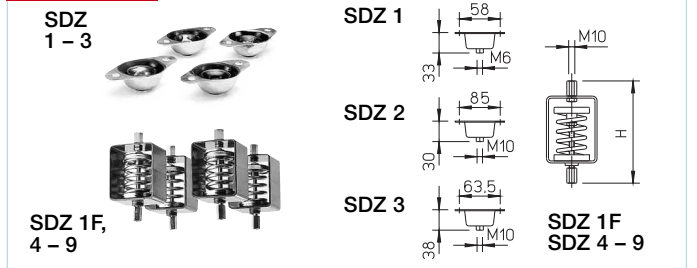


### Anti vibration mounts for suspension

To reduce noise and vibration transmission of fans installed hanging from ceilings. Specification as model SDD.


**Important note for installation!** Make sure that fan system is well balanced (centre of gravity of heavy motor may cause uneven loading of mounts).

Type	Ref. No.	Maximum fan weight in kg	H Height in mm	Spring element	Contents 1 set = 4 pieces
SDZ 1	1454	60	*		
SDZ 1F	1943	70	190 – 220	●	
SDZ 2	1455	160	*		
SDZ 3	1366	300	*		
SDZ 4	1945	130	190 – 216	●	
SDZ 5	1925	210	190 – 216	●	
SDZ 6	1927	400	190 – 221	●	
SDZ 7	1929	580	190 – 220	●	
SDZ 8	1931	900	190 – 220	●	
SDZ 9	1935	1300	190 – 217	●	

\* shown in dimensional drawing

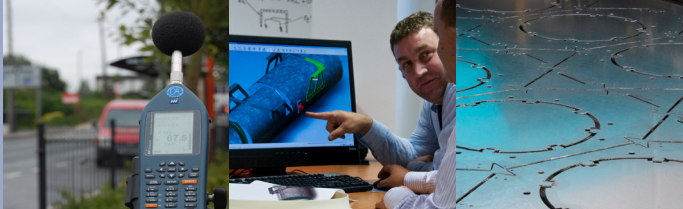

## CP03-C-0500

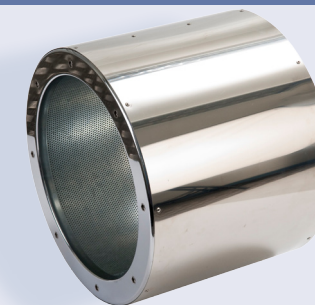

### 500 DIA FAN MOUNTED SILENCER


Available in two standard lengths C Series Silencers have excellent attenuation properties, achieved with sound absorbing infill retained in the attenuator casing by a perforated liner. The central pod (code P) is an option to increase the insertion loss, however it will add resistance.

- Fits directly onto 500mm diameter fans
- Standard lengths 500mm (1D) & 1000mm (2D)
- Use up to 70°C (standard construction)
- Systems up to 1000 Pascals
- Special lengths on request

### INSERTION LOSS (dB) - CENTRE BAND FREQUENCY

PRODUCT CODE	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	8000 Hz
CP03-C*-0500-1D	2	3	6	14	14	12	10	5
CP03-C*-0500-2D	3	7	8	19	20	17	14	11
CP03-C*P-0500-1D	2	7	9	17	24	24	20	16
CP03-C*P-0500-2D	4	10	16	26	29	29	29	20

Insertion loss data is derived from continual testing to BS4718 and other standards in independent UKAS certified laboratories, which includes where appropriate, re-generated or self noise testing in both forward and reverse flow conditions. If you request system analysis from our technicians all predictions will be assessed using the relevant certified insertion loss data together with relevant dynamic corrections.

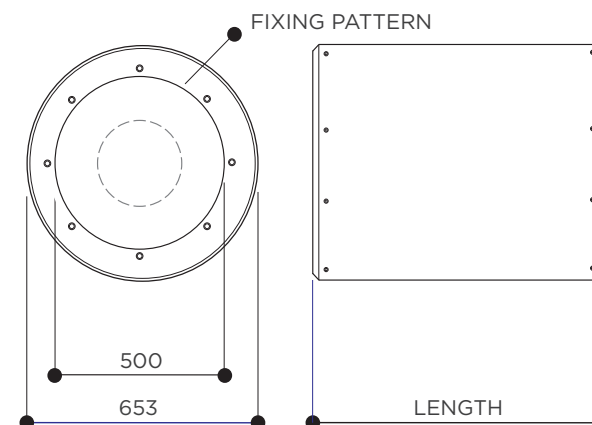

### DIMENSIONAL DATA

CODE	LENGTH	FIXING PATTERN	MASS
CP03-CA-0500-1D	500mm	12 x M10-560 PCD	18 Kg
CP03-CA-0500-2D	1000mm	12 x M10-560 PCD	32 Kg
CP03-CAP-0500-1D	500mm	12 x M10-560 PCD	22 Kg
CP03-CAP-0500-2D	1000mm	12 x M10-560 PCD	37 Kg
CP03-CB-0500-1D	500mm	12 x M8 - 541 PCD	18 Kg
CP03-CB-0500-2D	1000mm	12 x M8 - 541 PCD	32 Kg
CP03-CBP-0500-1D	500mm	12 x M8 - 541 PCD	22 Kg
CP03-CBP-0500-2D	1000mm	12 x M8 - 541 PCD	37 Kg

### MATERIAL & FINISH

All casings are manufactured from mill finish hot dip galvanised mild steel conforming to EN10327 (BS2989) including the flow formed one piece end fittings. To prevent erosion of absorbing materials the C Series Silencers are fitted with a perforated liner manufactured from galvanised mild steel conforming to EN10327 (BS2989). The C Series Silencers utilise acoustic grade mineral fibre absorbing infill and are manufactured to the HVCA specification DW144 class B and M&E 100 for sheet steel thickness and stiffening.

**Pressure** Up to 1000 Pascals positive and negative.  
**Temperature** -12° to +70° C.  
**Location** Internally & externally mountable.

### MELINEX LINING (OPTIONAL)

Where moist conditions exist (e.g. process systems) or for critically clean applications (e.g. hospitals) the sound absorbing material may be required to be fully sealed by Melinex lining to prevent fibre migration. This will however, effect the acoustic performance of the silencer. Please contact us to discuss your requirements.

### ALTERNATE SPECIFICATION

The above specification refers to our standard stock range. We can also supply custom made C Series Silencers with alternative dimensions, temperature ratings, construction materials and product finishes. Please contact us for further information and advice.

### PRODUCT CODE GUIDE

Example: **CP03-CAP-0500-2D**

**CP03** Product Group Code  
**CA** Drilling Pattern CA for A or CB for B  
**0500** Internal Diameter  
**2D** Length code 1D = 500, 2D = 1000

### RESISTANCE TO AIRFLOW (Pa)

AIR VOLUME M <sup>3</sup> /s	0.5	0.6	0.8	1.0	1.3
CP03-C*-0500-1D	-	-	-	-	-
CP03-C*-0500-2D	-	-	-	-	-
CP03-C*P-0500-1D	10	24	40	80	120
CP03-C*P-0500-2D	21	36	61	124	188

- represents a negligible resistance to airflow that can be assumed to be equivalent to a duct section of the same length.

### INSTALLATION

For recommendations for the support of the silencer the principles of Part Six (pages 43-46) of the HVCA DW144 standard should be followed. It is important that the recommendations in the table are adhered to when locating the silencer in relation to other duct-mounted equipment. If the silencers are to be used in conjunction with equipment not listed please enquire for advice.

ITEM	LOCATION
Centrifugal Fans	Direct couple only at the same size; use an inlet cone if open after silencer. PODDED - position one duct diameter from fan inlet / outlet.
Axial Fans	Direct couple only at the same size. Use an inlet cone if open after silencer. PODDED - match hub size within 30% of half nominal diameter.
Mixed-Flow Fans	Direct couple only at the same size. Use an inlet cone if open after silencer.
Ductwork Bends	Direct couple only at the same size. PODDED - position two duct diameters from bend.
Ductwork Reducers	Direct couple only with reducers of maximum 15° cheek slope.
Finned Coils & Filters	Leave 200mm plenum between silencer and coil or filter, and suitable reducer as specified in HVCA DW/144 1998.

### MAINTENANCE

Silencers are of a passive nature and as such require no routine maintenance or lubrication.

### INSPECTION

For inspection access the recommendations set out in Heating & Ventilating Contractors Association specification DW144 1998, appendix M – Guidance Notes for Inspection, Servicing and Cleaning Access Openings, should be followed. We would suggest Level 2 one 300mm x 200mm-inspection panel down-stream or Level 3 one 300mm x 200mm inspection door each side of the silencer. Refer to table 25 of DW144 or Section 2 of HVCA specification TR17 for further recommendations.

It is our recommendation that the silencers are inspected periodically to ensure that the airways are free from obstructions and no dust or foreign matter has collected and blocked the holes in the perforated liner elements.

### CLEANING

Should airways require routine cleaning we recommend low-pressure air blasting, vacuuming or wiping the exposed surfaces with a damp cloth. It is not unusual for “White Zinc Oxide” to develop on galvanised silencers when the zinc in the galvanising reacts electrolytically with moisture.

# R02 Rectangular Silencers

## Material & Finish

All components are manufactured from mill finish hot dip galvanised mild steel conforming to EN10327 (BS2989). To prevent erosion of absorbing materials, the R Series Silencers are fitted with perforated splitters manufactured from galvanised mild steel conforming to EN10327 (BS2989) R Series Silencers utilise acoustic grade mineral fibre absorbing infill and are manufactured to the HVCA specification DW144 class B and M&E 100 for sheet steel thickness and stiffening.

**Pressure** Up to 1500 Pascals positive and negative.

**Temperature** -12° to +100°C.

**Location** Internally & externally mountable.

## Melinex Lining (Optional)

Where moist conditions exist (e.g. process systems) or for critically clean applications (e.g. hospitals) the sound absorbing material may be required to be fully sealed by Melinex lining to prevent fibre migration. This will however, effect the acoustic performance of the silencer. Please contact us to discuss your requirements.

## Alternative Specification

The above specification refers to our standard, stock range. We can also supply custom materials such as 304 and 316 grade stainless steels, cold reduced (CR4) mild steel and aluminium.

## Dimensional Data

Units smaller than the minimum and larger than the maximum with the same aero-acoustic performances are available, but may have different manufacturing methods and are therefore coded accordingly.

Connection Options	
<b>MEX Flanges</b>	20, 30 & 40mm
<b>Ductmate Flanges</b>	25 & 35mm
<b>Circular Spigot</b>	"SPIRAL FIT" circular spigots, can be offset.
<b>Rectangular Spigot</b>	Rectangular spigots, can be offset
<b>Raw</b>	Plan end for slip jointing etc.

## Installation

For recommendations for the support of the fan the principles of Part Six (pages 43-46) of the HVCA DW144 standard should be followed. Always use the correct size bolts as specified in the dimensional data table above. The arcuate holes are sized to allow the metric thread sizes to be utilised, for example, for an M10 fixing, the slot is made 19mm long by 13mm wide. Please contact us to confirm the suitability of any fan manufacturers product.

Equipment	Location
<b>Centrifugal Fans</b>	Position at least one duct width from inlet or outlet.
<b>Axial Fans</b>	Position at least one duct width from inlet or outlet.
<b>Mixed Flow Fans</b>	Position at least one duct width from inlet or outlet.
<b>Ductwork Bends</b>	Position at least three duct widths from inlet or outlet. One duct width will increase resistance by 90%, two by 20%. Ensure splitters are in parallel plane to bend.
<b>Ductwork Reducers</b>	Direct couple only with reducers of maximum 15° cheek slope.
<b>Finned Coils &amp; Filters</b>	Leave 500mm plenum between silencer and coil or filter, and suitable reducer as specified in HVCA DW/144 1998.

## Cleaning & Maintenance

Should the product require routine cleaning we recommend low-pressure air blasting, vacuuming or wiping the exposed surfaces with a damp cloth. It is not unusual for "White Zinc Oxide" to develop on galvanised silencers when the zinc in the galvanising reacts electrolytically with moisture. Silencers are of a passive nature and as such require no routine maintenance or lubrication.