Rev.	Description	Date
P02	UPDATED TO ARCHITECTS LATEST LAYOUT.	JUL 21
P03	ISSUED FOR TENDER.	JUL 21
P04	UPDATED TO ARCHITECTS LATEST LAYOUT.	OCT 21
P05	UPDATED TO ARCHITECTS LATEST LAYOUT.	DEC 21
P06	UPDATED TO CONTRACT ISSUE.	JUN 22

DALI LCM Detail (NTS):

TYPICAL LIGHTING CONTROL DETAILS (NTS)

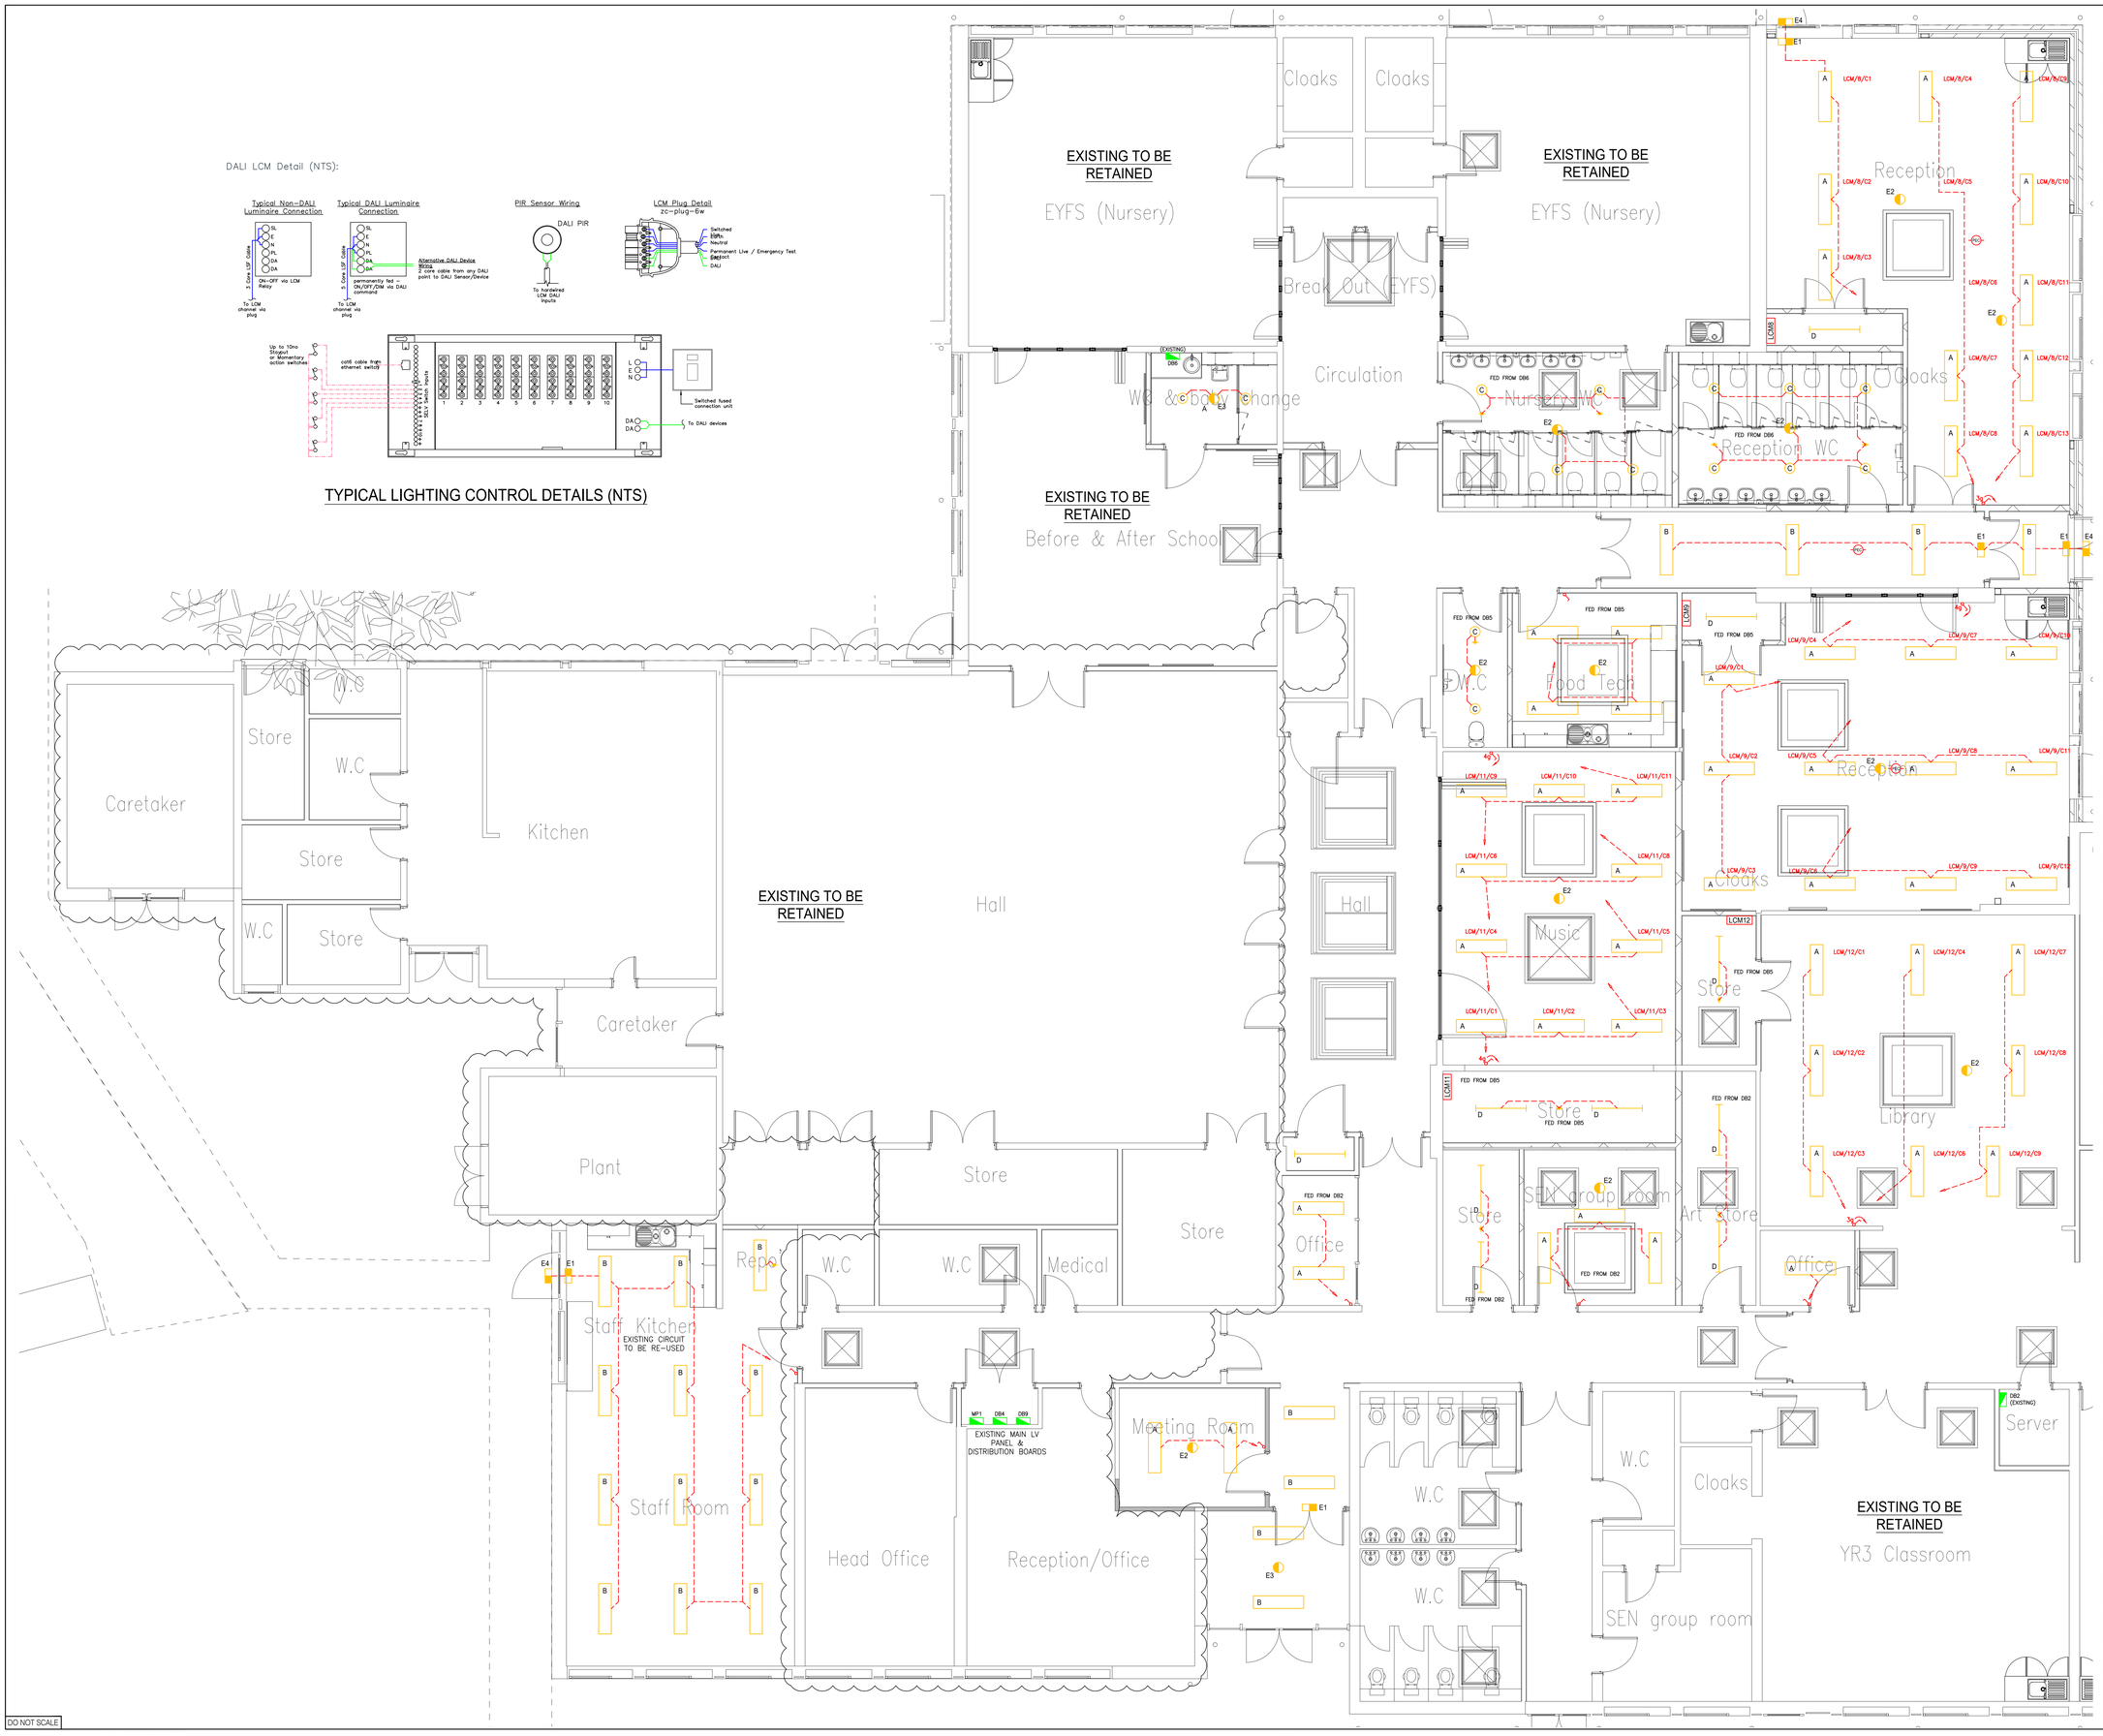

LEGEND

- 1200x300mm RECESSED LED LUMINAIRE.
- CEILING RECESSED LED DOWNLIGHT.
- SURFACE MOUNTED 1200mm LONG LED BATTEN.
- RECESSED LED EMERGENCY LIGHT 3 HOUR NON MAINTAINED.
- SURFACE MOUNTED CIRCULAR LED BULKHEAD RATED TO IP65.
- SURFACE MOUNTED LED WALL LIGHT RATED TO IP65.
- CEILING MOUNTED NON MAINTAINED LED EXIT SIGN WITH RUNNING MAN LEGEND.
- LCM* LIGHTING CONTROL MODULE

LCM REFERENCE

* DENOTES LCM REFERENCE.
** DENOTES CHANNEL NUMBER.

- 1 WAY SWITCH. g DENOTES No. OF GANGS
- 2 WAY SWITCH. g DENOTES No. OF GANGS
- 3 POINT RETRACTIVE SWITCH. g DENOTES No. OF GANGS.
- COMBINED PIR & PHOTOCELL FOR DAYLIGHT DIMMING & LUX LEVEL CONTROL.
- PHOTOCELL.
- PIR DETECTOR.
- WP DENOTES WEATHERPROOF DEVICE.

NOTES

1. FOR LUMINAIRE DETAILS SEE LUMINAIRE SCHEDULE.
2. FOR CIRCUIT CABLE DETAILS REFER TO DISTRIBUTION BOARD SCHEDULES.
3. LIGHTING CONTROL MODULES TO BE COORDINATED & MOUNTED IN A POSITION OPTIMAL FOR CABLE DISTRIBUTION.
4. LIGHTING CONTROL MODULES TO BE NETWORKED FOR COMPLETE CONTROL.

Client: Solihull Metropolitan Borough Council

Project: CHESWICK GREEN PRIMARY SCHOOL

Architect: BUILDING DESIGN GROUP

Drawing Title: LIGHTING & EMERGENCY LIGHTING SHEET 1

Scale	1:50 @ A0	Drawn By.	G.C.
Date	JUN 21	Checked.	M.A.C.
Purpose of Issue	CONTRACT ISSUE		
Drawing No.	17011-FAA-ZZ-GF-DR-E-1003-A5	Rev.	P06

17011-FAA-ZZ-GF-DR-E-1004

Faarup Associates
Building Services Consultants
The Old Stables, Friars Alley, Lichfield, staffs WS13 6PW
Telephone Lichfield (01543) 411420
Email: admin@faarup.co.uk

DO NOT SCALE