
Soft landscaping & Planting Specification

Site – Templars Farm, Holders Green Road, Lindsell

Client – J.G.A Services Ltd, Nevilles Farm, Mill End Green, Great Euston, CM6 2DW

Contact – Smart Planning

Date – 07-11-22

To be read in conjunction with – Landscape proposals drawing number SP/TMF3/01

Blue House Cottage
Maldon Rd Mob - 07912 617939
Bradwell on Sea
Essex CM0 7HR
judith.moore@moorepartners.co.uk
www.moorepartners.plus.com



Moore Partners Ltd

Contents

Site Preparation

1. De-compaction and grading
2. Top soiling
3. Setting Out
4. Cultivation

Planting

5. Trees
6. Native shrubs and hedge
7. Shrub planting
8. Mulching

Grass Areas

9. Turf

Maintenance

- 10 Trees
- 11 Shrubs
- 12 Hedging
- 13 Turf

Site Preparation

1 De-compaction and grading of sub soil

1.1 Prior to the spreading of any topsoil, the sub soil is to be graded to smooth flowing contours.

1.2 Areas of compaction are to be treated as follows:

Compaction zones within the root protection area of existing trees are to be carried out with a compressed air lance, should it be required.

For areas of open ground 5m or wider, a tractor mounted sub-soiler may be used, where access permits. A sub soiling tine to a depth of 450mm and at 600mm centres should be used.

Where the beds are less than 5m, the area is to be de-compacted by hand breaking up the sub soil to a depth of 450mm with a fork.

2 Top soiling

2.1 Topsoil to conform to *BS3882, 1994*. Topsoil is to be free from rocks over 50mm in diameter, pernicious weeds, wire, roots and bricks.

On planted areas topsoil to be a minimum of 300 mm deep. Tree pits to be minimum 750 x 750 x 750mm. All levels to be flush with any adjacent kerbs or hard surfaces after settlement, and not less than 150mm below the damp proof course of adjacent buildings.

Top soil should not be handled after heavy rainfall or when it is wetter than the plastic limit defined by BS3882, annex N2

Over areas that have received de-compaction treatment topsoil is to be spread with a low ground pressure tracked machine.

Top soiling would not be required within the crown spreads of the protected trees, where existing ground levels are to be retained.

3 Setting Out

3.1 Planting shall be laid out in line with drawing number SP/TMF3/01 and measured from existing fixed points.

The supervisor is to check that all beds conform to the plan, prior to cultivation. Failure to do so may result in rejection of the work by the client, making good will be at the contractors own cost.

4 Cultivation


- 4.1 Planted areas are to be cultivated to a minimum depth of 300mm, in line with *BS4428:1989 Code of practice for general landscape operations*. This is to be carried out by hand where beds are less than 5m wide. A tractor mounted rotavator with low ground pressure may be used on beds 5m or wider where access permits. The beds are to be levelled or graded to an evenly running fall and finish flush with adjacent hard surfaces. All weeds, grass and rubbish exposed during cultivation are to be removed from site.
- 4.2 Turfed or seeded areas are to be cultivated to a minimum depth of 100mm, by hand or with a mechanical rotavator for areas 5m wide or less. A tractor mounted rotavator with low ground pressure may be used on beds 5m or wider where access permits. Finished levels are to be 25mm higher than surrounding hard surfaces.
- 4.3 Cultivation within the root area of protected trees will be carried out by hand to minimise damage to roots.

Planting

5 Standard Trees

- 5.1 All trees to be of the size specified, true to type and free of pests and diseases. The trees are to be planted in the locations shown on drawing number SP/TMF3/01.
- 5.2 The plants are to conform *BS 3936:1980 Nursery stock specification for trees and shrubs*. Planting to be in line with *BS4043:1989 Recommendations for transplanting root balled trees*. All trees are to be container grown during the months of March – November, or root balled during the months of December to February.
- 5.3 Trees are to be planted in hand dug pits a minimum of 750mm x 750mm x 750mm or 300mm larger than the spread of the roots. An area of 1m x 1m x 500mm deep will be excavated and filled with good quality topsoil in the location of each tree pit, to reduce the potential for compaction around proposed tree planting. The bottom and sides of the pit are to be broken up using a fork. The tree is to be planted to the depth of the root-collar and the pit back filled, with the soil firmed in layers of 150mm. All trees are to receive an application of slow release fertiliser to manufacture's specifications.
- 5.4 All trees are to be single staked and tied, with a biodegradable tie, to a height of no more than a third of the tree. Stakes are to be peeled timber that has been pressure treated, see figure 1.

Figure 1 – tree pits

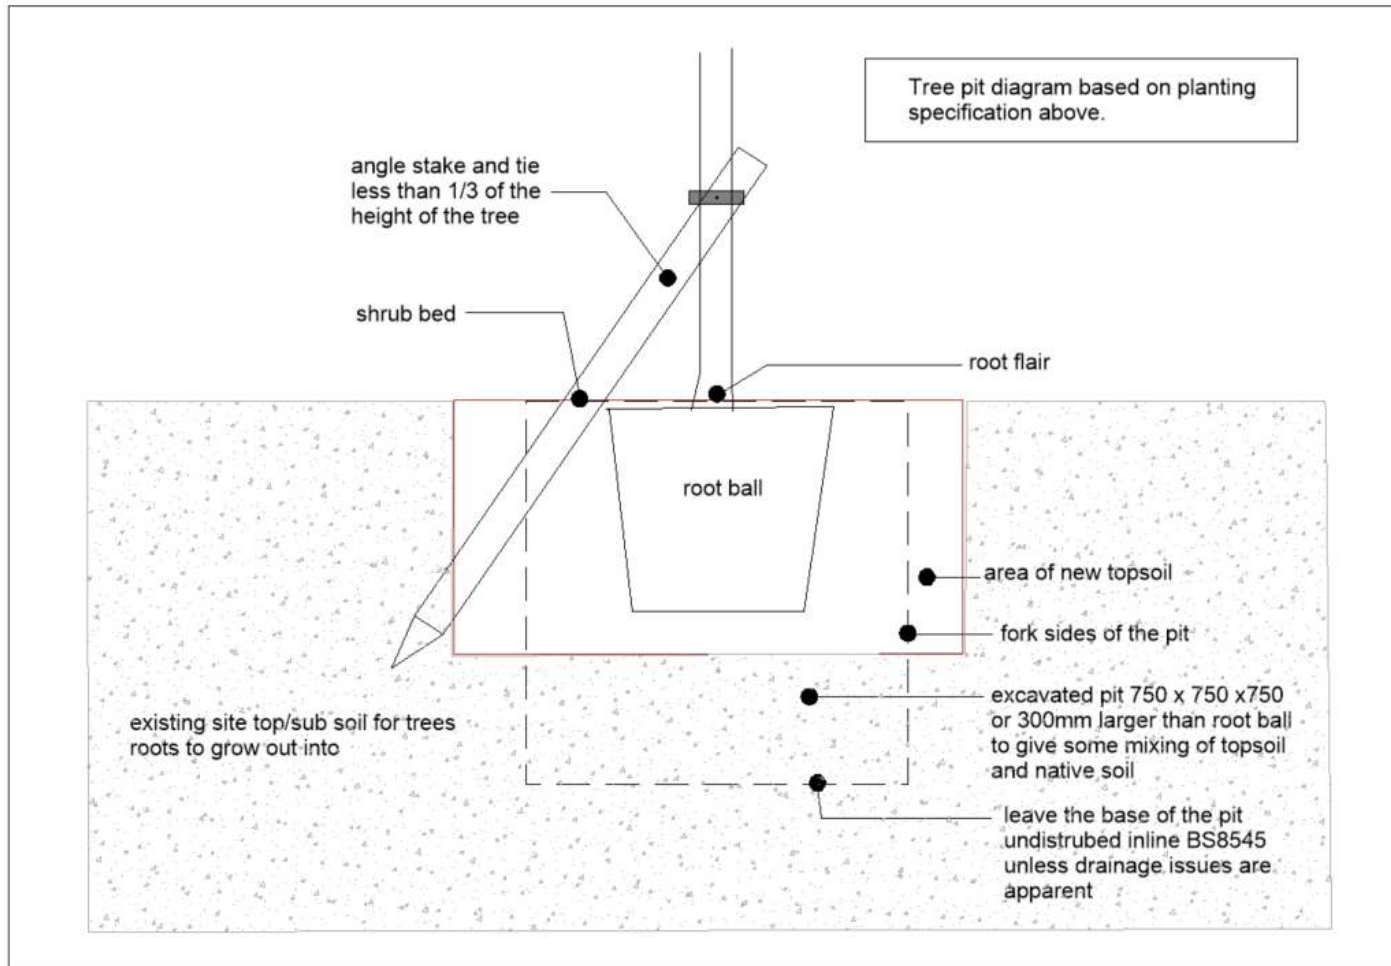

6 Native shrub planting

- 6.1 Bare root planting is to be carried out during the first available planting season of November to March, after completion of the residential areas.
- 6.2 All plants to be true to the type and to be bare root or container grown to the size specified on drawing numbers SP/TMF/01. No substitutions are to be accepted unless previously agreed with the landscape architect. Plants are to be of local provenance where possible.
- 6.3 Hedges to be planted in a double staggered row 450mm apart at 4 per liner meter. No *Crataegus monogyna* to be planted within 8m of a dwelling.
- Any plants that are rejected are to be replaced by the contractor at his own cost. For all bare root material, the roots are to be kept covered at all times to stop desiccation.
- Holes are to be hand excavated to a sufficient size to take the entire container or root system. The plant is to be planted to the depth of the root-collar.
- The soil is to be back filled and then firmed around the plant. Slow release fertiliser to manufacture's recommendations is to be mixed with the back filled topsoil. The surface of the bed is to be left cultivated and free from weeds, debris and stones

7 Container shrubs

- 7.1 All plants to be true to the type and to be container grown to the size specified on drawing number SP/TMF/01. No substitutions are to be accepted unless previously agreed.
- Any plants that are rejected are to be replaced by the contractor at his own cost.
- All shrubs and herbaceous material are to be in line with *BS 3936:1980 Nursery stock specification for trees and shrubs*, planting operations to be in line with *BS4428:1989 Code of practice for landscape operations*.
- 7.2 Immediately before planting the pots or root balls are to be well watered.
- Holes are to be hand excavated to a sufficient size to take the entire container or root ball. The plant is to be planted to the depth of the root-collar.
- The soil is to be back filled and then firmed around the plant.
- The surface of the bed is to be left cultivated and free from weeds, debris and stones.
- Any broken or unhealthy growth to be pruned from the plant after planting.
- All plants are to be watered in thoroughly to field capacity of the soil, directly after planting.
- Planted areas are to receive an application of slow-release fertiliser, to manufacture's specifications.

8 Mulching

- 8.1 All shrub beds to be mulch to a depth of 100mm with bark mulch. All hedges mulched to a width of 1m along the length of the run.

Grass Areas

9 Turfing lawns

- 9.1 Areas are to be cultivated in line with section 4 of this specification.
- Turf is to be cultivated in origin, in line with *BS3969: 1998 Recommendations for turf for general purposes*. Laying of the turf to be in line with *BS4428:1989 Code of practice for landscape operations*.
- The area is to be raked to level, in line with the existing contours and prepared to a fine tilth. Slow-release fertiliser is to be applied prior to laying the turves.
- Turves are to be laid from boards on to the prepared ground, with the edges butted together firmly. The joints are to be staggered, in a stretcher bond between rows. The turf is to be compacted with a turf thumper once laid.
- It is then to be watered in thoroughly to field capacity until the turf has rooted.

Maintenance for the establishment period of 5 years

10 Tree planting

- 10.1 All trees are to be watered once a week during the growing season of April to September, this may need to be adjusted during extreme climatic conditions such as drought. At least 20 litres of water per visit per tree.
Tree stakes and securing systems are to be checked once a month throughout the year.
All trees are to be formatively pruned annually if required during the winter months.
Dead or dying trees are to be replaced during the planting season of November to March and are to be of the same size and species as the original specification for the first 3 years
Tree stakes and ties are to be removed after 2 years.

11 Shrubs

- 11.1 Weed all beds throughout the growing season to maintain a weed free bed during establishment. During periods of dry weather, during the growing season water the beds fortnightly to field capacity. Additional waterings may be required during extreme climatic conditions.
Remove all litter fortnightly
Dead or dying shrubs are to be replaced during the planting season of November to March and are to be of the same size and species as the original specification for the first 5 years
Ornamental hedges will be pruned to 1.2m high annually.

12 Hedge planting

- 12.1 Maintain an area 1m in width weed free around each plan by applying a translocated, contact herbicide to weed growth in May and September in line with manufacturers guild lines and current herbicide regulations. All shrubs are to be watered once a week during the growing season of April to September, this may need to be adjusted during extreme climatic conditions such as drought.
Remove all litter fortnightly

Dead or dying shrubs are to be replaced during the planting season of November to March and are to be of the same size and species as the original specification for the first 5 years
The native hedges will be trimmed to 2m high annually. Ornamental hedges to a height of 1.2m twice annually.

13 Turfed

- 13.1 Areas of newly laid turf are to be watered as required during establishment, dependant on climatic conditions. Ground is to be watered to field capacity.
Lawn areas are to be mown fortnightly throughout the growing season. After mowing all adjacent hard surfaces are to be swept clean of cuttings.
Grass edges abutting planting beds are to be edged on each occasion with edging shears and with a half-moon edging tool twice during the growing season in May and September.
A spring and autumn application of fertiliser is to be applied to the lawn grass areas, not to wildflower grass areas. Remove all litter fortnightly.