



PROPOSED SIDE ELEVATION

PROPOSED FRONT ELEVATION

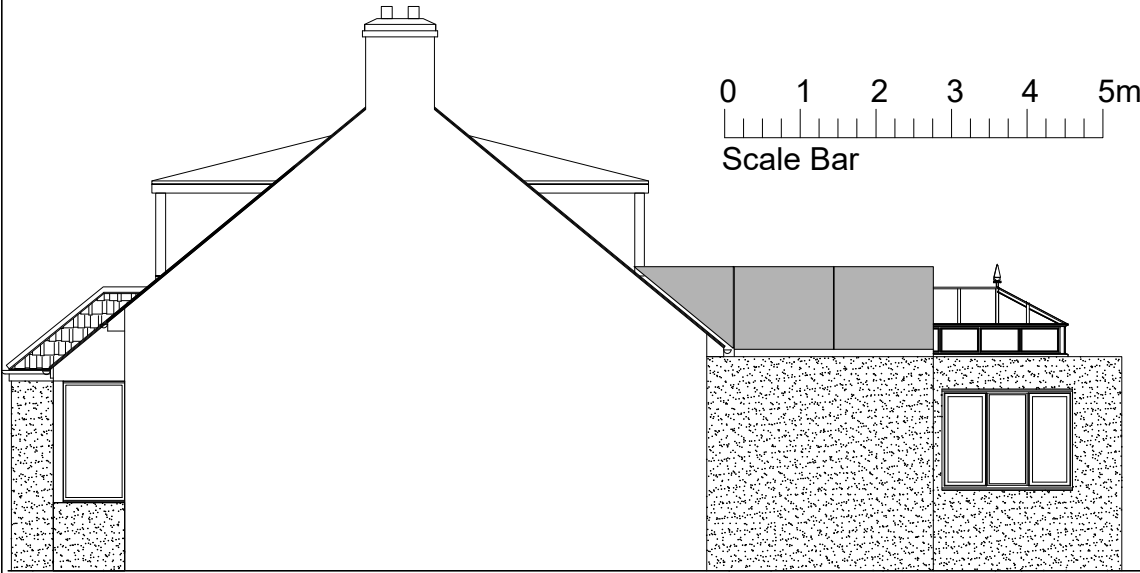

PROPOSED SIDE ELEVATION

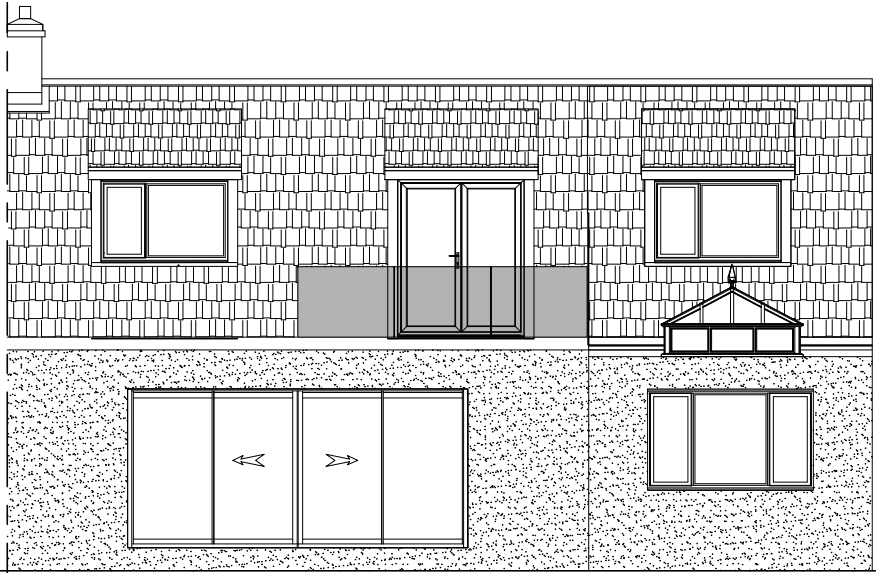

PROPOSED REAR ELEVATION

GENERAL

All works to comply with Building Regulations 2000 and associated legislation and to the satisfaction of the Local Authorities Building Control Officer. All building materials to comply with BSS and used in accordance with the relevant Codes of Practice. All structural timber to be C16 or C24 grade.
All openings to be fitted with vertical and horizontal DPM. All lintels to have 150mm end bearing and 1/2 hour fire resistance. All new electrical work to be 13A ring main and lighting circuit to comply to IEE standards and to clients instructions.

FOUNDATIONS

New strip foundations to comply to BS:8004 on suitable loadbearing strata and to the satisfaction of the Local Authority Building Control Officer. Top of foundations to be min 750mm below ground level and reinforced with A193 mesh with 50mm cover top and bottom. Foundations to be taken below invert levels of existing drains. Check existing foundations and underpin if necessary at staggered stages. Any deviation from a strip foundation may require design and calculations from Structural Engineer.

EXTERNAL WALL (Rendered)

300mm cavity walling shall comprise of an outer leaf of facing brickwork to match existing up to feature brick band, an inner leaf of 100mm thick blockwork "Toplite" or similar , 100mm Dritherm full fill insulation taken 225mm below dpc providing minimum U-Value of 0.3W/m2K. above brick band use 300mm cavity walling of an inner and outer leaf of 100mm thick blockwork "Toplite" or similar, 100mm Dritherm full fill insulation taken 225mm below dpc providing minimum U-Value of 0.3W/m2K. pebble dashed render to match existing applied to outer face of blockwork all to manufacturers recommendations. Colour to match existing. Stainless steel vertical twist type wall ties to BS 1243:1978 every 750mm horizontally and 450mm vertically and ties within 150mm of openings to be at 225mm crs vertically.

Lateral restraint provided by means of 30mm x 5mm galvanised steel holding down straps @ 2m centres maximum and carried across at least 3 timber members.
Vertical strapping required to joists / wallplates by 30mm x 5mm galvanised steel holding down straps @ 2m centres maximum. All masonry below ground level externally and dpc level internally shall be either Class B engineering bricks or loadbearing solid type A blocks.
Cavity fill below ground level shall be ordinary prescribed mix to BS 5328, grade C10P.

All cavities to be continuous. Where pipes pass through wall PC Lintel to be provided and 50mm compressible material to surround pipework. Dpc,s to all openings shall be a minimum width of 150mm Horizontal Dpc located 150 mm above ground level. Blockwork walls shall be finished in 12.5mm Gyproc wallboard on Dri-wall dabs with all joints to be taped and sealed.
Insulated cavity closers to all openings.

EFFICIENCY LIGHT FITTINGS

Provide lighting fittings as tabled below to be fixed lighting that only accepts lamps having a luminous efficiency greater than 45 lumens per circuit watt and a total output greater than 400 lamp lumens. Such fittings would include fluorescent tubes and compact fluorescent lamps but not GLS tungsten lamps with bayonet cap or Edison screw bases. *Number not less than three per four of all the light fittings.*

ABOVE GROUND DRAINAGE

All waste pipes and fittings from sanitary appliances are to be upvc to BS5255: 1076. Branch pipes and vent pipes to be UPVC to BS 4514 : 1983. All pipes to be fitted with rodding access to all changes of direction and at junctions. All wastes to be fitted with 75 mm deep seal traps.

SMOKE DETECTORS

Smoke detectors are to be installed in complete compliance with Approved Document B1, Section 1 of the Building Regulations. Multiple installations are to be wired together on a separate circuit in accordance with the current IEE regulations.

ROOF TO SINGLE STOREY EXTENSION

Lead Grey Sarna roof laid to manufacturer's recommendations on 100mm TR27 insulation on vapour control layer on 200x50 C24 rafters @ 400mm. Rafters are to be supported on 100 x 65mm wallplates at base and held down by means of galvanised mild steel restraint straps type BAT M305 or similar, 30 x 5 mm and 100 x 650 mm twice fixed to top of wallplate using No. 12x50mm countersunk head woodscrews and plugged and screwed to blockwork. 30 x 5mm Galvanised steel restraint straps to be installed at gable wall and 75 x 38 mm sw noggins to be between the rafters at each strap. Spacing of straps to be 1800mm centres max. and straps to be installed at ceiling level and carried across end 3 rafters.

GROUND FLOOR CONSTRUCTION

65mm Mesh reinforced screed to be laid on a 500 gauge separation membrane on 75mm Kingspan K3 floor insulation or similar on 2000 guage visqueen turned up 100mm at wall abutments with all laps and intersections taped and sealed in accordance with Agreement Certificate 87/1796. on 100mm oversite on 150mm approved consolidated hardcore. Must achieve minimum U-value of 0.22 W/m2K. Ventilation must be maintained to the existing house sub floor through the new ground supported floor. This can be achieved using 100mm diameter pipes and telescopic vents.

GARAGE FLOOR CONSTRUCTION

Power floated 150 mm thick concrete slab (concrete mix should be in accordance with BS 8110, BS 5328, mix type ST2 or GEN1), with 1 layer A252 steel mesh positioned mid span of slab on 1200g visqueen DPM/radon barrier on sand blinding on min. 150 well consolidated sulphate free clean hardcore.(no reclaimed demolished material is permitted). 1:80 fall on floor from back of garage to front garage door, floor to be thickened to 300mm at garage entrance. Provide 25mm polystyrene compressible clay board to perimeter of walls. If hardcore is more than 600mm deep- slab to be reinforced further, to NHBC/LA/Engineers requirements..

RADIATORS

All new radiators to be provided with Thermostatic valves. Client to agree locations with Builder prior to commencement of works.

INTERNAL WALL CONSTRUCTION

Non loadbearing internal walls shall be stud partitions comprising 75 x 75mm sole and head plates and 75 x 50 mm vertical studs at 600 mm maximum centres. 75 x 50mm noggins are to be incorporated between studs at 600 mm centres vertically. 50 x 38 mm intermediate noggins as required for radiators, shelves, socket and switch boxes etc. Stud Partitions to be dry-lined with 12.7 mm British Gypsum wallboard, Ames mechanical jointing, Topcoat finish.

WINDOWS

New windows to be double glazed in UPVC frame to match existing to pattern shown and are to be supplied pre-fitted with permanently fixed controllable trickle ventilators having an area not less than 8000 square millimetres.

All glazing below 800mm above floor level, and in doors or 300mm adjacent doors, to be either toughened or laminated safety glass in accordance with BS 6206:1981.
Soft coat Low E glass to inner skin.

Certification to verify Part L1 compliance 1.8W/m2K) to be issued from suppliers.

RAINWATER GOODS

Gutters to be moulded upvc to match existing Rainwater pipe to connect to existing drains. All pipes to be fitted with rodding access to all changes of direction and at junctions. All new underground pipes to be 110mm UPVC laid 1:40 fall min. with granular encasement. Rainwater gully to be trapped.

ELECTRICS

Electrics must be Part P compliant with full certification that all works are carried out in accordance with BS7671 to be provided, if not Part P credited then separate application to be made through Local Authority Building Control Dept.

FIRST FLOOR CONSTRUCTION

22mm Weyroc to BS 5669 on 200 x 50 C16 joists @ 400mm crs approx and built into brickwork both ends. Herring bone strutting spaced at mid span of floor joists. 2 x 12.5mm wallboard with staggered joints to garage ceiling with 200mm Quilt insulation in floor void. 15mm Plasterboard and skim to u/side with 100mm Quilt insulation in floor void over Kitchen

Rev.	Revision Note	Date
Proposed alterations to 29 Swinhoe Road Beadnell Northumberland - NE67 5AG		Scale 1:100 Date 25.11.22
Title Proposed Elevations		Sheet No. 102