

Handrails to ramp and steps

Balustrade Stanchion:

- RHS 60x60x4 at 1500 maximum ٠ centres
- ٠ Connection between RHS and spigot to be min - 50mm below top of concrete

Top Rail:

٠ HS 60x60x4 at 900 above ground level

Handrails:


- at two levels
- 50 diameter stainless steel hollow section ٠ Warm to touch

Proposed fixing:

Spigot and ground sleeve connection into ground;

Note- there should be a colour contrast between the ramps and the landings.

Handrailing to ramp fixing

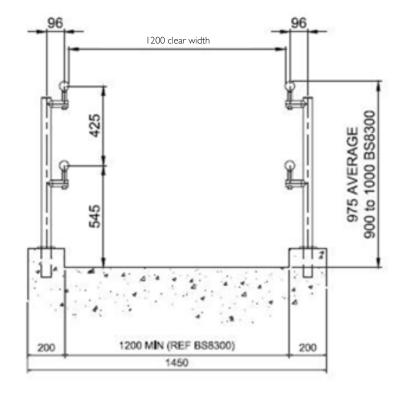



Hand Rail Detail

1:20



Scale Bar 1:100

Originator T H E	Project No.	Project	Layout Title	Purpose of Issue	Scales @ A3	Client
	2020- 1805	Haltwhistle	Platform I additional ramp	Approval	As Indicated	northern

In addition to the hazard/risks normally associated with the types of work detailed on this drawing take note of the above. It is assumed that all works on this drawing will be carried out by a competent contractor working, where appropriate, to an appropriate method statement.

Safety Health and Environmental Information Box

Notes

This document and its design content is copyright ©. It shall be read in conjunction with all other associated project information including models, specifications, schedules and related consultants documents. Do not scale from documents. All dimensions to be checked on site. Immediately report any discrepancies, errors or omissions on this document to the Originator. If i doubt ASK.

APPROVED FOR CONSTRUCTION					
PRINCIPLE CONTRACTOR					
SIGNED	TITLE				
NAME	DATE				
PRINCIPLE CONTRACTOR					
SIGNED	TITLE				
NAME	DATE				

	Date	Description			Drawn by	Checked by	Approved by	Revision	
SUC	05.09.22	5.09.22 Additional Ramp			КМ	CM	CM	/	
Revisio	07.09.22 Ramp removed and steps added				КМ	СМ	CM	A	
Re	10.11.22 Ramp and notes added,				КМ	CM	CM	В	
		hand-railing detail addec							
	Drawing Details								
	Drawing Number		Date	Designed by	Drawn by	Checked by	Approved by	Revision	
	1085-01		10.11.22		КМ	СМ	СМ	В	