


WAYLEAVE

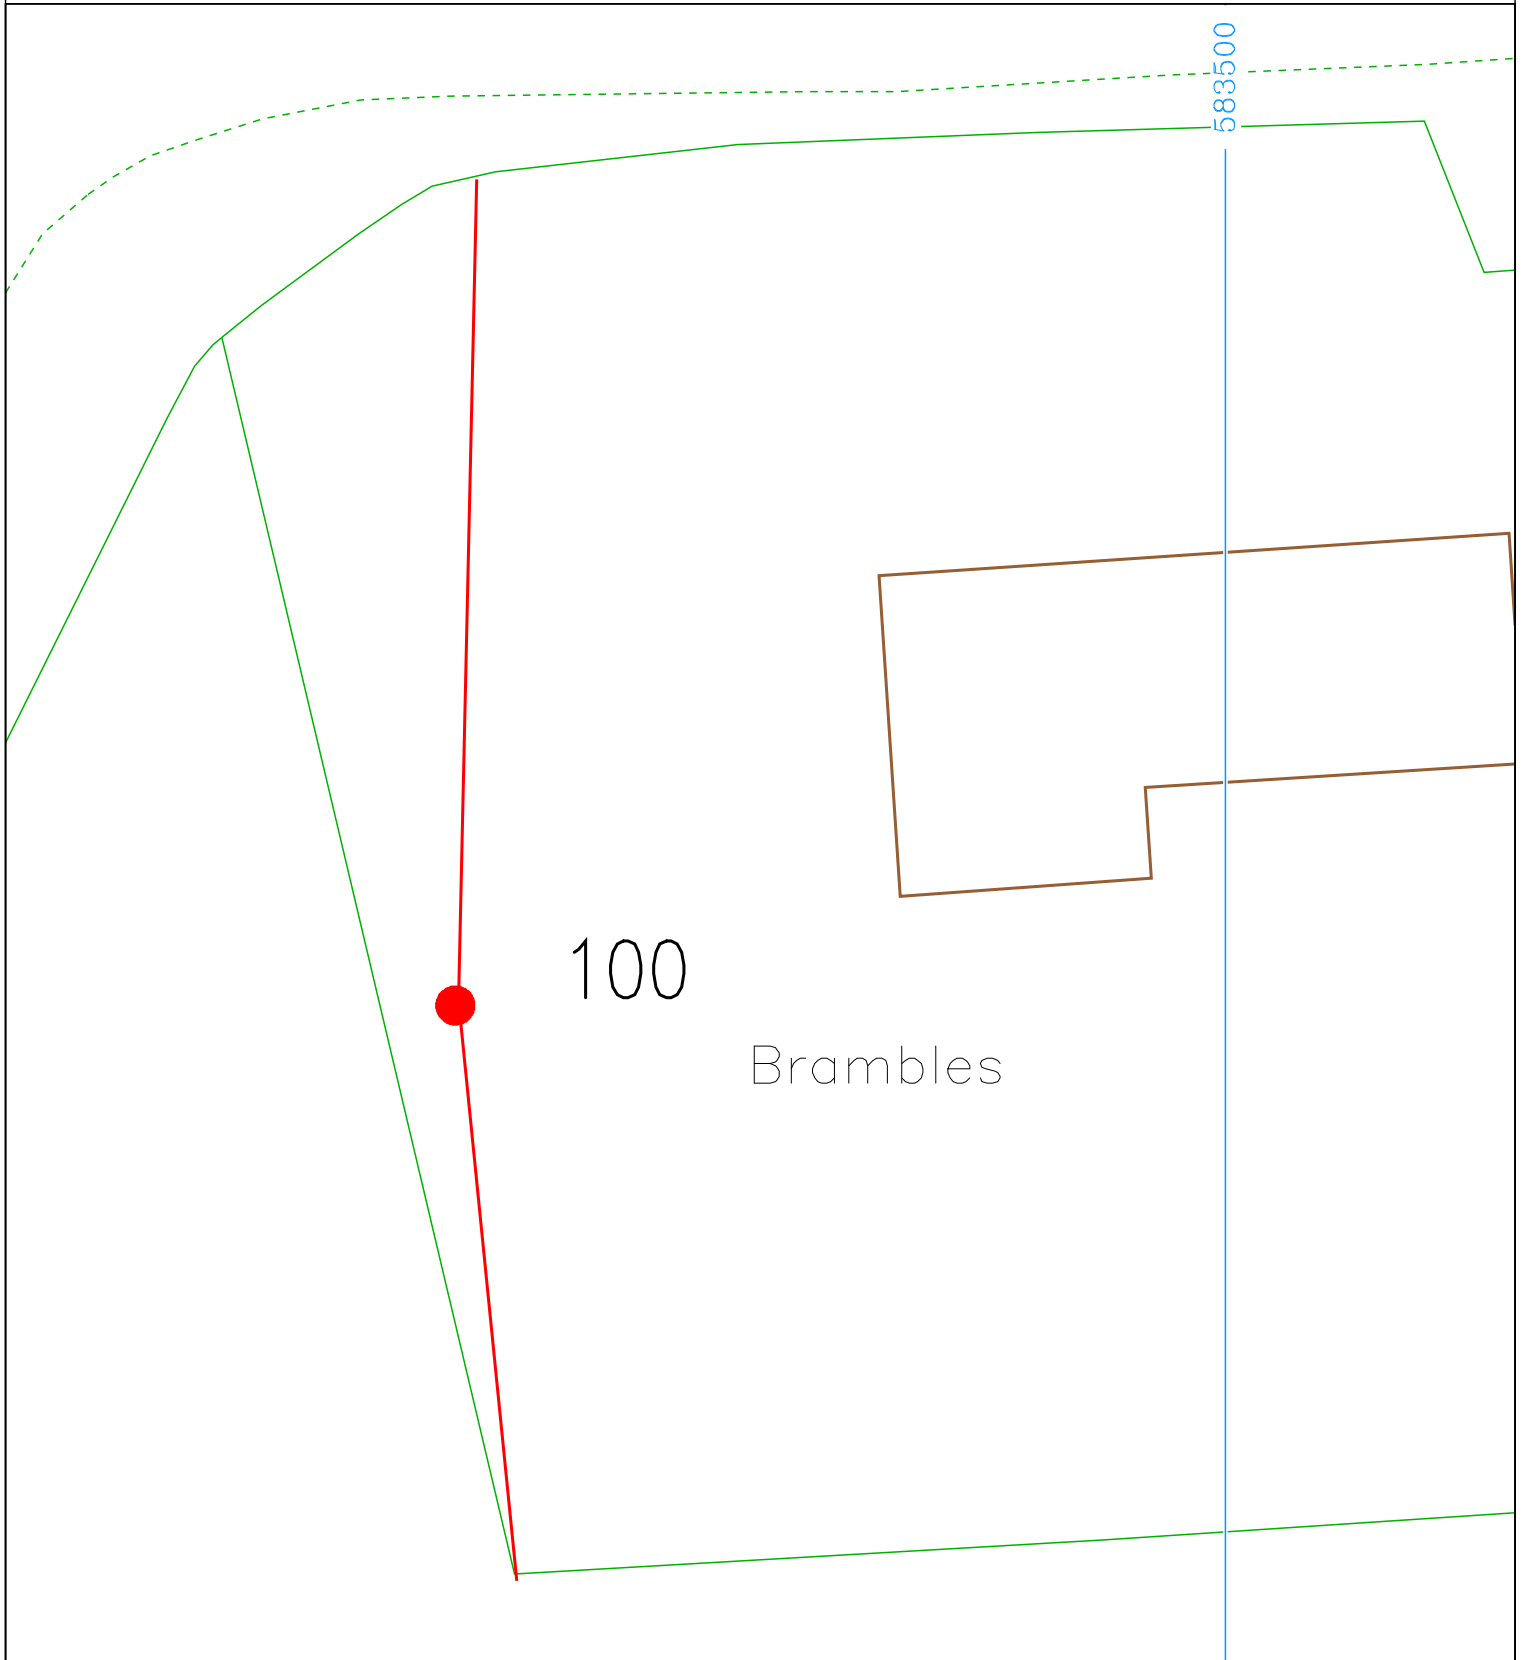

Existing		Proposed		Existing		Proposed	
Overhead Line – EHV			Underground Cable – EHV				
Overhead Line – HV			Underground Cable – HV				
Overhead Line – LV			Underground Cable – LV				
H-Pole(s)			Substation				
Pole(s)			Tower/Pylon				
Stay(s)							

Buried earthing conductor may be laid from any pole. This is not a precise record. In the interest of Safety, advice should be sought from UK Power Networks (Operations) Limited before any excavation is attempted in the vicinity of underground cables.

Site: Brambles, Collins Road, Little Maplestead, Halstead CO9 2SG
 Scale : 1:250 Map Centre : TL 8348 3443
 Drawing No.: UKPNE3244 Plotted On: 30/06/2020 Drawn by : Rikk Sowerby

Reproduced by permission of Ordnance Survey on behalf of HMSO. (c) Crown copyright and database right 2020. All rights reserved. Ordnance Survey Licence number 100019626. Data has been added to the Ordnance Survey base map; all proprietary rights in such additional data are and shall remain the exclusive property of (c) Eastern Power Networks plc or London Power Networks plc each being a distribution licensee under section 6(1)(c) of the Electricity Act 1989 for the relevant distribution services area as that term is defined in such licensee's distribution licence. All rights in such data reserved.