DUST BLINDED PATH WITH TIMBER EDGE

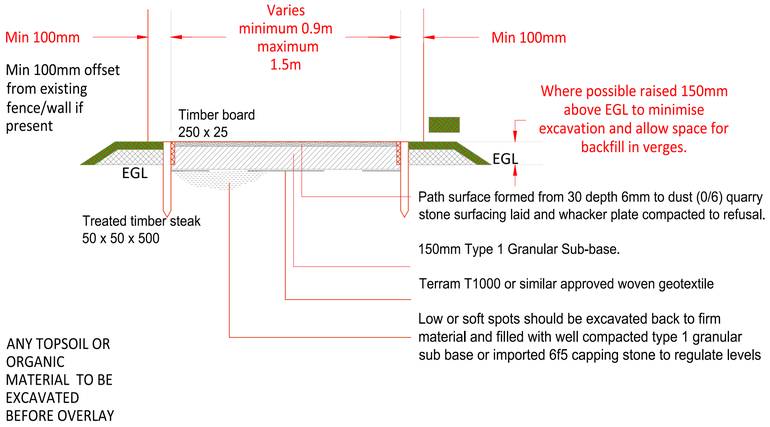

30MM GRAVEL ROLLED TO 2.5M OR EXISTING EXTENT

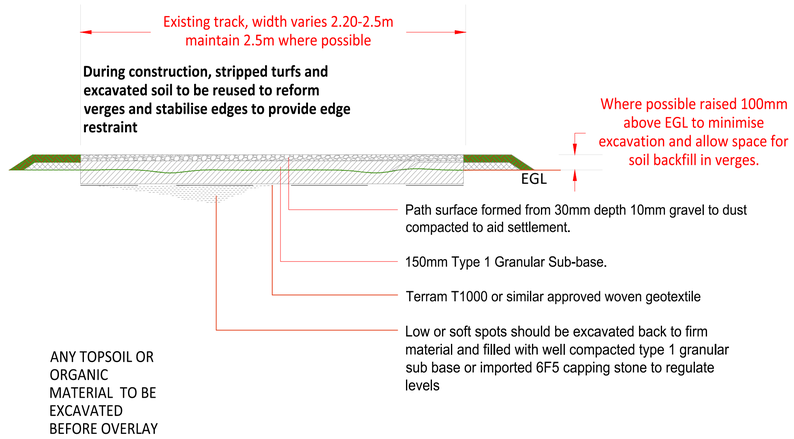

SECTION THOUGH STEPS

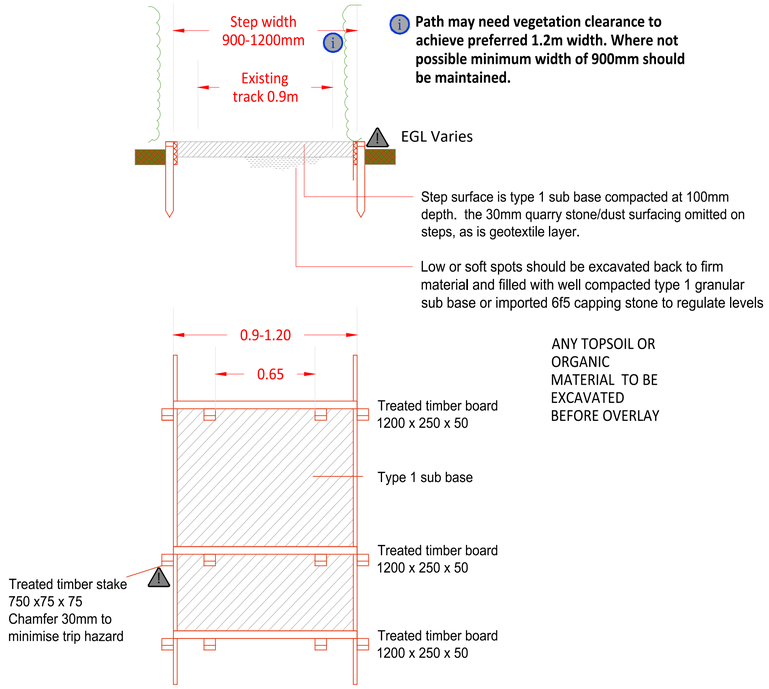

The step arrangement shown is based on long section topography along section line and may vary in practice. Some variation in steps dimensions might be necessary.

Step lengths (going) and heights (rising) should be maintained at going minimum 300mm min to 1000mm max.

Steps should rise 150mm minimum and 200mm maximum.

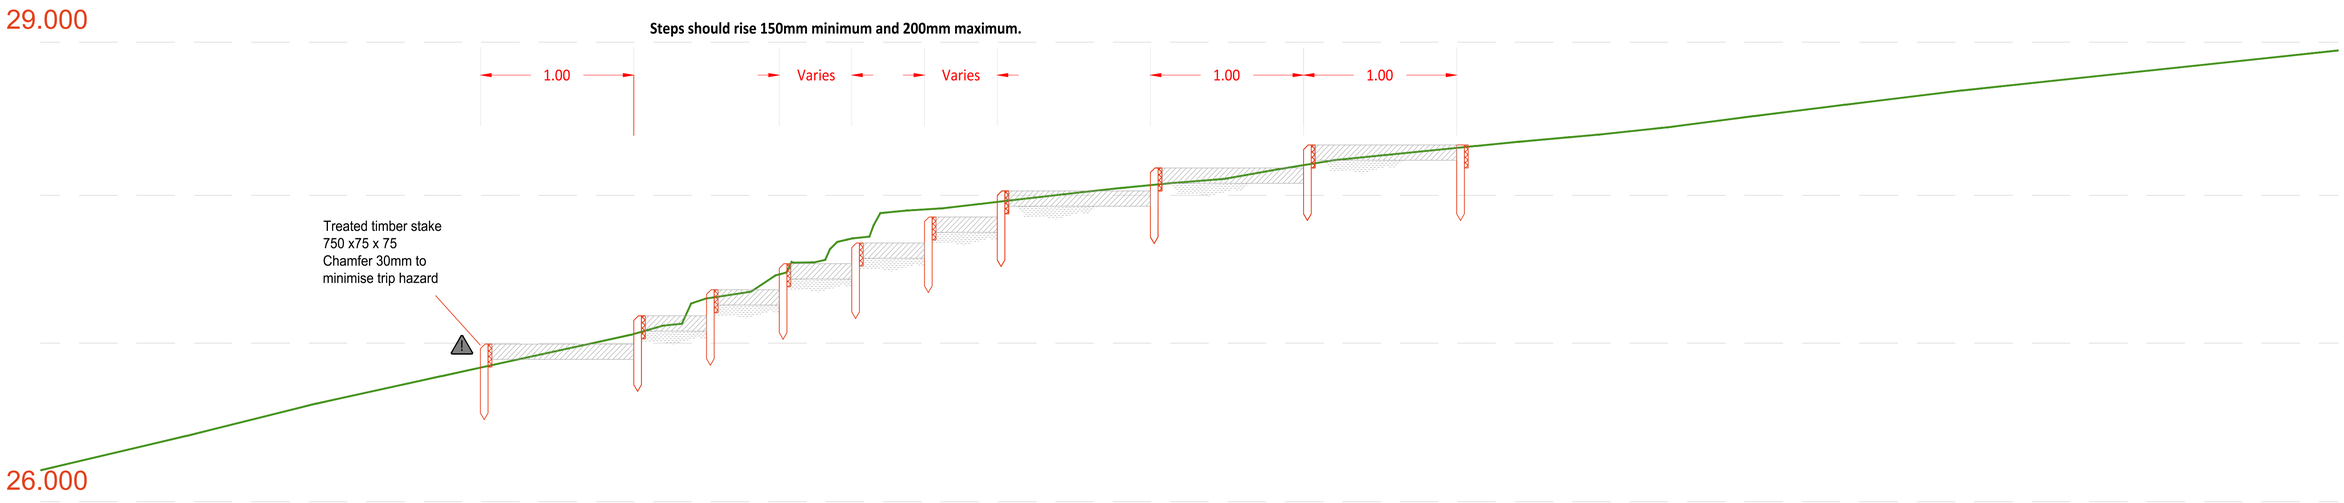

EDENSTONE HOMES

1st Floor
Building 102
Wales 1 Business Park
Magor
NP26 3DG
Tel - 01291674800

Project	Bleadon Quarry
Drawing	Path construction details
Status	Preliminary
Project No.	1258
Drawing No.	115
Revision	-

Drawn By	MJ	Scale	NTS	@A1
Checked By	DB	Date	Mar 23	

Rev	Date	By	Description
-	30.03.2023	MJ	
A	28.04.2023	MJ	path width 1.5m 13 to S1