


- NOTES**
1. SCALED INSTALLATION DIMENSIONS MUST NOT BE TAKEN FROM THIS DRAWING.
  2. THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL RELEVANT SPECIFICATIONS, SCHEDULES AND OTHER DOCUMENTS PREPARED BY THE ENGINEER.

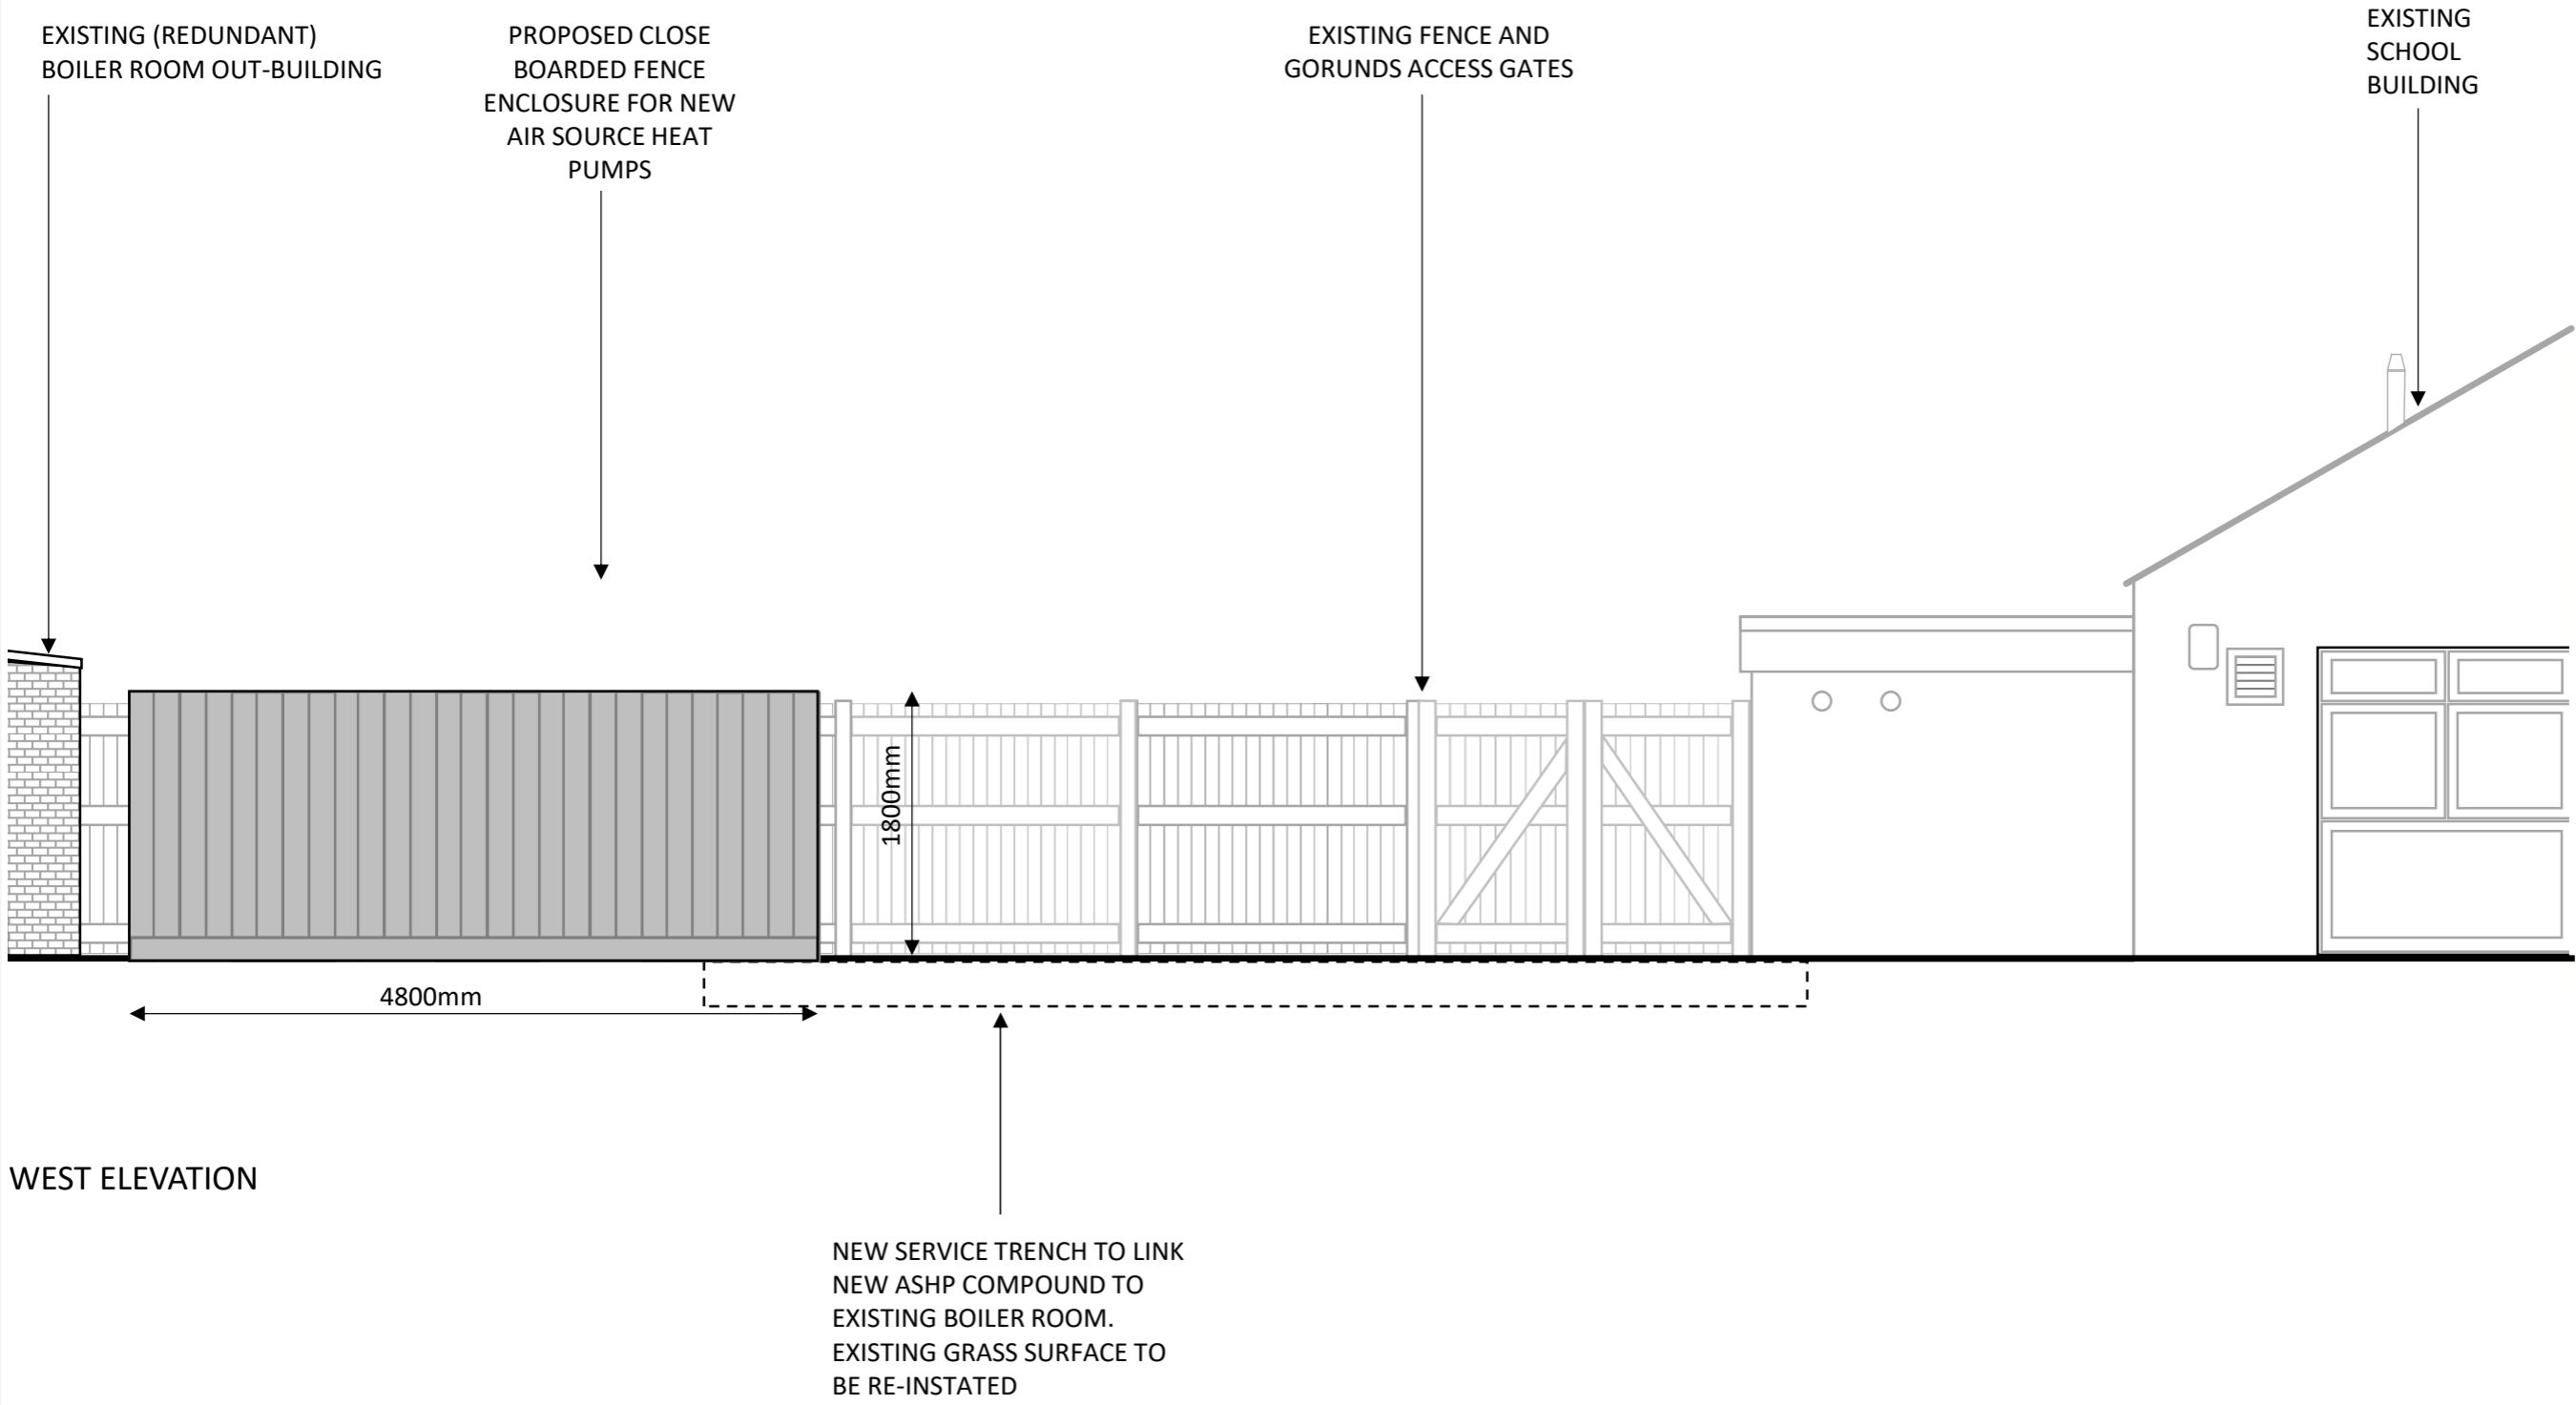

No.	Revision	Date	INIT.
4	ASHP ENCLOSURE FENCE HEIGHT REDUCED FROM 2500mm TO 1800mm FOLLOWING ACOUSTICIAN'S ADVICE	JUL 23	RJA
3	PDF PAPER SIZE CORRECTED	MAR 23	RJA
2	MINOR SCALING ERROR CORRECTED	MAR 23	RJA
1	FOR PLANNING APPLICATION	MAR 23	RJA

Drawing description  
**WICK CE PRIMARY SCHOOL  
 AIR SOURCE HEAT PUMP  
 HEATING REPLACEMENT**

Drawing title  
**PROPOSED ASHP EXTERNAL  
 PLANT ENCLOSURE  
 WEST ELEVATION**

<b>E089.PXX_003</b>	Rev <b>4</b>
1:50@A3.	Date drawn MAR 23
	Drawn by RJA

South Gloucestershire Council  
 Property Services  
 The Council Offices  
 Badminton Road  
 Yate  
 BS37 5AF