


DO NOT SCALE THIS DRAWING

Notes


All dimensions must be checked on site and not scaled from this drawing.

To comply with BS-6173-2001 mandatory interlocks are required between the gas supply and the mechanical kitchen ventilation system (extract and make-up air). Interlocking gas solenoid valve, control panel and sensors to be supplied and fitted by others unless otherwise stated.

Plan View

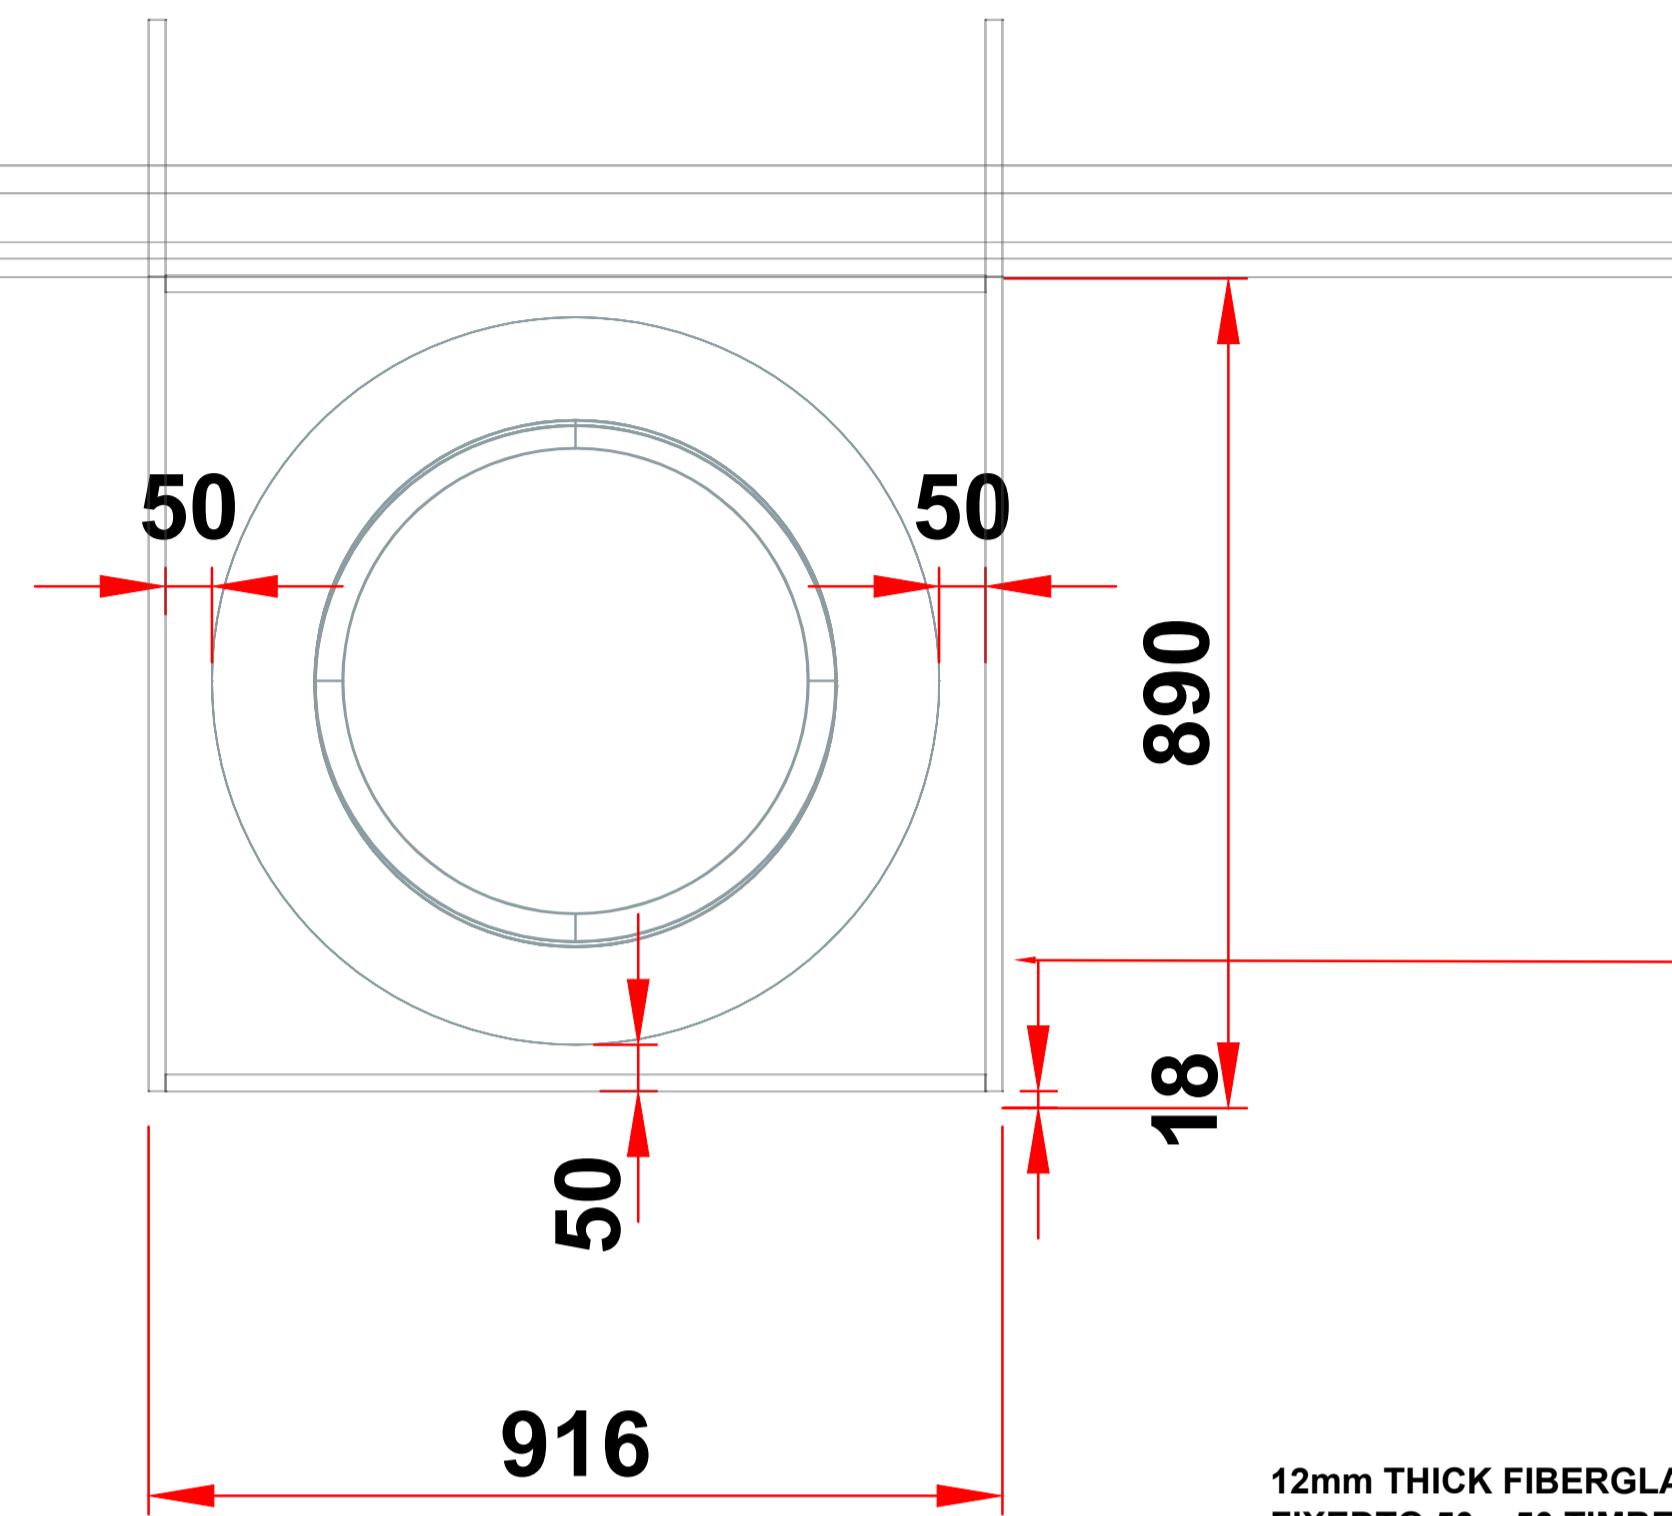


12mm THICK FIBERGLASS FALSE CHIMNEY  
FIXED TO 50 x 50 TIMBER FRAME. TEXTURE  
AND COLOUR TO MATCH EXISTING WALLS

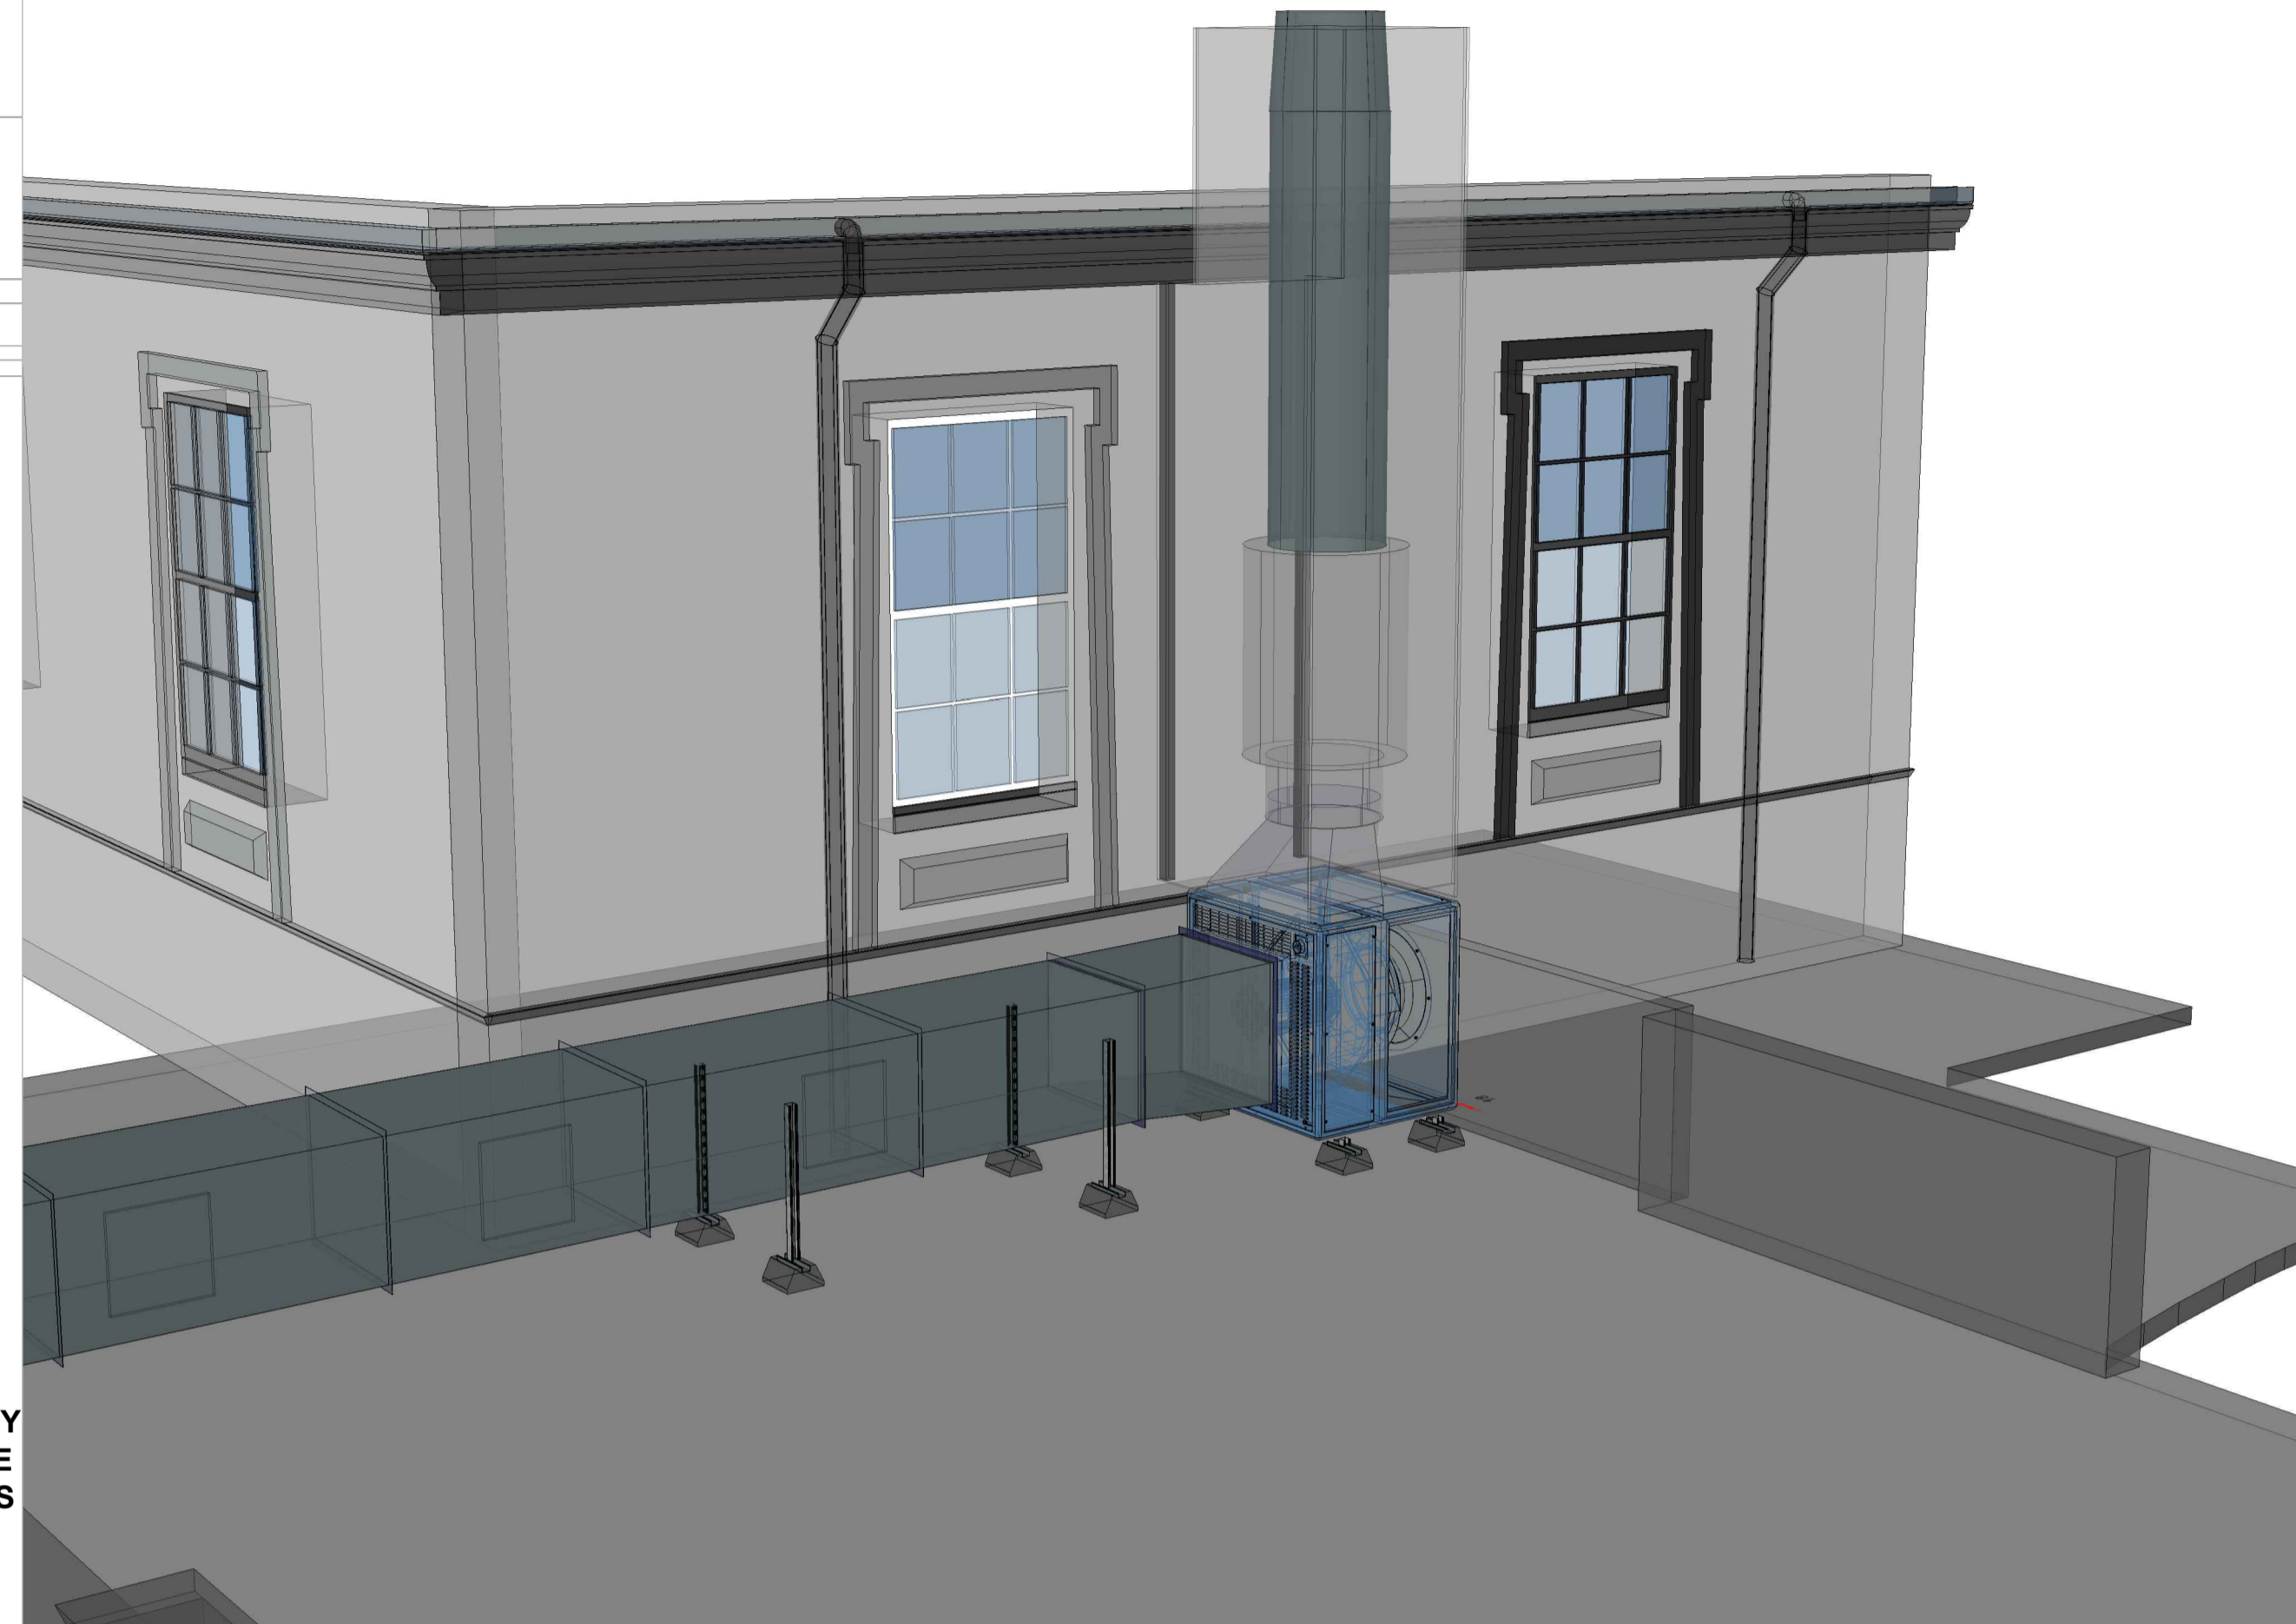


12mm THICK FIBERGLASS FALSE CHIMNEY  
FIXED TO 50 x 50 TIMBER FRAME. TEXTURE  
AND COLOUR TO MATCH EXISTING WALLS

DUCT TO REDUCE FROM 560 TO 500 TO  
INCREASE EFLUX VELOCITY TO 15 m/s

1000

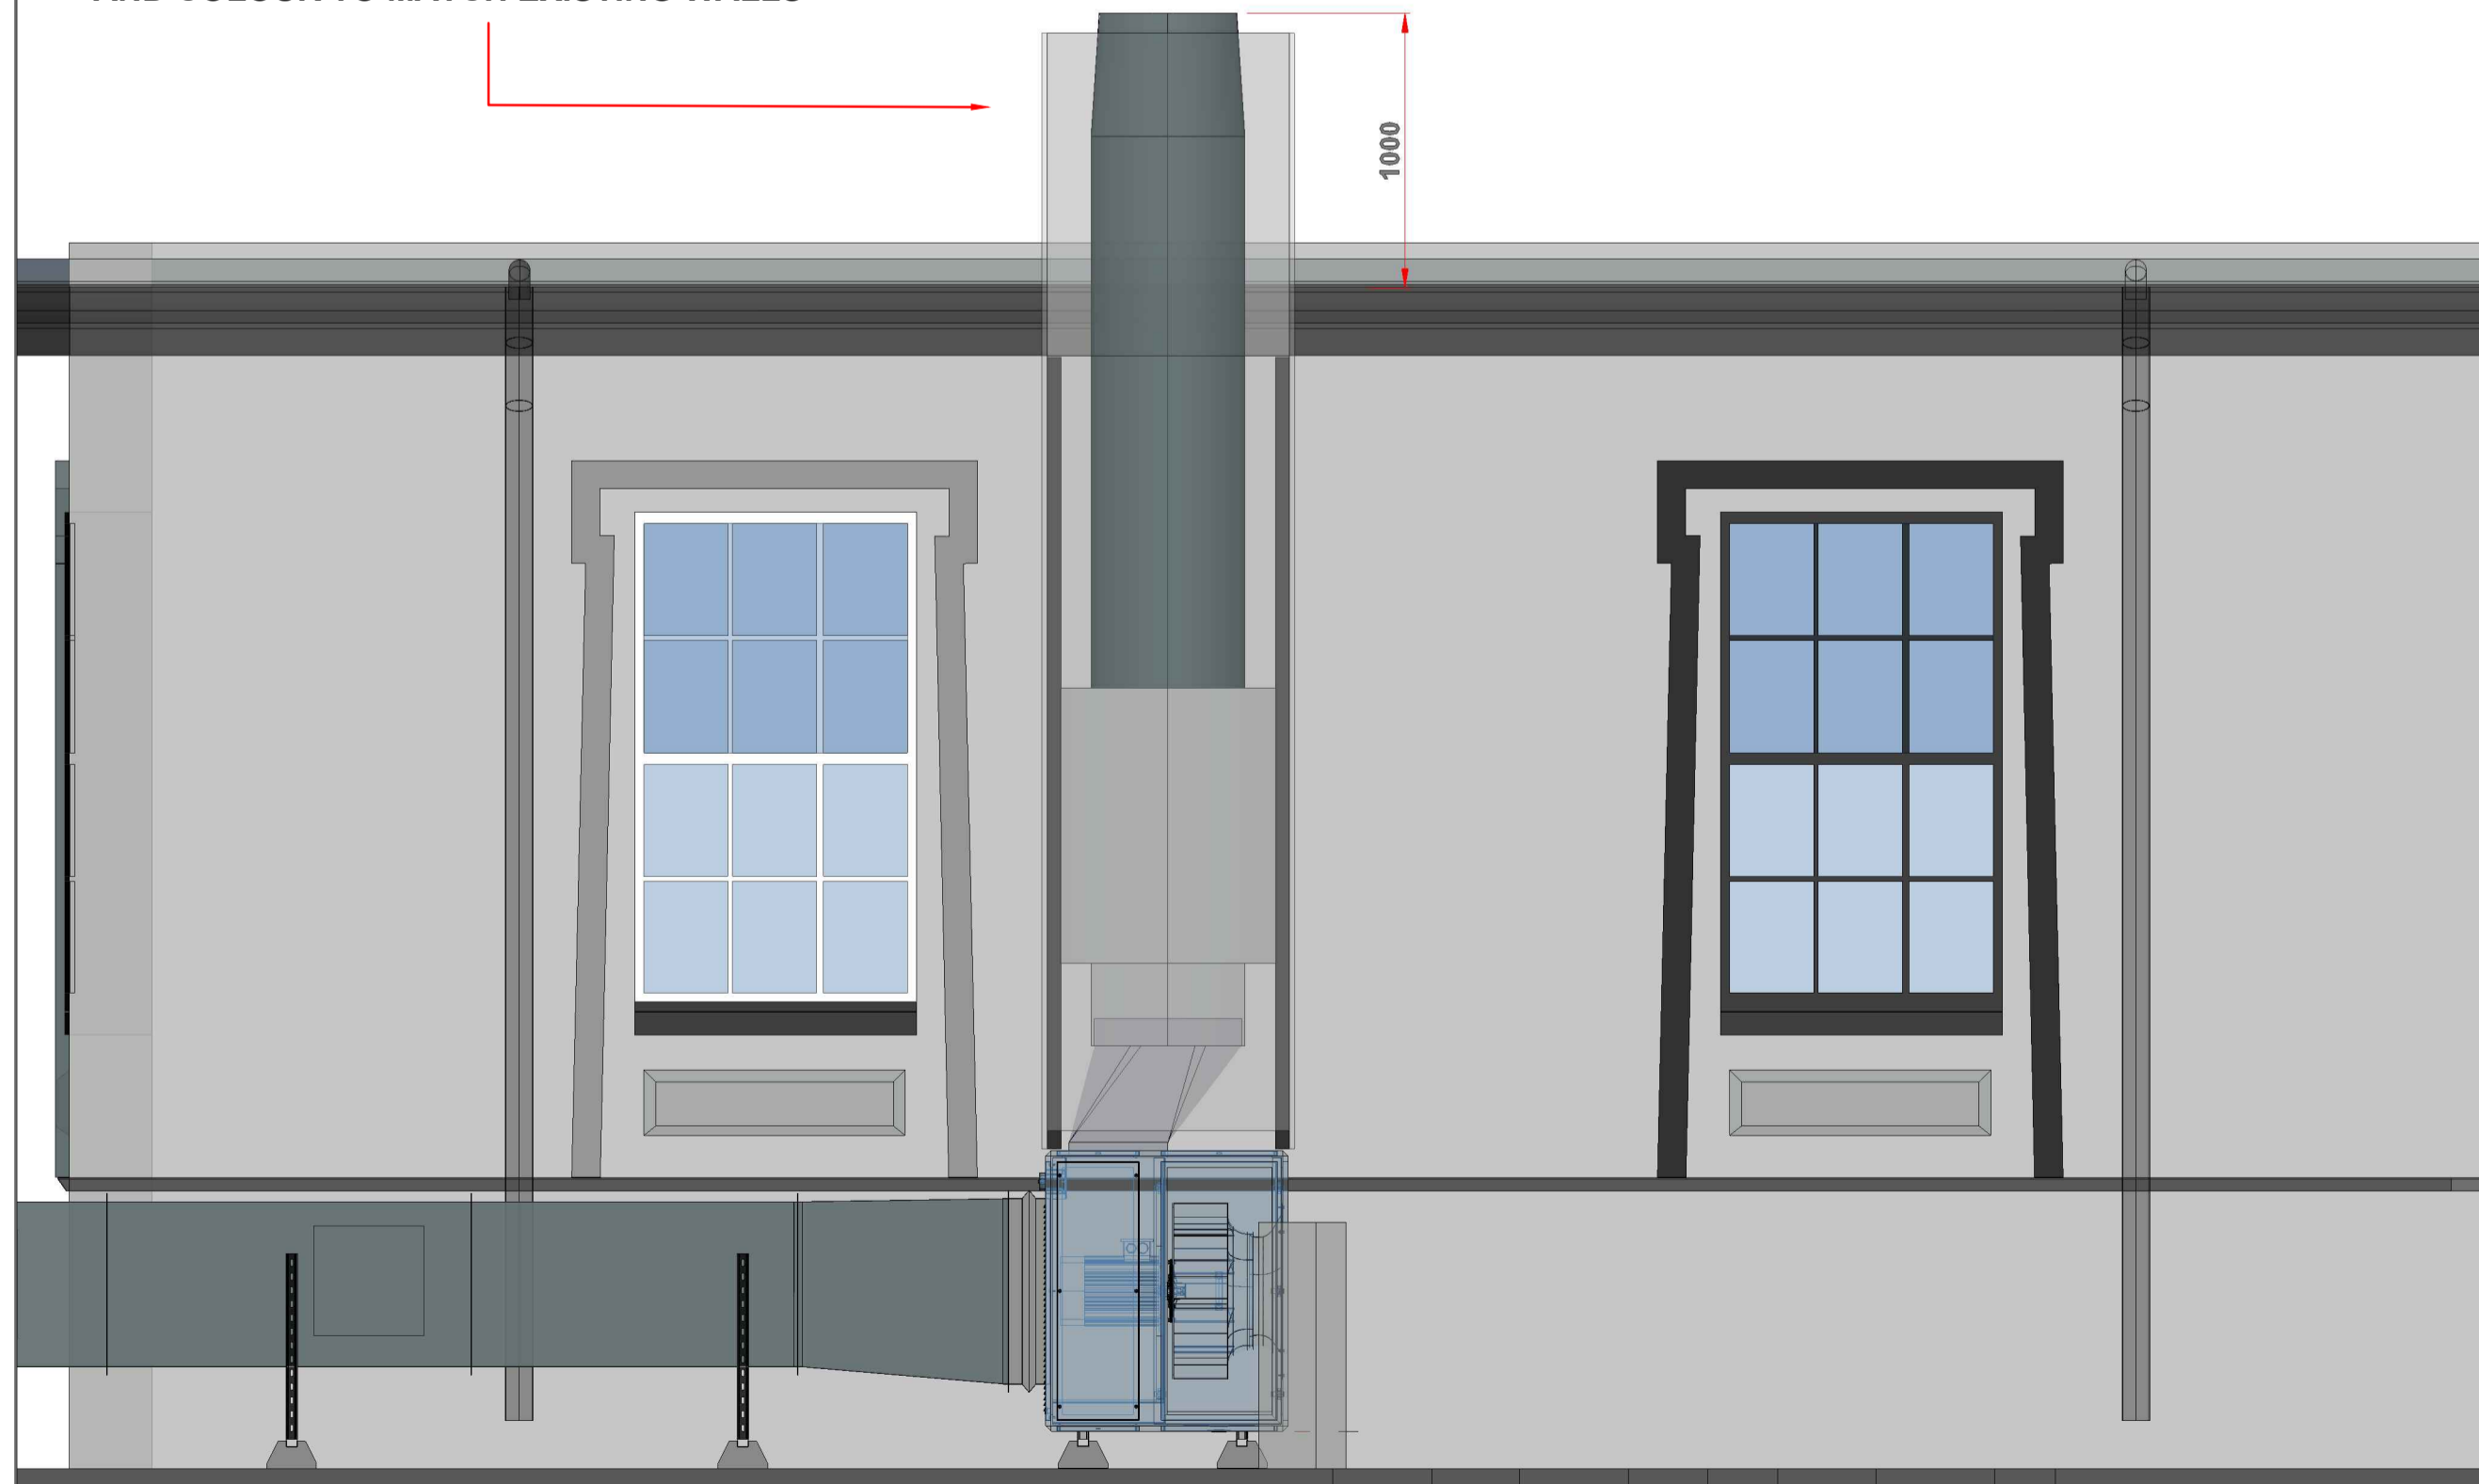

REAR  
BLANKED

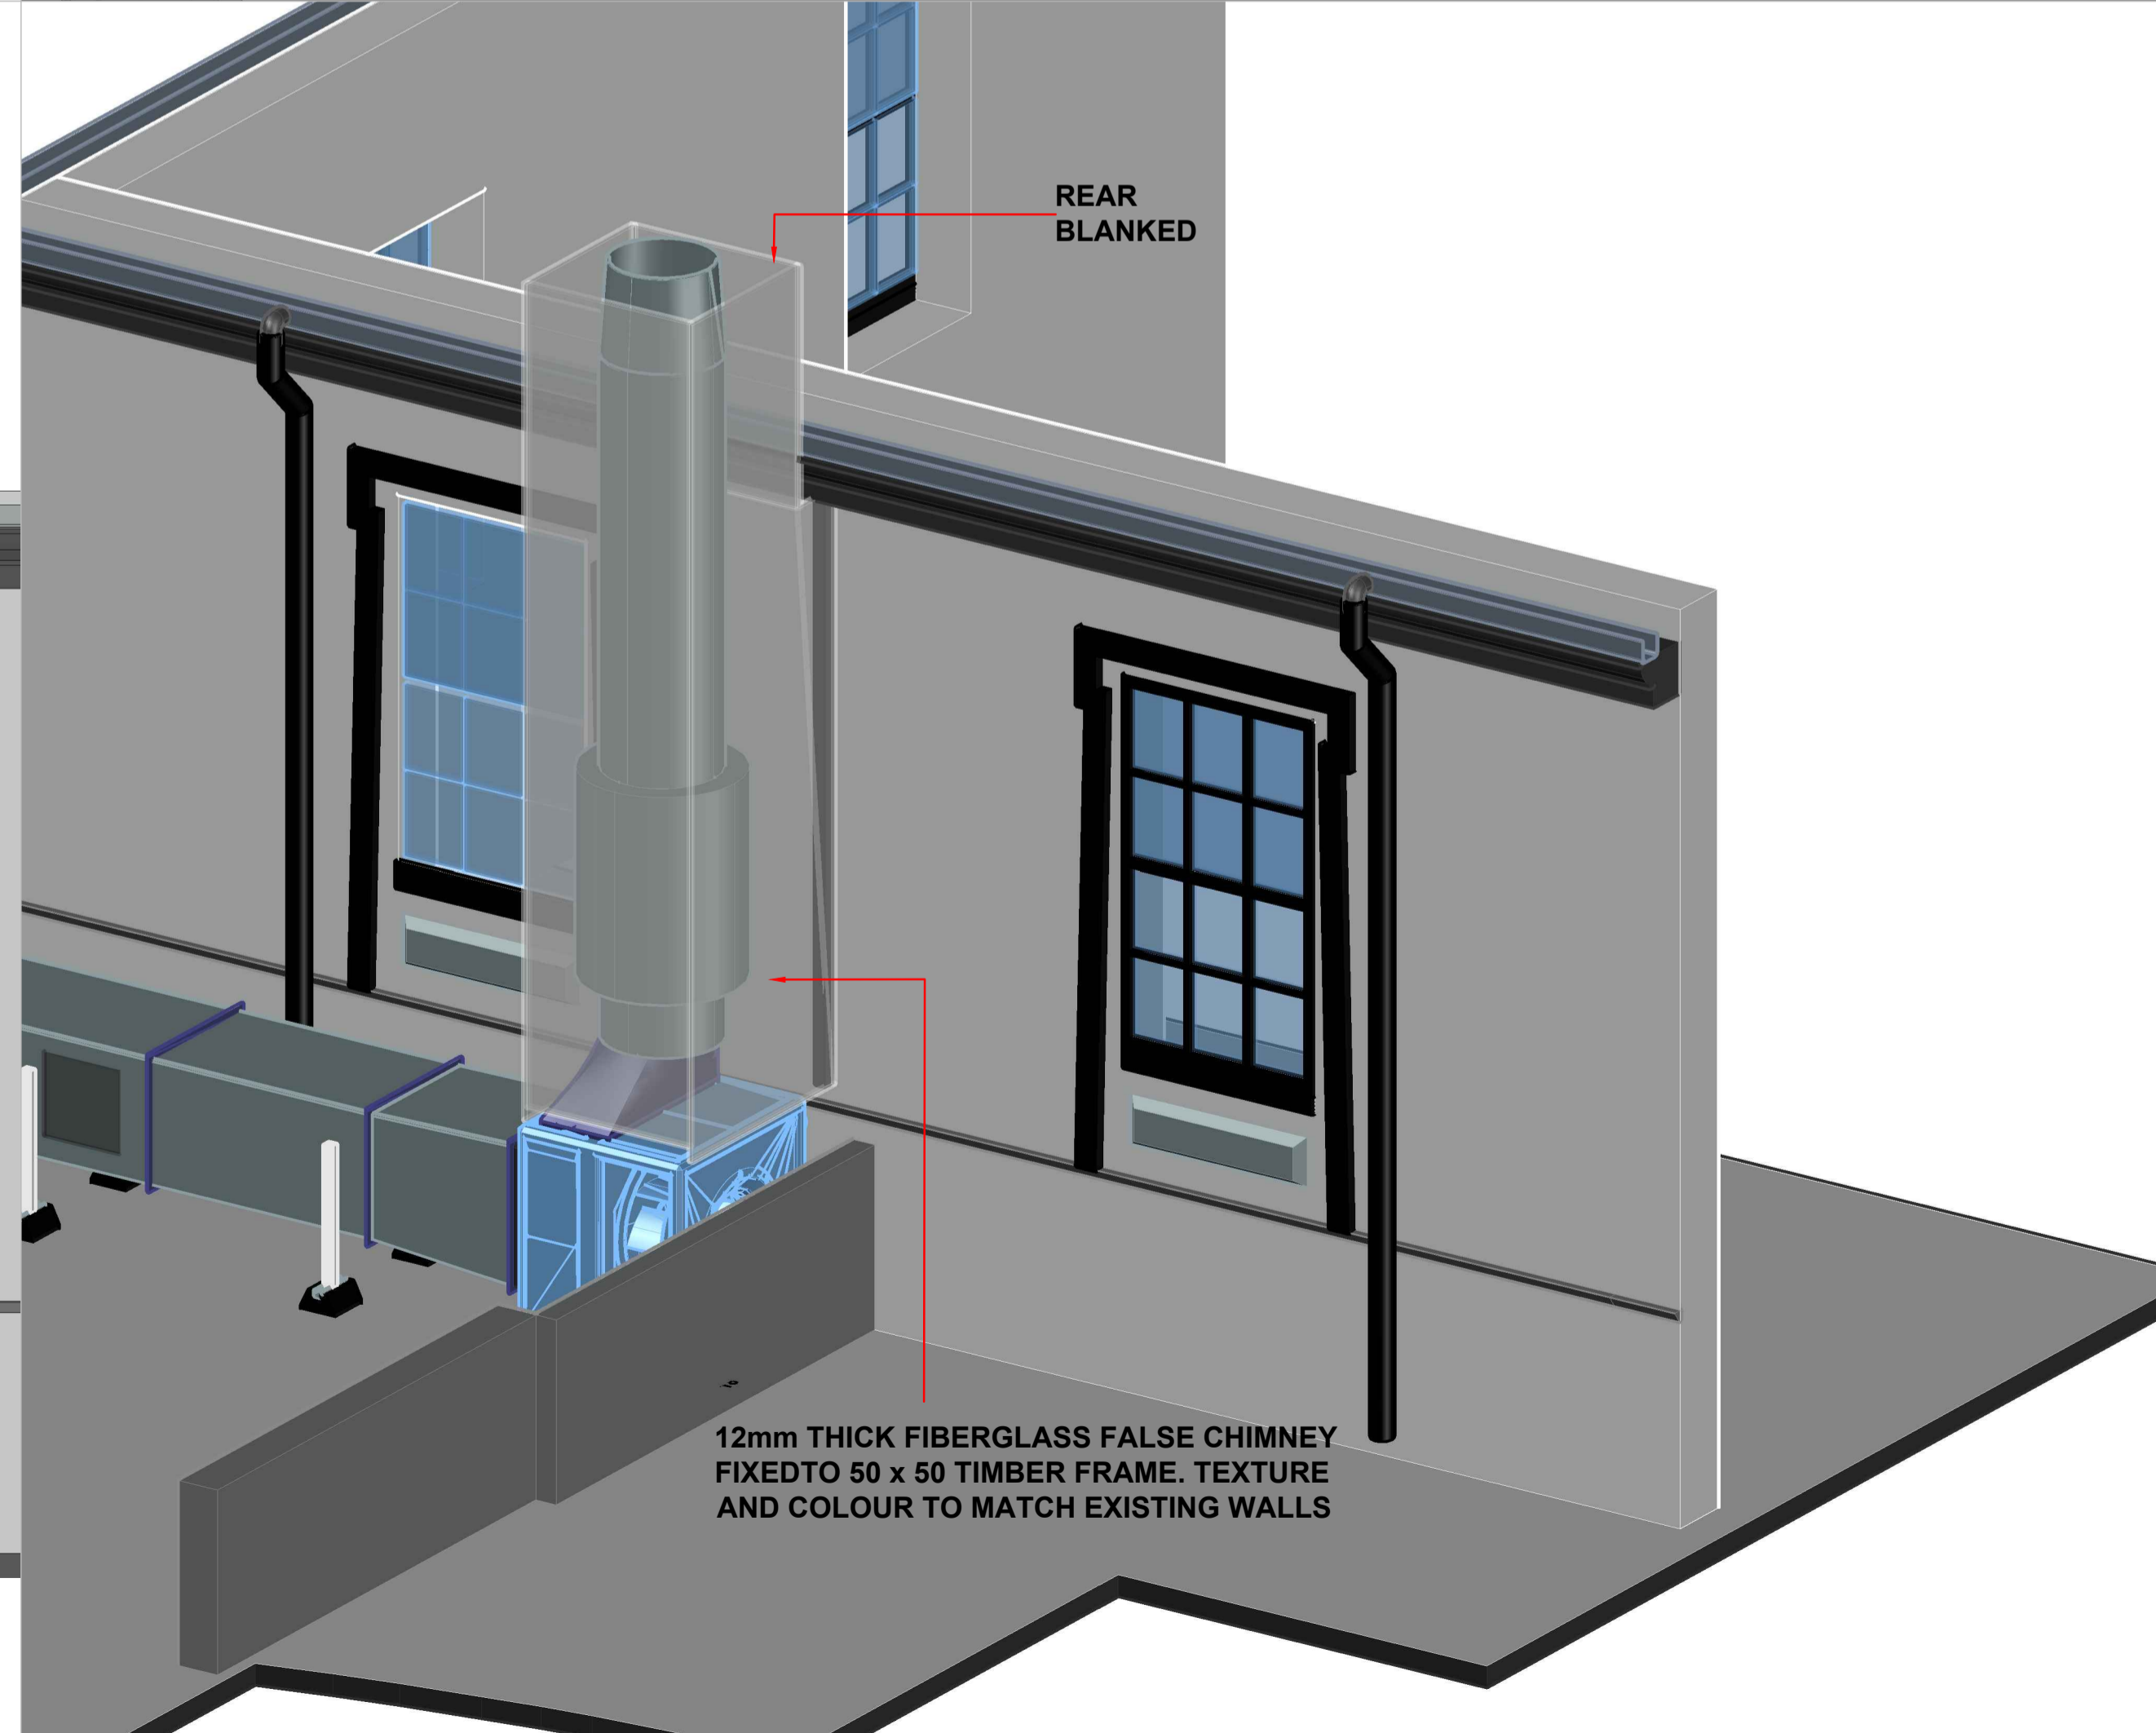

12mm THICK FIBERGLASS FALSE CHIMNEY  
FIXED TO 50 x 50 TIMBER FRAME. TEXTURE  
AND COLOUR TO MATCH EXISTING WALLS

Rev	Date	Description	By
C	21.03.23	Cornice removed from chimney cladding	LM
B	03.03.23	Cladding made smaller	LM
A	01.03.23	Issued For Approval	LM

**PLAN-IT CONTRACTS**  
CONSULTANCY AND DESIGN LTD  
29 - 30 Milk Street  
Digbeth  
Birmingham  
B5 5TR  
TEL: 0121 333 7077  
WEB: www.plan-itcontracts.co.uk  
EMAIL: info@plan-itcontracts.co.uk

Client  
Soho Tavern

Project  
Hampton In Arden

Title  
3D Model - Stack

Scale	1:25	Paper Size	A1
Date	01.03.23	Drawn By	LM
Drawing No	EQ1408-1027-05		Rev C