

## ANNEX D – Form B (Type III)

Notes: This Form is for use in connection with an application for the Secretary of State for the Department for Energy Security and Net Zero, consent under section 37 of the Electricity Act 1989 to install and keep installed above ground an electric line of a nominal voltage of less than 132 kilovolts (kV). The Form should be sent in triplicate to each District / Borough Council / Authority in whose area the proposed development would be situated.

### Details of The Applicant

Name – Southern Electric Power Distribution plc (SEPD) / Scottish and Southern Electricity Networks (SSEN) (“the Applicant”)

Address – No.1, Forbury Place, 43 Forbury Rd, Reading RG1 3JH

Phone – [REDACTED]

Email – [REDACTED] on behalf of the Applicant]

Applicant’s reference: **EZV006**

Date: 21<sup>st</sup> August 2023

### FAO The Chief Executive

### Electricity Act 1989

Dear Sir/Madam,

Application is being made to the Secretary of State for the Department for Energy Security and Net Zero for consent to the development described overleaf and detailed on the appended plan. The Secretary of State will at the same time be requested to direct that planning permission for this development shall be deemed to be granted. The consent and the direction may be given subject to conditions.

To assist the Secretary of State in determining the application the District/Council/Authority is requested to return to SSEN two copies of this Form with Part I Certificate and Part II Information & Observations completed and signed. The Department for Energy Security and Net Zero note 14D/226 describes this procedure and the reason for it. More information in that regard is available at the GOV web page - [https://assets.publishing.service.gov.uk/government/uploads/system/uploads/attachment\\_data/file/336136/section\\_37\\_revised\\_guidance.pdf](https://assets.publishing.service.gov.uk/government/uploads/system/uploads/attachment_data/file/336136/section_37_revised_guidance.pdf)

I trust the above is acceptable and look forward to receiving your response.

Yours faithfully,

Ella Scroby

**WSP Land & Property** for and on behalf of the **Applicant**

**PART I**  
**CERTIFICATE**

(to be completed by or on behalf of the District/Borough Council/Authority)

- The .....
- (iii) \*object on the grounds set out below/have no objection to make to the development described overleaf;
- (iv) \*request/do not request that a public inquiry be held pursuant to paragraph 2 of Schedule 8 to the Electricity Act 1989 before the Secretary of State reaches his decision on the application.
- \*Delete as appropriate**

**Dated**

**Signed**

**Designation**

On behalf of .....

## **PARTICULARS OF PROPOSED DEVELOPMENT AND REPRESENTATIONS**

(to be completed by the Applicant)

Application is being made:

- (c) for consent under Section 37 of the Electricity Act 1989 to install or keep installed an electric line above ground;
- (d) for a direction under section 90(2) of the Town and Country Planning Act 1990 that planning permission for the proposed development be deemed to be granted.

### **1. Particulars of proposed development -**

SSEN have received a connection request from a customer for a new supply at New Site, The Flat, Brookeswood Farm, Loperwood Lane, Southampton, SO40 2RR. SSEN are seeking a Section 37 for the existing line back to the Brookwood Farm S/S PMT.

The request is for approximately 20m of overhead line from an existing wood pole to provide a supply to the customer's property. The existing pole stands within the customers land boundary and currently supplies the property known as 3A Southernwood.

The customer's proposal is to install an overhead supply from the existing overhead line, from which there is already one existing overhead supply, the property will therefore have two supplies and is not exempt from Section 37 of the Electricity Act 1989 under The Overhead Lines (Exemption) (England and Wales) Regulations 2009.

### **2. Particulars of any representations or objections which have been made to the Applicant -**

N/A as part of the overhead line is existing. New apparatus only visible to customer.

### **3. Particulars of the Applicant's compliance with the duty under Paragraph 1 of Schedule 9 to the Electricity Act 1989 -**


Part of the overhead line is existing. Any visual impact on the area by the proposal/proposed route is broken up by existing buildings/hedges/trees.

**Date** 21<sup>st</sup> August 2023

**Signed**

**Designation** Land Consultant

(on behalf of the Applicant)



**PART II**

**INFORMATION AND OBSERVATIONS**

(to be completed by the District/Borough Council/Authority)

Planning Reference Number –

1. Names of interested parties consulted as to the proposals with details of any observations received.
  
2. Particulars of any representations which have been made to the relevant planning authority objecting to the proposals.
  
3. Have any general or specific restrictions been imposed by any authority on development of the land affected by the proposed development?
  
4. Does the proposed development involve the demolition, alteration or extension of a building of special architectural or historic interest included in a list compiled or approved under section 1 of the Planning (Listed Buildings and Conservation Areas) Act 1990?
  
5. Does the relevant planning authority agree that the proposed development should be approved by the Secretary of State for Energy and Climate Change as described? (If the answer is no, please answer question 6)
  
6. Would the relevant planning authority be prepared to agree that the proposed development should be approved subject to modifications or conditions? (If so, specify the modifications or conditions proposed and state whether they are acceptable to the applicant). (Note: the precise form of any modifications or conditions subject to which the consent or direction is given is a matter for the Secretary of State, who will however have regard to the form of words used)
  
7. Does the relevant planning authority consider that the application should be accompanied by an environmental statement in accordance with the Electricity Works (Environmental Impact Assessment) (England and Wales) Regulations 2000? (If so, please specify the particular points arising from the application which have caused the local planning authority to take this view).

**Date**

**Signed**

**Designation**

On behalf of the .....

(Local Planning Authority (LPA) for the area in which the proposed development is to be carried out)

Two completed copies of this Form, both signed, should be returned to the Applicant for submission to the Department for Energy Security and Net Zero.



Map Centre: 433551, 115511

Grid Ref: SU33551551

Scale: 1:1250

Page Size: A4

Plot Date: 18/08/2023

Designer Name: Ella Scroby

Job Number: EZV006

### [INDICATIVE PLAN ONLY]

#### Key


Proposed overhead connection shown by a dashed red line.

Existing overhead line shown by a solid red line.

Existing poles shown as red circles.

Existing stays shown as a red "T".

SSEN's customers boundary shown edged blue (HMLR Title HP256651 and HP619756).

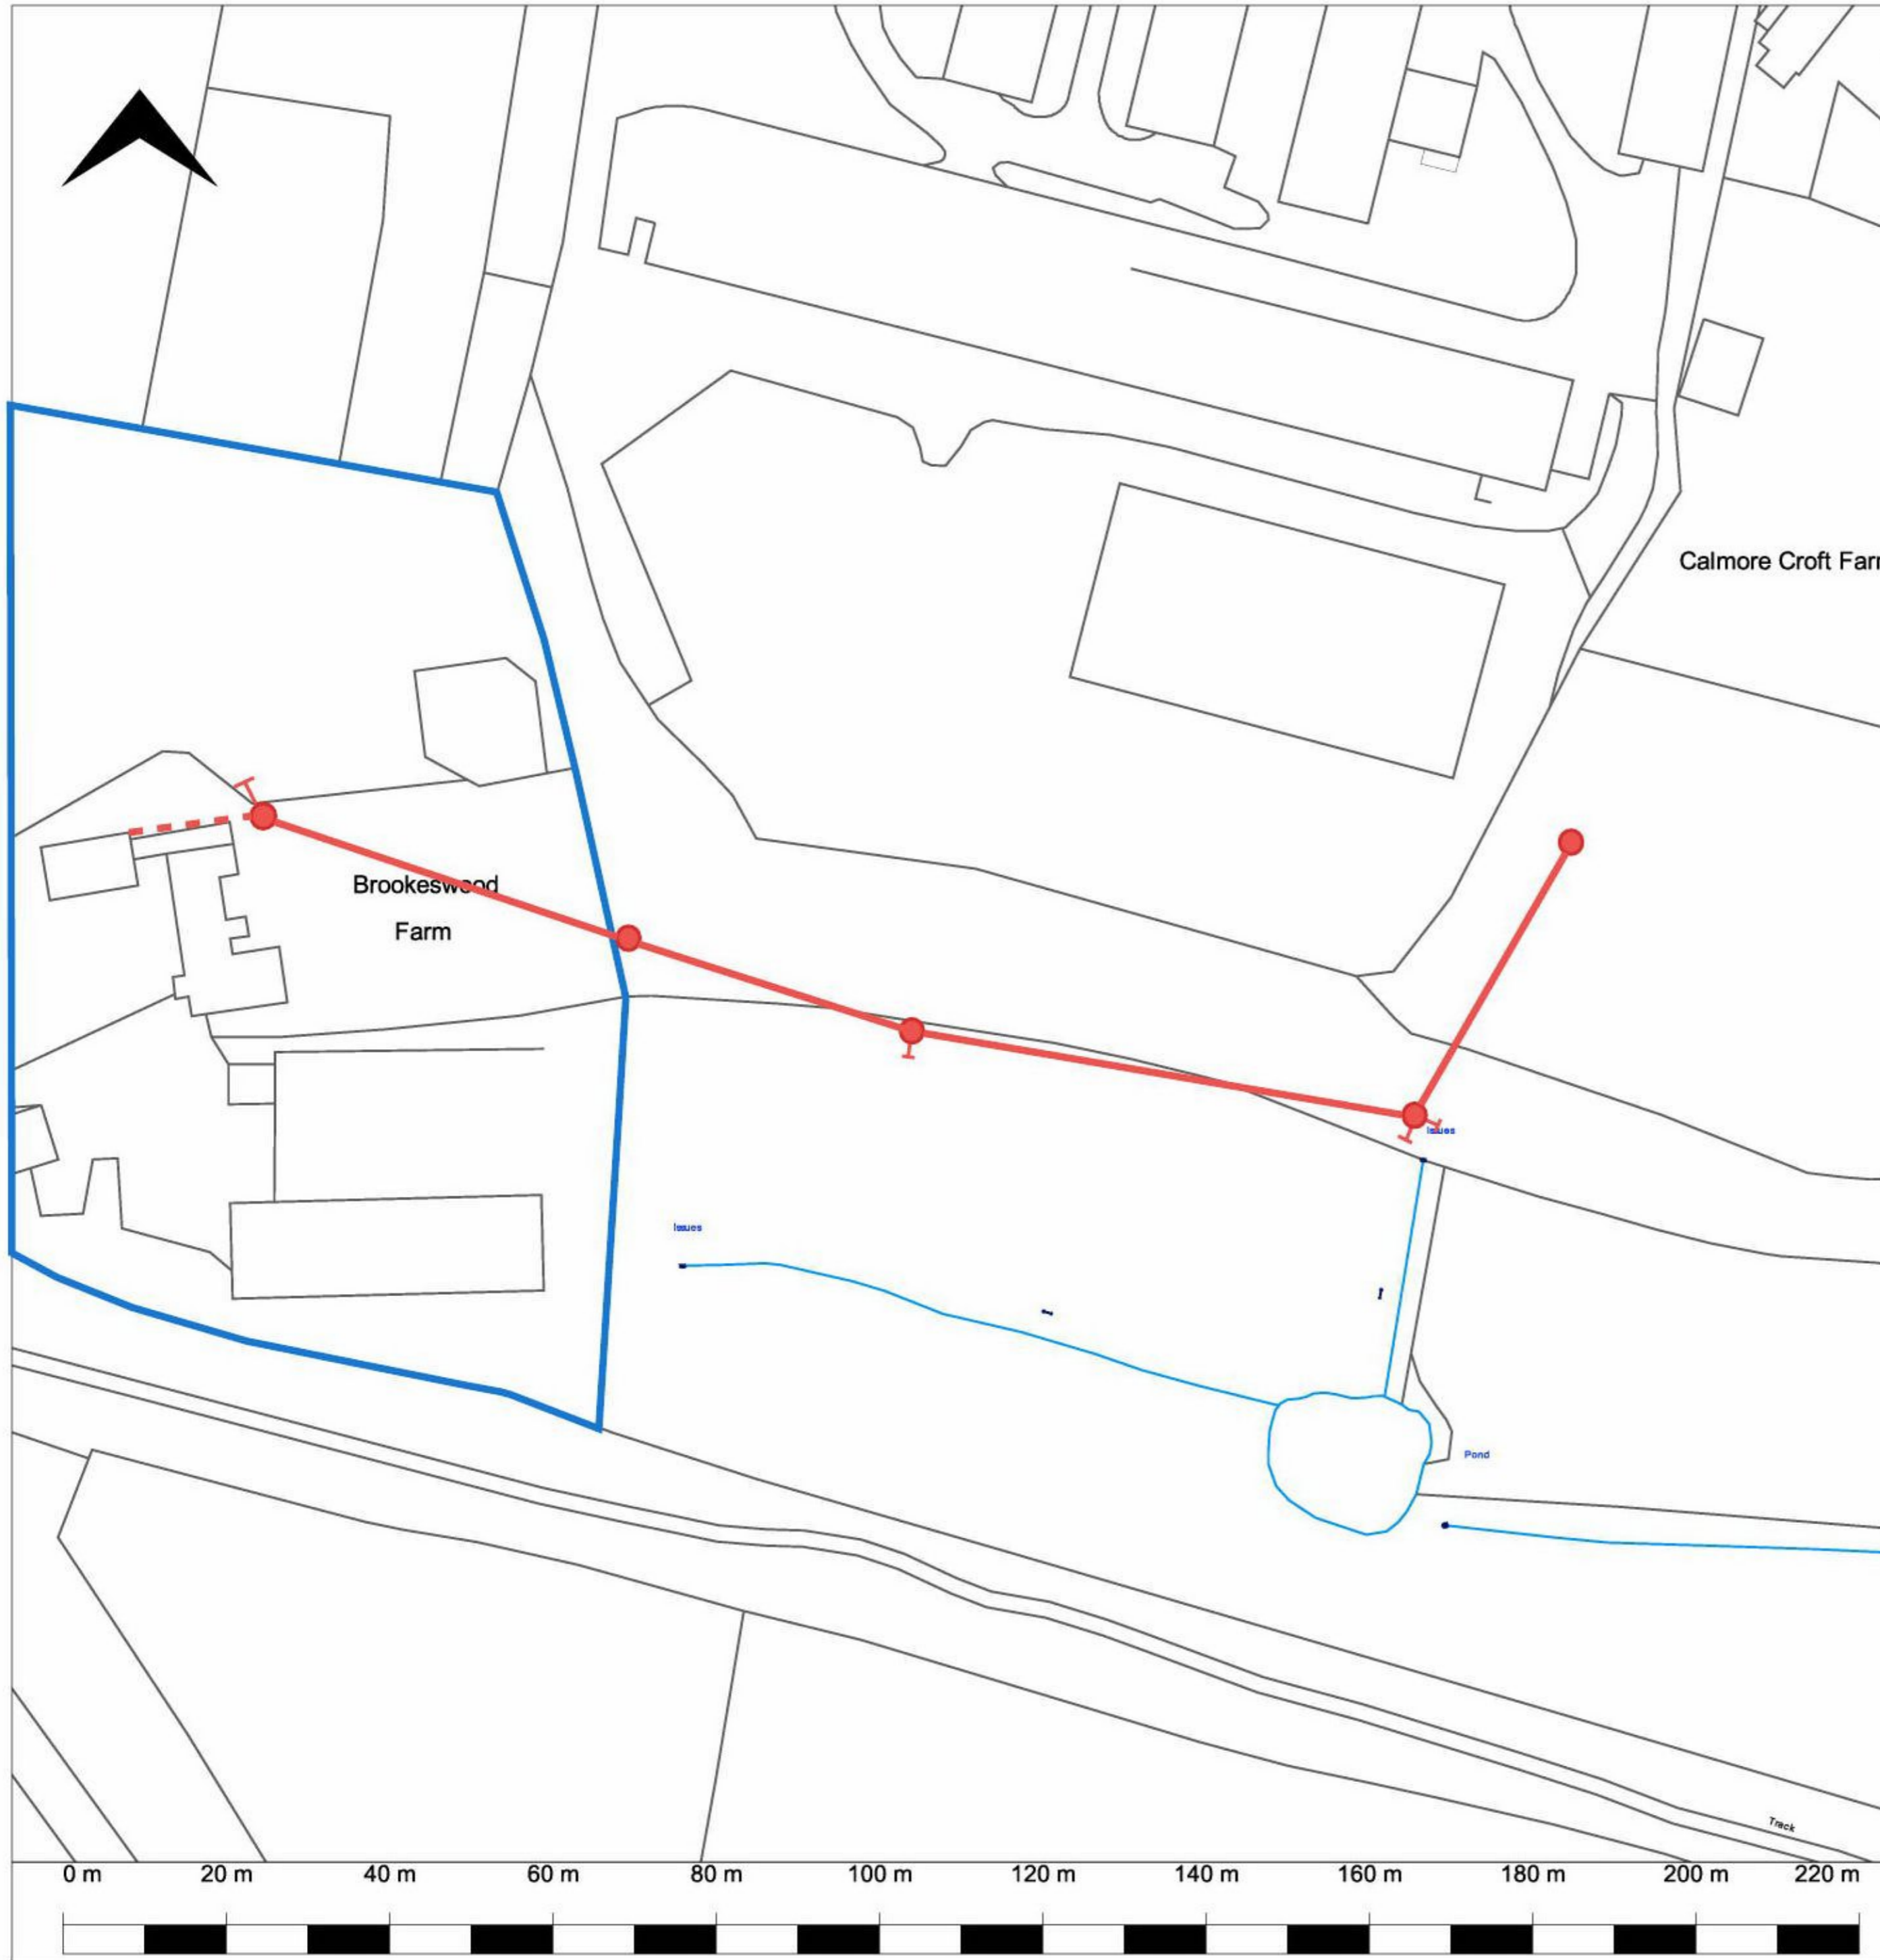

### WARNING

There may have been subsequent alterations to the surface levels. Trial holes must be taken to determine positions and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work.

**WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTE GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)**

If you are unsure & need to seek advice before commencing excavations please contact;

General Enquiries

0800 048 3516

Southern Electric Power Distribution plc  
Registered Office: No.1 Forbury Place  
43 Forbury Road Reading RG1 3JH  
Registered in England & Wales No.04094290

Subject to revision - Master held by SSEN Distribution Asset Data Team:  
Asset.Data@sse.com 01256 337 294

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF  
H.M STATIONERY OFFICE CROWN COPYRIGHT RESERVED.

This copy has been made by or with the authority of Southern Electric Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner. Plans generated by DigSAFE Pro(TM) software provided by LinesearchbeforeUdig.