


PROPOSAL

NOTE: DO NOT SCALE OFF THIS DRAWING.
ALWAYS WORK TO NOTED DIMENSIONS

LOCATION PLAN:

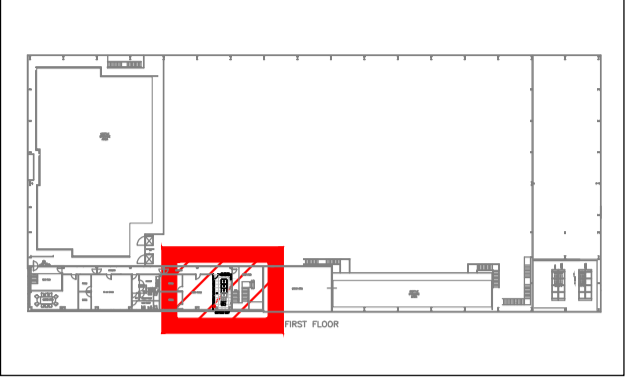

LEGEND:

MEDIUM DUTY CABLE TRAY - REFER TO DRAWING FOR SIZE OF TRAY

NOTES:

- ALL CABLE LENGTHS ARE TO BE CHECKED AND MEASURED ON SITE BEFORE ORDERING.
- WHERE SITE MEASURED CABLE LENGTHS EXCEED THE DESIGN LENGTHS PROVIDED, PLEASE INFORM THE ELECTRICAL DESIGN TEAM ASAP IN ORDER TO REVALIDATE THE DESIGN.
- WHERE ELECTRONIC TRIP UNITS ARE TO BE USED, PLEASE REFER TO THE BREAKER SETTINGS SCHEDULE FOR MCCB MODEL NUMBERS AND BREAKER SETTINGS.
- WHERE DESIGN DISCREPANCIES EXIST, THE INFORMATION CONTAINED WITHIN THE PROVIDED AMTECH DOCUMENTATION SHALL TAKE PRECEDENCE.
- DISCREPANCIES SHOULD BE HIGHLIGHTED TO THE ELECTRICAL DESIGN TEAM AS SOON AS IDENTIFIED TO ALLOW DESIGN/AS FITTED INFORMATION TO BE UPDATED.
- PLEASE REFER TO MANUFACTURERS DATA FOR REQUIRED TORQUE SETTINGS.
- ALL SWA CABLE GLANDS TO BE CW TYPE.
- FOR CABLE DETAILS OF SUBMAIN CABLING PLEASE REFER TO CABLE SCHEDULE.
- FOR CABLE DETAILS OF FINAL CIRCUITS PLEASE REFER TO DISTRIBUTION BOARD SCHEDULE.
- WHERE CONTAINMENT IS INSTALLED INTERNALLY IT SHALL BE OF HOT DIPPED PRE-GALV CONSTRUCTION IN ACCORDANCE WITH BS EN 10346.
- NEW CONTAINMENT SHALL COORDINATE WITH ALL NEW AND EXISTING SERVICES.
- THE ELECTRICAL INSTALLATION SHALL BE DESIGNED, CONSTRUCTED, INSTALLED AND TESTED IN ACCORDANCE WITH THE 18TH EDITION AMENDMENT 2 OF THE IET WIRING REGULATIONS BS 7671 "REQUIREMENTS FOR ELECTRICAL INSTALLATIONS"
- EXTERNAL LADDER RACK SHALL HAVE LIDDING FITTED THROUGHOUT IT'S LENGTH

P01	PROPOSAL ISSUE	14/07/23	SE	AG
REV	DESCRIPTION	DATE	BY	CHK

SUDLOWS
working at the core of your business

SUDLOWS LIMITED
DUCIE WORKS
HULME HALL LANE
MANCHESTER M40 8HH

TELEPHONE: 0800 783 5697
FAX: 0161 205 0295
EMAIL: CAD@SUDLOWS.COM
WWW.SUDLOWS.COM

Client:



Site:

BELLSHILL

Status: PROPOSAL Scale: 1:25


Date Created: 12/07/23 Drawn By: SE Sheet Size: A1

Drawing Title:

CONTAINMENT LAYOUT
DC2
FIRST FLOOR

Project No.: PR85150 Suitability: S3


Drawing No.: SUD-XX-01-DR-E-5001 Rev: P01

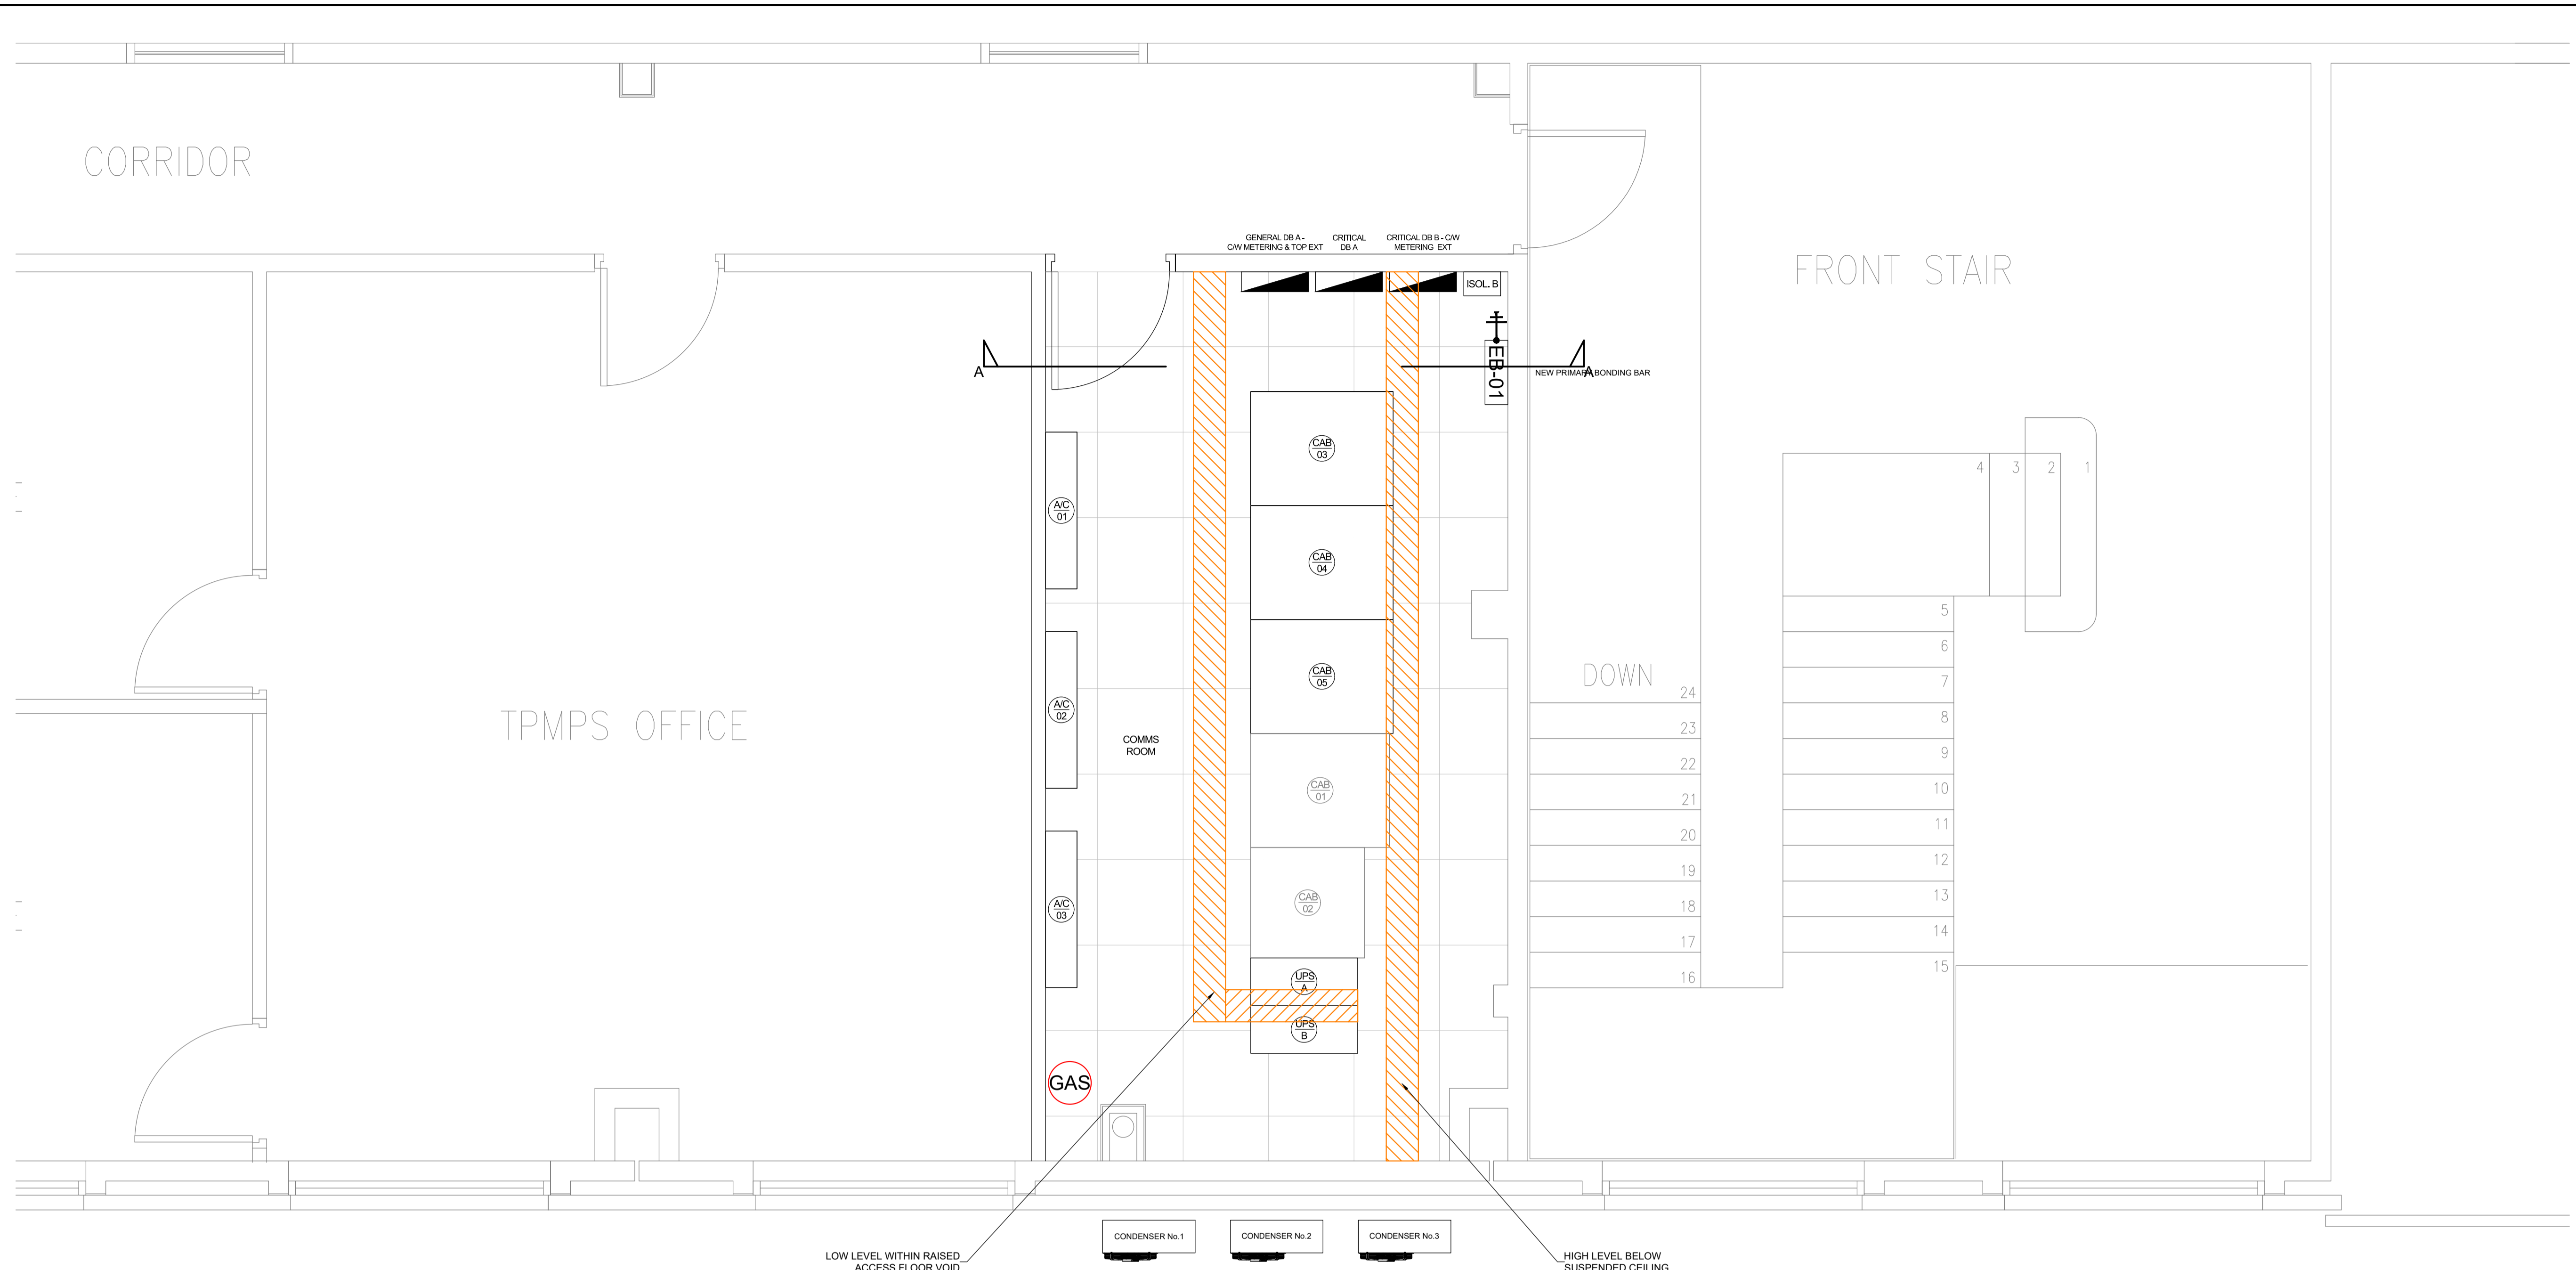

LOW LEVEL WITHIN RAISED ACCESS FLOOR VOID

CONDENSER No.1 CONDENSER No.2 CONDENSER No.3

HIGH LEVEL BELOW SUSPENDED CEILING

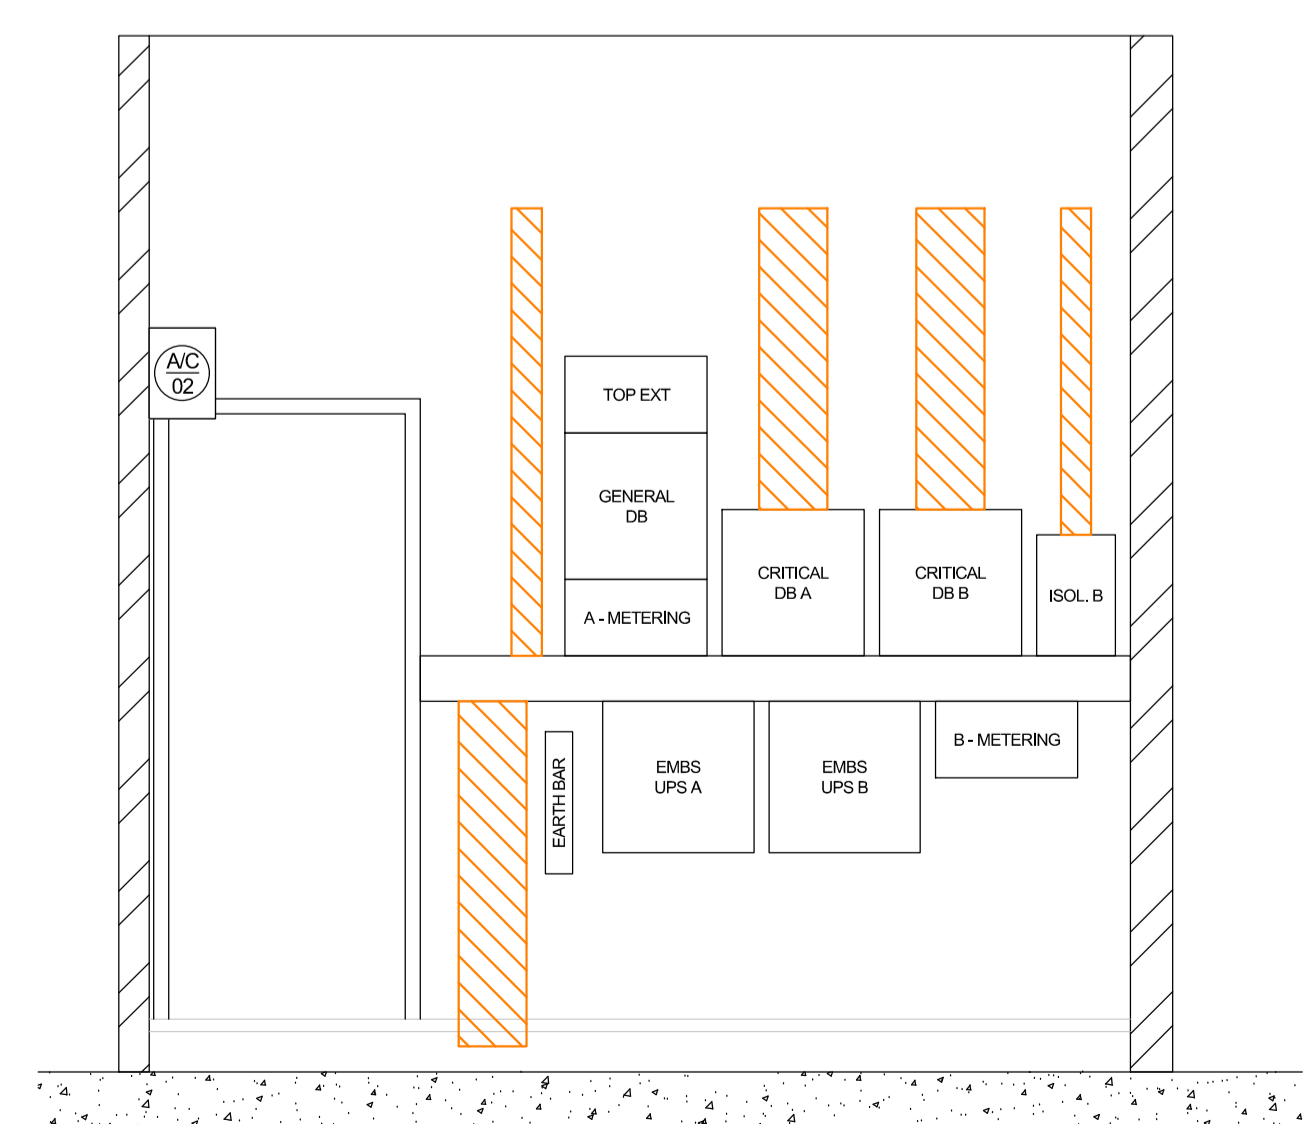

SECTION A-A
SCALE: 1:25