


## Proposed floor plan

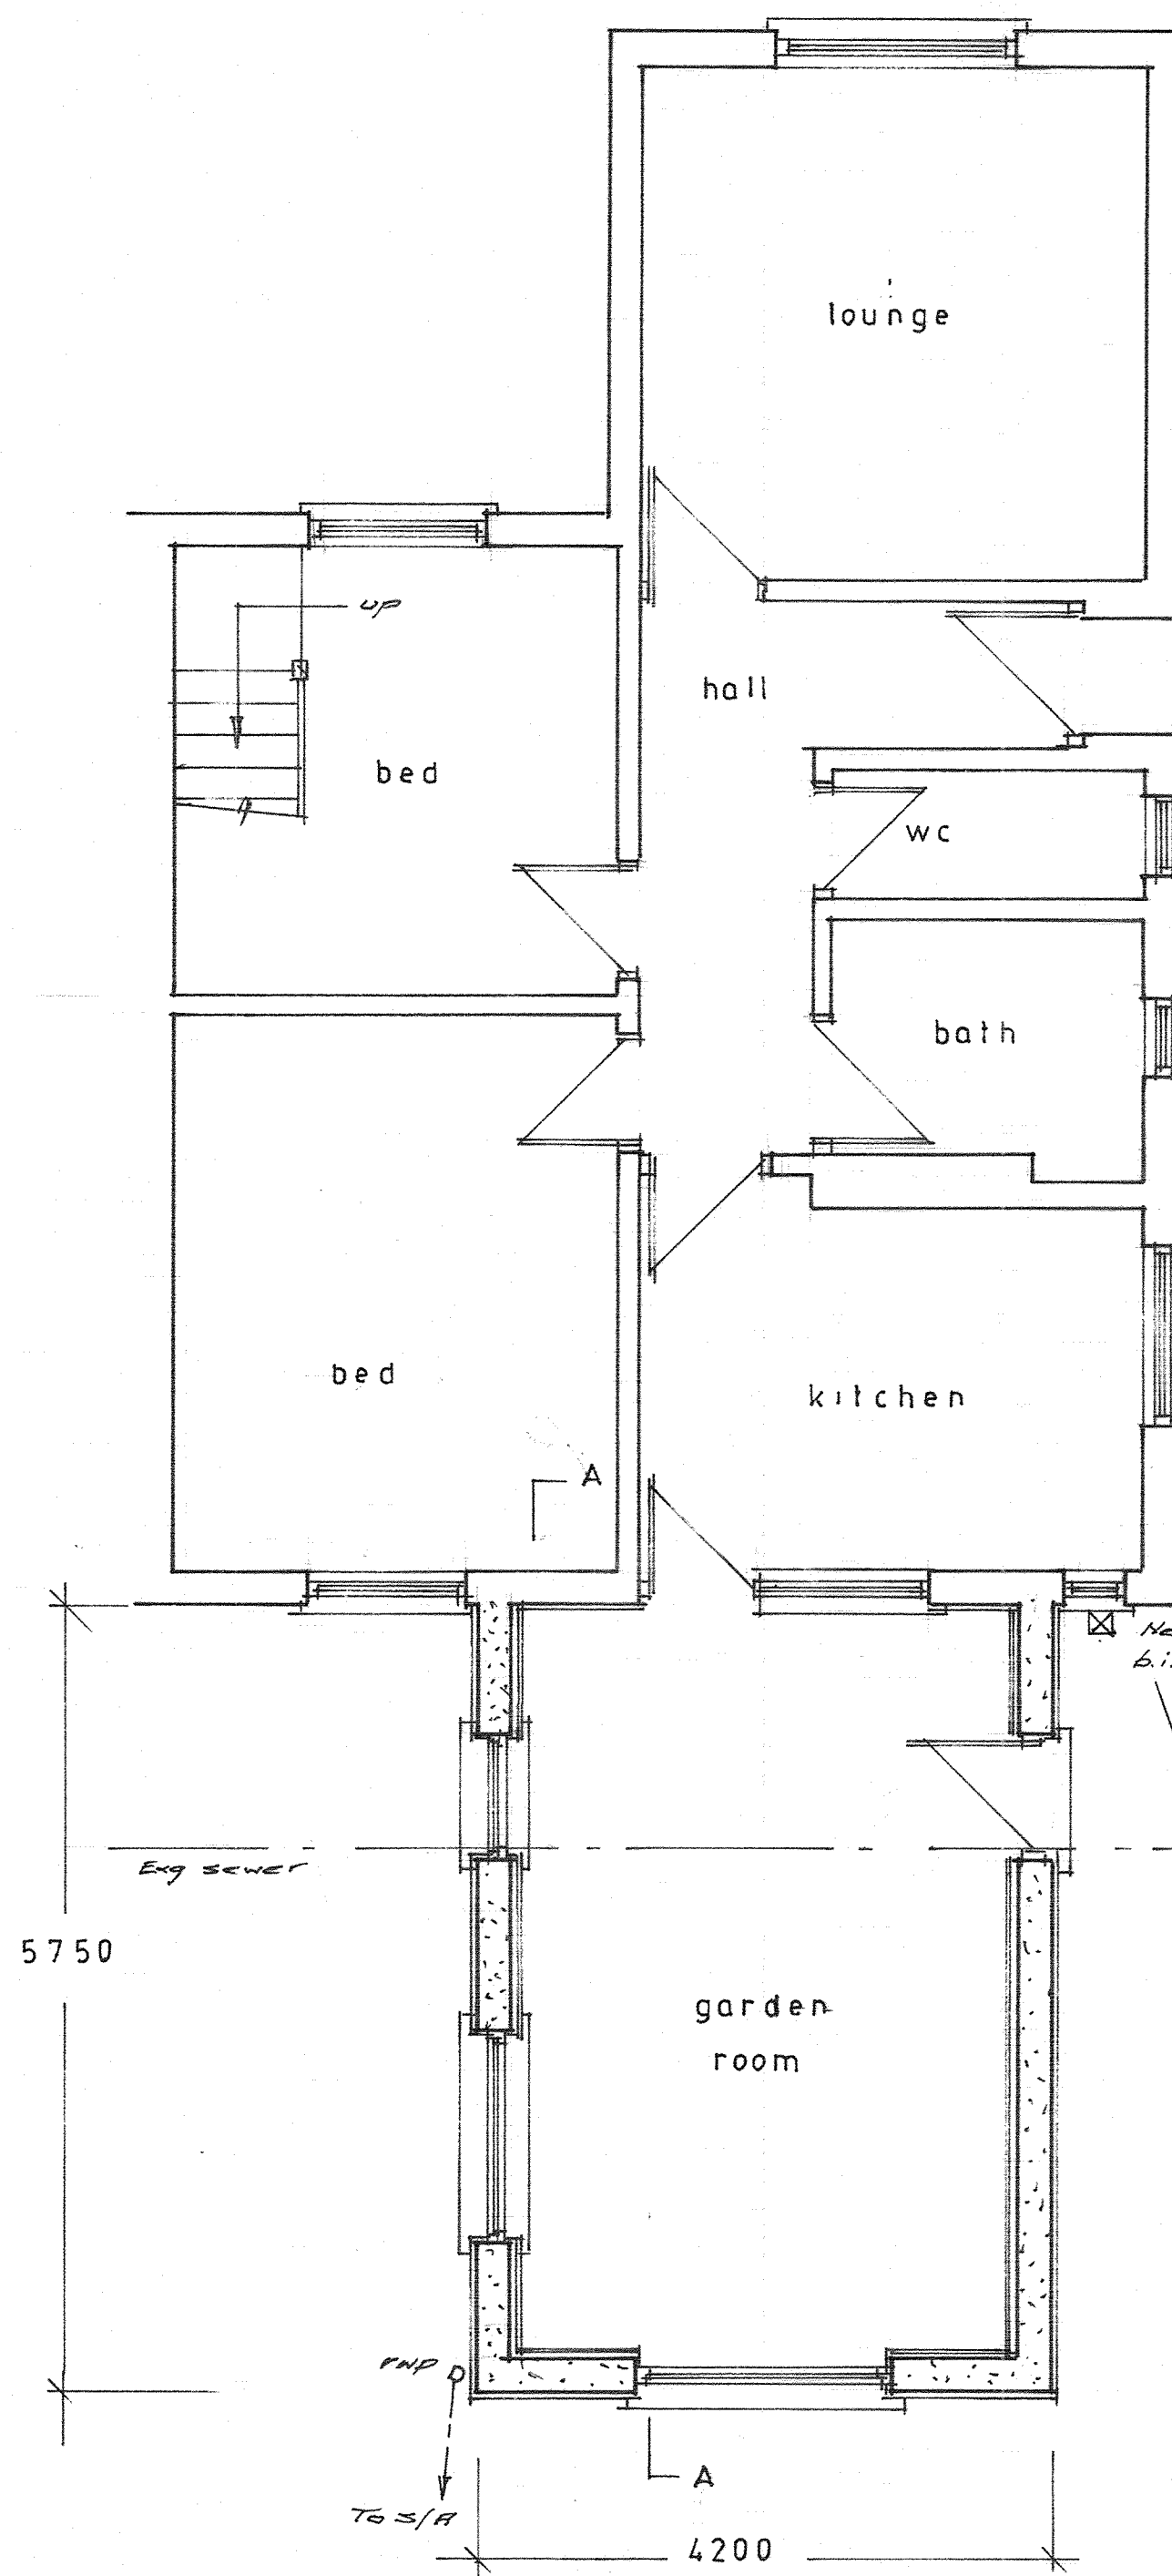

**External Walls** to be of 215mm conc. blocks laid in 1:3cm below DPC 'Hyload' DPC connected to exg. & min. 150mm a.g.l. above DPC walls of 215mm Celcon Solar blocks, plastered internally. Blocks laid in 1:1:6 gm in stretcher bond with E.M.L. in every 3rd course, between windows and below windows within a 45 degree angle. New work bonded to exg. at junctions with s.s. profiles. Walls sealed externally and rendered with 1:1:6 render with drip above DPC. Internally, walls lined with 80mm Kingspan Kooltherm K112 insulated plasterboard on 25mm battens & 3mm skim. Windows bridged with catnic insul. Lintels with min. 150mm end brgs. Windows double-glazed with glass area min. 10% floor area, openable area min. 5% floor area. Render to be 20mm thick, 2 coat finish.

**Movement Joints** to be formed of Flexcel or similar boarding with masonry either side tied together with flexible ties. Joint to be masked internally and with a waterproof mastic sealant externally. Joints to be min. 1mm thickness per metre run + 30%.

**Roof Structure** formed with timbers to sizes & ccs shown. Joists hung on walls in galv. m.s. hangers & set on 100 x 50mm s.w. wallplate on new walls. Solid strutting at mid-span. All strapped to walls with 30 x 50mm galv. m.s. straps at 1200 ccs, plugged and screwed. S.w. firings set on joists to give 1 in 80 fall with 50 x 50mm s.w. cross battens & 22mm ext. ply deck. 100mm PIR insulation between roof joists & 65mm PIR below & 500 gauge polythene vapour barrier stapled to u/s of joists to form 'cold roof'. 37.5 PL400 boards below joists, taped & skimmed. 19mm ext. ply fascia set.

**Rainwater Disposal** by means of 100mm dia. uPVC gutters fixed to falls to fascias with stop-ends & outlet to 63mm dia. r.w.p., connected at base to b.g. & run via drain to new brick stein S/A min. 5m from buildings.

**Cavity Walls - Full Fill:** To achieve minimum 'U' value of 0.28W/m<sup>2</sup>K. Provide 100mm block outer skin (as below) 100mm cavity with 90mm Celotex Thermaclad 21 insulation & 100mm lightweight block K value 0.11. Internal finish 13mm lightweight plasterboard on dabs. Walls to be built with 1:1:6 cement mortar. Wall ties to be at 450mm vertical centres. Cavity to be carried min. 225mm below DPC.


**Windows and Doors** to be double-glazed uPVC framed units with draught strip to all openers. Glazing to be in safety glass where appropriate and locks on all openers and doors. Sealed units to have overall width of 28mm with min. 20mm Argon filled gap and Low-E aluminium soft coated glass. Average U values to be 1.2W/m<sup>2</sup>K for windows and 1.0W/m<sup>2</sup> for doors. Background vents to be min. 1.75m<sup>2</sup> all. Habitable rooms and Kitchen windows to have min. width 450mm escape casement with min. o/a area of 0.33sq M. Vent to Bedroom to be min. 8000mm sq and to Bathrooms 4000mm sq.

**New Solid Floor** formed of min. 150mm thick, well rammed, broken brick hardcore, blinded with 50mm sand. 100mm thick 1:2:4 conc. slab. Marley 'Dampseal' DPM connected to exg. & new DPC's min. 1200g 100mm dia. PVC air-ducts built in as necessary to vent. exg. timber floor. Floor to have 100mm Kingspan K103 PIR insulation & 65mm 1:4 c.s. screed. Perimeter insulation upstands & separating membrane.

**Public Drainage** Exg MH on sewer to be removed & exg drain made good in full round clayware. Existing sewer to be surrounded in 150mm thick pea shingle & bridged where passing through foundations with RC lintels. Foundations to be kept min. 600mm clear of exg sewer. New drain branch connections to sewer to discharge in direction of flow of sewer. New MH formed externally of extension with drain for rodding connected to main sewer.

**Exg. Drains** Where becoming internal to be surrounded in 150mm pea-shingle & bridged where passing through structure with r.c. lintels with Flexcel between drain & lintel.

**New Drains** to be of 100mm dia. Supersleeve, laid to 1 in 40 falls & run as shown, with 150mm thick pea-shingle bedding. Where internal, new drains to be encased as for exg. (i.e. surround in 150mm pea-shingle). Bridged with 2 no. 100 x 150mm r.c. lintels.

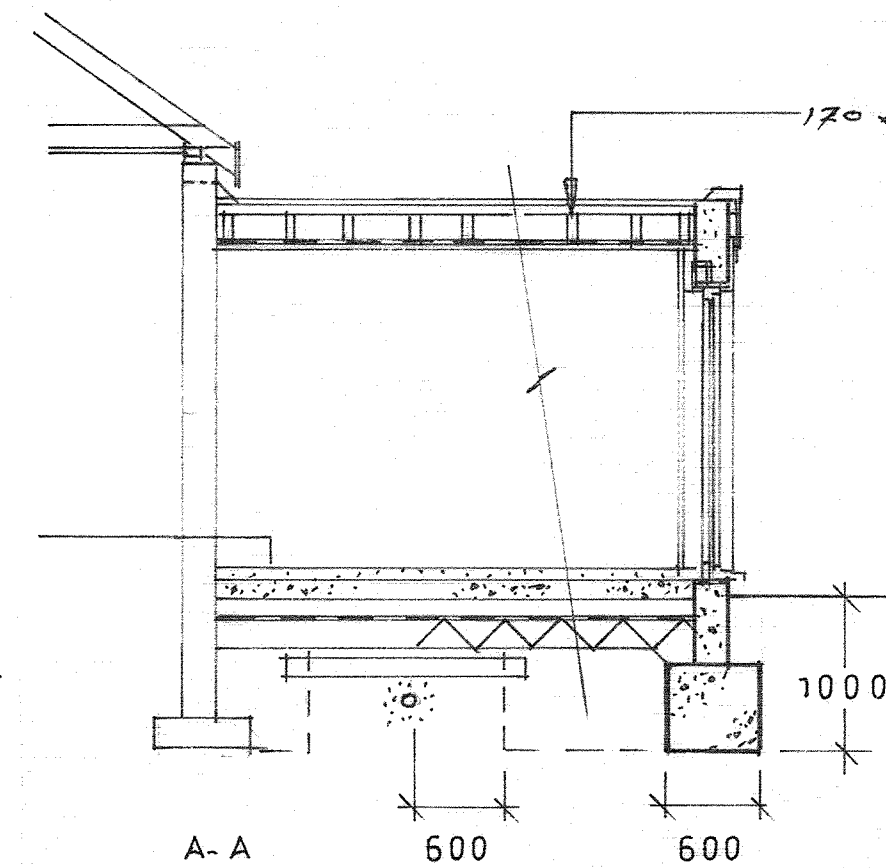

**Foundations** to be formed to sizes & depths shown & agreed on-site with B.C.O. to suit prevailing soil conditions. All in 1:2:4 conc.

**Electrical:** All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a competent person registered under a competent person self-certification scheme such as BRE Certification Ltd, BSI, NICEIC Certification Services or Zurich Ltd. An appropriate BS 7671 Electrical Installation Certificate is to be issued for the work by a person competent to do so. A copy of a Part P Certificate will be given to the Council.


**Lighting:** to new rooms to be provided with min. 1 no. light fitting with luminous efficacy of n.l.t. 40 lumens / circuit watt. 1 fitting / 25m<sup>2</sup> & 75% of fittings to be low energy.

**Ventilation** to rooms as follows:- Habitable Rooms:- 10,000 sq mm background ventilation. Kitchens:- 4000 sq mm back. vent & ext. fan to extract 60 litres/sec. Bathrooms:- Ext. fan 15 litres/sec. 10mm gap left under bathroom door. W.C.-0 Ext. fan 3 air changes/hour & 15 min. over-run, light switch operated. Utility room 30 litres/sec. extraction. All fans ducted to external air.


Exg. central heating system to be extended into extension with pressed steel radiators, TRV's & insulated pipework. If boiler position to be changed new positioning to be decided by Gas Safe registered engineer.

Existing Proposed


## Block plans

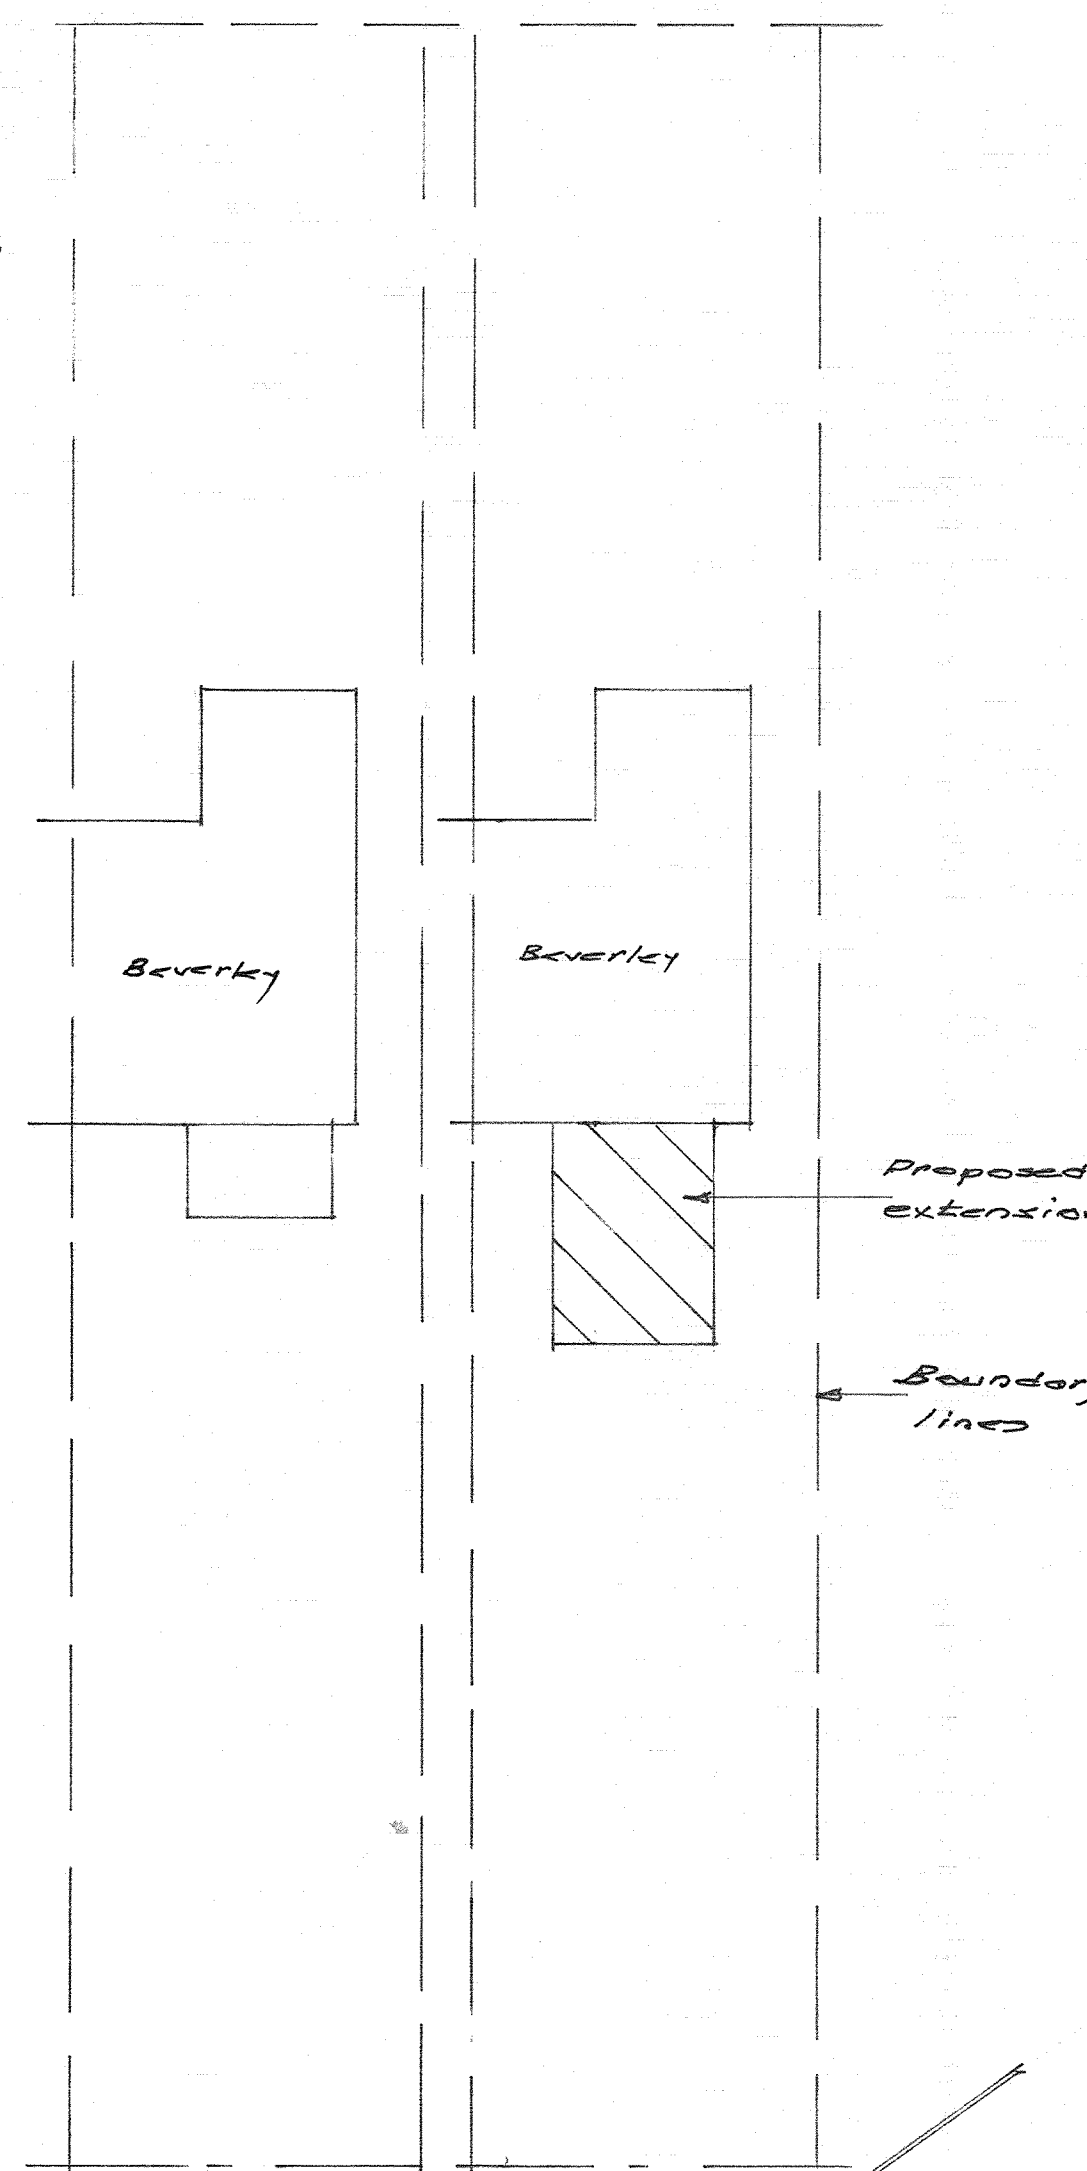


## Scale Bars (m)

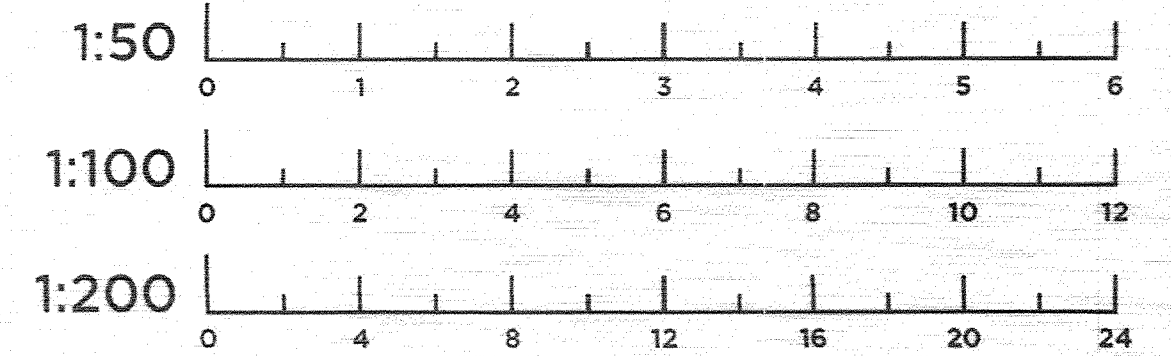

## Roof plans

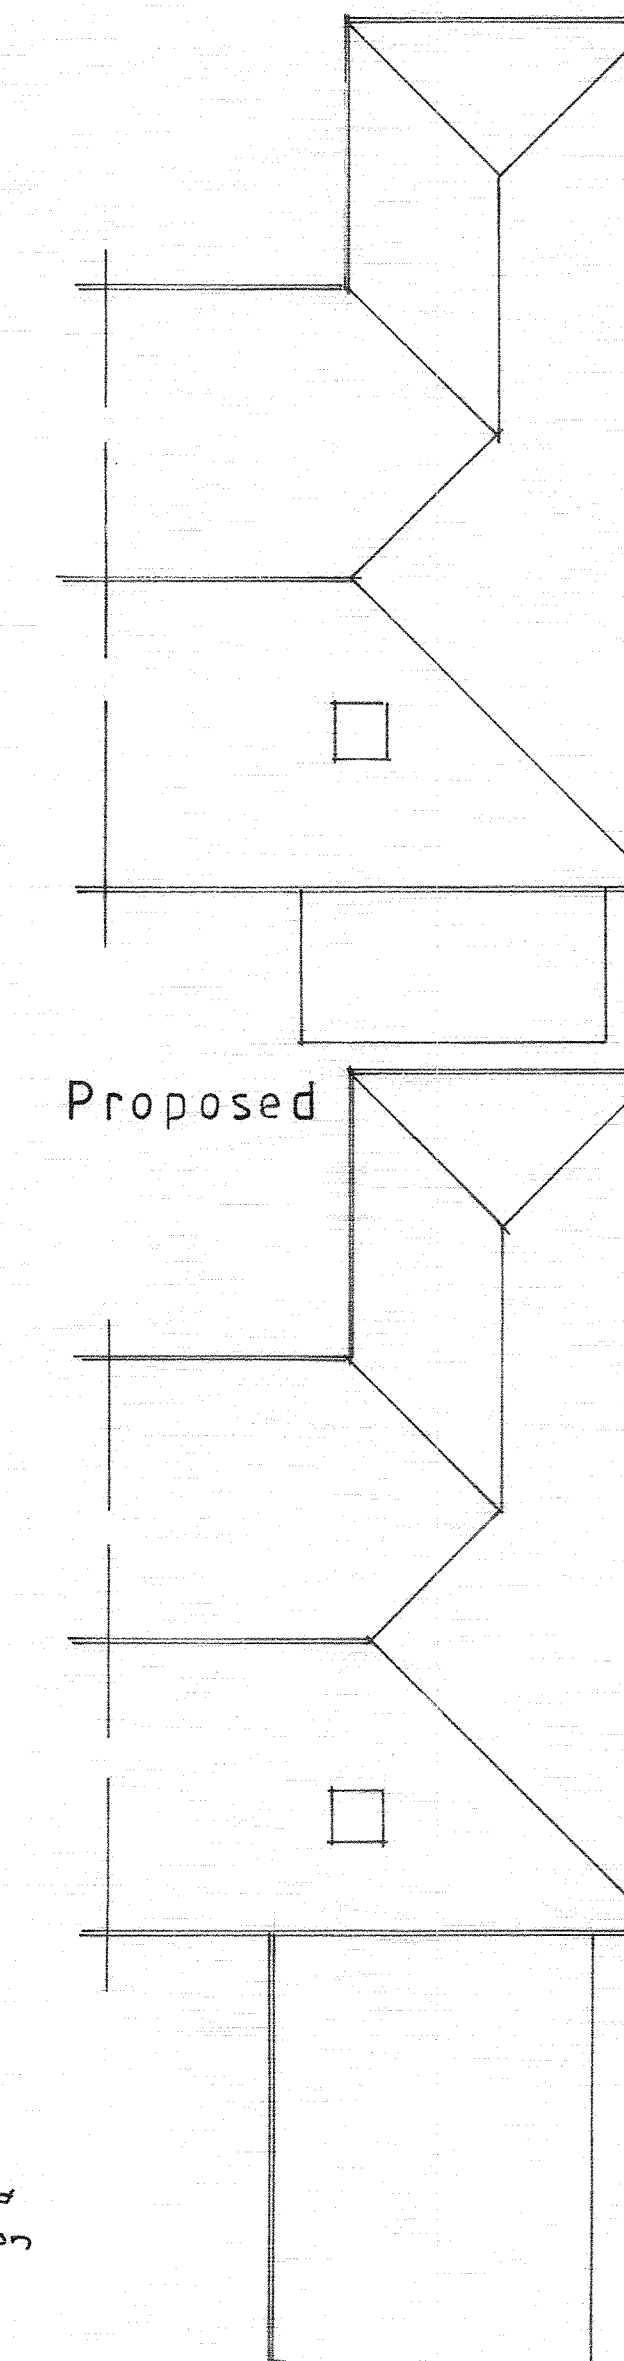

## Exg floor plan

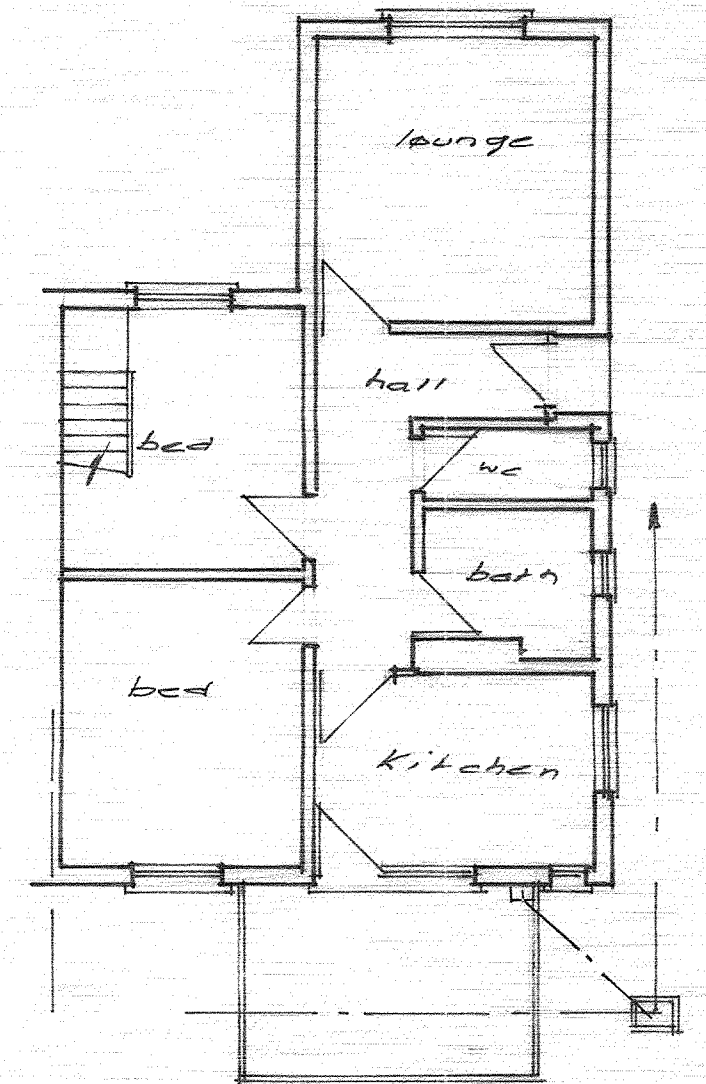

**Standard Items**  
Prior to commencement of work contractor and client to confirm exact boundary positions. Contractor to inform architect of any anomalies between plans and elevations/section prior to start of work. Any key elements of the existing structure such as foundations and/or lintels, which by virtue of the proposed works, will be accepting greater loadings will need to be exposed for consideration by the building control surveyor and upgraded or replaced if found necessary. All measurements are to be checked on site prior to ordering any materials. The Party Wall Act 1996 must be adhered to wherever relevant. It is the client's responsibility to seek expert advice from a professional party wall surveyor to ensure full compliance with the regulations. Water board agreement must be provided in writing when necessary, prior to commencement of works. Heating, lighting and internal finishes are to be agreed between the owner and chosen builder. All structural timber members are to be grade c24 treated softwood marked KD (kiln dried) or dry to ensure the timbers have been properly stored. All leadwork should be fixed and installed in accordance with the Lead Development Associations Handbook - 'Lead Sheet Building - A Guide to Good Practice'.

## PLAN & SURVEY LTD BUILDING SURVEYORS

25 Alton Close, Bexley, Kent DA5 3JQ  
Mike Course  
Email: planandsurvey@btinternet.com Mobile: 07767 881 391


Client  
Mr N. Woolger

Job Title  
'Beverley' Mill Hill,  
Edenbridge, Kent.  
TN8 5DQ


Drawing Title  
Single storey rear  
extension

Scale 1:50 1:100 1:200


## Elevations

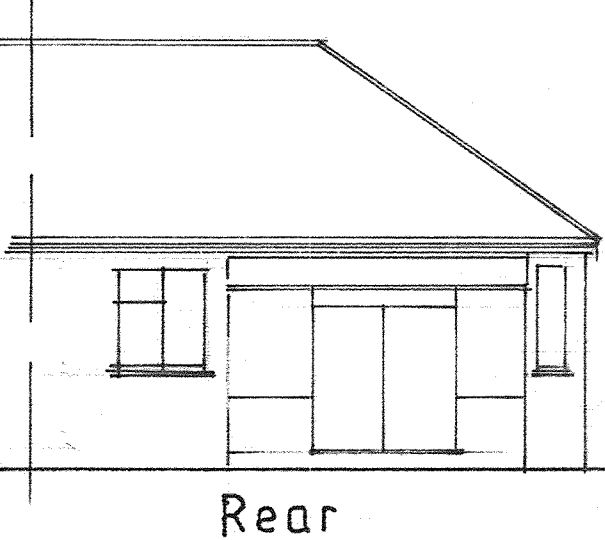

Rear

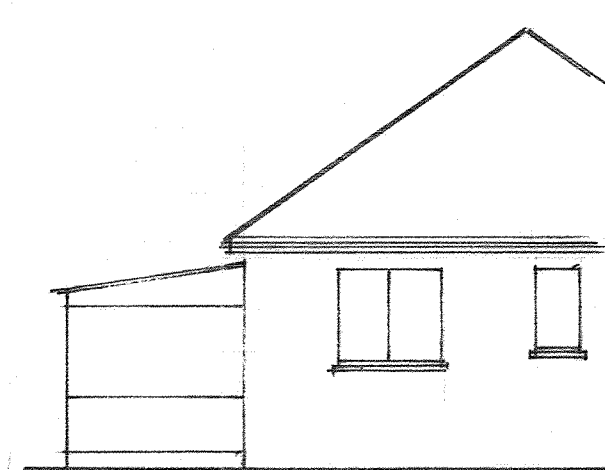


Flank

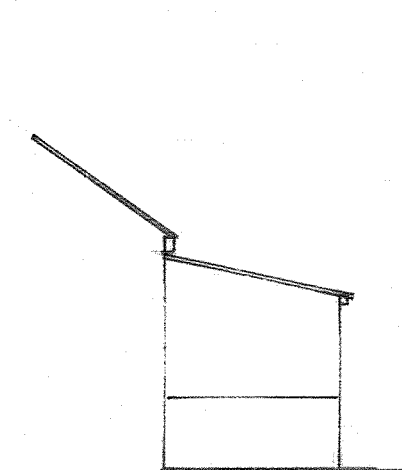


Side


## Proposed

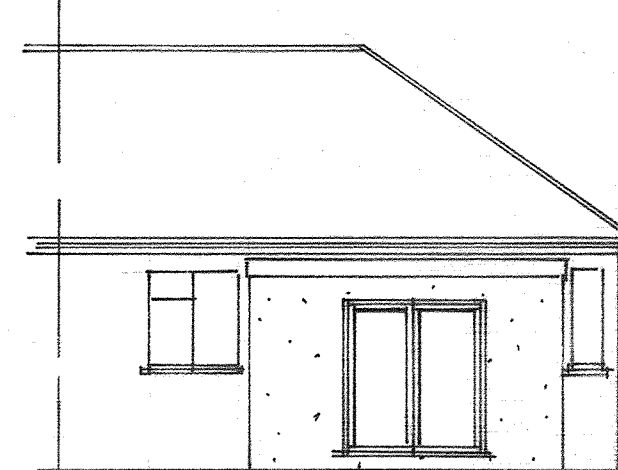

Rear

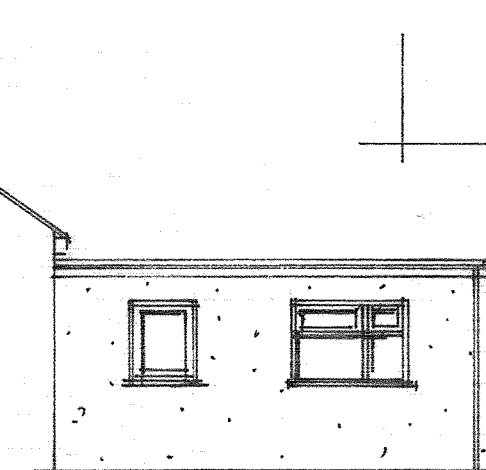

Side

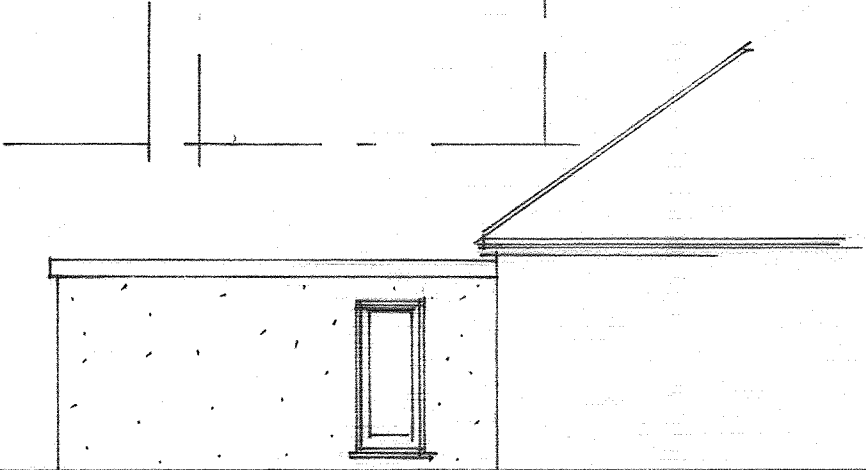

Flank