

Our ref: PW/ ENQ23057082

via email & RECORDED DELIVERY

Northumberland County Council
Planning Department
County Hall
Morpeth
Northumberland
NE61 2EF

31st October 2023

Dear sir/madam

Northern Powergrid – New Connections Scheme at Bockenfield Country Park, Felton,
Northumberland NE65 9QJ

Electricity Act 1989: Overhead Lines (Exemption) (England and Wales) Regulations 2009
Part 1 s.37 of the Electricity Act 1989

I enclose herewith 3 copies of an application form and plans regarding the above works.

I would be obliged to receive the return of the form duly completed, together with any comments, at your earliest convenience within the period of 6 weeks from the date of this submission.

I thank you for your help in this matter and look forward to your reply, but should you require any further information please do not hesitate to contact me.

Yours faithfully,



Philip Watkinson MRICS
Senior Surveyor

E: philip.watkinson@freedom-group.co.uk
M: 07973 623356

For and on behalf of Northern Powergrid

Correspondence address:
Northern Powergrid, 1-3 Lakeside Way, Ashington, Northumberland NE63 8QW

THIS FORM IS FOR USE BY ELECTRICITY NETWORK OPERATORS TO ADVISE LOCAL PLANNING AUTHORITIES OF PROPOSED WORKS TO BE UNDERTAKEN WITHIN THEIR DESIGNATED AREA THAT ARE CONSIDERED TO BE EXEMPTED UNDER THE OVERHEAD LINES (EXEMPTION) (ENGLAND AND WALES) REGULATIONS 2009. LOCAL AUTHORITIES HAVE THE RIGHT TO INVOKE THE FULL SECTION 37 PROCESS UNDER THE ELECTRICITY ACT 1989 SHOULD IT BE CONSIDERED NECESSARY.

The Form should be sent in triplicate to each Local Planning Authority in whose area the proposed development would be situated.

Details of Applicant

Name: Northern Powergrid (Northeast) plc

Contact Person: Philip Watkinson

Address: Northern Powergrid
1-3 Lakeside Way
Ashington
Northumberland NE63 8QW

Telephone No: Mob.07973623356

Applicant's Ref: PW/ENQ23057082

Date: 31/10/2023

To: The Chief Executive, Northumberland County Council

Electricity Act 1989: Overhead Lines (Exemption)(England and Wales) Regulations 2009

It is proposed to undertake the following work that is considered to be exempted from the Electricity Act 1989 by falling within the Overhead Lines (Exemption)(England and Wales) Regulations 2009:

Bockenfield Country Park, Felton, Northumberland NE65 9QJ - Install new H pole at Bockenfield

Country Park as indicated on the attached plans.

Particulars of proposed development to be completed by Applicant:

In order to maintain/improve the security of supplies in the area and to provide a new connection/supply to the single customer at

Bockenfield Country Park it is proposed to install a new H pole (with relocated transformer) in the position indicated on the attached plans.

The Council/Authority is requested to indicate that it has no objection to the work being carried out by returning two copies of this Form with the Certificate completed and signed.

Yours Faithfully



For and on behalf of the Applicant

CERTIFICATE

**TO BE COMPLETED BY THE LOCAL PLANNING AUTHORITY AND RETURNED
TO THE APPLICANT ELECTRICITY NETWORK COMPANY WITHIN SIX WEEKS OF
RECEIPT**

Northumberland County Council

(i) objects/does* not object for the proposed development detailed above to be undertaken under the exemptions laid down in the Overhead Lines (Exemption)(England and Wales) Regulations

(ii) wishes/does* not wish the Secretary of State to consider the application using the full section 37 process under the Electricity Act 1989.

The reasons for requesting the full section 37 process are*:

Signed:
Designation:
on behalf of **Northumberland County Council**

Dated:

*delete as appropriate

Applicant's Reference: PW/ENQ23057082




Existing Overhead Line

5
BOGKELD
3A
PARK

New H Pole

Existing underground line



Northern Powergrid Holdings Company
The position of our equipment is shown on this plan as accurately as possible, it may have changed since the plan was produced. Therefore the position of our equipment and those services which may not be shown should be established on site. Electricity cables not owned by Northern Powergrid Holdings Company may be laid in this area and may not be shown on this plan. Where private cables are shown, the information should not be regarded as accurate and should be used for guidance purposes only. In all cases, accurate information should be obtained from the owner of such cables prior to the commencement of work on site.

Reference should be made to HSE Guidance: **HS647 Avoiding Danger from Underground Services and GS6 Avoiding Danger from Overhead Power Lines**

© Northern Powergrid Holdings Company 2023. This document, and its contents, are for your sole use only. You must not use the contents of this document for any other purpose. You must not incorporate the contents of this document into your networks or use such contents for any other commercial purposes. You must seek our prior written consent before sharing the contents of this document with any third party.

© Crown Copyright and database rights 2023. (Northern Powergrid Holdings Company 100029432). Reproduced here for ease of use on the Ordnance Survey map by Northern Powergrid Holdings Company by permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationary Office.

Version 1.10 15th June 2023 Call Centre Phone Numbers: If the area is located in North East call 0800 668877, Yorkshire or North, Lincs call 0800 375678.

Warning - Work in progress in this area	
Underground Cables:	Overhead Conductors:
132kV	132kV
66kV	66kV
33kV	20kV
20kV	11kV
11kV	6kV
6kV	3kV
3kV	3kV
LV Mains	LV Mains
LV Service	LV Service
LV Service Assumed Route	LV Service Logical Connection
LV Service Logical Connection	Duct
Let In Site	Asx


Date Printed: 31-Oct-2023 Scale: 1: 750 Original Print Size: A4

OS Grid Reference: NZ1823997587

Printed By: phil.watkinson

Title:



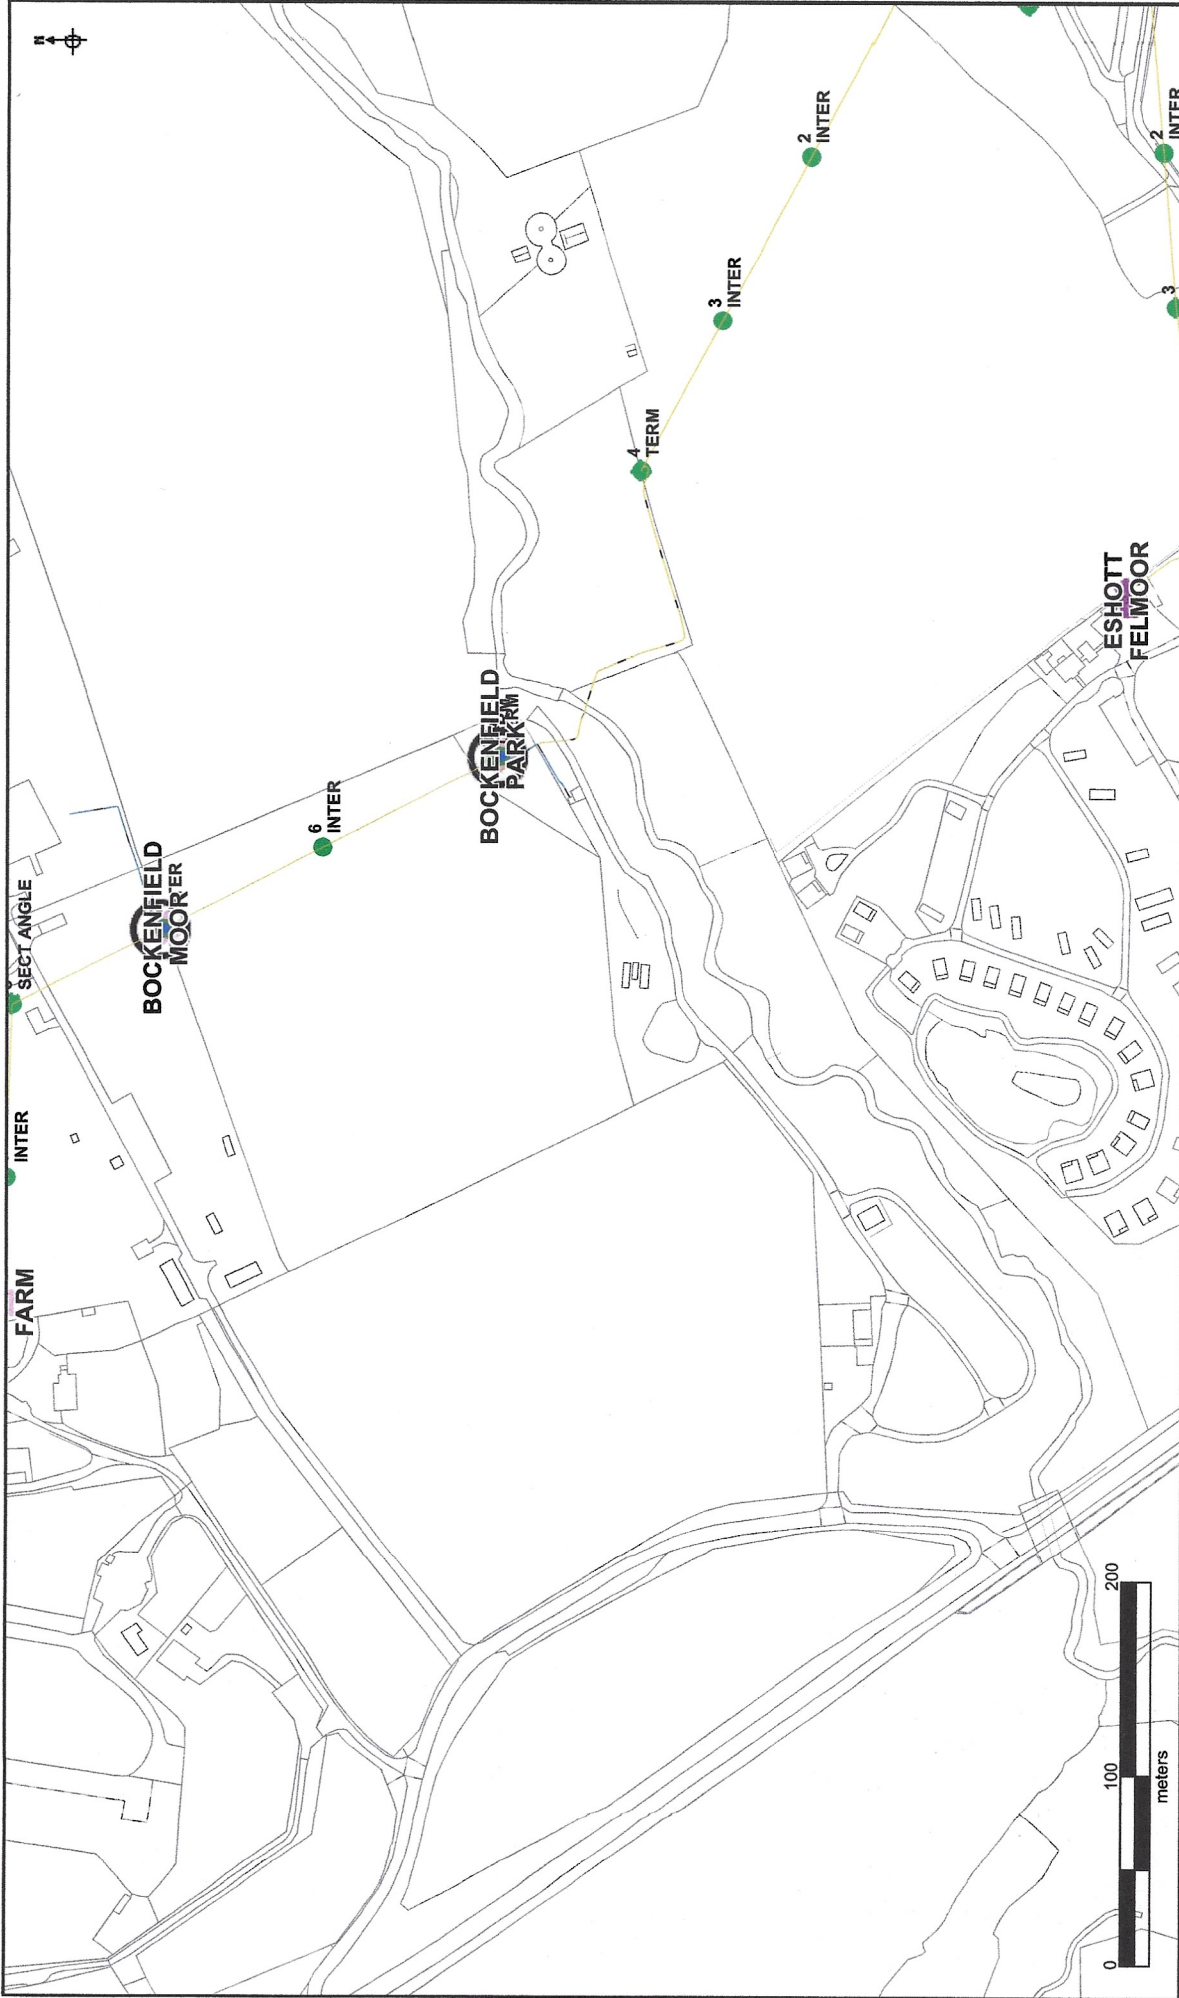

OS Grid Reference: NZ1811297559

Printed By: phil.watkinson

Title:

Original Print Size A3

Scale: 1: 2500

Date Printed: 31-Oct-2023

Northern Powergrid Holdings Company
 The position of our equipment is shown on the plan as accurately as possible. It may have changed since the plan was produced. Therefore the position of our equipment and those services which may not be shown should be established on site. Electricity cables are owned by Northern Powergrid Holdings Company. The position of these cables is shown on the plan as accurately as possible. The position of these cables should not be regarded as accurate and should be used for guidance purposes only. In all cases, accurate information should be obtained from the owner of such cables prior to the commencement of work on site.

Reference should be made to HSE Guidance:
HSE77 Avoiding Danger from Underground Services and GSA Avoiding Danger from Overhead Power Lines

© Northern Powergrid Holdings Company 2023. This document, and its contents, are for your sole use only. You must not use the contents of this document for any other purpose. You must not incorporate the contents of this document into your own works or use such contents for any other commercial purpose. You must seek our prior written consent before sharing the contents of this document with any third party.

© Crown Copyright and database rights 2023. (Northern Powergrid Holdings Company, 100028432).
 This document is the property of Northern Powergrid Holdings Company. It is to be used only for the purposes stated above. It is to be returned to the Controller of the Metering System, Northern Powergrid Holdings Company, 110, 120, June 2023. Call Centre Phone Numbers: If the area is located in: North East call 0800 668877, Yorkshire or North Lincoln call 0800 378675.