


KEY

- Foul UPVC Pipe at 225mm
- D400 Inspection Chamber
- KLARGESTER ALPHA 2,800 LITRE SEPTIC TANK OR SIMILAR APPROVED

Weir

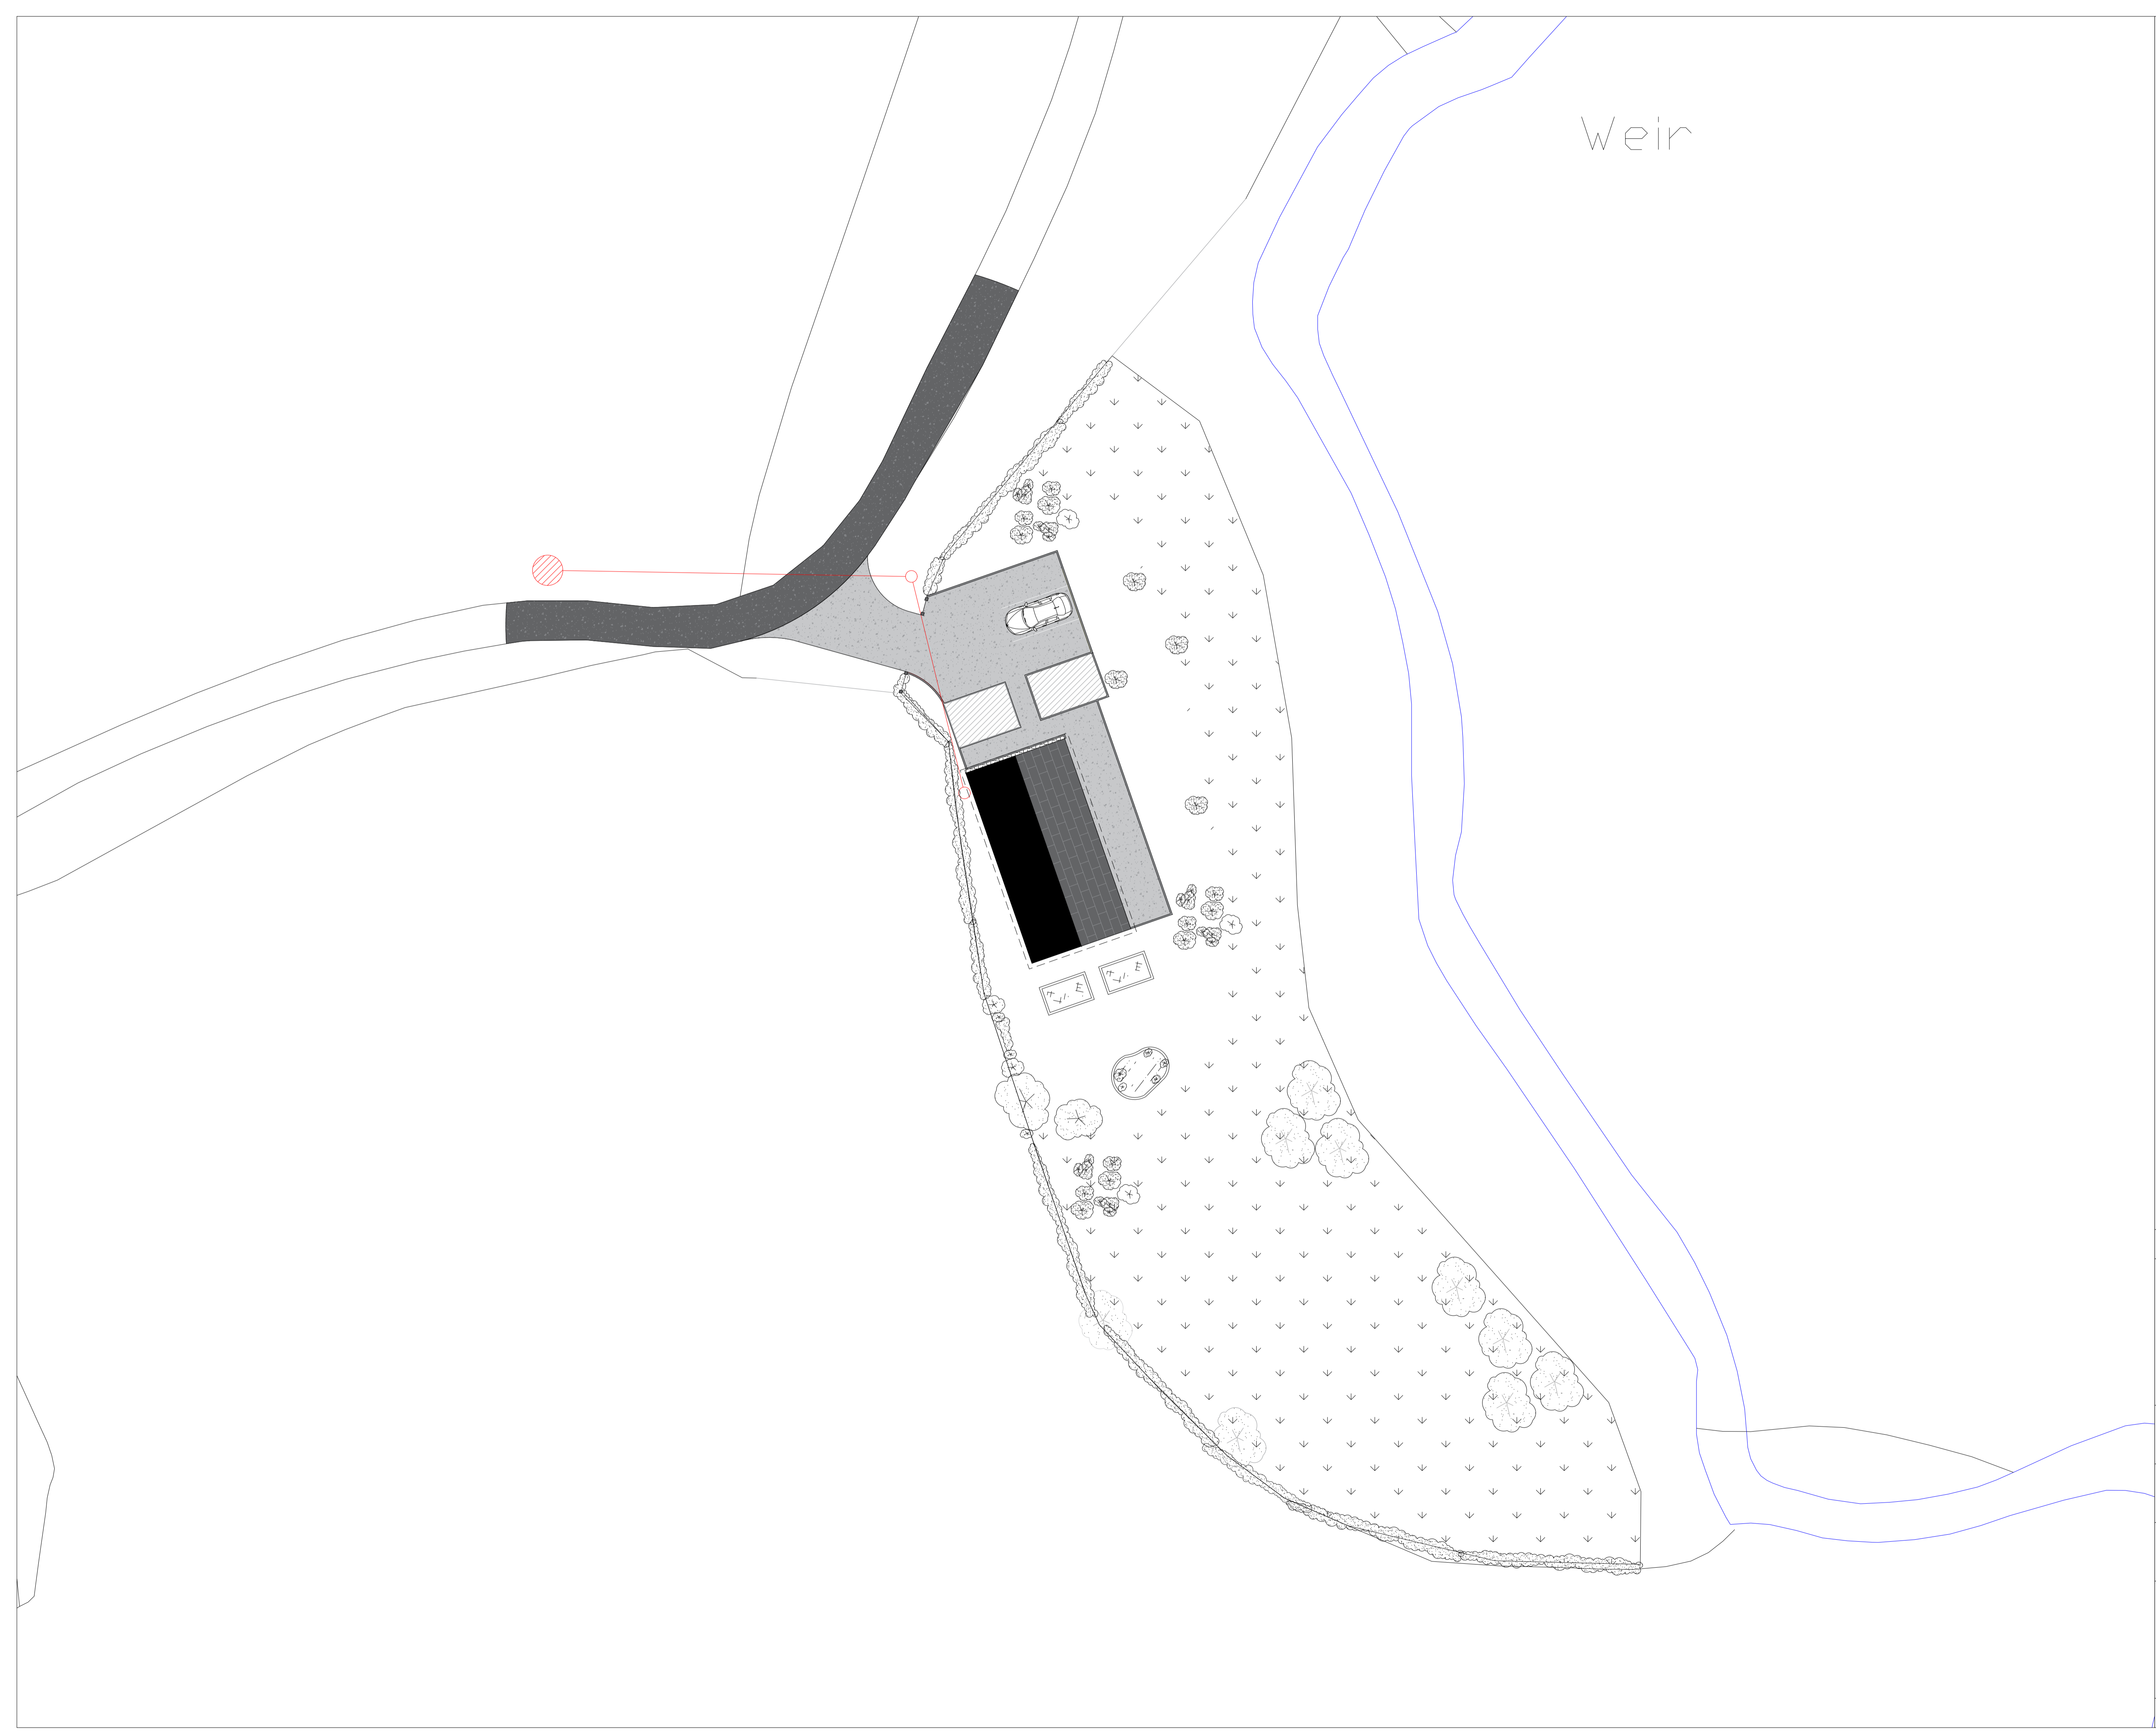

NAME:

LOWER TREWERN
TIMBER CHALET

DATE: AUG 2023

SCALE: 1:200

DRAWN BY: AJ

REF:
FOUL DRAINAGE
PL.06