
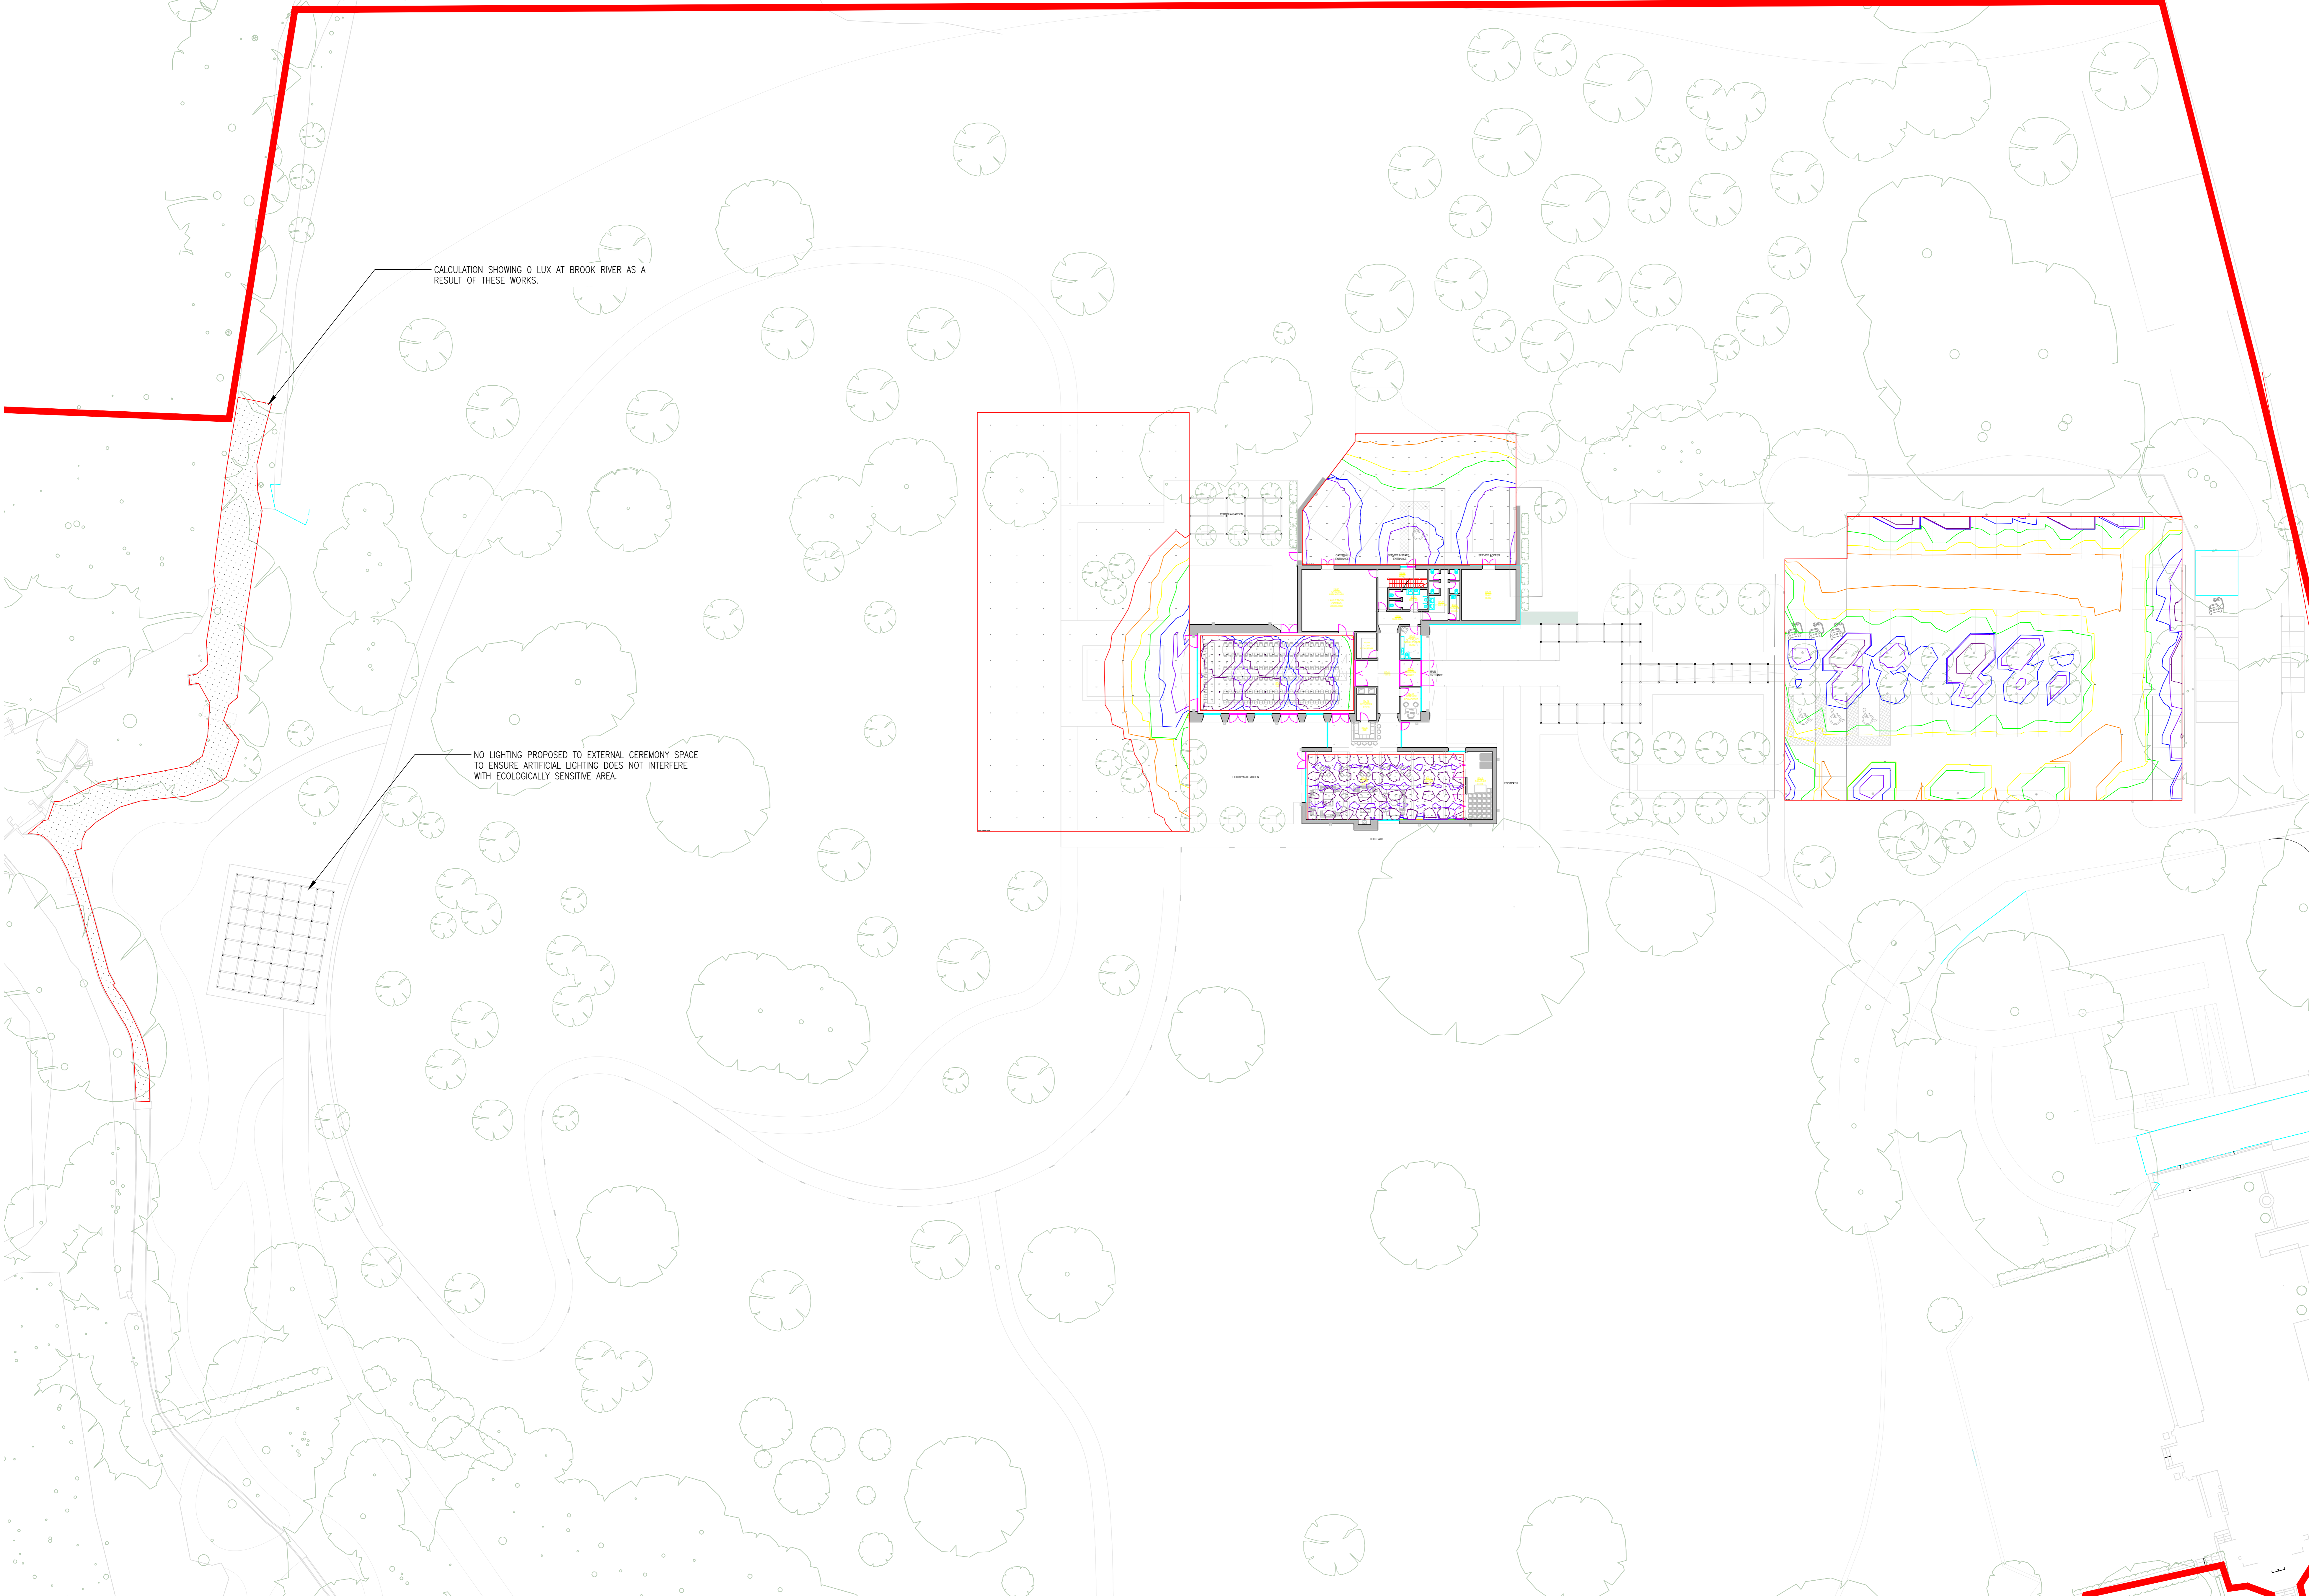


- NOTES:**
1. DO NOT SCALE FROM THIS DRAWING, IF IN DOUBT REQUEST FURTHER INFORMATION.
 2. THIS DRAWING IS TO BE REVIEWED WITH THE RELUX (LIGHT CALCULATION) REPORT AND LIGHTING CONTROLS STRATEGY ISSUED SEPARATELY.
 3. ALL LUMINAIRES SELECTED UTILISE DOWNWARD LIGHT DISTRIBUTION ONLY TO MINIMIZE LIGHT SPILL FROM THE PROPERTY.
 4. ALL LUMINAIRES TO BE DARK SKY CERTIFIED.
 5. REFER TO ARCHITECTS DRAWING PACKAGE FOR ADDITIONAL INFORMATION.
 6. ALL EXTERNAL LIGHTING SHALL BE CONTROLLED VIA A TIMECLOCK OR MOTION SENSORS TO PROVIDE MINIMAL LIGHT POLLUTION AND DISRUPTION TO LOCAL WILDLIFE.
 7. REFER TO THE ECOLOGICAL REPORT FOR FURTHER INFORMATION PERTAINING TO THE SENSITIVE HABITATS, WITH PARTICULAR ATTENTION TO BE PAID TO AMPNEY BROOK.

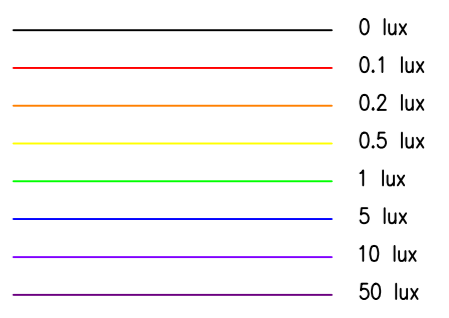

CALCULATION SHOWING 0 LUX AT BROOK RIVER AS A RESULT OF THESE WORKS.

NO LIGHTING PROPOSED TO EXTERNAL CEREMONY SPACE TO ENSURE ARTIFICIAL LIGHTING DOES NOT INTERFERE WITH ECOLOGICALLY SENSITIVE AREA.

Date	Description	Rev	By
26/09/23	For Information	-	CE

Revision Description

EQUINOX SOUTH, GREAT PARK ROAD, BRISTOL, BS32 4DL
 0117 9512514
 OFFICE@INFORMCE.CO.UK | WWW.INFORMCE.CO.UK

Project:
 Ampney Park
 The Venue - Lighting Assessment

Drawing Title:
 External Lighting
 Light Spill Contours

Drawing Number:
 IN381(632)001

Revision: -
Date: 26/09/23
Scale: NTS
Drawn By: CE
CAD Dwg File: -
Arch. Base Dwg: -

Issue Status:
 For Information