




**NOTES**

A/D ACCESS DOORS TO BE INSTALLED ON THE DUCTWORK AT MAXIMUM 2 METRE CENTRES FOR FUTURE CLEANING OF THE SYSTEM

SUPPORTS TO BE INSTALLED AT MAXIMUM 2.5 METRE CENTRES - EACH SUPPORT TO COMPRISE OF ANTI-VIBRATION MOUNTS AGAINST THE SLAB OR RISER WITH HORIZONTAL UNISTRUT TO AVOID NOISE TRANSFER TO THE SURROUNDING SPACE

SYSTEM CLEANING TO BE CARRIED OUT BY A BESA APPROVED CLEANING CONTRACTOR WHO SHOULD BE APPOINTED WITHIN 3 MONTHS OF THE STORE OPENING TO CARRY OUT A RISK ASSESSMENT FOR THE SYSTEM - SEE SPECIFICATION FOR RECOMMENDED MAINTENANCE INTERVALS

**NOTES**  
ALL DIMENSIONS MUST BE CHECKED ON SITE AND NOT SCALED FROM THIS DRAWING

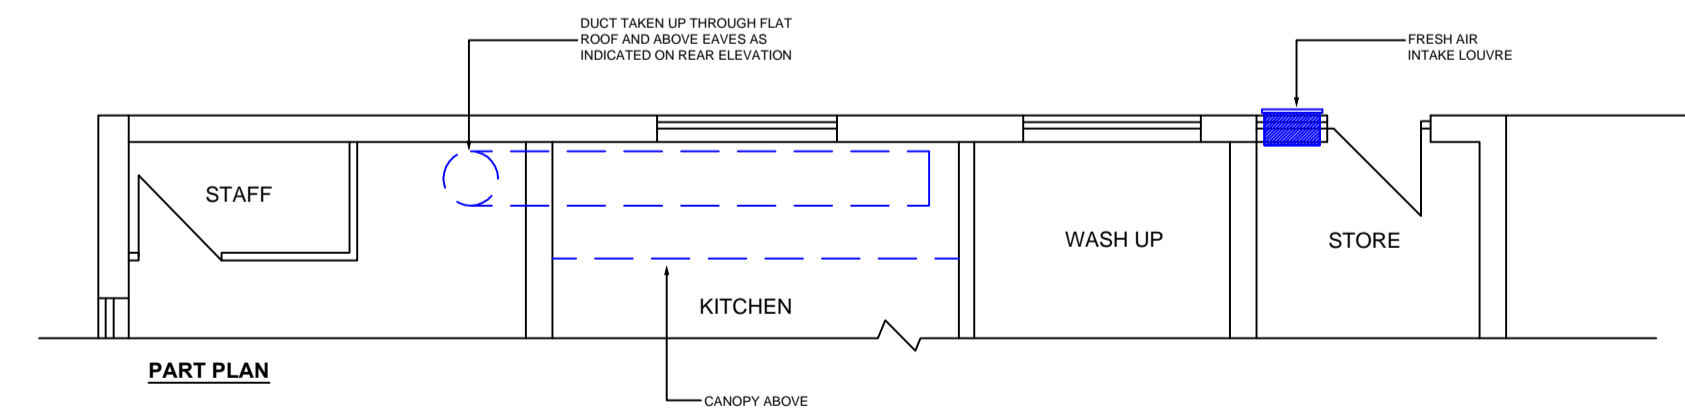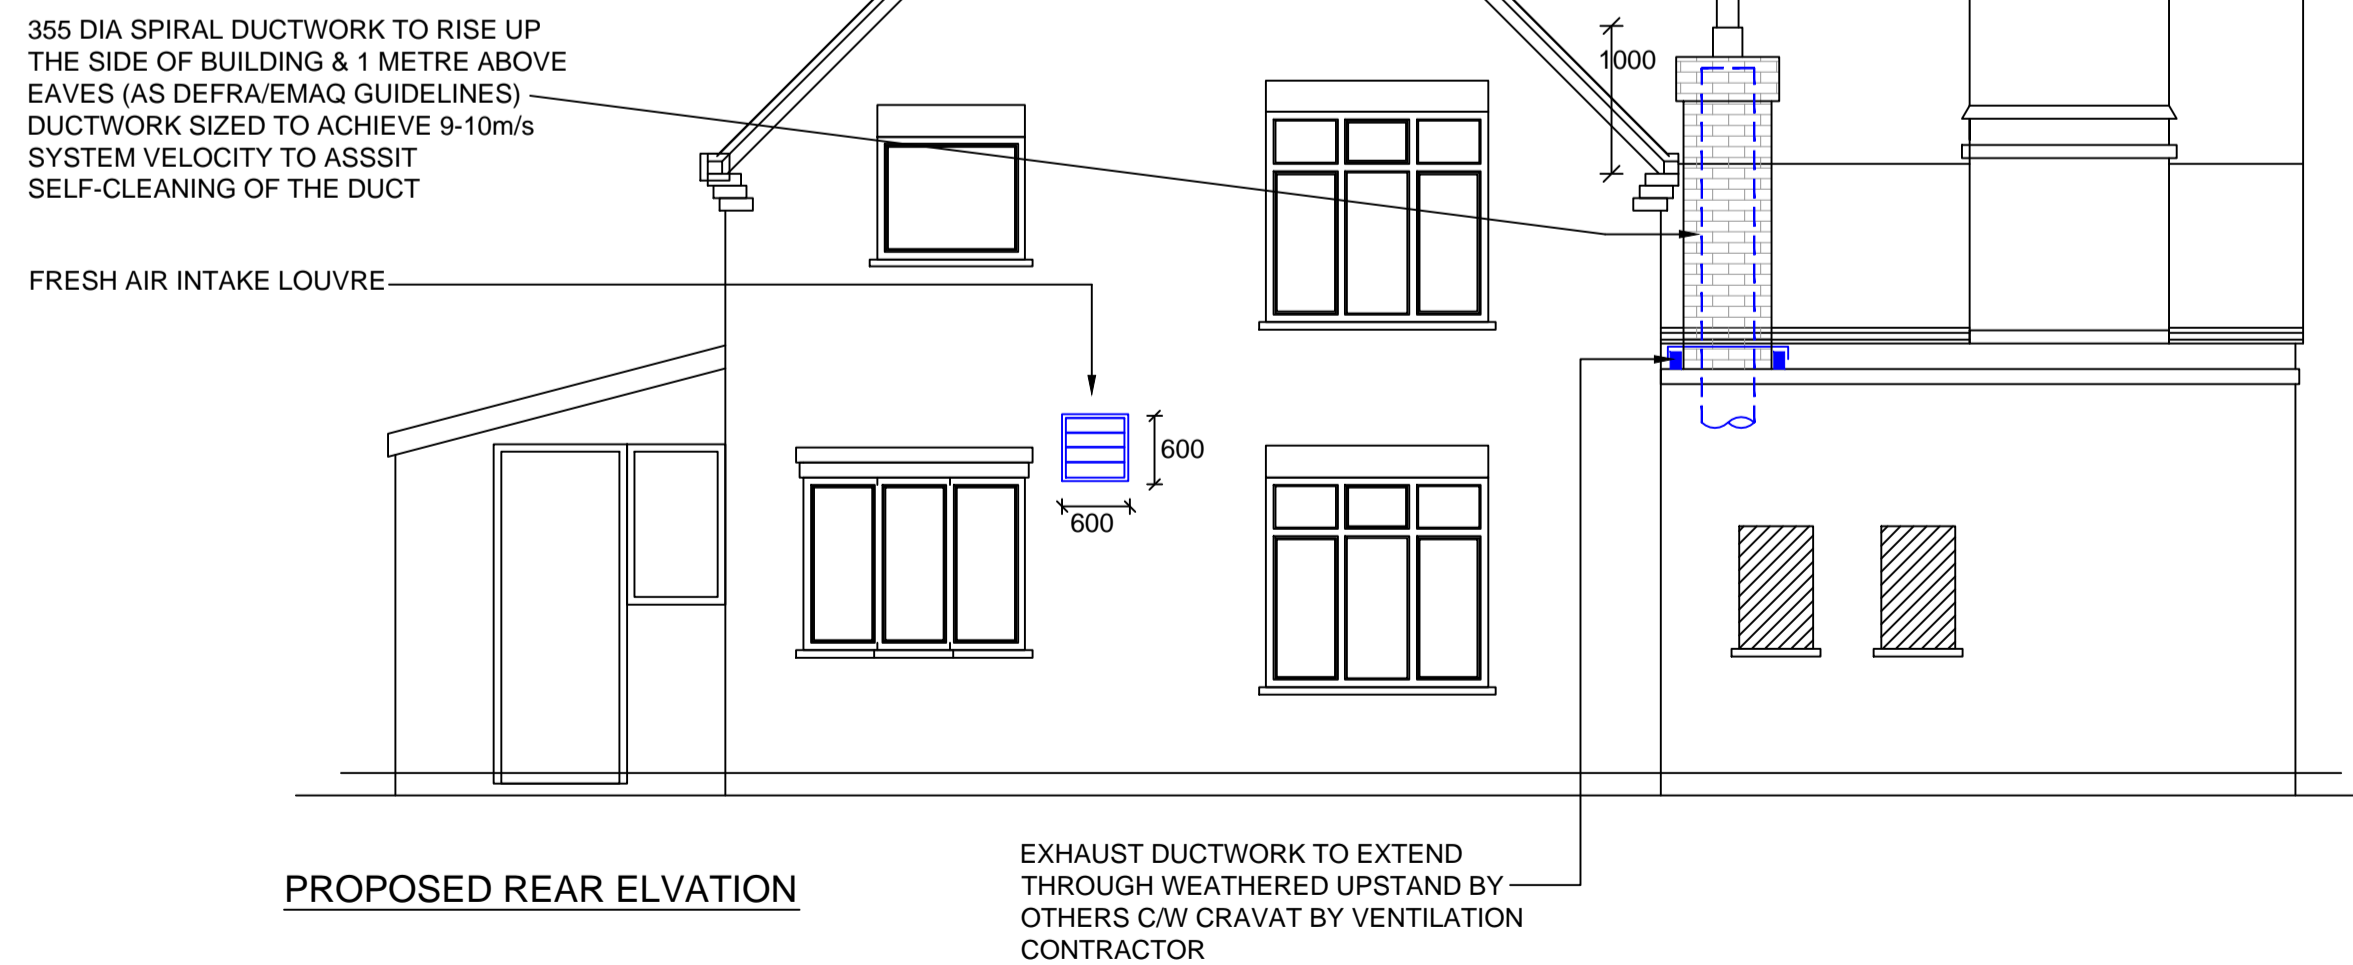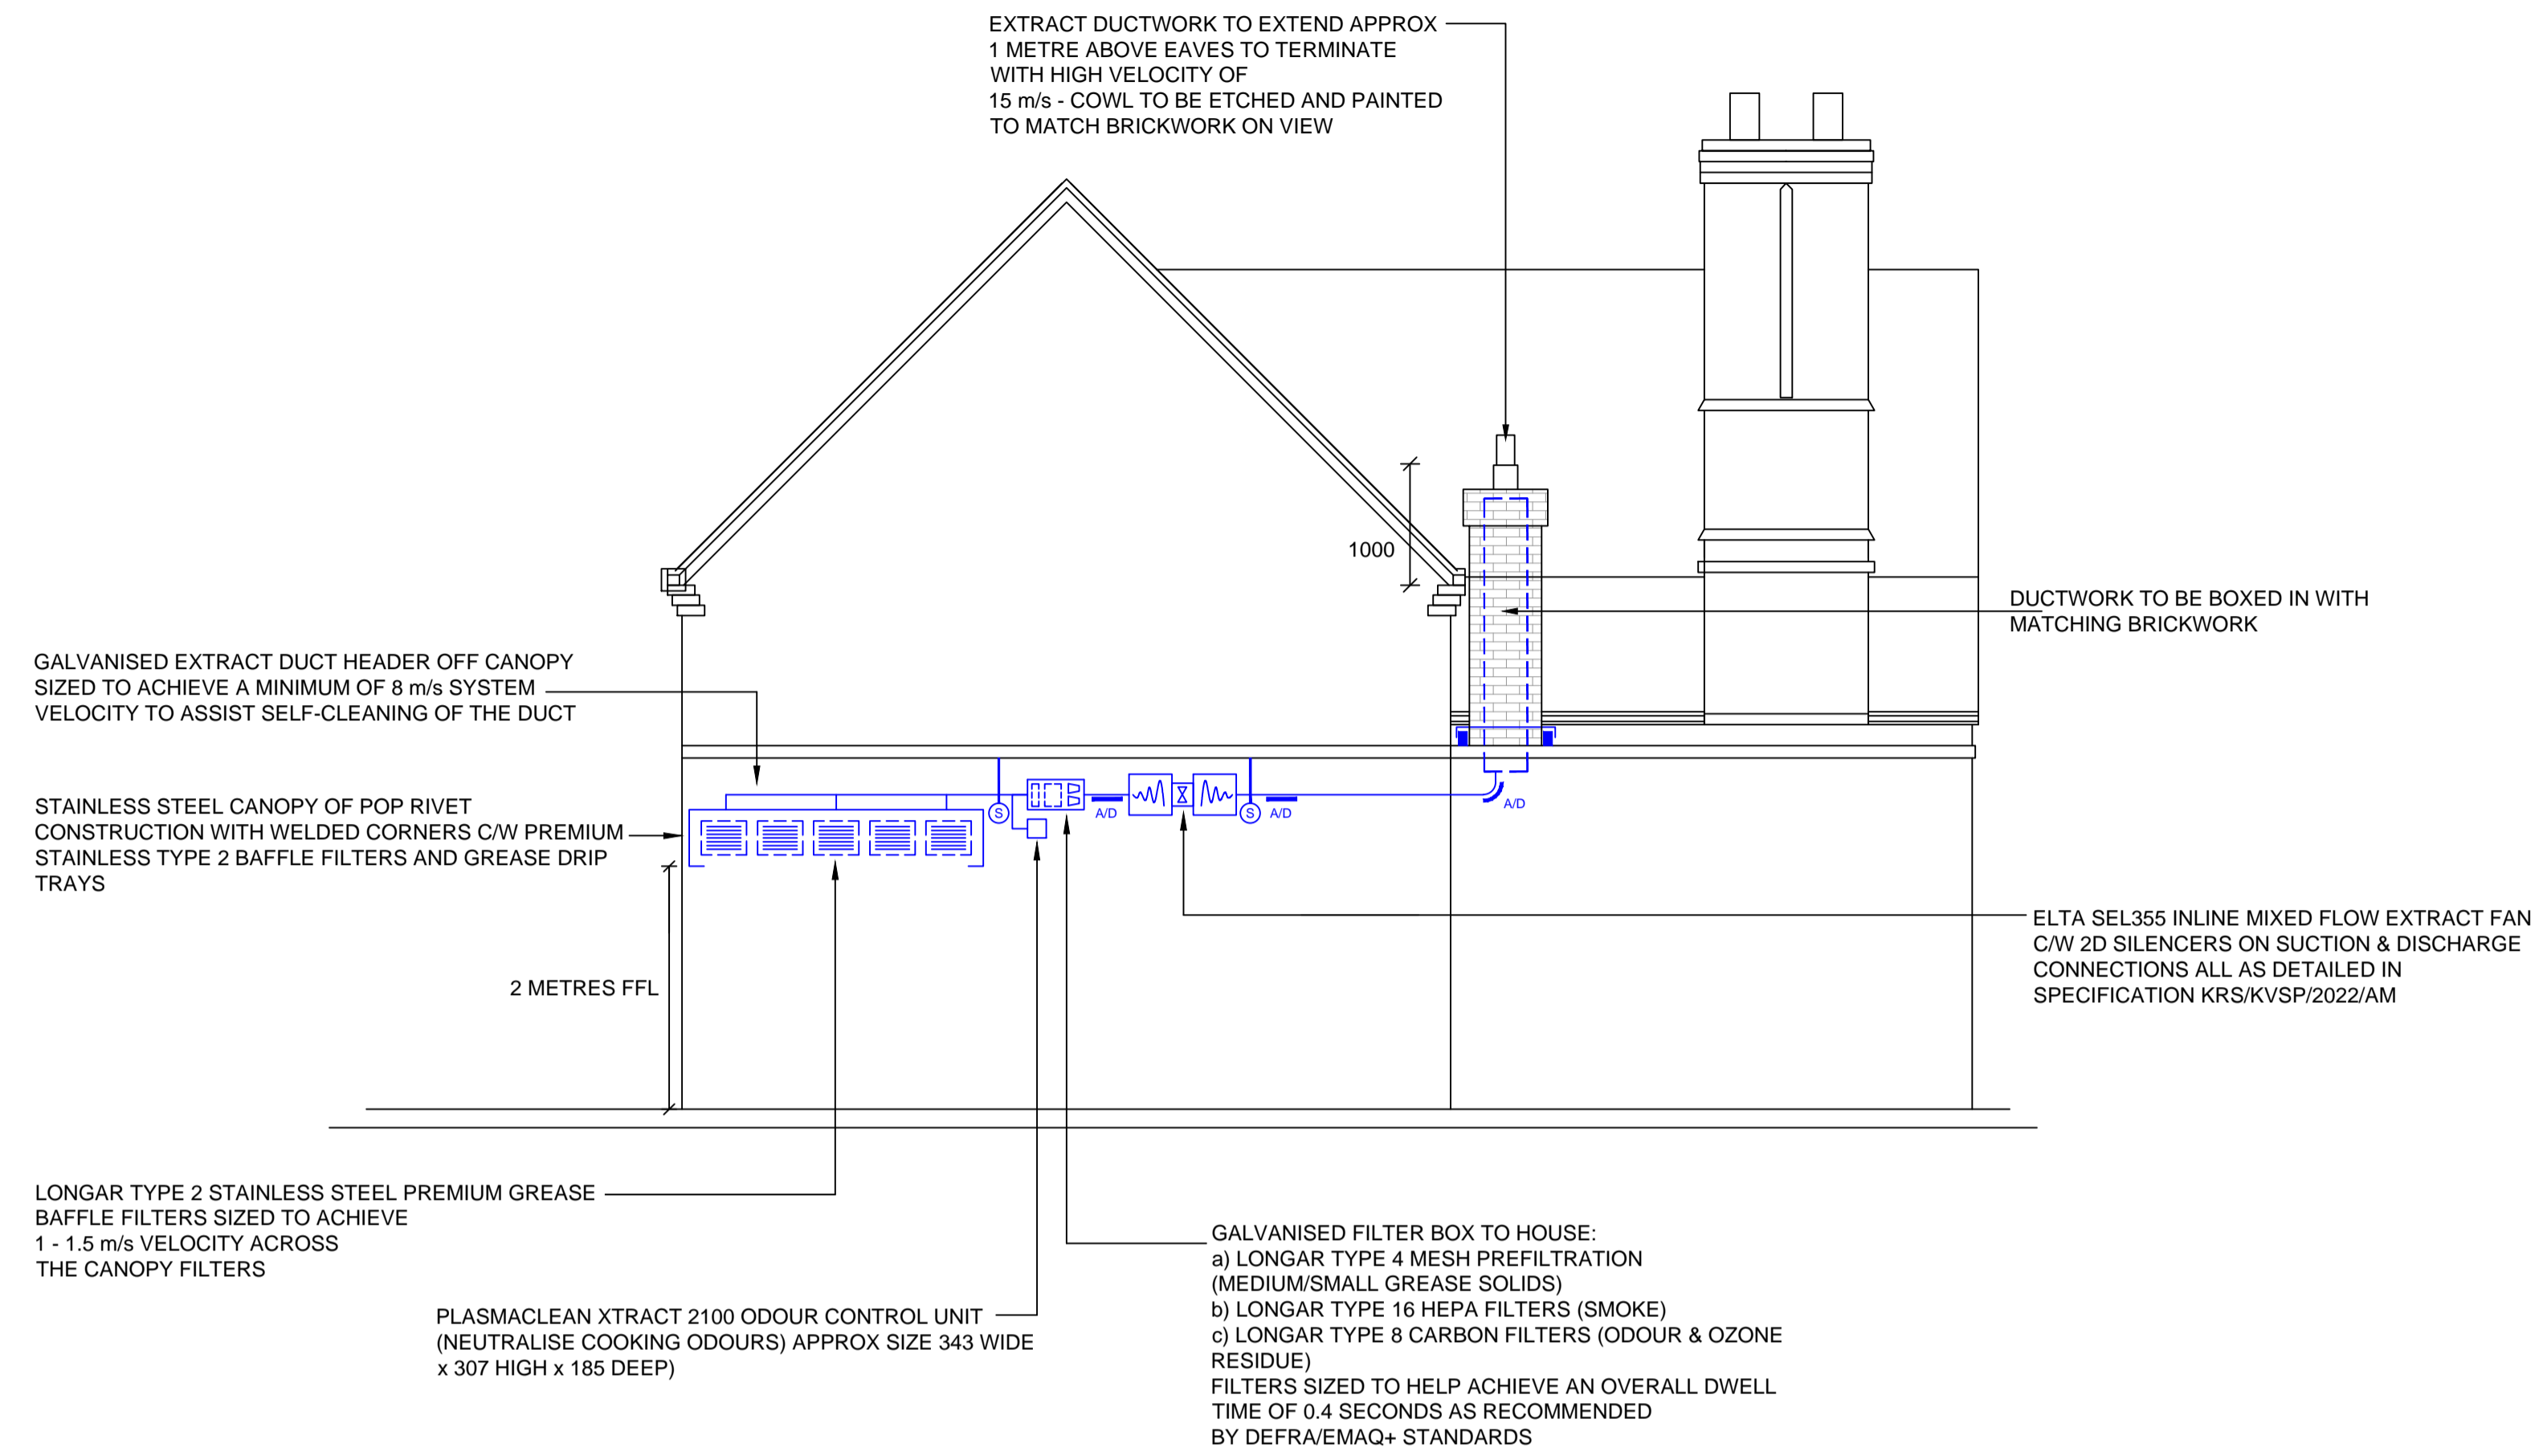

|          |                                  |
|----------|----------------------------------|
| 11/02/23 | REV D - ELEVATION DETAIL AMENDED |
| 28/02/23 | REV C - LOUVRE RE POSITIONED     |
| 17/02/23 | REV B - FRESH AIR INTAKE SHOWN   |
| 16/02/23 | REV A - ELEVATION DETAILS ADDED  |
| DATE     | REVISION                         |

KRS STEEL SERVICES LTD  
UNIT 6, 629 THE MEADOWWAY  
KITTS GREEN  
BIRMINGHAM B33 0DX

TEL: 0121 783 7404 FAX: 0121 786 6603

CLIENT: MR G OLSEN

JOB TITLE:  
PROPOSED RESTAURANT  
THE GREEN  
MAIN ROAD  
MERIDAN CV7 7LN

DRAWING TITLE:  
SCHEMATIC LAYOUT OF  
EXTRACT VENTILATION

SCALE: NTS@A1 DATE: FEB23 DRAWN BY: CAD

DRAWING NO: C2022/SK1 REV: D

PLEASE NOTE THAT THIS DESIGN & ACCOMPANYING DESIGN DRAWING ARE THE COPYRIGHT OF KRS LTD AND MUST NOT BE COPIED IN PART OR IN FULL WITHOUT THE WRITTEN CONSENT OF KRS LTD. NOR MUST THEY BE PASSED ON TO A THIRD PARTY IN ANY FORM, UNDER ANY CIRCUMSTANCES