


GENERAL NOTES

- ALL CLADDING TO BE CE MARKED AND HOT-DIP GALVANISED TO BS EN 10346:2009.
- ALL STEEL (INCLUDING PURLINS) TO BE CE MARKED AND TO EXECUTION CLASS 2 AS PER EN 1090 - 1:2009 AND HOT-DIP GALVANISED TO BS EN 10346:2009 Fe E390G-Z275.
- DESIGN LOADS TO BS 6399-1:1997 AND BS 6399-3:1997. DEAD LOADS: SW CONSIDERED INTERNALLY WITHIN PROGRAMME
 -CEILINGS AND SERVICES = 0.049 kN/m²
 -RAFTER CLADDINGS AND PURLINS = 0.107 kN/m²
 -COLUMN CLADDINGS AND RAILS = 0.088 kN/m²
 -SNOW LOAD = 0.6 kN/m²
 -LIVE LOAD = 0.6 kN/m²
- WIND LOAD ACCORDING TO BS 6399-2:1997 WITH THE FOLLOWING PARAMETERS:
 BASIC WIND SPEED = 26 m/s
 SITE ALTITUDE = 13.614986 m
 SITE ALTITUDE FACTOR = 1.013614986
 SEASONAL FACTOR = 1.0
 DIRECTION FACTOR = 1.0
 SITE DISTANCE FROM SEA = Coastal (0-2 km)
- ALL STEEL TO HAVE YIELD STRENGTH $P_y = 450$ MPa.

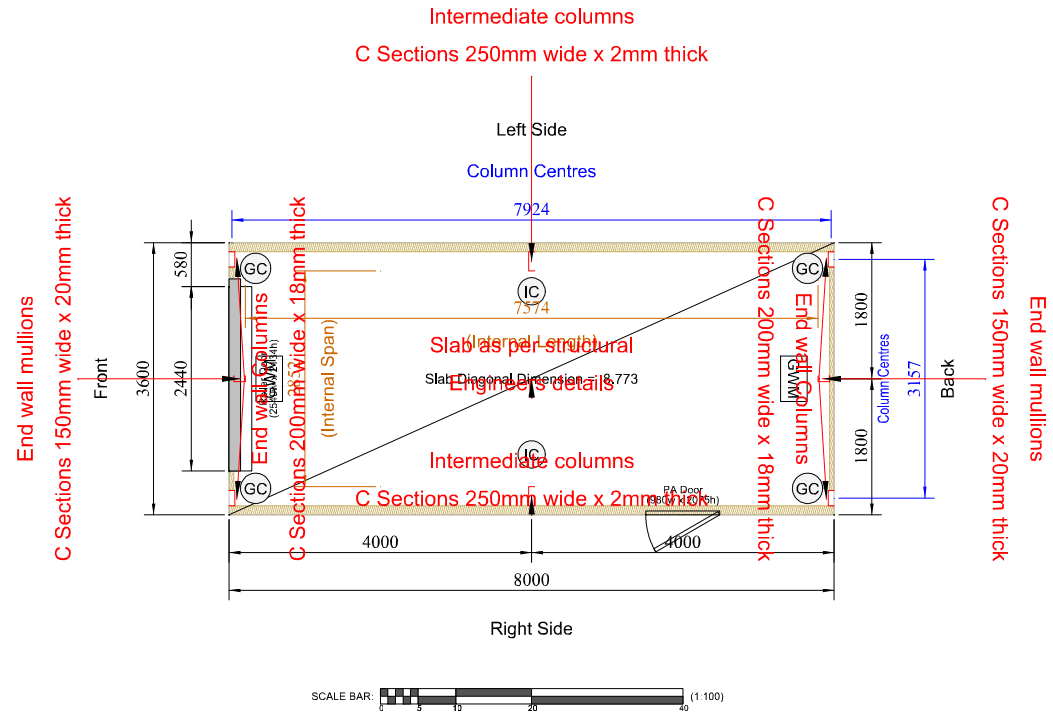

IC: INTERMEDIATE COLUMN
 GC: GABLE COLUMN
 GWM: GABLE WALL MULLION

DESIGN SUPPLIED BY: MURRAY STEEL BUILDINGS
 ADDRESS: MURRAY HOUSE 13 ABBEY PARK PLACE DUNFERMLINE FIFE
 EMAIL: DYLAN@MURRAYSTEELBUILDINGS.COM, LOUISE@MURRAYSTEELBUILDINGS.COM
 PHONE: 01383 668820

CLIENT: STEVE ATHERTON
 ADDRESS: 0, YO19 6ES
 EMAIL: STEVENATHERTON@AOL.COM
 PHONE: 0 - 07974 923908

DRAWING TITLE: FLOOR PLAN
 DRAWING REVISION NUMBER: 00
 SCALE: 1:100