


BA Room Notes:

(See M&E drawings for M&E details).

1. Draeger Wash6DR BA Wash unit (provided by Client / Draeger). Contractor to provide:
 - 1 off 32 amp 3 phase supply with female 5 pin wall socket.
 - 110mm uPVC below ground drainage connection with 50mm reducer cap. Finished to center of machine no more than 200mm from floor level.
 - 22mm water supply run into a TMV with isolation valve.
2. Space for storage cylinder, neutralizer and detergent (all supplied by Draeger / Client).
3. Contractor to provide and install new bespoke stainless steel BA cleaning bench (supplied by Arkinstall). Include for 1nr storage shelf beneath. Details to be provided to CA for approval prior to ordering.
4. Water softener (supplied by Client / Draeger) Contractor to provide:
 - 2nr 110mm below ground uPVC drainage connections reduced to 50mm and left 100mm high.
5. Dryer. Contractor to provide electrical connections.
6. Draeger Wash9 and stand (supplied by Client / Draeger). Contractor to provide:
 - 1 off 16amp 3 phase supply, female 5 pin wall socket.
 - 110mm uPVC below ground drain with 50mm reducer cap left 2000mm high at center of machine.
7. Existing BA cleaning sinks / worktop moved to new location. Contractor to modify cleaning sinks / worktop to suit new layout as shown.
8. Floor to drain to new M150D ACO MultiDrain channel with 23161 Heelguard ductile iron grating. Load class C250 / D400. Connect to existing foul drainage with 110mm dia. outlet.

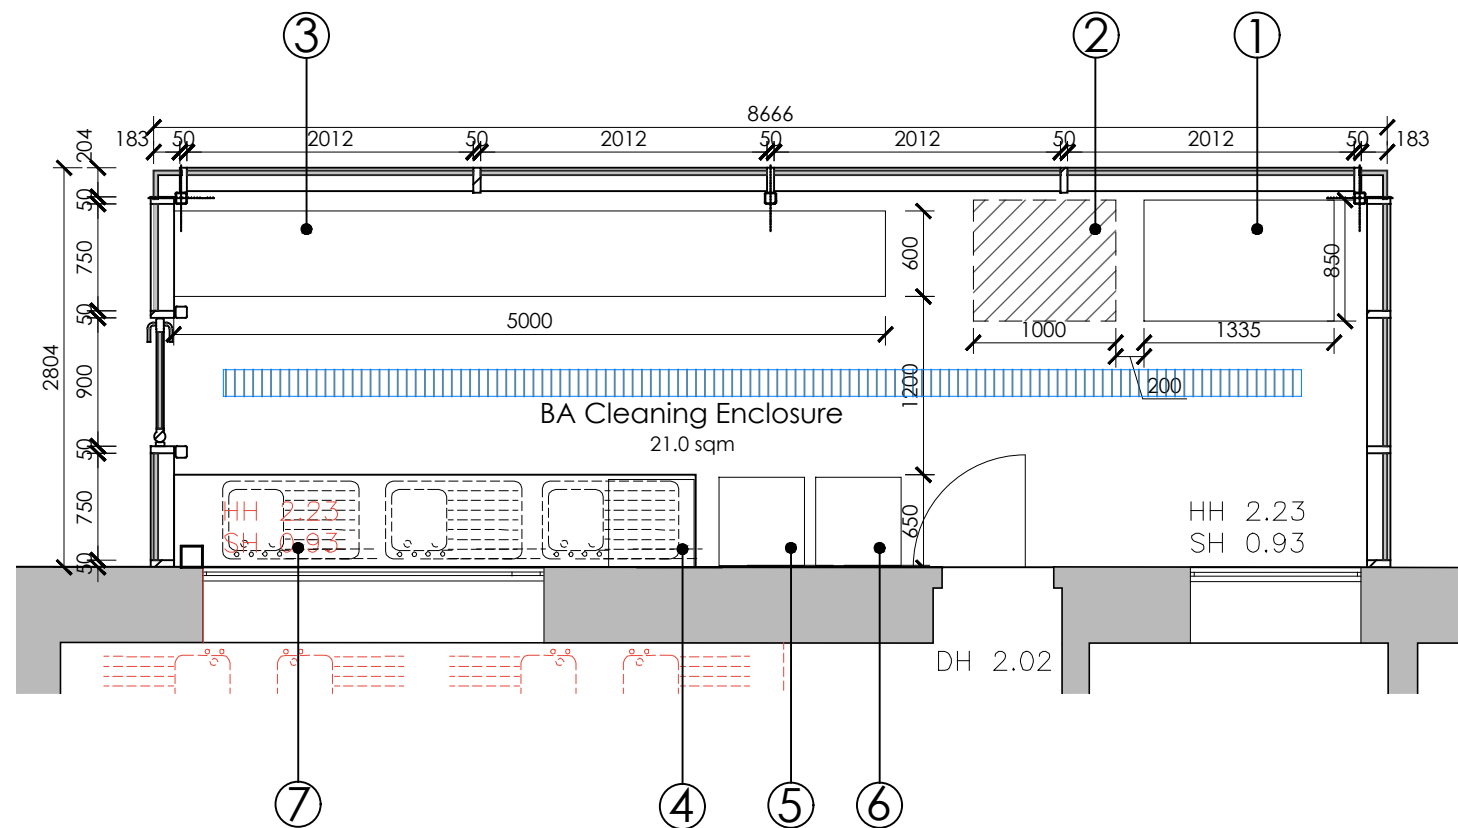

DO NOT SCALE FROM THIS DRAWING
EXCEPT FOR PLANNING PURPOSES ONLY
Copyright reserved

This drawing is issued for the sole & exclusive use of the named recipient. Distribution to any third party is on the strict understanding that no liability is accepted by YMD Boon Ltd for any discrepancies, errors or omissions that may be present & no guarantee is offered as to the accuracy of information shown. All dimensions to be checked on site & any discrepancies found shall be brought to the attention of YMD Boon Ltd prior to commencement of any building works.

THIS DRAWING IS TO BE READ IN COLOUR PRINT

CDM - RESIDUAL RISKS
The following are considered to be significant risks relevant to this drawing, which could not be fully mitigated or removed through design. Further possible control measures have been identified within the Design Risk Assessments which may help to mitigate these and other identified risks further during the construction / maintenance process.

G	BA enclosure updated	14.11.2023	JG
Rev.	Description	Date	Drawn / Chk'd

PLANNING



6b Anson House, Compass Point Business Park,
Market Harborough, LE16 9HW

Ground Floor, Loxley House, Tottle Road, Nottingham, NG2 1RT

Oak House Business Centre, Waterside South, Lincoln, LN5 7FB

Client
Nottingham Fire and Rescue

Project
Ollerton SDC

Scale 1:50 @ A3	Date June 23	Drawn RSL
Drawing Title BA Room Benching Details		Checked JK
Drawing Number J5368-96		Revision G

T:\Jobs\BLUE LIGHT\Nottingham Fire and Rescue\J5368N - Ollerton SDC Refurbishment\4-0 Drawings\J5368 Ollerton SDC Refurbishment CURRENT