


## Feasibility of connection to the public foul sewer – Fieldhead, Luppitt, EX14 4RX

There has been a dwelling on this site for over 50 years. Historically it had a septic tank, however this did not conform to new regulations. As such, the site was upgraded to a water treatment plant in the summer of 2022.

As per the below map image, the public foul sewer runs down the middle of the village (highlighted by the pink line) which is approximately 600ft (180m) from the site (denoted by the pink arrow).

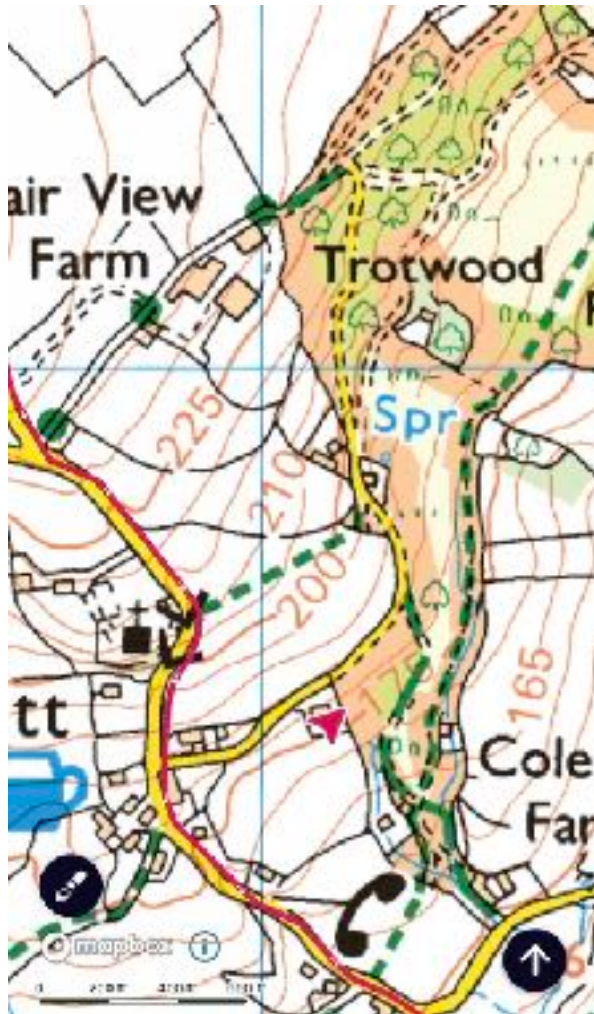

Given the considerable distance and the historical treatment of foul drainage, it is not feasible for the site to be connected to the main public foul sewer.