



RIGHT OF LIGHT
CONSULTING
Chartered Surveyors

Daylight and Sunlight Report

(Neighbouring Properties)

15 November 2023

The Hawthorns
57 Warminster Road
London
SE25 4DF

Right of Light Consulting

Burley House
15-17 High Street
Rayleigh
Essex SS6 7EW

Tel: 0800 197 4836

www.right-of-light.co.uk

CONTENTS

1 EXECUTIVE SUMMARY2

1.1 Overview2

2 INFORMATION SOURCES3

2.1 Drawings3

2.2 Daylight Distribution Room Layout Information3

3 METHODOLOGY OF THE ASSESSMENT4

3.1 Local Planning Policy.....4

3.2 National Planning Policy Framework.....4

3.3 National Planning Practice Guidance.....5

3.4 Daylight to Windows5

3.5 Sunlight availability to Windows7

3.6 Overshadowing to Gardens and Open Spaces7

4 RESULTS OF THE ASSESSMENT9

4.1 Windows & Amenity Areas Considered.....9

4.2 Daylight to Windows9

4.3 Sunlight to Windows9

4.4 Overshadowing to Gardens and Open Spaces9

4.5 Conclusion.....9

5 CLARIFICATIONS10

5.1 General.....10

APPENDICES

APPENDIX 1 WINDOW & GARDEN KEY

APPENDIX 2 DAYLIGHT AND SUNLIGHT RESULTS

APPENDIX 3 OVERSHADOWING TO GARDENS AND OPEN SPACES

1 EXECUTIVE SUMMARY

1.1 Overview

- 1.1.1 Right of Light Consulting has been commissioned by Frankham Projects Limited to undertake a daylight and sunlight assessment of the proposed development at The Hawthorns, 57 Warminster Road, London SE25 4DF.
- 1.1.2 The assessment is based on the various numerical tests laid down in the Building Research Establishment (BRE) guide 'Site Layout Planning for Daylight and Sunlight: a guide to good practice, 3rd Edition' by P J Littlefair 2022.
- 1.1.3 The aim of the assessment is to consider the impact of the development on the light receivable by the neighbouring properties at 33 Pittville Gardens, 57, 59 & 63 Warminster Road and Ashleigh Lodge.
- 1.1.4 The window key in Appendix 1 identifies the windows analysed in this assessment. Appendix 2 gives the numerical results of the various daylight and sunlight tests.
- 1.1.5 All neighbouring windows (that have a requirement for daylight or sunlight) pass the relevant BRE diffuse daylight and direct sunlight tests. The development also passes the BRE overshadowing to gardens and open spaces test.
- 1.1.6 In summary, the numerical results in this assessment demonstrate that the proposed development will have a low impact on the light receivable by its neighbouring properties. In our opinion, the proposed development sufficiently safeguards the daylight and sunlight amenity of the neighbouring properties.

2 INFORMATION SOURCES

2.1 Drawings

2.1.1 This report is based on the following drawings:

Lane & Frankham

| | | |
|------|-------------|--------|
| 1001 | Site Survey | Rev R1 |
|------|-------------|--------|

| | | |
|------|-------------------------------|-------|
| 1218 | Proposed Plans and Elevations | Rev - |
|------|-------------------------------|-------|

Promap OS Plan

| | | |
|--|-----------|-------|
| | Site Plan | Rev - |
|--|-----------|-------|

2.2 Daylight Distribution Room Layout Information

2.2.1 The daylight distribution test has been applied based on the following room layout information:

Online Local Authority planning records

| | | |
|---------------------|---------------------------------|-------|
| 59 Warminster Road: | Second Floor Plans As Extension | Rev - |
|---------------------|---------------------------------|-------|

| | | |
|-----------------------------|--|-------|
| 63 Warminster Road: 100B | Proposed Plans, Elevations and Sections | Rev - |
|-----------------------------|--|-------|

www.rightmove.co.uk

| | | |
|---------------------|-------------|-------|
| 59 Warminster Road: | Floor Plans | Rev - |
|---------------------|-------------|-------|

| | | |
|-----------------|-------------|-------|
| Ashleigh Lodge: | Floor Plans | Rev - |
|-----------------|-------------|-------|

3 METHODOLOGY OF THE ASSESSMENT

3.1 Local Planning Policy

- 3.1.1 We understand that the Local Authority takes the conventional approach of considering daylight and sunlight amenity with reference to the various numerical tests laid down in the Building Research Establishment (BRE) guide 'Site Layout Planning for Daylight and Sunlight: a guide to good practice, by P J Littlefair. This report is based on the 3rd edition of the BRE guide which was published on 8 June 2022.
- 3.1.2 The standards set out in the BRE guide are intended to be used flexibly. The BRE guide states:
- 3.1.3 “The guide is intended for building designers and their clients, consultants and planning officials. The advice given here is not mandatory and the guide should not be seen as an instrument of planning policy; its aim is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly, since natural lighting is only one of many factors in site layout design.”
- 3.1.4 In reference to applying different numerical target values in different locations, the BRE guide states:
- 3.1.5 “These values are purely advisory and different targets may be used based on the special requirements of the proposed development or its location.”

3.2 National Planning Policy Framework

- 3.2.1 The BRE numerical guidelines should be considered in the context of the National Planning Policy Framework (NPPF), which stipulates that local planning authorities should take a flexible approach to daylight and sunlight to ensure the efficient use of land. The NPPF states:
- 3.2.2 “Local planning authorities should refuse applications which they consider fail to make efficient use of land, taking into account the policies in this Framework. In this context, when considering applications for housing, authorities should take a flexible approach in applying policies or guidance relating to daylight and sunlight, where they

would otherwise inhibit making efficient use of a site (as long as the resulting scheme would provide acceptable living standards).”

3.3 National Planning Practice Guidance

3.3.1 The BRE numerical guidelines should also be considered in the context of the National Planning Practice Guidance (NPPG). The NPPG states that developments should maintain acceptable living standards. It goes on to explain that what this means in practice is that appropriate levels of sunlight and daylight, will depend to some extent on the context for the development. This is consistent with the BRE guide which as noted in paragraphs 3.1.4 to 3.1.5 above, states that site location is a relevant factor when setting sunlight and daylight targets.

3.4 Daylight to Windows

3.4.1 Diffuse daylight is the light received from the sun which has been diffused through the sky. Even on a cloudy day, when the sun is not visible, a room will continue to be lit with light from the sky. This is diffuse daylight.

3.4.2 Diffuse daylight calculations should be undertaken to all rooms within domestic properties, where daylight is required, including living rooms, kitchens and bedrooms. The BRE guide states that windows to bathrooms, toilets, storerooms, circulation areas and garages need not be analysed. These room types are non-habitable and do not have a requirement for daylight.

3.4.3 The BRE guide states that the tests may also be applied to non-domestic buildings where there is a reasonable expectation of daylight. The BRE guide explains that this would normally include schools, hospitals, hotels and hostels, small workshops and some offices. The BRE guide is not explicit in terms of which types of offices it regards as having a requirement for daylight. However, it is widely accepted amongst consultants and local authorities, that for planning purposes, offices (which are commercial in nature) do not have a requirement for daylight. The point is touched on in the ‘Daylighting and Sunlighting’ guidance note published by the Royal Institution of Chartered Surveyors (RICS), which gives guidance to surveyors on how to produce their reports:

3.4.4 “The report should establish the limits of the assessment. For example, existing commercial premises are rarely assessed for loss of amenity.”

3.4.5 The BRE guide contains two tests which measure diffuse daylight:

Test 1 Vertical Sky Component

3.4.6 The Vertical Sky Component is a measure of available skylight at a given point on a vertical plane. Diffuse daylight may be adversely affected if after a development the Vertical Sky Component is both less than 27% and less than 0.8 times its former value.

3.4.7 The BRE guide states that the total amount of skylight can be calculated by finding the Vertical Sky Component at the centre of each main window. However, the guide states that if there would be a significant loss of light to the main window but the room also has one or more smaller windows, an overall Vertical Sky Component may be derived by weighting each Vertical Sky Component element in accordance with the proportion of the total glazing area represented by its window.

Test 2 Daylight Distribution

3.4.8 The distribution of daylight within a room can be calculated by plotting the ‘no sky line’. The no sky line is a line which separates areas of the working plane that do and do not have a direct view of the sky. Daylight may be adversely affected if, after the development, the area of the working plane in a room which can receive direct skylight is reduced to less than 0.8 times its former value.

3.4.9 The BRE guide states that both the total amount of skylight (Vertical Sky Component) and its distribution within the building (Daylight Distribution) are important. The BRE guide states that the daylight distribution calculation can only be carried out where room layouts are known. It states that using estimated room layouts is likely to give inaccurate results and is not recommended. Therefore, we don’t endorse the practice of applying the test based on assumed room layouts. However, we can provide additional daylight distribution data upon request by the local authority, if neighbouring room layout information is confirmed.

3.5 Sunlight availability to Windows

3.5.1 The BRE sunlight tests should be applied to all main living rooms and conservatories which have a window which faces within 90 degrees of due south. The BRE guide states that kitchens and bedrooms are less important, although care should be taken not to block too much sunlight. It also states that normally loss of sunlight need not be analysed to kitchens and bedrooms, except for bedrooms which also comprise a living space. The tests should also be applied to non-domestic buildings where there is a particular requirement for sunlight.

3.5.2 The test is intended to be applied to main windows which face within 90 degrees of due south. However, the BRE guide explains that if the main window faces within 90 degrees of due north, but a secondary window faces within 90 degrees of due south, sunlight to the secondary window should be checked. For completeness, we have tested all windows which face within 90 degrees of due south. The BRE guide states that sunlight availability may be adversely affected if the centre of the window:

- receives less than 25% of annual probable sunlight hours, or less than 5% of annual probable sunlight hours between 21 September and 21 March and
- receives less than 0.8 times its former sunlight hours during either period and
- has a reduction in sunlight received over the whole year greater than 4% of annual probable sunlight hours.

3.6 Overshadowing to Gardens and Open Spaces

3.6.1 The availability of sunlight should be checked for all open spaces where sunlight is required. This would normally include:

- Gardens, usually the main back garden of a house
- Parks and playing fields
- Children's playgrounds
- Outdoor swimming pools and paddling pools
- Sitting out areas, such as those between non-domestic buildings and in public squares
- Focal points for views such as a group of monuments or fountains.

-
- 3.6.2 One way to consider overshadowing is by preparing shadow plots. However, the BRE guide states that it must be borne in mind that nearly all structures will create areas of new shadow, and some degree of transient overshadowing is to be expected. Therefore, shadow plots are of limited use as interpretation of the plots is subjective. Shadow plots have not been undertaken as part of this assessment.
- 3.6.3 The BRE guide also contains an objective overshadowing test which has been adopted for the purpose of this assessment. The guide recommends that at least 50% of the area of each amenity space listed above should receive at least two hours of sunlight on 21 March. If as a result of new development an existing garden or amenity area does not meet the above, and the area which can receive two hours of sunlight on 21 March is less than 0.8 times its former value, then the loss of light is likely to be noticeable.

4 RESULTS OF THE ASSESSMENT

4.1 Windows & Amenity Areas Considered

4.1.1 The aim of the assessment is to assess the impact of the development on the light receivable by the neighbouring properties at 33 Pittville Gardens, 57, 59 & 63 Warminster Road and Ashleigh Lodge.

4.1.2 Appendix 1 provides a plan and photographs to indicate the positions of the windows and outdoor amenity areas analysed in this assessment. Appendix 2 lists the detailed numerical daylight and sunlight test results.

4.2 Daylight to Windows

Vertical Sky Component

4.2.1 All windows with a requirement for daylight pass the Vertical Sky Component test.

Daylight Distribution

4.2.2 We have undertaken the Daylight Distribution test where room layouts are known. All rooms with a requirement for daylight pass the daylight distribution test.

4.3 Sunlight to Windows

4.3.1 All windows that face within 90 degrees of due south have been tested for direct sunlight. All windows pass both the total annual sunlight hours test and the winter sunlight hours test. The proposed development therefore satisfies the BRE direct sunlight to windows requirements.

4.4 Overshadowing to Gardens and Open Spaces

4.4.1 All gardens and open spaces tested meet the BRE recommendations.

4.5 Conclusion

In summary, the numerical results in this assessment demonstrate that the proposed development will have a low impact on the light receivable by its neighbouring properties. In our opinion, the proposed development sufficiently safeguards the daylight and sunlight amenity of the neighbouring properties.

5 CLARIFICATIONS

5.1 General

- 5.1.1 The report provided is solely for the use of the client and no liability to anyone else is accepted.
- 5.1.2 The assessment is limited to assessing daylight, sunlight and overshadowing to neighbouring windows, gardens and open spaces as set out in section 2.2, 3.2 and 3.3 of the BRE Guide.
- 5.1.3 The assessment is based on the information listed in section 2 of this report and a site visit undertaken on 27 March 2023. We have not had access to neighbouring properties.
- 5.1.4 This assessment does not calculate the effects of trees and hedges on daylight, sunlight and overshadowing to gardens. The BRE guide states that it is usual to ignore the effect of existing trees.
- 5.1.5 We have undertaken the assessment following the guidelines of the RICS publication "Surveying Safely". Where limited access or information is available, assumptions will have been made which may affect the conclusions reached in this report. For example, where neighbouring room uses are not known, we will either make a reasonable assumption regarding the use based on external observations, or take the prudent approach of assuming the room is of domestic purposes.
- 5.1.6 This report is based upon and subject to the scope of work set out in Right of Light Consulting's quotation and standard terms and conditions.

APPENDICES

APPENDIX 1

WINDOW & GARDEN KEY



33 Pittville Gardens

Ashleigh Lodge


57 Warminster Road

Proposed
Development

59 Warminster Road

63 Warminster Road

Warminster Road

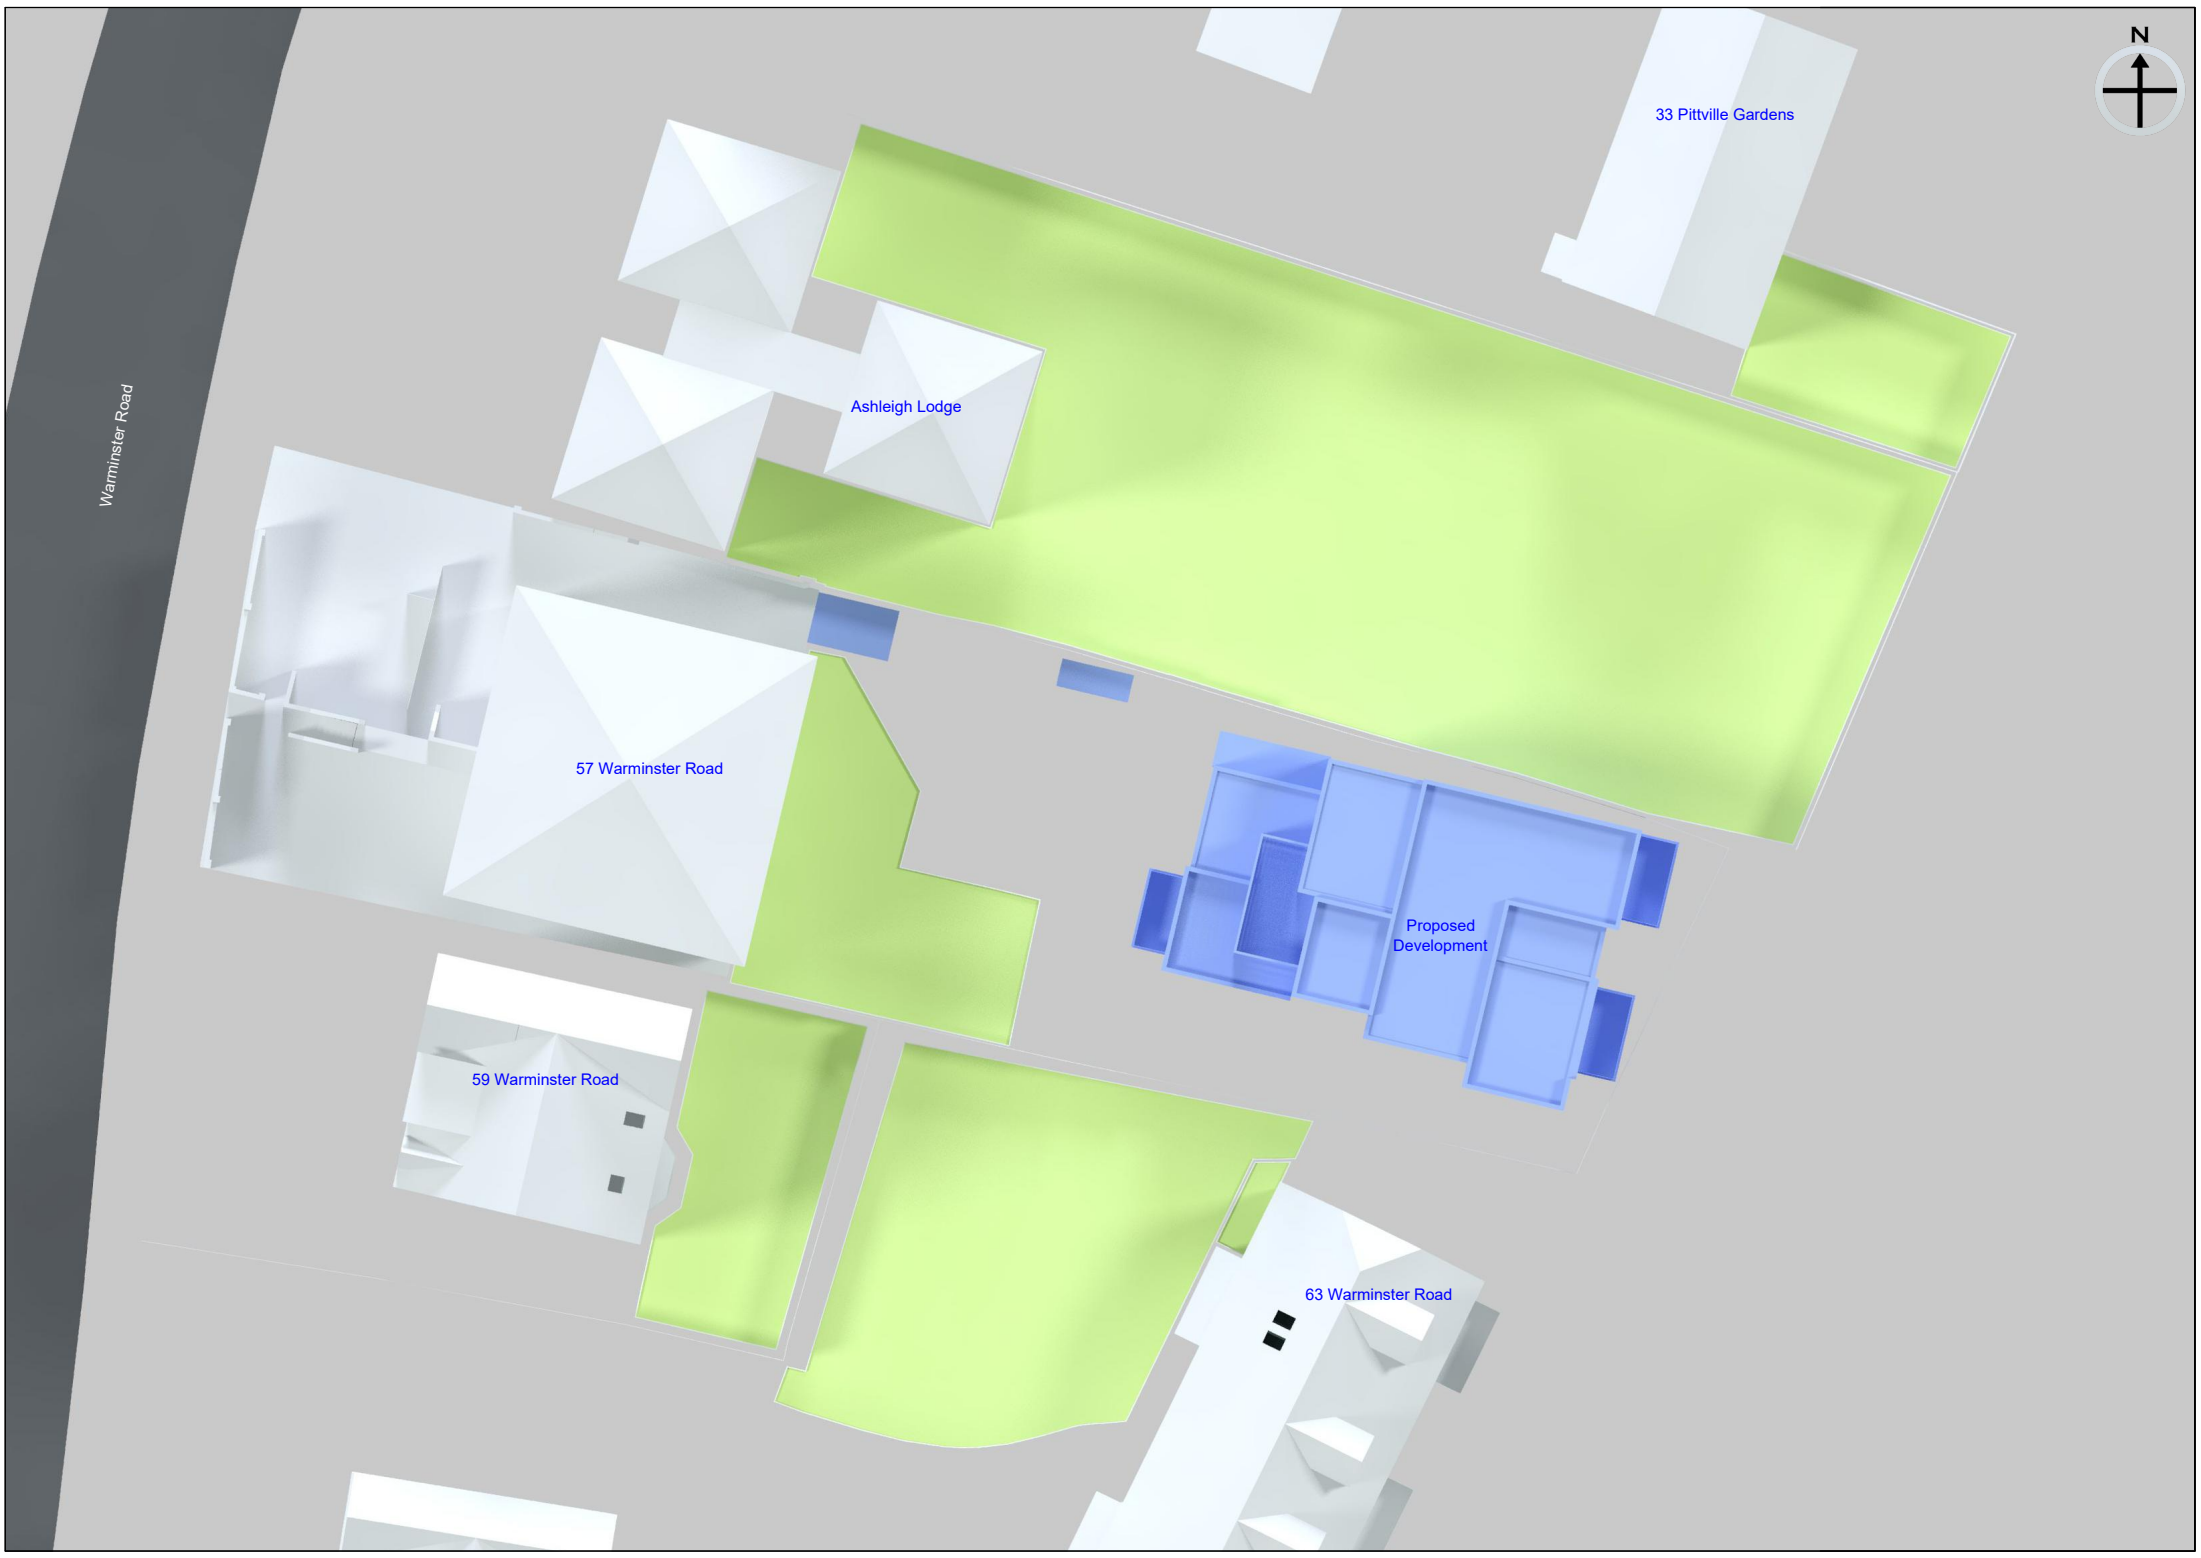



Warminster Road

57 Warminster Road


Ashleigh Lodge

59 Warminster Road

33 Pittville Gardens

Proposed Development

63 Warminster Road

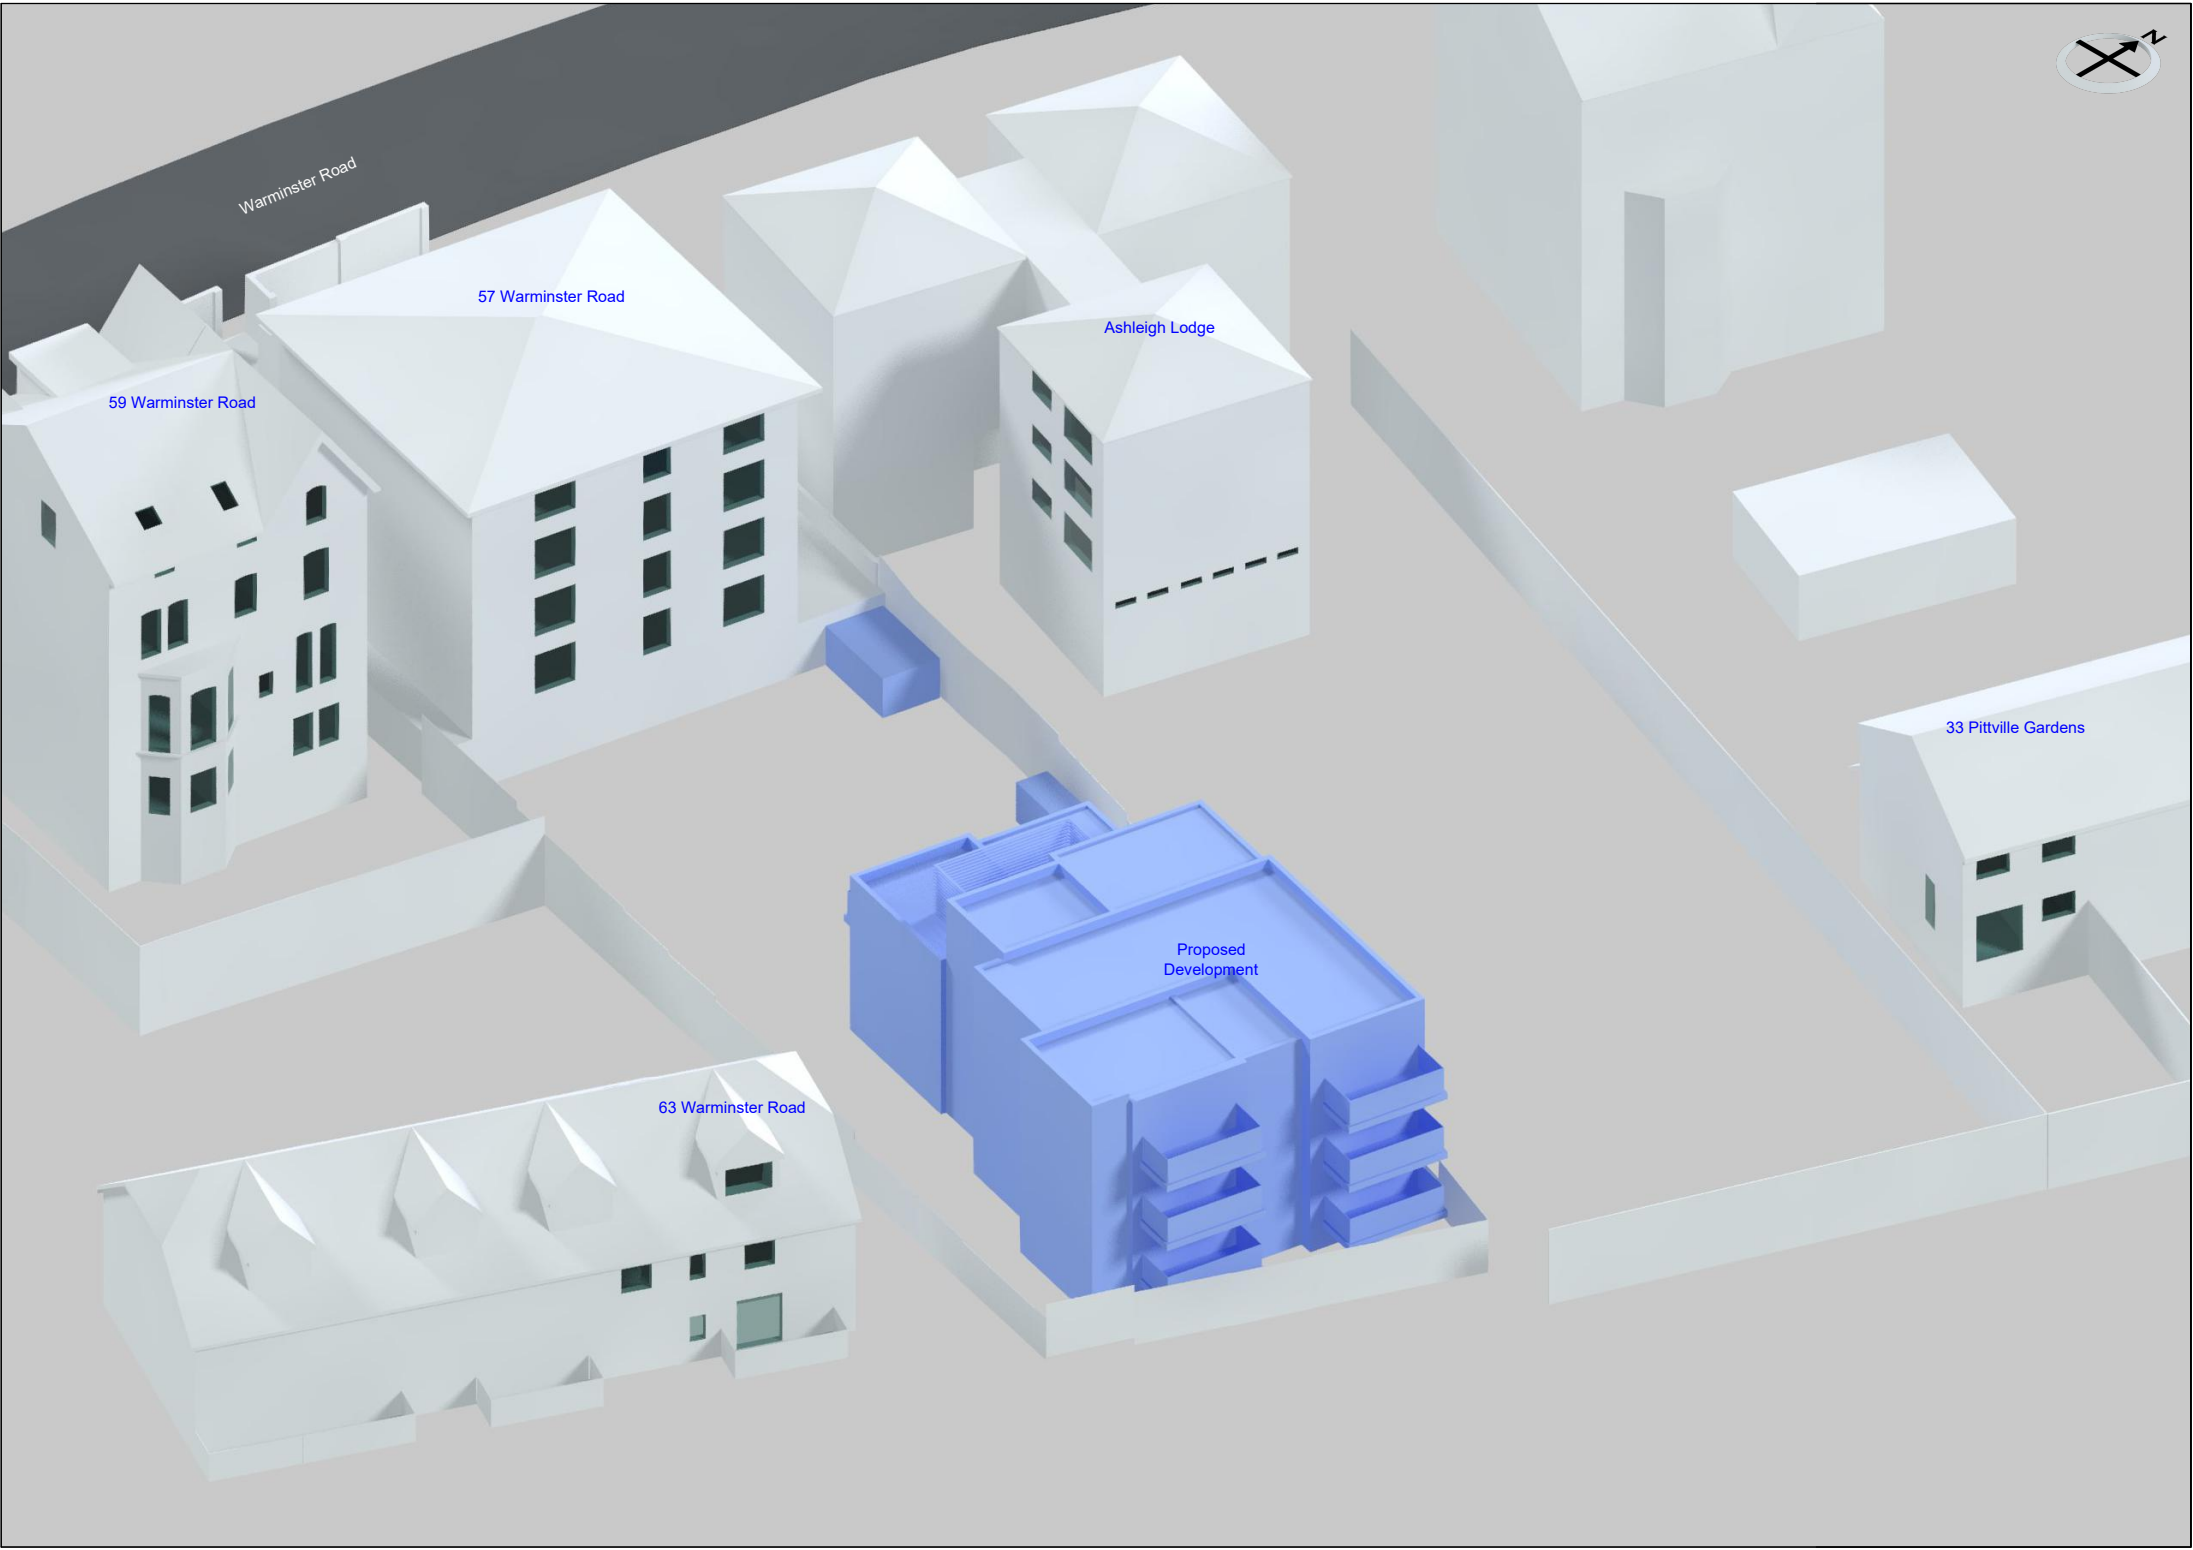



33 Pittville Gardens

Ashleigh Lodge


Proposed
Development

57 Warminster Road

63 Warminster Road

59 Warminster Road

Warminster Road

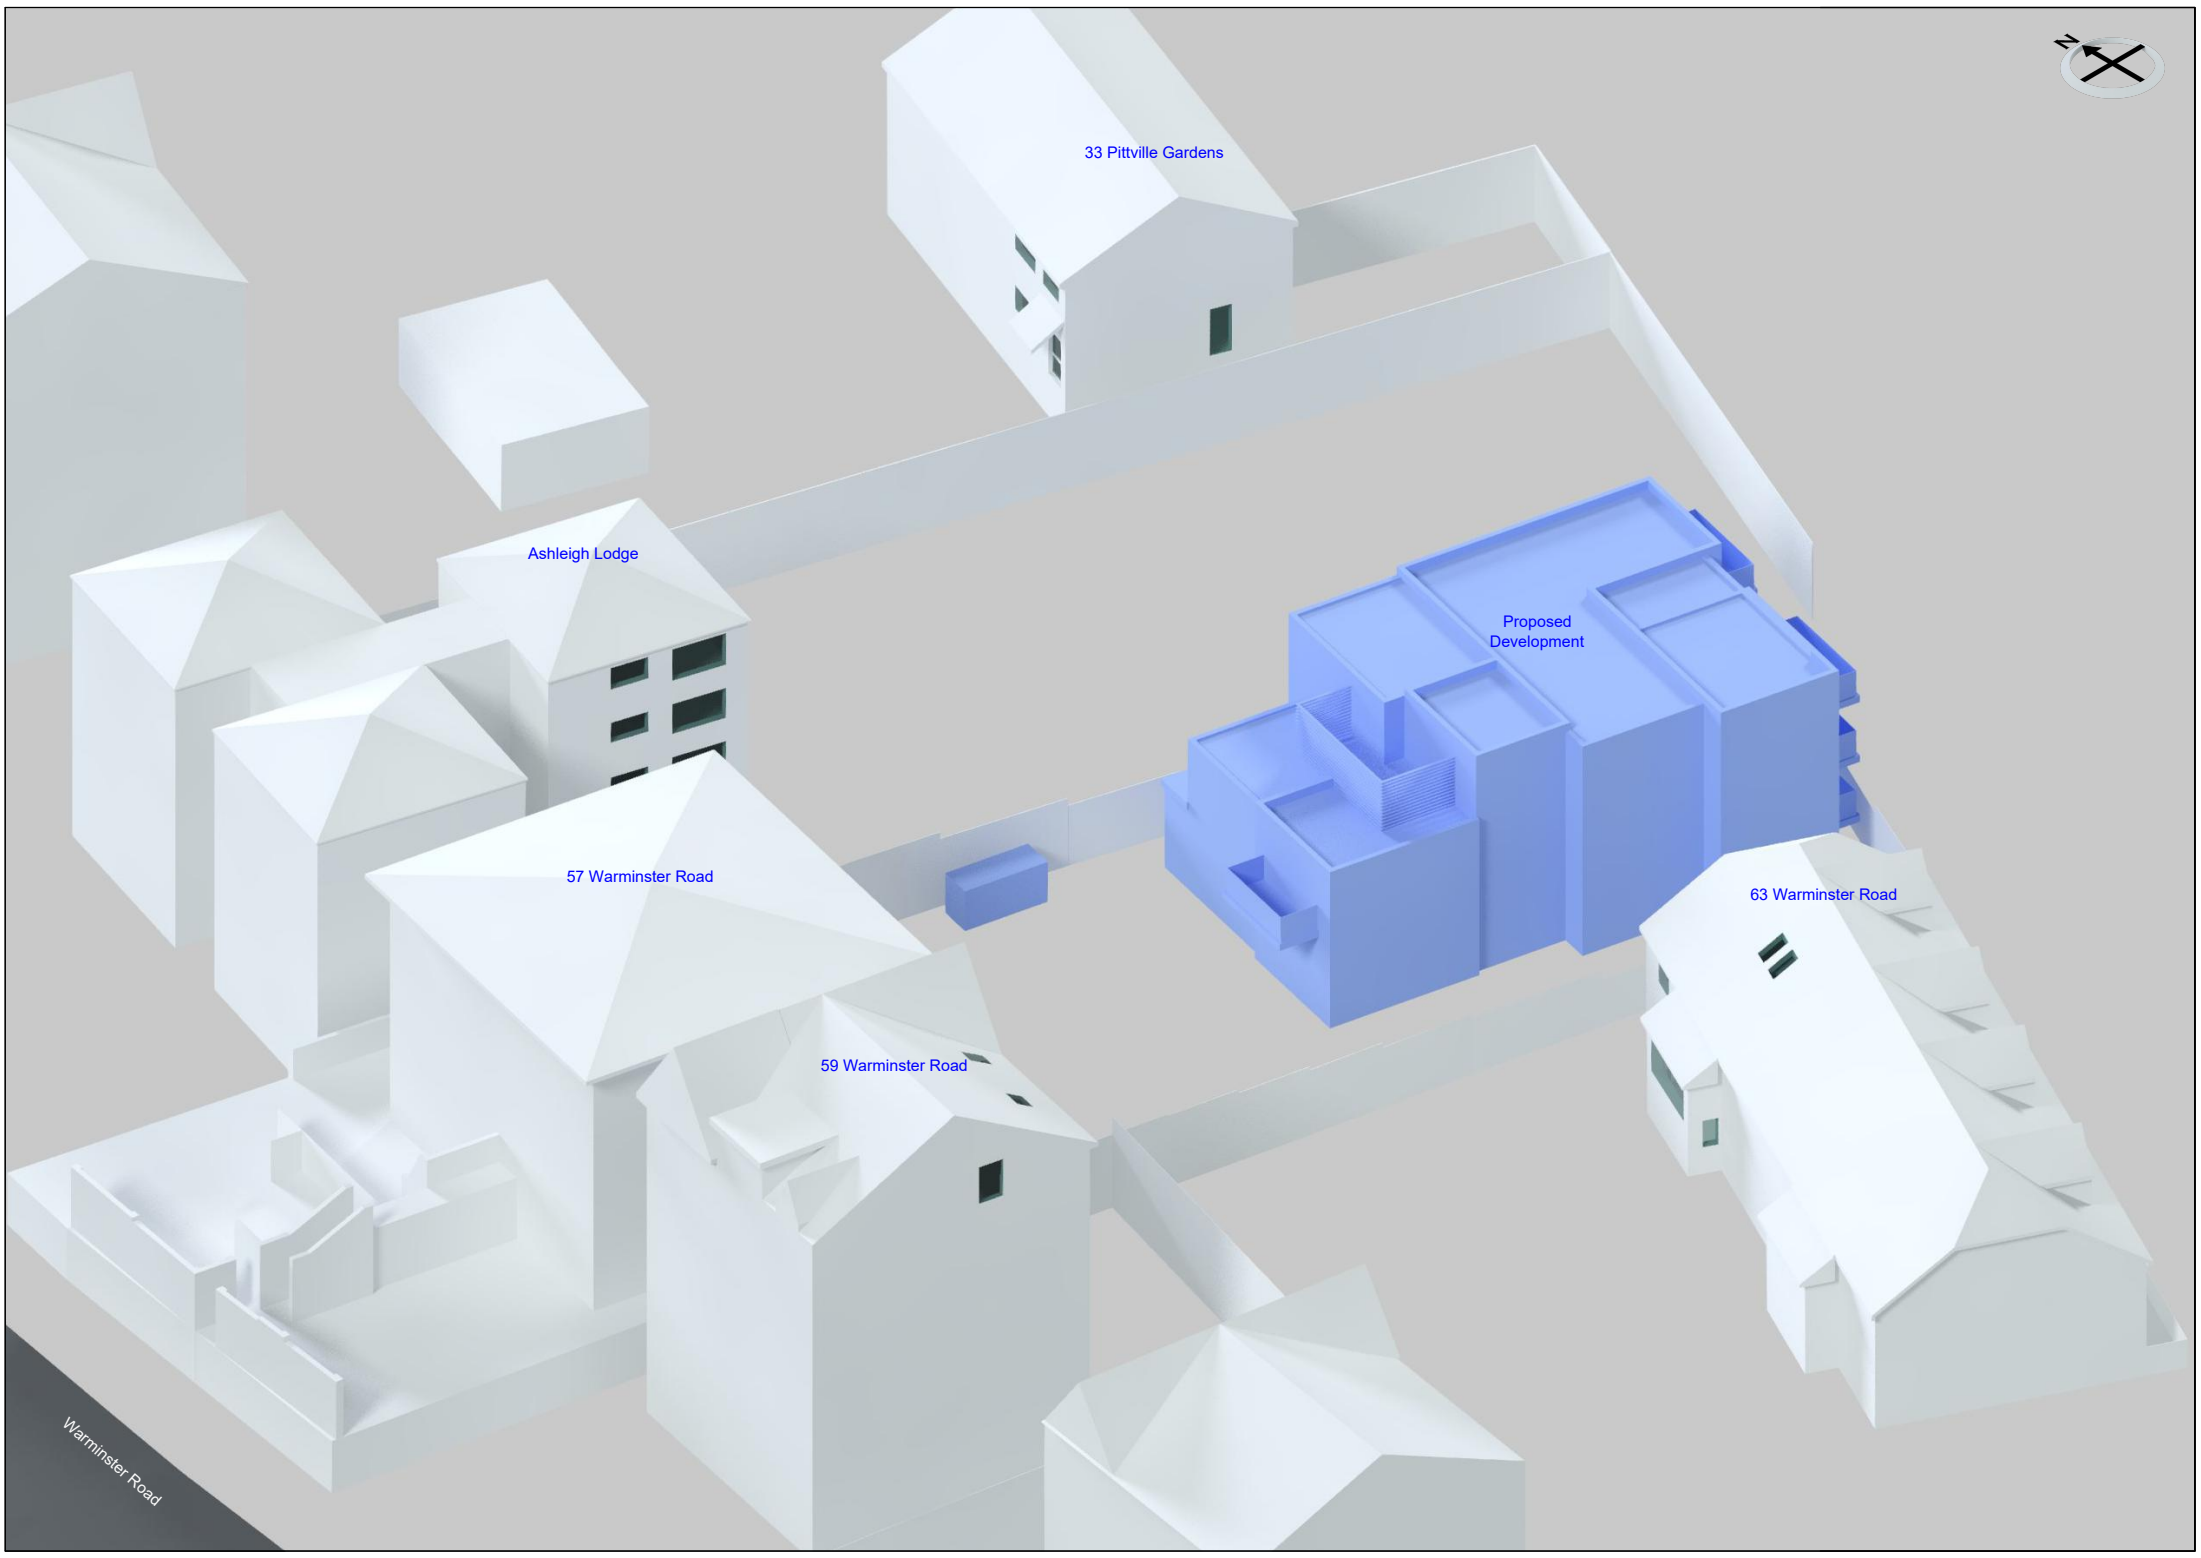



Warminster Road

59 Warminster Road





57 Warminster Road

63 Warminster Road

Proposed
Development

Ashleigh Lodge

33 Pittville Gardens

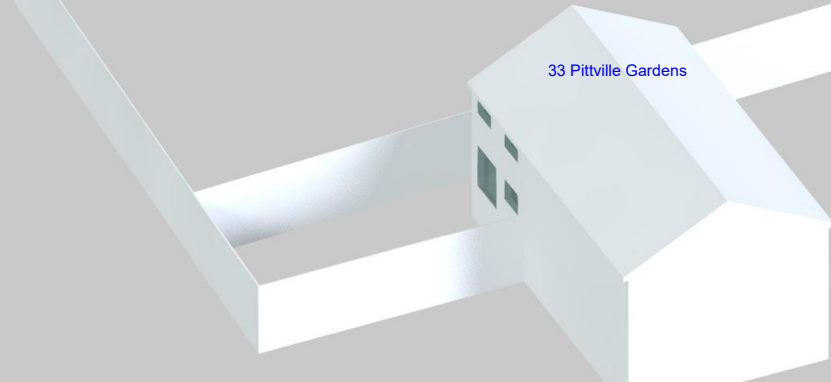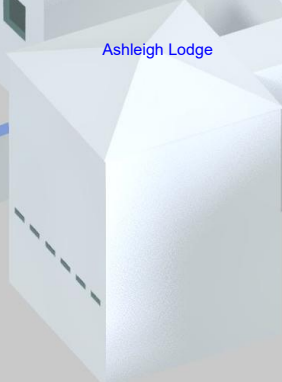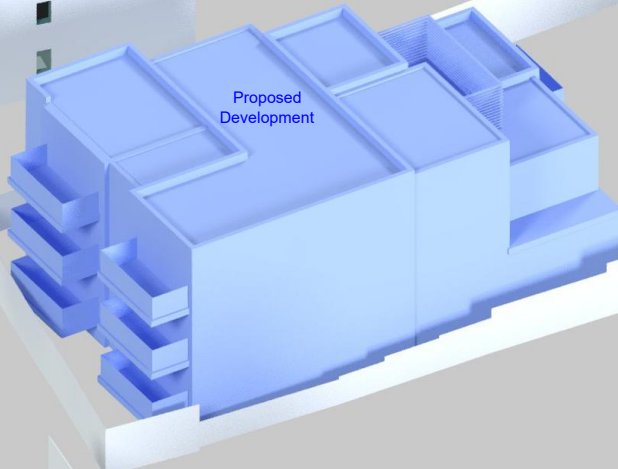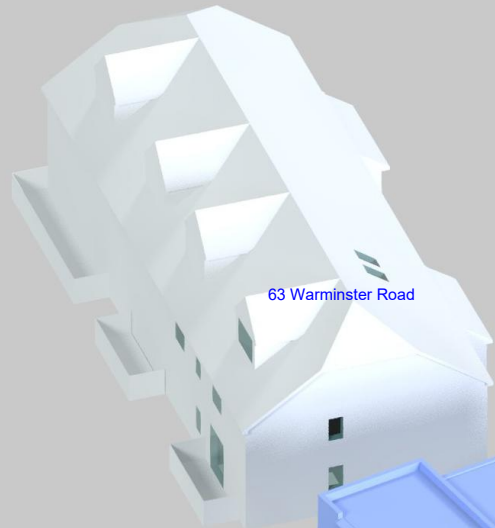



63 Warminster Road

Proposed Development


33 Pittville Gardens

59 Warminster Road


57 Warminster Road

Ashleigh Lodge


Warminster Road

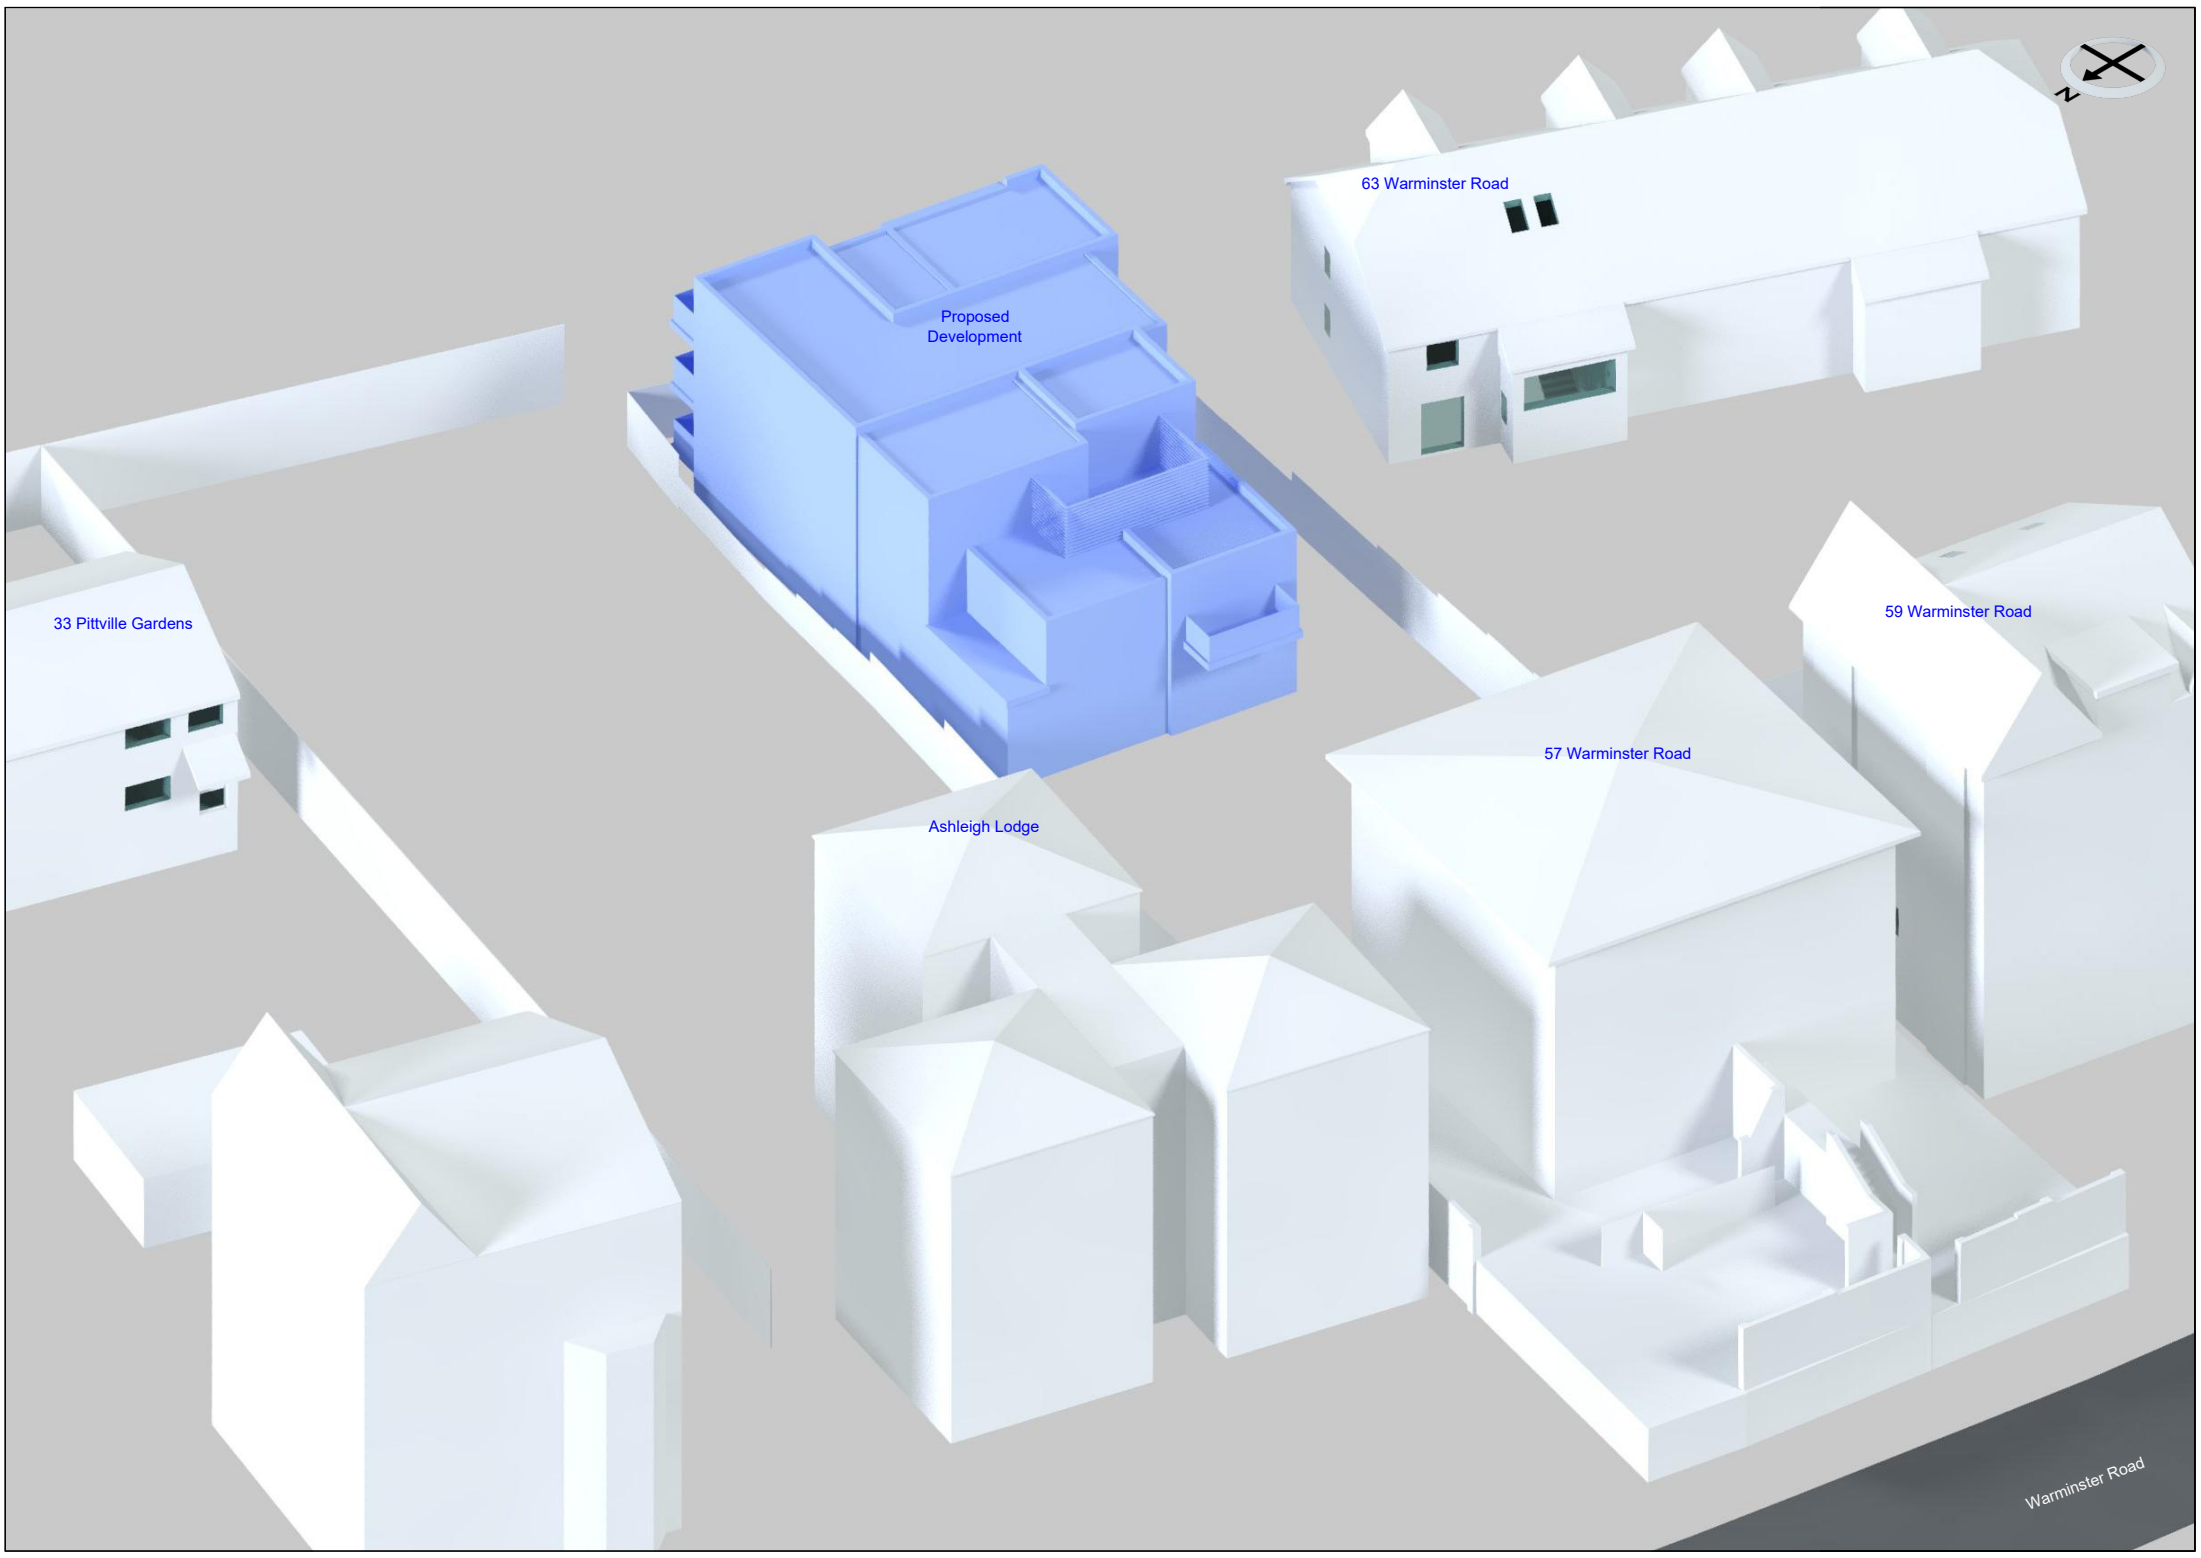


Neighbouring Windows

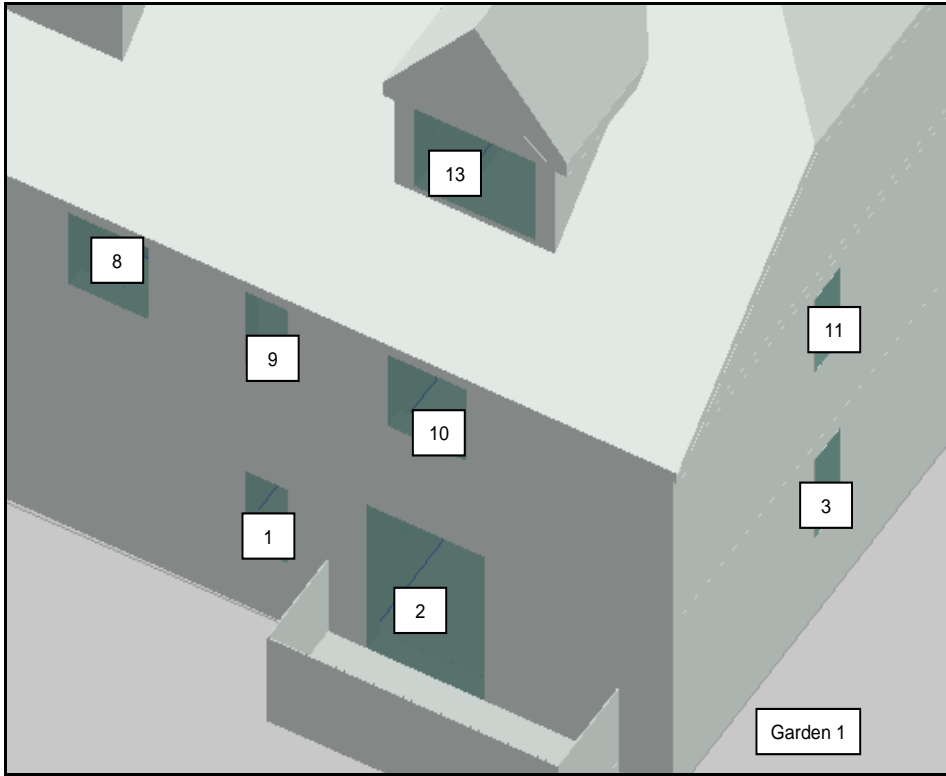

63 Warminster Road

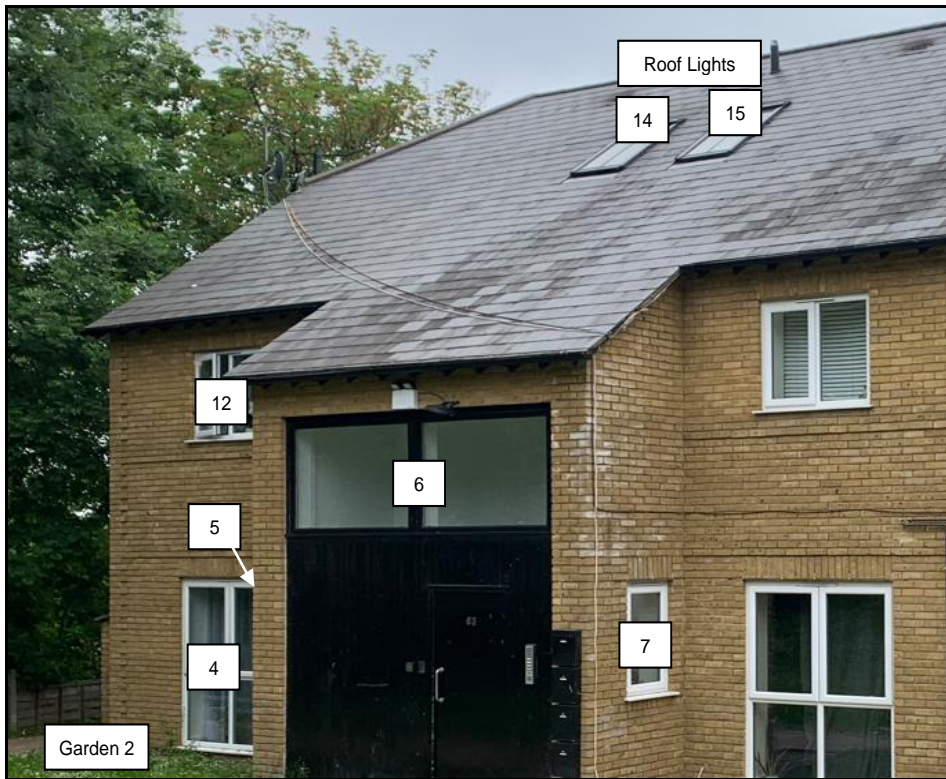

63 Warminster Road

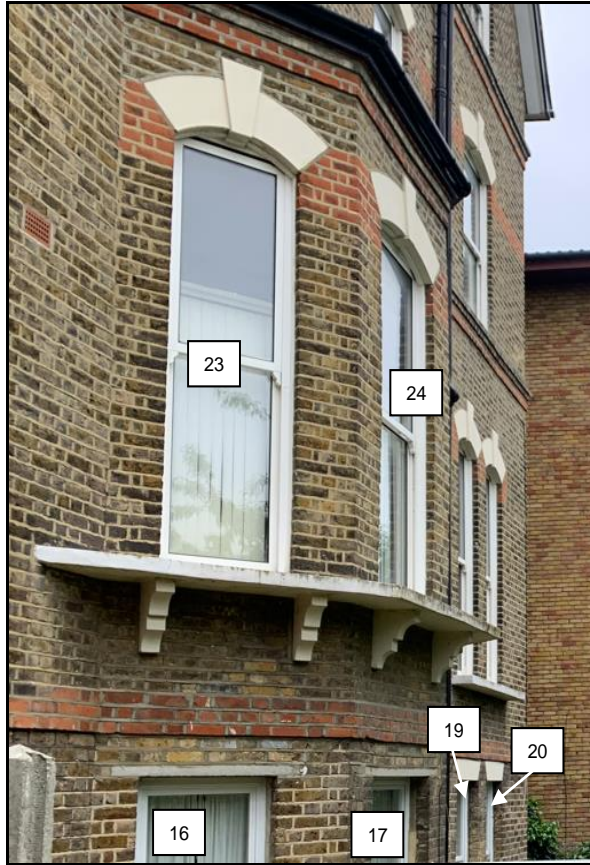

59 Warminster Road



59 Warminster Road



59 Warminster Road



59 Warminster Road



57 Warminster Road




Ashleigh Lodge



Ashleigh Lodge



33 Pittville Gardens

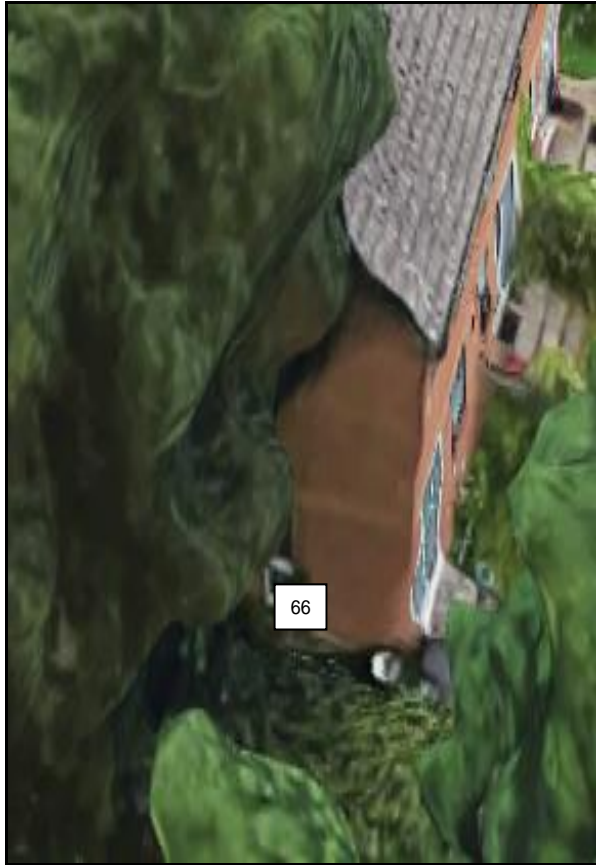

33 Pittville Gardens



33 Pittville Gardens

APPENDIX 2

DAYLIGHT AND SUNLIGHT RESULTS

Appendix 2 - Vertical Sky Component
The Hawthorns, 57 Warminster Road, London SE25 4DF

| Reference | Room Use | Vertical Sky Component | | | |
|---------------------------|----------------|------------------------|-------|-------|-------|
| | | Before | After | Loss | Ratio |
| <u>63 Warminster Road</u> | | | | | |
| <u>Ground Floor</u> | | | | | |
| Window 1 | Bathroom/WC | 39.5% | 39.5% | 0.0% | 1.0 |
| Window 2 | Bedroom | 39.5% | 39.5% | 0.0% | 1.0 |
| Window 3 | Bathroom/WC | 38.1% | 26.0% | 12.1% | 0.68 |
| Window 4 | Living/Dining | 29.1% | 27.6% | 1.5% | 0.95 |
| Window 5 | Hallway | 19.6% | 15.4% | 4.2% | 0.79 |
| Window 6 | Hallway | 31.0% | 30.6% | 0.4% | 0.99 |
| Window 7 | Hallway | 17.7% | 17.7% | 0.0% | 1.0 |
| <u>First Floor</u> | | | | | |
| Window 8 | Bedroom | 37.4% | 37.4% | 0.0% | 1.0 |
| Window 9 | Bedroom | 37.4% | 37.4% | 0.0% | 1.0 |
| Window 10 | Study | 37.4% | 37.4% | 0.0% | 1.0 |
| Window 11 | Living/Dining | 38.4% | 31.3% | 7.1% | 0.82 |
| Window 12 | Living/Dining | 31.3% | 30.7% | 0.6% | 0.98 |
| <u>Second Floor</u> | | | | | |
| Window 13 | Bedroom | 39.6% | 39.6% | 0.0% | 1.0 |
| Window 14 | Landing | 85.4% | 85.3% | 0.1% | 1.0 |
| Window 15 | Landing | 85.4% | 85.3% | 0.1% | 1.0 |
| <u>59 Warminster Road</u> | | | | | |
| <u>Ground Floor</u> | | | | | |
| Window 16 | Reception Room | 31.9% | 31.6% | 0.3% | 0.99 |
| Window 17 | Reception Room | 36.4% | 35.4% | 1.0% | 0.97 |
| Window 18 | Bedroom | 31.0% | 29.8% | 1.2% | 0.96 |
| Window 19 | Bedroom | 35.9% | 34.7% | 1.2% | 0.97 |
| Window 20 | Bedroom | 35.9% | 34.7% | 1.2% | 0.97 |
| Window 21 | Kitchen | 5.7% | 5.4% | 0.3% | 0.95 |
| Window 22 | Bathroom/WC | 5.9% | 5.7% | 0.2% | 0.97 |
| <u>First Floor</u> | | | | | |
| Window 23 | Domestic | 34.3% | 34.3% | 0.0% | 1.0 |
| Window 24 | Domestic | 38.5% | 38.2% | 0.3% | 0.99 |
| Window 25 | Domestic | 32.9% | 32.6% | 0.3% | 0.99 |
| Window 26 | Domestic | 36.5% | 36.0% | 0.5% | 0.99 |
| Window 27 | Domestic | 37.9% | 37.6% | 0.3% | 0.99 |
| Window 28 | Domestic | 37.7% | 37.4% | 0.3% | 0.99 |
| <u>Second Floor</u> | | | | | |
| Window 29 | Bedroom | 38.9% | 38.9% | 0.0% | 1.0 |
| Window 30 | Bedroom | 38.9% | 38.9% | 0.0% | 1.0 |
| Window 31 | Kitchen | 38.9% | 38.9% | 0.0% | 1.0 |

Appendix 2 - Vertical Sky Component

The Hawthorns, 57 Warminster Road, London SE25 4DF

| Reference | Room Use | Vertical Sky Component | | | |
|---------------------------|----------|------------------------|-------|------|-------|
| | | Before | After | Loss | Ratio |
| Window 32 | Bedroom | 39.0% | 39.0% | 0.0% | 1.0 |
| <u>Third Floor</u> | | | | | |
| Window 33 | Domestic | 37.2% | 37.2% | 0.0% | 1.0 |
| Window 34 | Domestic | 17.8% | 17.8% | 0.0% | 1.0 |
| Window 35 | Domestic | 89.2% | 89.2% | 0.0% | 1.0 |
| Window 36 | Domestic | 18.0% | 18.0% | 0.0% | 1.0 |
| Window 37 | Domestic | 84.5% | 84.5% | 0.0% | 1.0 |
| Window 38 | Domestic | 37.4% | 37.4% | 0.0% | 1.0 |
| <u>57 Warminster Road</u> | | | | | |
| <u>Ground Floor</u> | | | | | |
| Window 39 | Domestic | 37.4% | 35.9% | 1.5% | 0.96 |
| Window 40 | Domestic | 37.2% | 35.8% | 1.4% | 0.96 |
| Window 41 | Domestic | 36.6% | 35.1% | 1.5% | 0.96 |
| <u>First Floor</u> | | | | | |
| Window 42 | Domestic | 38.1% | 37.5% | 0.6% | 0.98 |
| Window 43 | Domestic | 38.0% | 37.3% | 0.7% | 0.98 |
| Window 44 | Domestic | 37.6% | 37.0% | 0.6% | 0.98 |
| <u>Second Floor</u> | | | | | |
| Window 45 | Domestic | 38.2% | 38.2% | 0.0% | 1.0 |
| Window 46 | Domestic | 38.1% | 38.1% | 0.0% | 1.0 |
| Window 47 | Domestic | 38.0% | 38.0% | 0.0% | 1.0 |
| <u>Third Floor</u> | | | | | |
| Window 48 | Domestic | 29.3% | 29.3% | 0.0% | 1.0 |
| Window 49 | Domestic | 29.5% | 29.5% | 0.0% | 1.0 |
| Window 50 | Domestic | 29.6% | 29.6% | 0.0% | 1.0 |
| <u>Ashleigh Lodge</u> | | | | | |
| <u>Ground Floor</u> | | | | | |
| Window 51 | Domestic | 38.4% | 36.5% | 1.9% | 0.95 |
| Window 52 | Domestic | 38.3% | 36.6% | 1.7% | 0.96 |
| Window 53 | Domestic | 38.3% | 36.7% | 1.6% | 0.96 |
| Window 54 | Domestic | 38.3% | 36.8% | 1.5% | 0.96 |
| Window 55 | Domestic | 38.3% | 36.8% | 1.5% | 0.96 |
| Window 56 | Domestic | 38.2% | 36.9% | 1.3% | 0.97 |
| <u>First Floor</u> | | | | | |
| Window 57 | Domestic | 27.8% | 27.4% | 0.4% | 0.99 |
| Window 58 | Domestic | 30.2% | 29.7% | 0.5% | 0.98 |

Appendix 2 - Vertical Sky Component

The Hawthorns, 57 Warminster Road, London SE25 4DF

| Reference | Room Use | Vertical Sky Component | | | | |
|-----------------------------|----------|------------------------|-------|------|-------|--|
| | | Before | After | Loss | Ratio | |
| <u>Second Floor</u> | | | | | | |
| Window 59 | Domestic | 31.8% | 31.7% | 0.1% | 1.0 | |
| Window 60 | Domestic | 33.3% | 33.2% | 0.1% | 1.0 | |
| <u>Third Floor</u> | | | | | | |
| Window 61 | Domestic | 35.7% | 35.7% | 0.0% | 1.0 | |
| Window 62 | Domestic | 36.2% | 36.2% | 0.0% | 1.0 | |
| <u>33 Pittville Gardens</u> | | | | | | |
| <u>Ground Floor</u> | | | | | | |
| Window 63 | Domestic | 32.4% | 32.4% | 0.0% | 1.0 | |
| Window 64 | Domestic | 24.7% | 24.7% | 0.0% | 1.0 | |
| Window 65 | Domestic | 11.8% | 11.8% | 0.0% | 1.0 | |
| Window 66 | Domestic | 37.0% | 35.0% | 2.0% | 0.95 | |
| Window 67 | Domestic | 39.5% | 39.4% | 0.1% | 1.0 | |
| Window 68 | Domestic | 39.5% | 39.4% | 0.1% | 1.0 | |
| <u>First Floor</u> | | | | | | |
| Window 69 | Domestic | 31.4% | 31.4% | 0.0% | 1.0 | |
| Window 70 | Domestic | 31.2% | 31.2% | 0.0% | 1.0 | |
| Window 71 | Domestic | 35.1% | 35.1% | 0.0% | 1.0 | |
| Window 72 | Domestic | 35.1% | 35.0% | 0.1% | 1.0 | |

Appendix 2 - Daylight Distribution

The Hawthorns, 57 Warminster Road, London SE25 4DF

| Reference | Room Use | Daylight Distribution | | | |
|---------------------------|----------------|-----------------------|-------|------|-------|
| | | Before | After | Loss | Ratio |
| <u>63 Warminster Road</u> | | | | | |
| <u>Ground Floor</u> | | | | | |
| Window 1 | Bathroom/WC | 94% | 94% | 0% | 1.0 |
| Window 2 | Bedroom | 94% | 94% | 0% | 1.0 |
| Window 3 | Bathroom/WC | 94% | 71% | 23% | 0.76 |
| Window 4 | Living/Dining | 93% | 92% | 1% | 0.99 |
| Windows 5 to 7 | Hallway | 95% | 95% | 0% | 1.0 |
| Window 5 to 7 | Staircase | 72% | 72% | 0% | 1.0 |
| <u>First Floor</u> | | | | | |
| Windows 8 & 9 | Bedroom | 93% | 93% | 0% | 1.0 |
| Window 10 | Study | 88% | 88% | 0% | 1.0 |
| Windows 11 & 12 | Living/Dining | 94% | 94% | 0% | 1.0 |
| Window 14 | Staircase | 66% | 66% | 0% | 1.0 |
| Window 15 | Staircase | 67% | 67% | 0% | 1.0 |
| <u>Second Floor</u> | | | | | |
| Window 13 | Bedroom | 89% | 89% | 0% | 1.0 |
| Window 14 | Landing | 76% | 76% | 0% | 1.0 |
| Window 15 | Landing | 75% | 75% | 0% | 1.0 |
| <u>59 Warminster Road</u> | | | | | |
| <u>Ground Floor</u> | | | | | |
| Windows 16 & 17 | Reception Room | 97% | 97% | 0% | 1.0 |
| Window 18 | Bedroom | 57% | 57% | 0% | 1.0 |
| Windows 19 & 20 | Bedroom | 97% | 97% | 0% | 1.0 |
| Window 21 | Kitchen | 9% | 9% | 0% | 1.0 |
| Window 22 | Bathroom/WC | 16% | 16% | 0% | 1.0 |
| <u>First Floor</u> | | | | | |
| Windows 23 to 25 | Domestic | 99% | 99% | 0% | 1.0 |
| Window 26 | Domestic | 96% | 96% | 0% | 1.0 |
| Windows 27 & 28 | Domestic | 98% | 98% | 0% | 1.0 |
| <u>Second Floor</u> | | | | | |
| Windows 29 & 30 | Bedroom | 97% | 97% | 0% | 1.0 |
| Window 31 | Kitchen | 98% | 98% | 0% | 1.0 |
| Window 32 | Bedroom | 97% | 97% | 0% | 1.0 |
| <u>Third Floor</u> | | | | | |
| Windows 33 to 35 | Domestic | 100% | 100% | 0% | 1.0 |
| Windows 36 & 37 | Domestic | 100% | 100% | 0% | 1.0 |
| Window 38 | Domestic | 95% | 95% | 0% | 1.0 |

Appendix 2 - Daylight Distribution

The Hawthorns, 57 Warminster Road, London SE25 4DF

| Reference | Room Use | Daylight Distribution | | | | |
|-----------------------|----------|-----------------------|-------|------|-------|--|
| | | Before | After | Loss | Ratio | |
| <u>Ashleigh Lodge</u> | | | | | | |
| <u>First Floor</u> | | | | | | |
| Window 57 | Domestic | 92% | 92% | 0% | 1.0 | |
| Window 58 | Domestic | 99% | 99% | 0% | 1.0 | |

Appendix 2 - Sunlight to Windows

The Hawthorns, 57 Warminster Road, London SE25 4DF

| Reference | Room Use | Sunlight to Windows | | | | | | | |
|---------------------------|----------------|----------------------|-------|------|-------|-----------------------|-------|------|-------|
| | | Total Sunlight Hours | | | | Winter Sunlight Hours | | | |
| | | Before | After | Loss | Ratio | Before | After | Loss | Ratio |
| <u>63 Warminster Road</u> | | | | | | | | | |
| <u>Ground Floor</u> | | | | | | | | | |
| Window 1 | Bathroom/WC | 61% | 61% | 0% | 1.0 | 21% | 21% | 0% | 1.0 |
| Window 2 | Bedroom | 61% | 61% | 0% | 1.0 | 21% | 21% | 0% | 1.0 |
| Window 7 | Hallway | 33% | 33% | 0% | 1.0 | 7% | 7% | 0% | 1.0 |
| <u>First Floor</u> | | | | | | | | | |
| Window 8 | Bedroom | 56% | 56% | 0% | 1.0 | 20% | 20% | 0% | 1.0 |
| Window 9 | Bedroom | 57% | 57% | 0% | 1.0 | 20% | 20% | 0% | 1.0 |
| Window 10 | Study | 56% | 56% | 0% | 1.0 | 20% | 20% | 0% | 1.0 |
| <u>Second Floor</u> | | | | | | | | | |
| Window 13 | Bedroom | 64% | 64% | 0% | 1.0 | 21% | 21% | 0% | 1.0 |
| <u>59 Warminster Road</u> | | | | | | | | | |
| <u>Ground Floor</u> | | | | | | | | | |
| Window 16 | Reception Room | 56% | 55% | 1% | 0.98 | 13% | 13% | 0% | 1.0 |
| Window 17 | Reception Room | 53% | 52% | 1% | 0.98 | 14% | 14% | 0% | 1.0 |
| Window 19 | Bedroom | 48% | 48% | 0% | 1.0 | 13% | 13% | 0% | 1.0 |
| Window 20 | Bedroom | 49% | 49% | 0% | 1.0 | 13% | 13% | 0% | 1.0 |
| <u>First Floor</u> | | | | | | | | | |
| Window 23 | Domestic | 60% | 60% | 0% | 1.0 | 17% | 17% | 0% | 1.0 |
| Window 24 | Domestic | 57% | 57% | 0% | 1.0 | 18% | 18% | 0% | 1.0 |
| Window 26 | Domestic | 46% | 46% | 0% | 1.0 | 11% | 11% | 0% | 1.0 |
| Window 27 | Domestic | 54% | 54% | 0% | 1.0 | 17% | 17% | 0% | 1.0 |
| Window 28 | Domestic | 54% | 54% | 0% | 1.0 | 17% | 17% | 0% | 1.0 |
| <u>Second Floor</u> | | | | | | | | | |
| Window 29 | Bedroom | 55% | 55% | 0% | 1.0 | 17% | 17% | 0% | 1.0 |
| Window 30 | Bedroom | 52% | 52% | 0% | 1.0 | 17% | 17% | 0% | 1.0 |
| Window 31 | Kitchen | 51% | 51% | 0% | 1.0 | 16% | 16% | 0% | 1.0 |
| Window 32 | Bedroom | 51% | 51% | 0% | 1.0 | 16% | 16% | 0% | 1.0 |
| <u>Third Floor</u> | | | | | | | | | |
| Window 33 | Domestic | 87% | 87% | 0% | 1.0 | 30% | 30% | 0% | 1.0 |
| Window 34 | Domestic | 23% | 23% | 0% | 1.0 | 9% | 9% | 0% | 1.0 |
| Window 35 | Domestic | 87% | 87% | 0% | 1.0 | 26% | 26% | 0% | 1.0 |
| Window 36 | Domestic | 23% | 23% | 0% | 1.0 | 9% | 9% | 0% | 1.0 |
| Window 37 | Domestic | 87% | 87% | 0% | 1.0 | 26% | 26% | 0% | 1.0 |
| Window 38 | Domestic | 49% | 49% | 0% | 1.0 | 15% | 15% | 0% | 1.0 |

Appendix 2 - Sunlight to Windows

The Hawthorns, 57 Warminster Road, London SE25 4DF

| Reference | Room Use | Sunlight to Windows | | | | | | | | |
|---------------------------|----------|----------------------|-------|------|-------|-----------------------|-------|------|-------|--|
| | | Total Sunlight Hours | | | | Winter Sunlight Hours | | | | |
| | | Before | After | Loss | Ratio | Before | After | Loss | Ratio | |
| <u>57 Warminster Road</u> | | | | | | | | | | |
| <u>Ground Floor</u> | | | | | | | | | | |
| Window 39 | Domestic | 57% | 57% | 0% | 1.0 | 17% | 17% | 0% | 1.0 | |
| Window 40 | Domestic | 55% | 55% | 0% | 1.0 | 17% | 17% | 0% | 1.0 | |
| Window 41 | Domestic | 55% | 54% | 1% | 0.98 | 18% | 17% | 1% | 0.94 | |
| <u>First Floor</u> | | | | | | | | | | |
| Window 42 | Domestic | 56% | 56% | 0% | 1.0 | 17% | 17% | 0% | 1.0 | |
| Window 43 | Domestic | 55% | 55% | 0% | 1.0 | 18% | 18% | 0% | 1.0 | |
| Window 44 | Domestic | 54% | 54% | 0% | 1.0 | 17% | 17% | 0% | 1.0 | |
| <u>Second Floor</u> | | | | | | | | | | |
| Window 45 | Domestic | 52% | 52% | 0% | 1.0 | 18% | 18% | 0% | 1.0 | |
| Window 46 | Domestic | 50% | 50% | 0% | 1.0 | 16% | 16% | 0% | 1.0 | |
| Window 47 | Domestic | 50% | 50% | 0% | 1.0 | 16% | 16% | 0% | 1.0 | |
| <u>Third Floor</u> | | | | | | | | | | |
| Window 48 | Domestic | 39% | 39% | 0% | 1.0 | 13% | 13% | 0% | 1.0 | |
| Window 49 | Domestic | 39% | 39% | 0% | 1.0 | 13% | 13% | 0% | 1.0 | |
| Window 50 | Domestic | 40% | 40% | 0% | 1.0 | 13% | 13% | 0% | 1.0 | |
| <u>Ashleigh Lodge</u> | | | | | | | | | | |
| <u>Ground Floor</u> | | | | | | | | | | |
| Window 51 | Domestic | 59% | 58% | 1% | 0.98 | 20% | 19% | 1% | 0.95 | |
| Window 52 | Domestic | 59% | 58% | 1% | 0.98 | 20% | 19% | 1% | 0.95 | |
| Window 53 | Domestic | 59% | 58% | 1% | 0.98 | 20% | 19% | 1% | 0.95 | |
| Window 54 | Domestic | 59% | 58% | 1% | 0.98 | 20% | 19% | 1% | 0.95 | |
| Window 55 | Domestic | 59% | 59% | 0% | 1.0 | 20% | 20% | 0% | 1.0 | |
| Window 56 | Domestic | 60% | 60% | 0% | 1.0 | 20% | 20% | 0% | 1.0 | |
| <u>First Floor</u> | | | | | | | | | | |
| Window 57 | Domestic | 62% | 61% | 1% | 0.98 | 20% | 19% | 1% | 0.95 | |
| Window 58 | Domestic | 69% | 68% | 1% | 0.99 | 23% | 22% | 1% | 0.96 | |
| <u>Second Floor</u> | | | | | | | | | | |
| Window 59 | Domestic | 73% | 73% | 0% | 1.0 | 22% | 22% | 0% | 1.0 | |
| Window 60 | Domestic | 75% | 75% | 0% | 1.0 | 23% | 23% | 0% | 1.0 | |
| <u>Third Floor</u> | | | | | | | | | | |
| Window 61 | Domestic | 78% | 78% | 0% | 1.0 | 27% | 27% | 0% | 1.0 | |
| Window 62 | Domestic | 80% | 80% | 0% | 1.0 | 27% | 27% | 0% | 1.0 | |

Appendix 2 - Sunlight to Windows

The Hawthorns, 57 Warminster Road, London SE25 4DF

| Reference | Room Use | Sunlight to Windows | | | | | | | | |
|-----------------------------|----------|----------------------|-------|------|-------|-----------------------|-------|------|-------|--|
| | | Total Sunlight Hours | | | | Winter Sunlight Hours | | | | |
| | | Before | After | Loss | Ratio | Before | After | Loss | Ratio | |
| <u>33 Pittville Gardens</u> | | | | | | | | | | |
| <u>Ground Floor</u> | | | | | | | | | | |
| Window 66 | Domestic | 82% | 81% | 1% | 0.99 | 28% | 27% | 1% | 0.96 | |
| Window 67 | Domestic | 60% | 60% | 0% | 1.0 | 20% | 20% | 0% | 1.0 | |
| Window 68 | Domestic | 60% | 60% | 0% | 1.0 | 20% | 20% | 0% | 1.0 | |
| <u>First Floor</u> | | | | | | | | | | |
| Window 71 | Domestic | 50% | 50% | 0% | 1.0 | 17% | 17% | 0% | 1.0 | |
| Window 72 | Domestic | 49% | 49% | 0% | 1.0 | 16% | 16% | 0% | 1.0 | |

Appendix 2 - Overshadowing to Gardens and Open Spaces
The Hawthorns, 57 Warminster Road, London SE25 4DF



| Reference | Total Area | Area receiving at least two hours of sunlight on 21st March | | | | | | | | | |
|-----------------------------|------------|---|------|-----------|-------|----------|----|------|--|-------|--|
| | | Before | | | After | | | Loss | | Ratio | |
| <u>63 Warminster Road</u> | | | | | | | | | | | |
| <u>Ground Floor</u> | | | | | | | | | | | |
| Garden 1 | 317.11 m2 | 317.1 m2 | 100% | 317.1 m2 | 100% | 0.0 m2 | 0% | 1.0 | | | |
| Garden 2 | 7.34 m2 | 3.89 m2 | 53% | 3.89 m2 | 53% | 0.0 m2 | 0% | 1.0 | | | |
| <u>59 Warminster Road</u> | | | | | | | | | | | |
| <u>Ground Floor</u> | | | | | | | | | | | |
| Garden 3 | 120.11 m2 | 108.54 m2 | 90% | 108.54 m2 | 90% | 0.0 m2 | 0% | 1.0 | | | |
| <u>57 Warminster Road</u> | | | | | | | | | | | |
| <u>Ground Floor</u> | | | | | | | | | | | |
| Garden 4 | 152.41 m2 | 141.37 m2 | 93% | 141.37 m2 | 93% | 0.0 m2 | 0% | 1.0 | | | |
| <u>Ashleigh Lodge</u> | | | | | | | | | | | |
| <u>Ground Floor</u> | | | | | | | | | | | |
| Garden 5 | 1042.28 m2 | 987.22 m2 | 95% | 925.83 m2 | 89% | 61.39 m2 | 6% | 0.94 | | | |
| <u>33 Pittville Gardens</u> | | | | | | | | | | | |
| <u>Ground Floor</u> | | | | | | | | | | | |
| Garden 6 | 84.43 m2 | 66.17 m2 | 78% | 66.17 m2 | 78% | 0.0 m2 | 0% | 1.0 | | | |


APPENDIX 3

OVERSHADOWING TO GARDENS AND OPEN SPACES



Key

-  Receives under two hours sunlight on 21st March before and after the development.
-  Receives under two hours sunlight on 21st March before the development; but will receive at least two hours sunlight on 21st March after the development (light improved).
-  Receives at least two hours sunlight on 21st March before the development; but will receive under two hours sunlight after the development (light loss).
-  Receives at least two hours sunlight on 21st March before and after the development.
-  Neighbouring Gardens and Amenity Areas

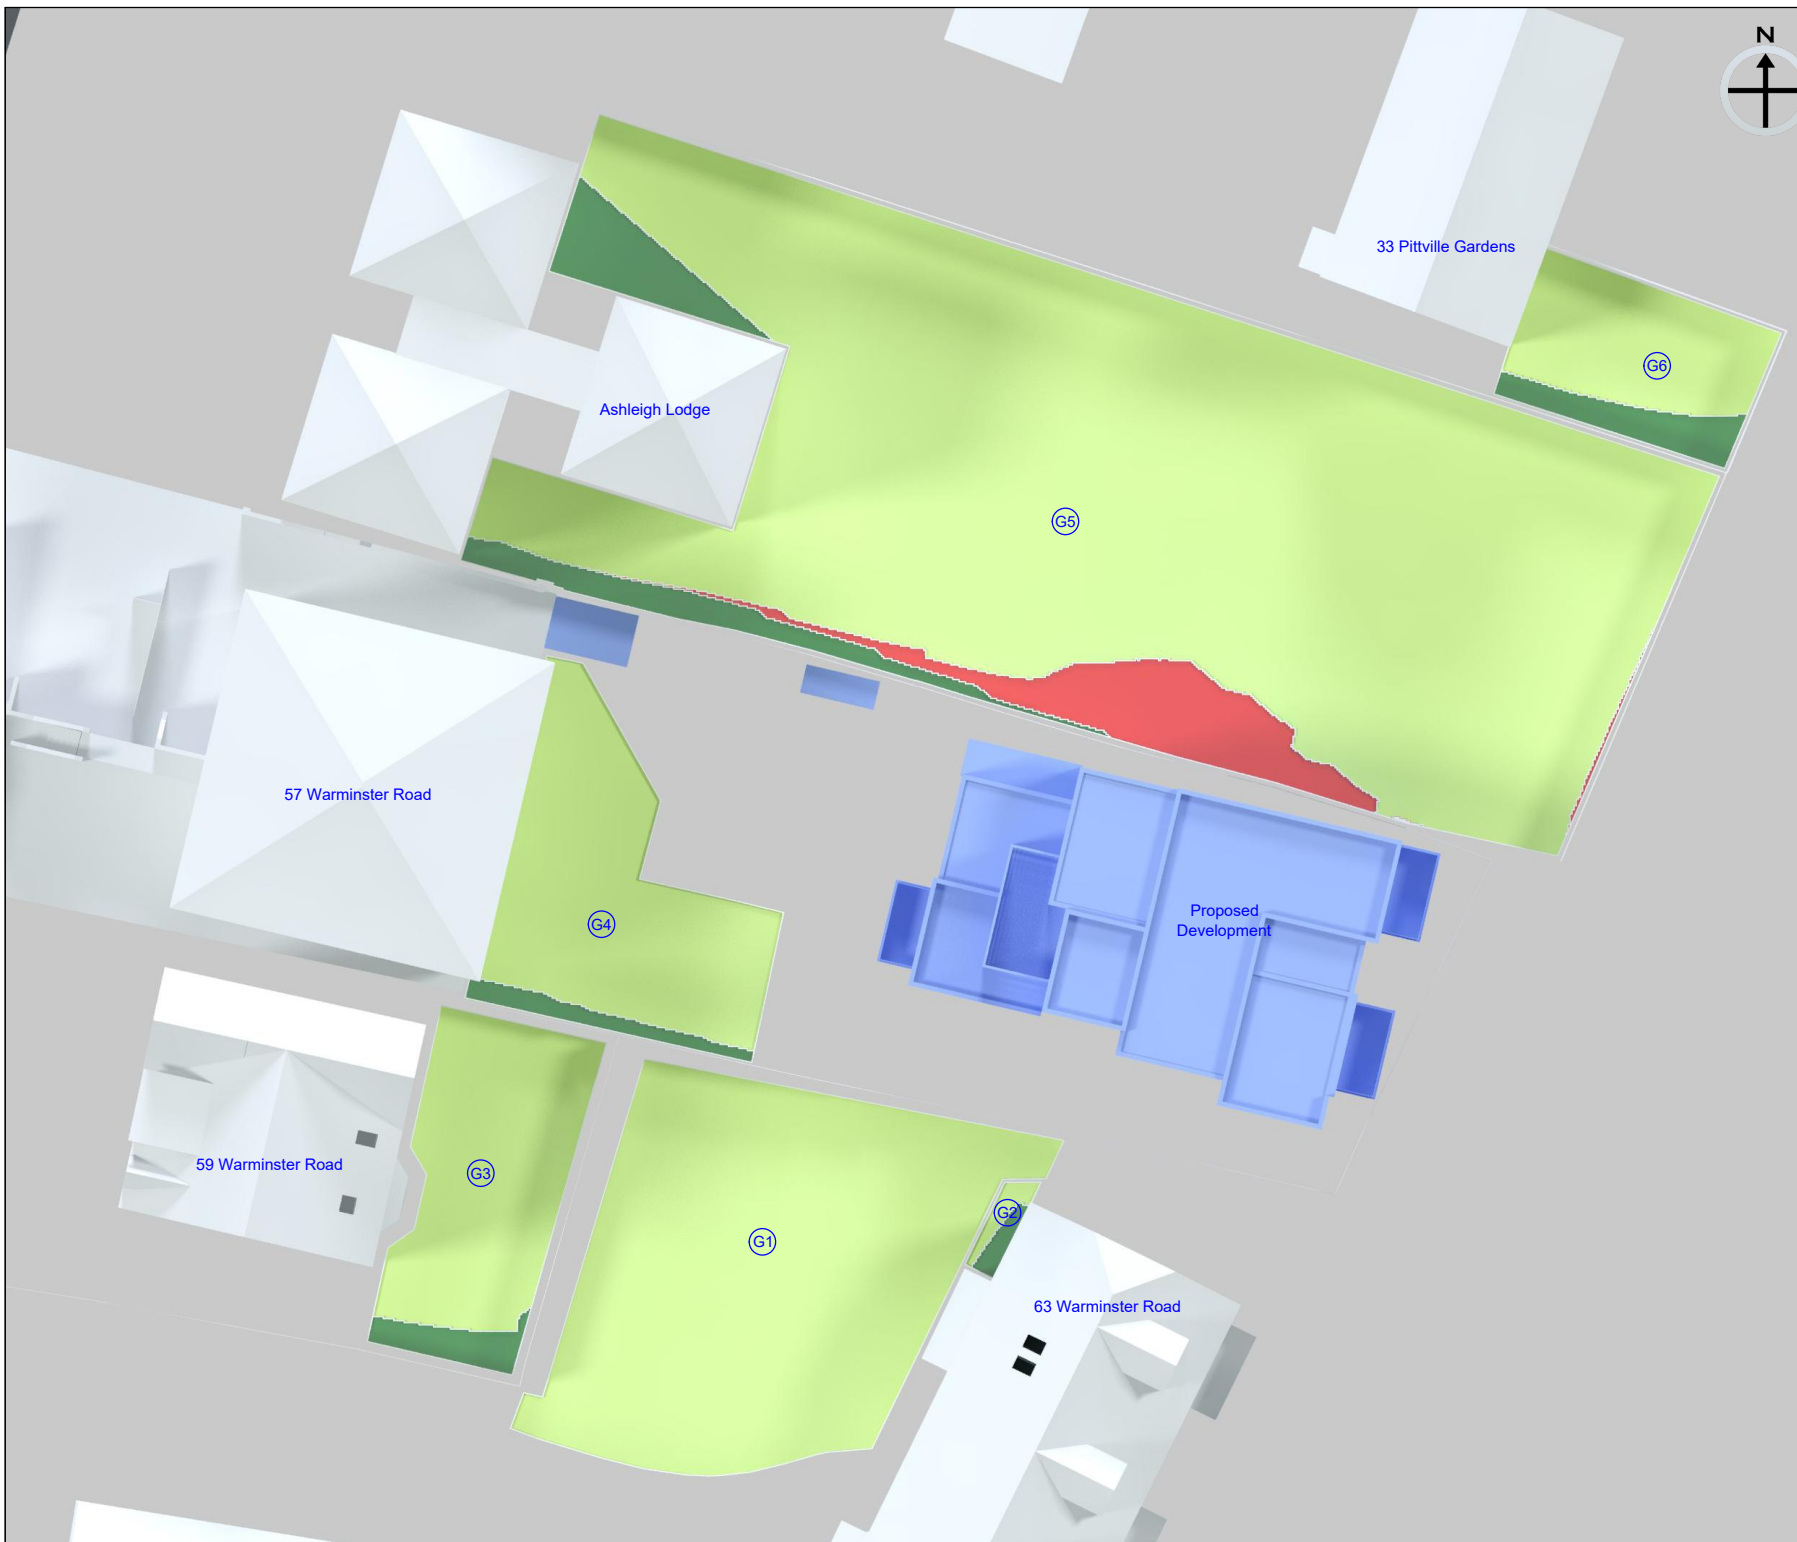

Drawing Title: Appendix 3 - Overshadowing to Gardens and Open Spaces



RIGHT OF LIGHT CONSULTING
Chartered Surveyors

Right of Light Consulting
Burley House
15 - 17 High Street
Rayleigh
ESSEX
SS6 7EW
TEL 0800 197 4836
E-MAIL enquiries@right-of-light.co.uk
WEBSITE www.right-of-light.co.uk