



EXISTING ROOF PLAN 1:100

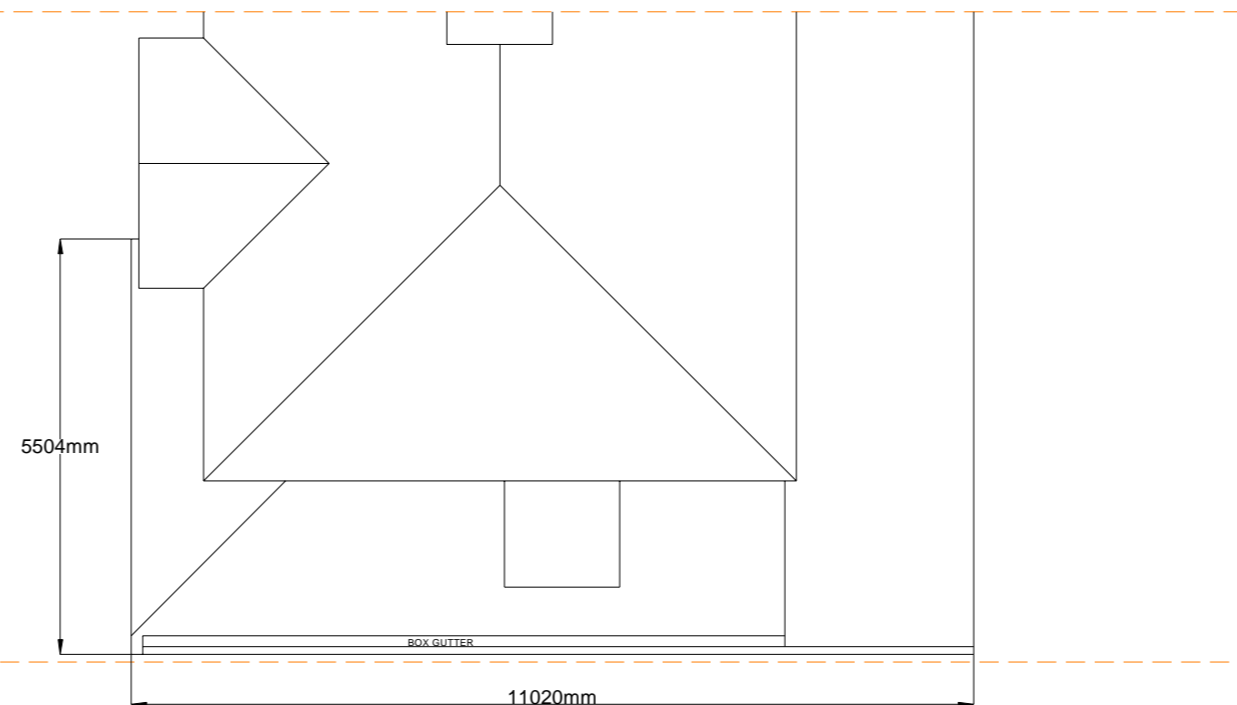

PROPOSED ROOF PLAN 1:100

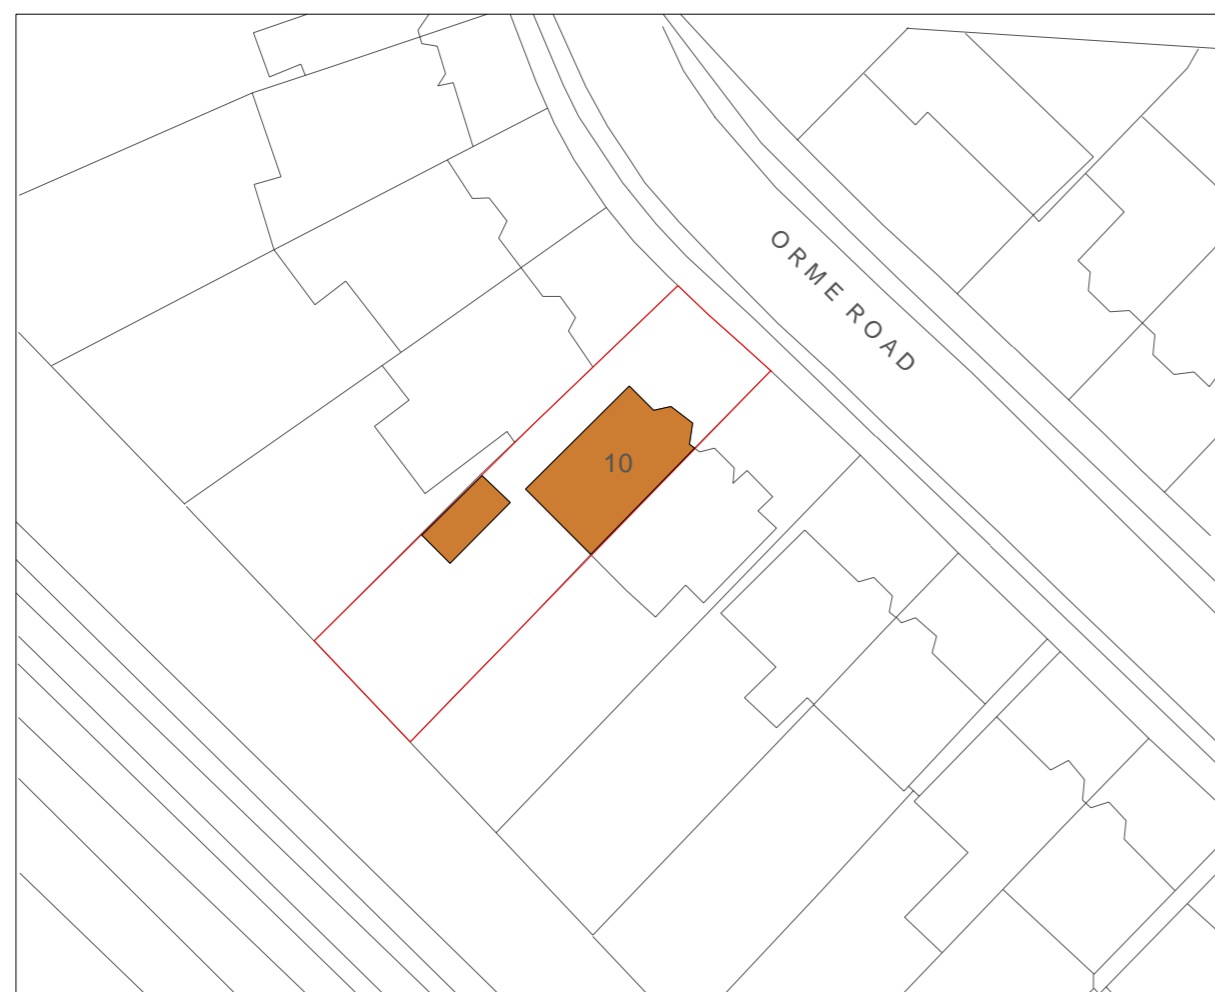

EXISTING BLOCK PLAN 1:500



PROPOSED BLOCK PLAN 1:500



DRAINAGE

RAINWATER DRAINAGE

New rainwater goods to be new 110mm UPVC half round gutters taken and connected into 68mm dia UPVC downpipes. Rainwater taken to new soakaway, situated a min distance of 5.0m away from any building, via 110mm dia UPVC pipes surrounded in 150mm granular fill.

SOAKAWAY USING CRATES

Trench of soakaway to be provided slightly larger than designed depth after porosity test (if required) but just over 1m3 min from invert level of pipe. Provide suitable geotextile over the base and up the sides of the trench over 100mm level and compact bed of coarse sand. Install AquaCell crate units or equivalent as manufacturer's details. Geotextile to be wrapped around crates. Provide 100mm of coarse sand between the trench walls and over the AquaCell structure. Backfill with suitable material.

UNDERGROUND FOUL DRAINAGE

Underground drainage to consist of 100mm diameter UPVC proprietary pipe work to give a 1:40 fall. Surround pipes in 100mm pea shingle. Provide 600mm suitable cover (900mm under drives). Shallow pipes to be covered with 100mm reinforced concrete slab over compressible material. Provide rodding access at all changes of direction and junctions. All below ground drainage to comply with BS EN 1401-1.

INSPECTION CHAMBERS

Underground quality proprietary UPVC 450mm diameter inspection chambers to be provided at all changes of level, direction, connections and every 45m in straight runs. Inspection chambers to have bolt down double sealed covers in buildings and be adequate for vehicle loads in driveways.

ABOVE GROUND DRAINAGE

All new above ground drainage and plumbing to comply with BS EN 12056-2 for sanitary pipework. All drainage to be in accordance with Part H of the Building Regulations. Wastes to have 75mm deep anti vac bottle traps and rodding eyes to be provided at changes of direction.

Size of wastes pipes and max length of branch connections (if max length is exceeded then anti vacuum traps to be used)

Wash basin - 1.7m for 32mm pipe 3m for 40mm pipe

Bath/shower - 3m for 40mm pipe 4m for 50mm pipe

W/c - 6m for 100mm pipe for single WC

All branch pipes to connect to 110mm soil and vent pipe terminating min 900mm above any openings within 3m. Or to 110mm upvc soil pipe with accessible internal air admittance valve complying with BS EN 12380, placed at a height so that the outlet is above the trap of the highest fitting.

Waste pipes not to connect on to SVP within 200mm of the WC connection.

Supply hot and cold water to all fittings as appropriate.

SOIL AND VENT PIPE

Svp to be extended up in 110mm dia UPVC and to terminate min 900mm above any openings within 3m. Provide a long radius bend at foot of SVP.

AUTOMATIC AIR VALVE

Ground floor fittings from WC to be connected to new 110mm UPVC soil pipe with accessible internal air admittance valve complying with BS EN 12380, placed at a height so that the outlet is above the trap of the highest fitting and connected to underground quality drainage encased with pea gravel to a depth of 150mm.

PIPEWORK THROUGH WALLS

Where new pipework passes through external walls the pipe work is to be provided with 'rocker pipes' at a distance of 150mm either side of the wall face. The 'rocker pipes' must have flexible joints and be a maximum length of 600mm.l. Alternatively provide 75mm deep pre-cast concrete plank lintels over drain to form opening in wall to give 50mm space all round pipe: mask opening both sides with rigid sheet material and compressible sealant to prevent entry of fill or vermin.

H4 BUILDING OVER OR NEAR PUBLIC SEWERS

The developer is to consult the Local Sewers Undertaker when constructing, extending or underpinning over a sewer or within 3m of the centreline of sewer shown on the sewerage undertakers sewer records and when the following applies:

- The building or extension is to be constructed over a manhole or inspection chamber or other access fitting on a sewer.
- The length of the drain or sewer under the proposed building or extension will exceed 6m.
- The Building or extension is to be constructed over or within 3m of any drain or sewer more than 3m deep or greater than 225mm in diameter.

	<p>THIS DRAWING MUST NOT BE SCALED PRIOR TO THE COMMENCEMENT OF ANY WORKS THE BUILDER IS TO CHECK AND/OR DETERMINE ALL CONSTRUCTION DETAILS INCLUDING CHECKING EXISTING SITE LEVELS AND DIMENSIONS. THE DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER PROJECT DRAWINGS, CONSTRUCTION NOTES AND/OR PROJECT SPECIFICATION. ALL DISCREPANCIES SHOULD BE REPORTED IMMEDIATELY.</p>	<p>PLANNING CLIENTS & CONTRACTORS ARE REMINDED THAT IF THE PROJECT REQUIRES AN APPLICATION FOR PLANNING, THIS APPLIES TO PRIOR APPROVAL, LAWFUL DEVELOPMENT APPROVAL, PERMITTED DEVELOPMENT RIGHTS TO RECENTLY BUILT PROPERTY'S AND HOUSES IN CONSERVATION AREAS. MBL ASSOCIATES Ltd WILL NOT BE RESPONSIBLE IF WORKS COMMENCE AGAINST THIS ADVICE AND ENFORCEMENT ACTION IS TAKEN AGAINST YOU. MBL ASSOCIATES Ltd ADVISE THAT ALL CERTIFICATION OF PLANNING APPROVAL HAS BEEN GRANTED BEFORE ANY BUILDING WORK COMMENCES.</p>	<p>CLIENT</p>	<p>ADDRESS</p>	<p>DESCRIPTION</p>
	<p>[REDACTED]</p>	<p>ALL STRUCTURAL INFORMATION TO BE IN CONNECTION WITH STRUCTURAL ENGINEERS CALCULATION AND DRAWINGS</p>	<p>CDM Regulations 2007. Party Wall Act 1996, Clients and contractors are reminded that the project is within the scope of these regulations MBL Associates Ltd engaged as designers will not accept any liability for failure of these parties to carryout their duties as required by these statutes</p>	<p>10 ORME ROAD KINGSTON KT1 3SA</p>	<p>ROOF PLANS BLOCK PLANS</p>
	<p>[REDACTED]</p>			<p>Scale: 1:100 1:500 @A2</p>	<p>Date: 12/12/2023</p>
				<p>Drawing No</p>	<p>OR10/005</p>