



PLANT SCHEDULE				
REF	MANUFACTURER	MODEL	UNIT SIZE (mm)	AIR FLOW (l/s)
OU 1	MTSUBISHI	PUMY-P200	1338H x 1050W x 370D	2350
OU 2	MTSUBISHI	PUMY-P200	1338H x 1050W x 370D	2350
OU 3	MTSUBISHI	PUMY-SP140	961H x 1050W x 370D	1833
KC 1	GREEN COOLING	JEHR-0150-B2-M-1	1100W x 445D x 660H	500

KITCHEN EXTRACT FAN - FINAL SPECIFICATION TBC. FOLLOWING FULL DESIGN				
REF	MANUFACTURER	MODEL	DUTY	PRESSURE
EF1	HELIOS	GBW 710/4/4 T120	3.0 m3/s	1000Pa

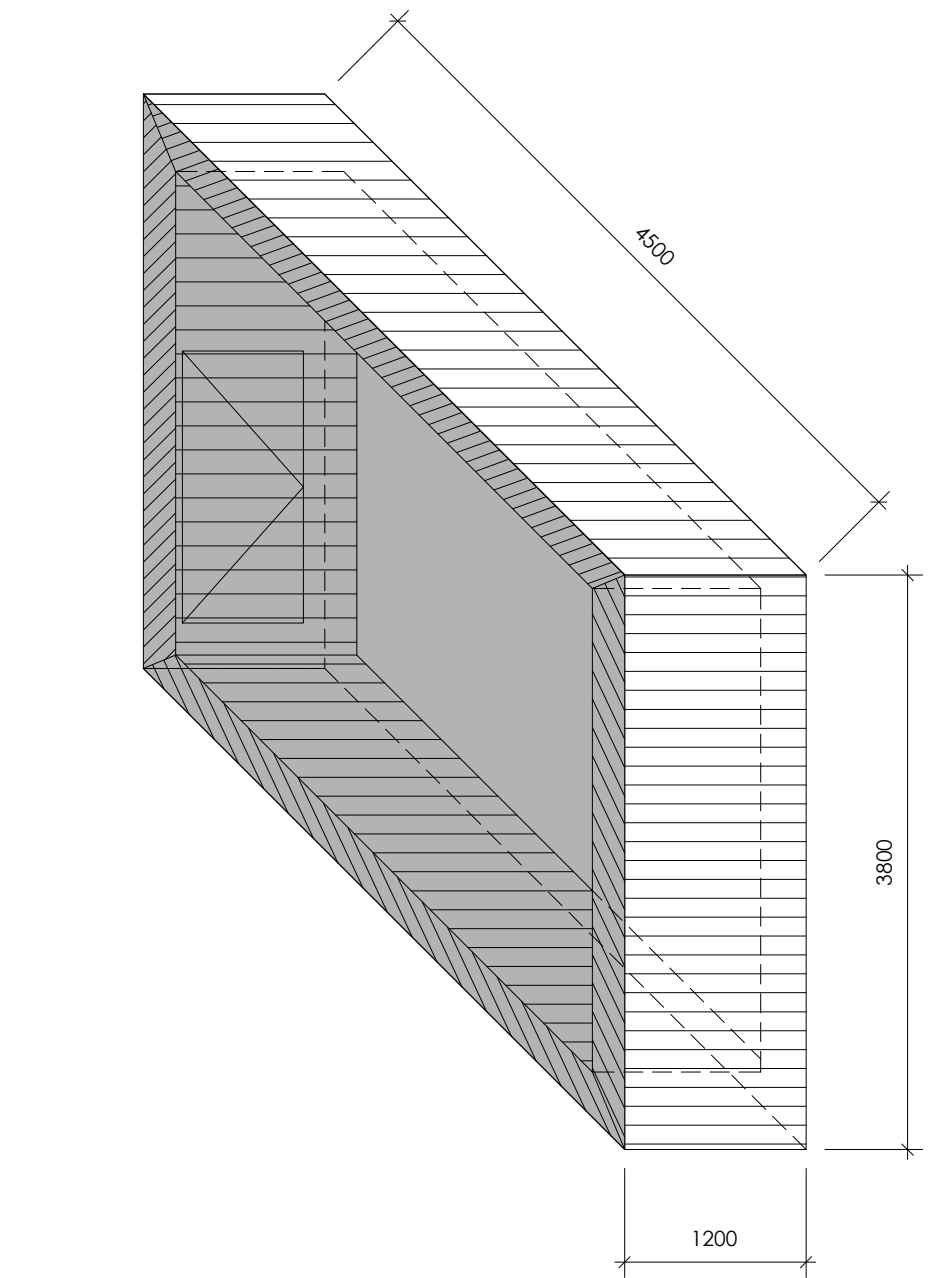

ACOUSTIC ENCLOSURE ISOMETRIC VIEW
SCALE 1:50 @ A1

APPROXIMATE SIZE OF LOUVRED PANELS	
	TOTAL SIZE
LEFT SIDE	1200x3800
RIGHT SIDE	1200x3800
TOP	1200x4500
BOTTOM	1200x4500
FRONT	3800x4500
BACK	3800x4500
TOTAL	14.2 m2

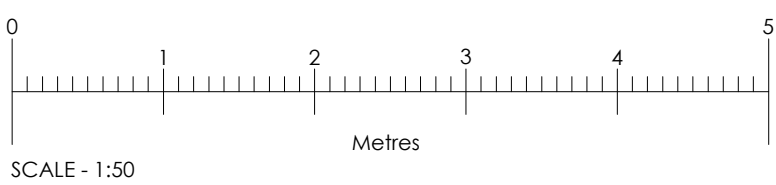

- GENERAL NOTES:
1. ALL SERVICES/ROUTES THROUGHOUT BUILDING TO BE FULLY COORDINATED ON SITE.
 2. DRAWING TO BE READ IN CONJUNCTION WITH THE INSTALLATION SPECIFICATION AND ALL OTHER RELEVANT DRAWINGS.
 3. DUCTWORK MATERIAL & INSTALLATION TO DW/144 CLASS 'A'.
 4. FINAL DESIGN SHOP DRAWING AND DETAIL CO-ORDINATION DRAWINGS TO BE SUBMITTED FOR ENGINEER COMMENT PRIOR TO START ON SITE.
 5. FIRE DAMPERS TO BE PROVIDED AT ALL PENETRATIONS THROUGH FIRE COMPARTMENTS, SEE ARCHITECT'S DRAWING FOR COMPARTIMENTATION DETAILS.
 6. DUCTWORK ACCESS DOORS TO BE PROVIDED ADJACENT TO EACH CHANGE OF DIRECTION, DAMPERS AND DUCT MOUNTED EQUIPMENT OR EVERY 10m.
 7. PROVIDE VOLUME CONTROL DAMPERS ON ALL DUCTWORK BRANCHES.

Rev Date Comments

PLANNING

Client
LSL CAPITAL

Project
49 SOUTH AUDLEY STREET
LONDON

Title
APPROVED PLANT & EXTRACT
APPROVED PLANS WITH ACOUSTIC
ENCLOSURE / CLADDING SHOWN

Project No.

8435

Drawing No.
8435_PD_13

Scale
1:100 @ A1
1:50 @ A1

Date

FEB 2023

Revision

Drawn MN

Check RC

Nepiclar House, London Road,
Wrotham Heath, Kent, TN15 7RS
phone: 01732 753333
fax: 01732 753334
info@offsetarchitects.co.uk
www.offsetarchitects.co.uk

offset
architects