


NOTE ③

NOTCH CONCRETE BLOCKS TO RECEIVE AIR VENTS BETWEEN FLOOR BEAMS

NOTE ① (2 PARTS)

- ④ 50x25 BATTEN ON EDGE REQUIRED AT DOOR THRESHOLDS
- ⑤ 500 MICRON SLIP LAYER REQUIRED UNDER FLOATING FLOOR

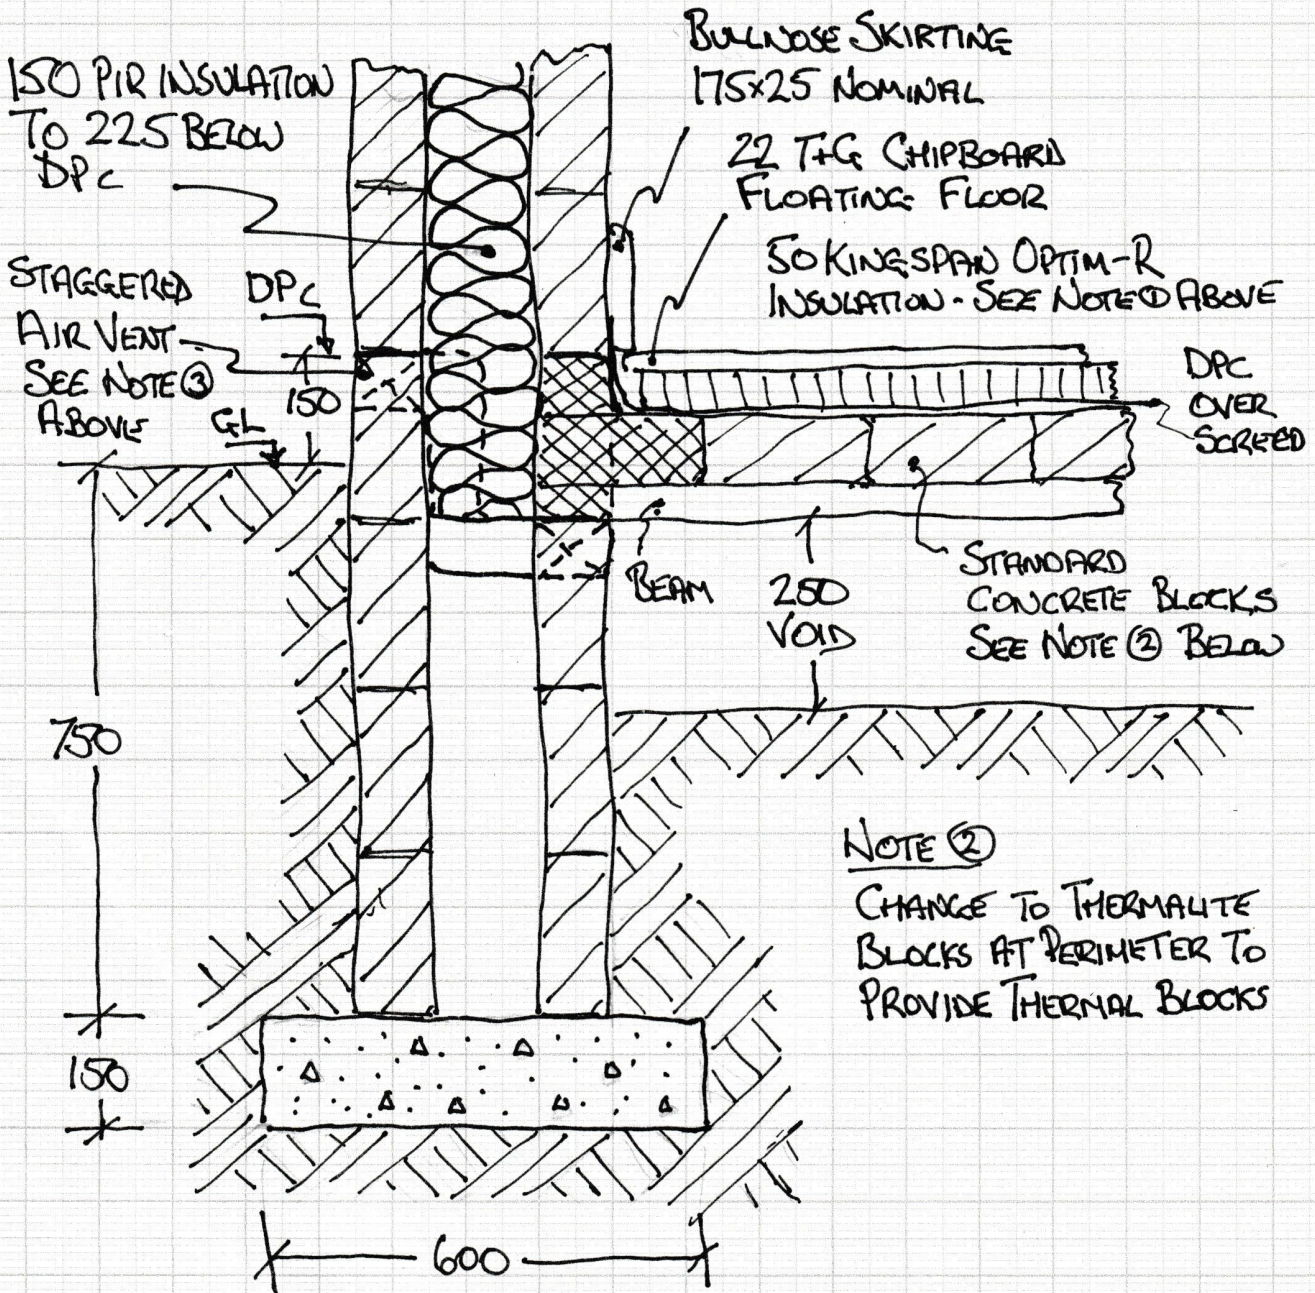

NOTE ②

CHANGE TO THERMALITE BLOCKS AT PERIMETER TO PROVIDE THERMAL BLOCKS

BECKFIELD, STATION ROAD, ANDOVERSFORD

FLOOR/WALL DETAIL

SCALE 1:10 A. GOIND 25/10/23