


EXTRACT RISER. ATTENUATOR IN RISER.  
 EXTRACT DUCT RISER TO RISE UP THROUGH SERVICE DUCT AND TERMINATE AT ROOF LEVEL. ALLOWANCE FOR ACCESS AND CLEANING TO BE ALLOWED FOR WITHIN SERVICE DUCT  
 DISHWASHER EXTRACT. FAN AND ATTENUATOR IN TRANSITION TO RISER.  
 SUPPLY INTAKE LOUVRE GRILLE AND PLENUM WITHIN LIGHTWELL AT GROUND FLOOR LEVEL.  
 SUPPLY FAN PLANT INSTALLED AT HIGH LEVEL AND WITHIN CEILING VOID  
 ATTENUATION INSTALLED TO DUCTWORK  
 EXTRACT FAN PLANT INSTALLED AT HIGH LEVEL AND WITHIN CEILING VOID  
 Extract Ductwork Connection to Canopy  
 WAITER STATION  
 WAITER STATION  
 ramp up  
 WC  
 WC  
 lift  
 WAITER STATION

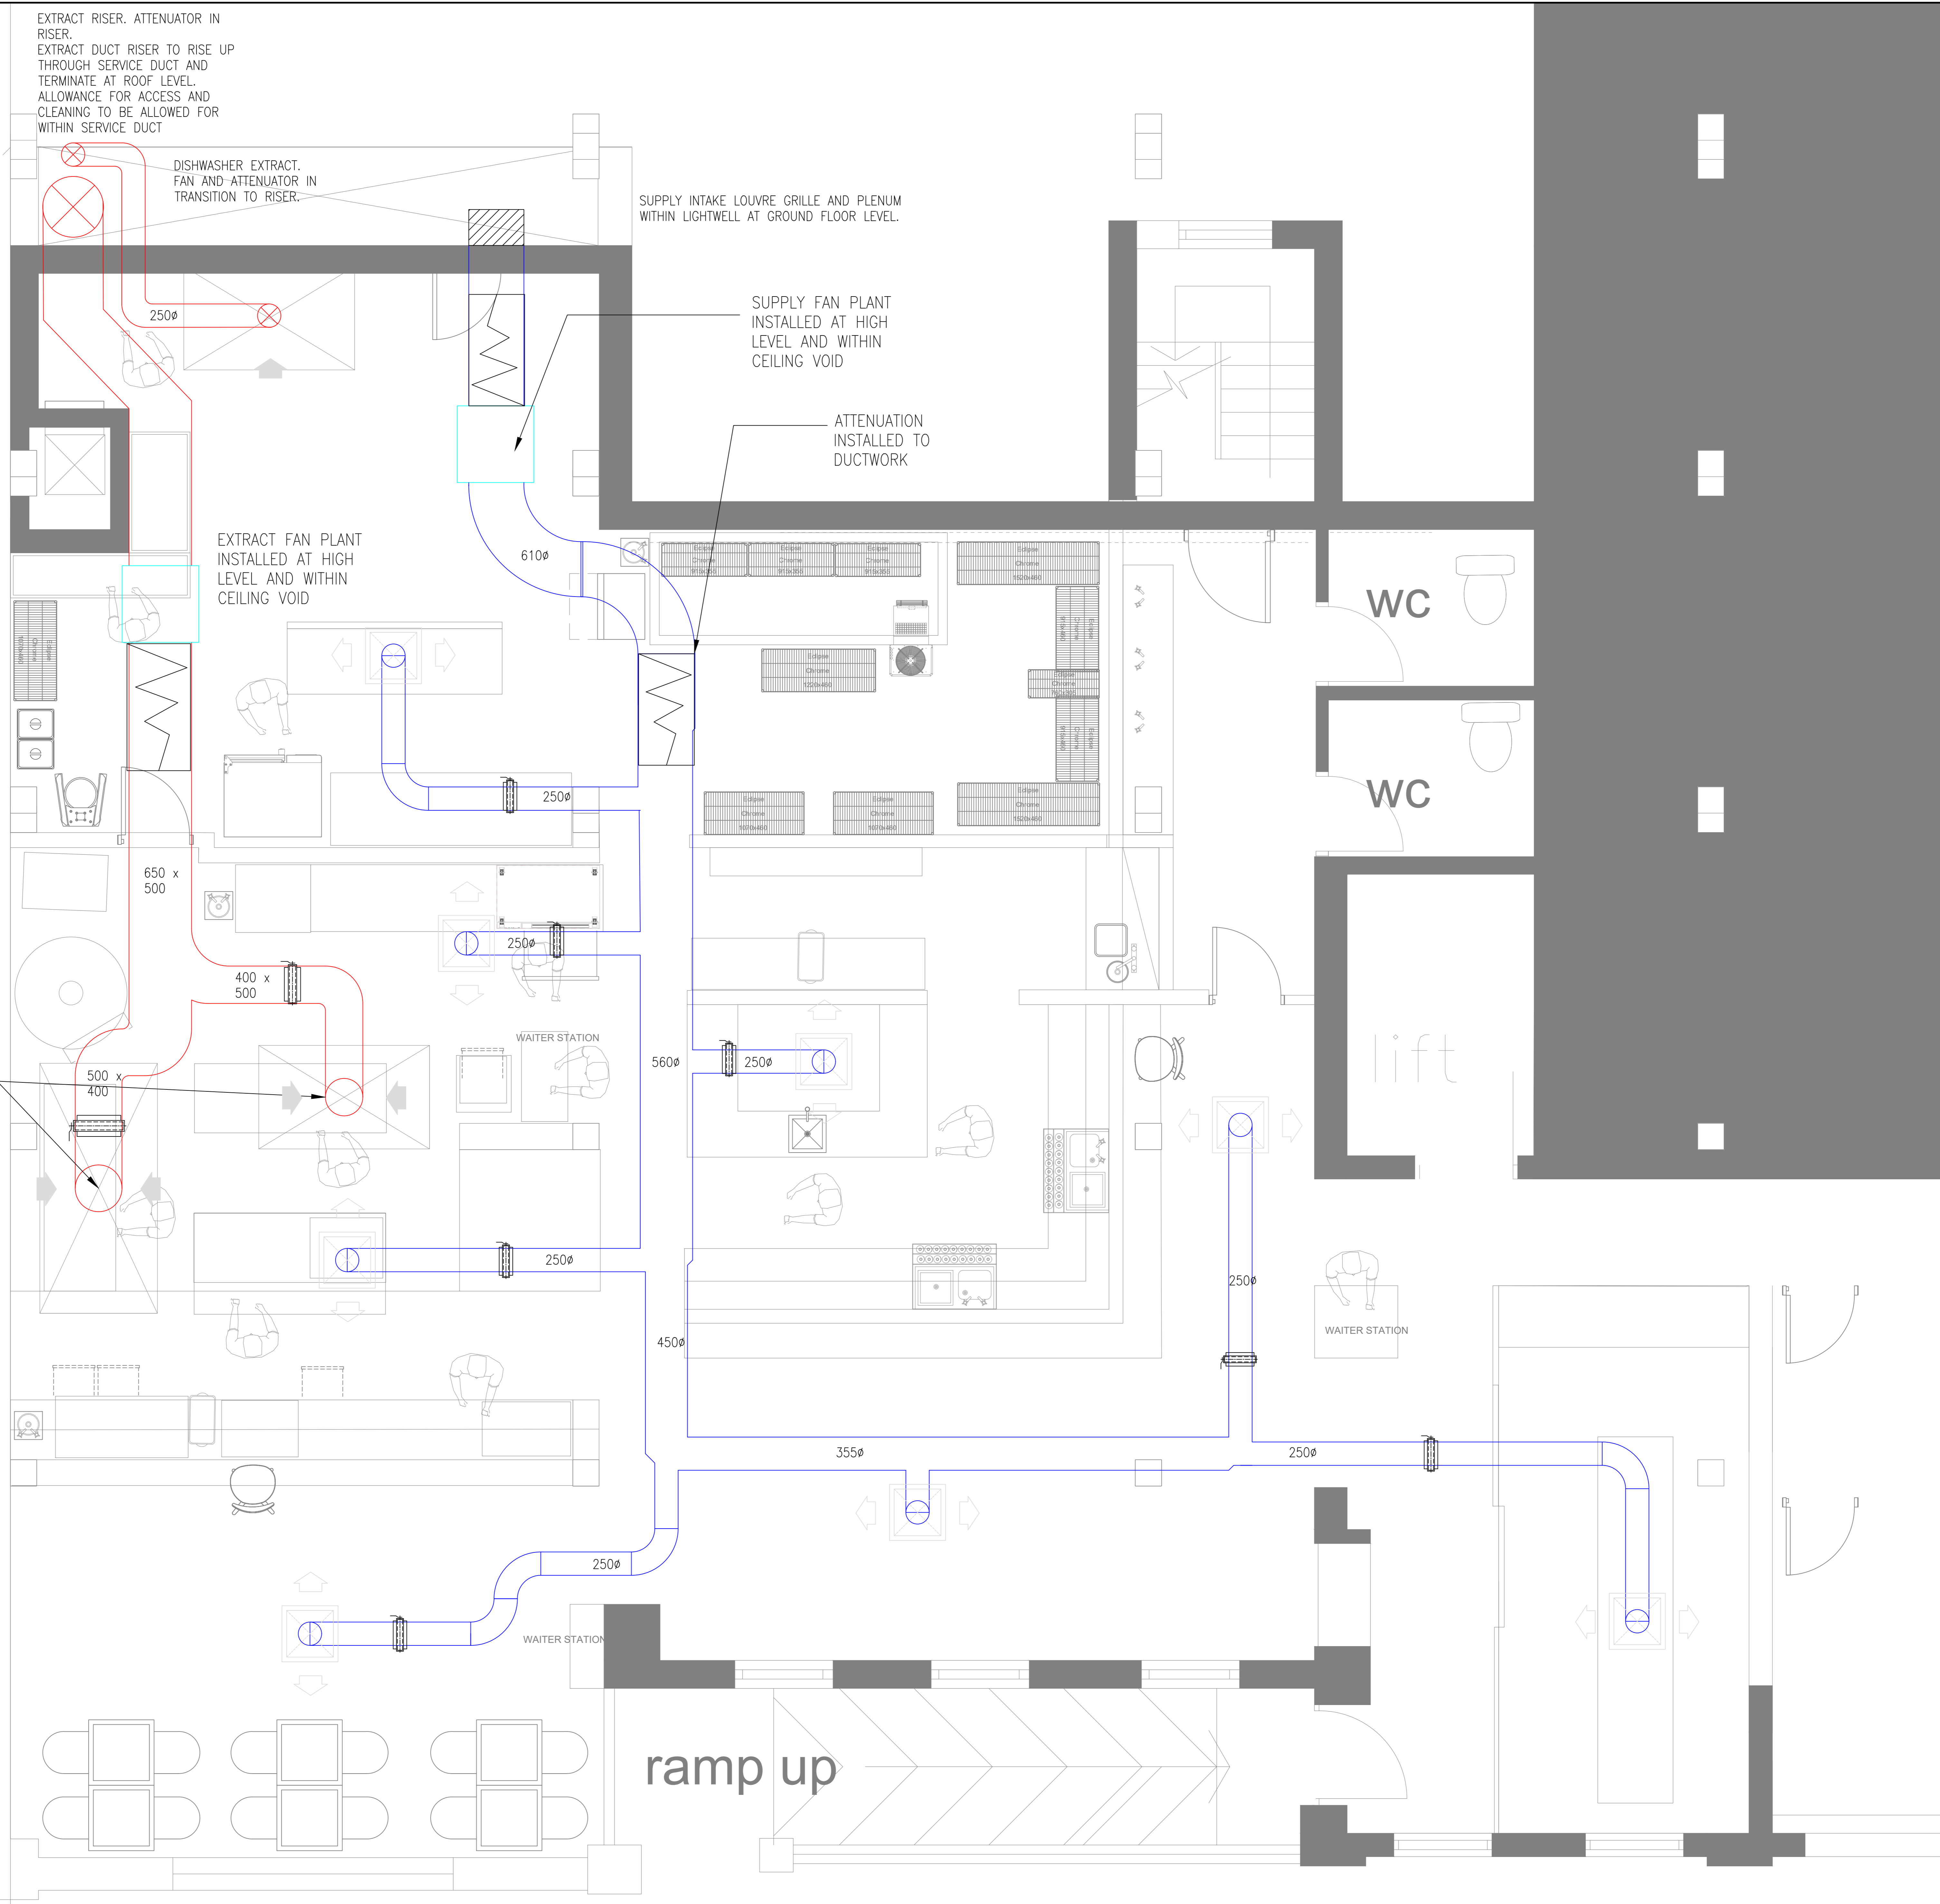

- NOTES**
- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.
  - IF RECEIVED ELECTRONICALLY, IT IS THE RECIPIENT'S RESPONSIBILITY TO PRINT TO THE CORRECT SCALE. ONLY THE DIMENSIONS STATED ARE TO BE USED.
  - THIS DRAWING IS INDICATIVE ONLY. CONTRACTOR TO ALLOW FOR ALL FINAL SITE CO-ORDINATION AND SETTING OUT.
  - CONTRACTOR TO ALLOW FOR FINAL SIZING AS DETERMINED BY FINAL PLANT POSITIONING AND DUCTWORK RUNS.
  - CONTRACTOR TO ALLOW TO POWER ALL NEW PLANT FROM LOCAL DISTRIBUTION BOARD.
  - CONTRACTOR SHALL ALLOW TO INCORPORATE ALL NECESSARY ATTENUATION TO ENSURE THAT ALL NOISE RATINGS AS SPECIFIED BY THE ARCHITECT ARE MET.
  - CONTRACTOR TO ALLOW FOR THE INSTALLATION OF FIRE DAMPERS AS REQUIRED BY THE FIRE STRATEGY AND ALL ASSOCIATED DRAWINGS.
  - CONTRACTOR TO ALLOW FOR SUITABLE ROOF COWLS TO PROTECT THE SUPPLY AND EXTRACT ROOF TERMINATIONS.

SCALE : N/A

**SHEET TITLE**  
25 QUEENS RD GROUND FLOOR -  
PROPOSED VENTILATION LAYOUT

**SHEET NUMBER**  
25 QUEENS RD PROPOSED  
VENTILATION LAYOUT