




100mm UVC gutter on fascia board
 2m high UVC windows
 Dormers to be slate hung to match existing roof

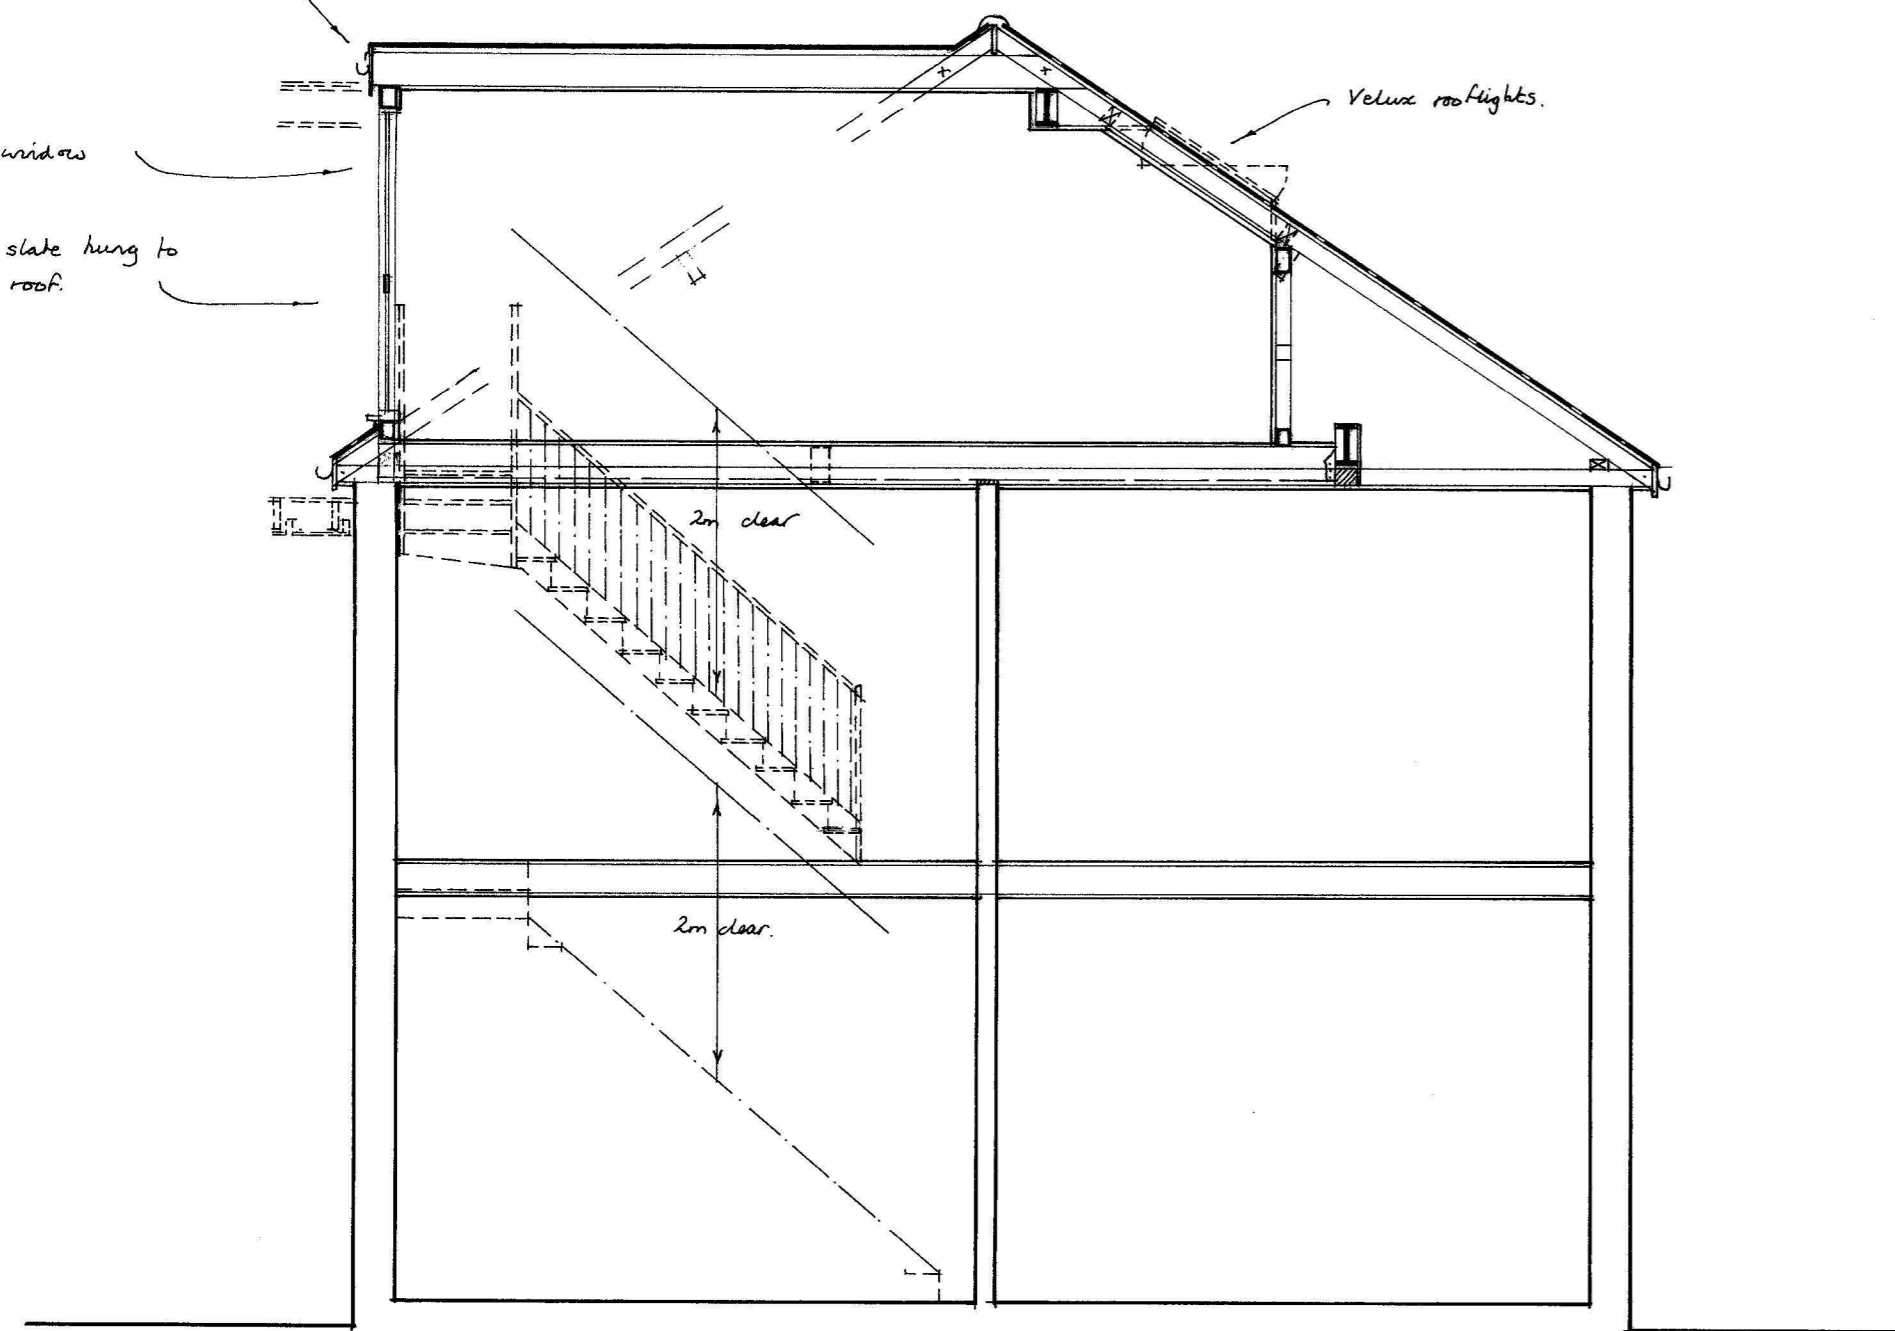

SECTION

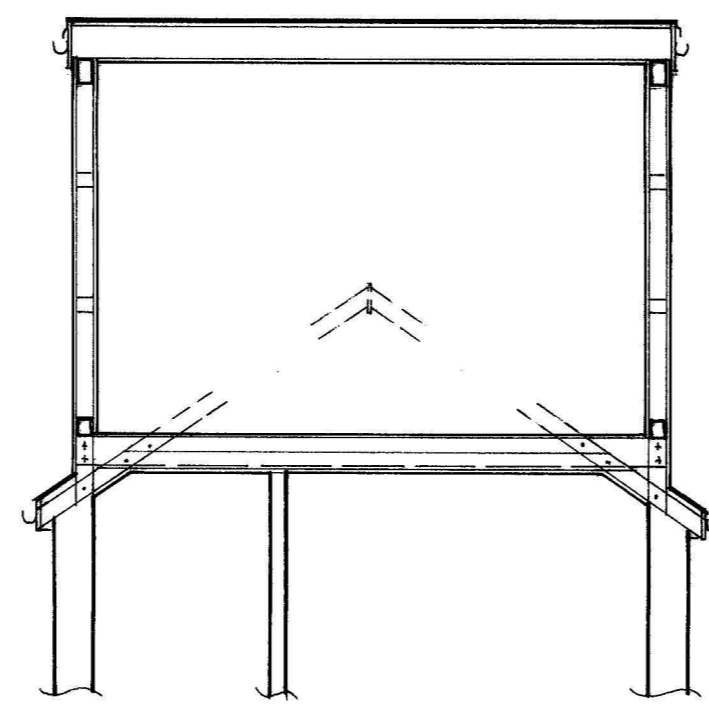


SECTION A-A

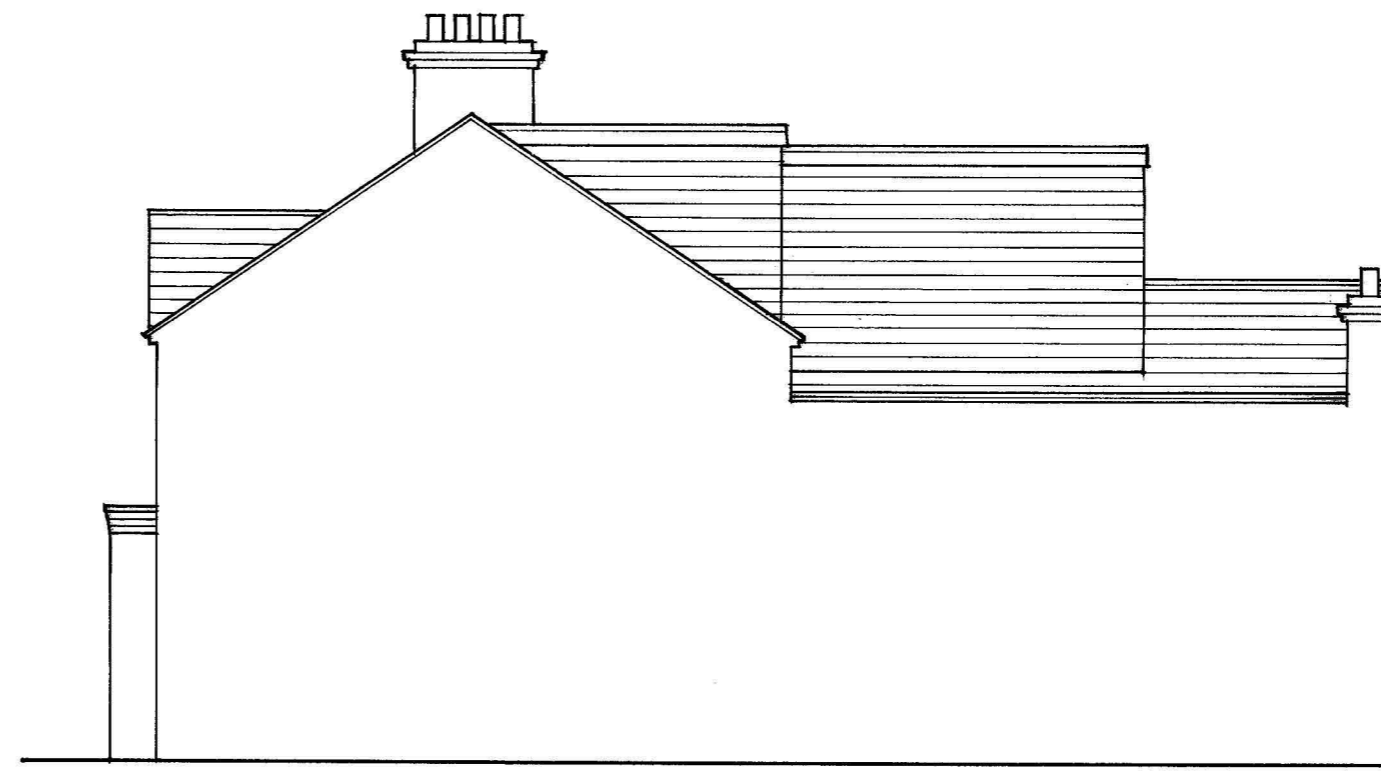


SIDE ELEVATION




FRONT ELEVATION

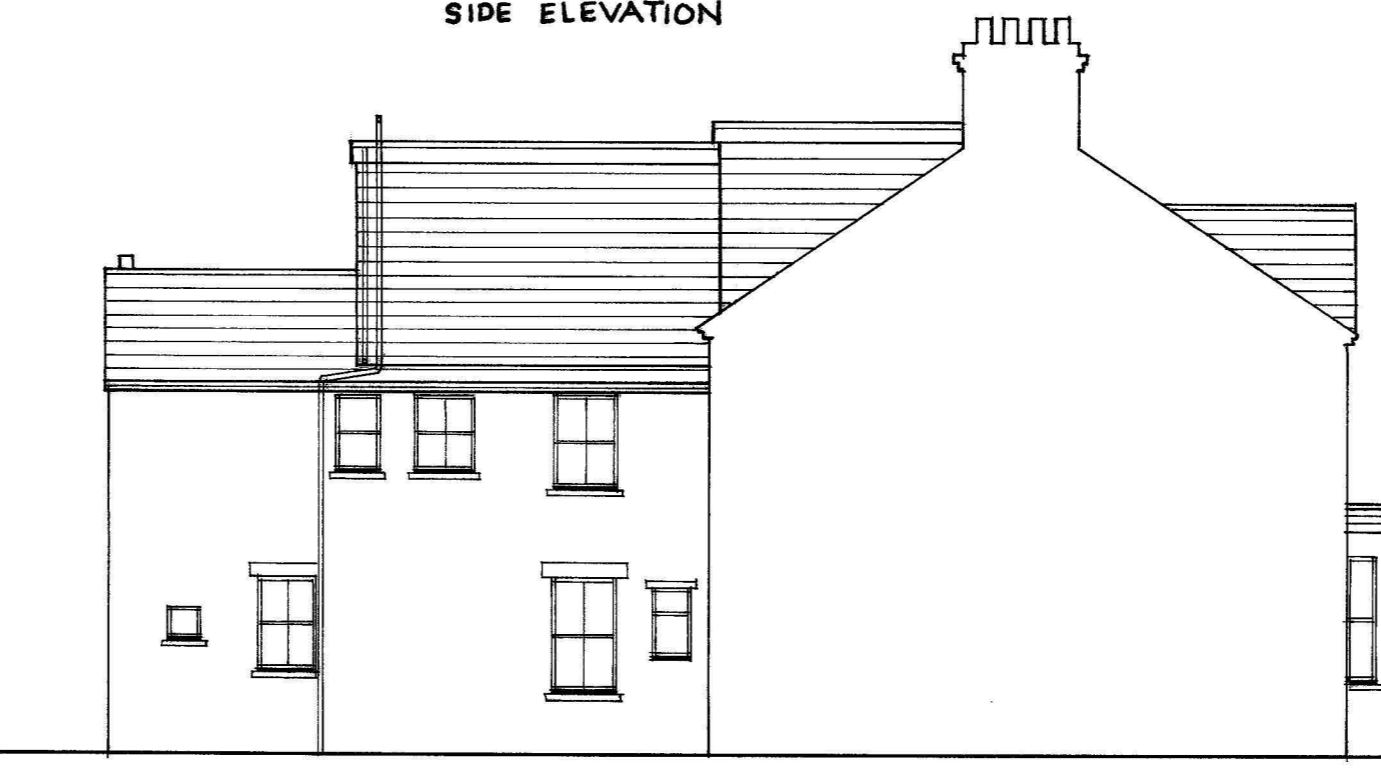


SIDE ELEVATION

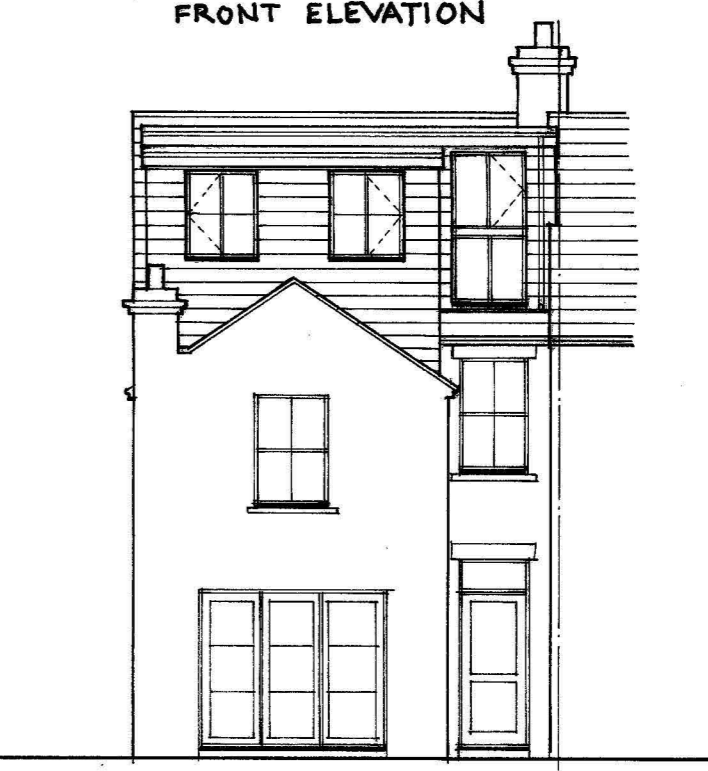


REAR ELEVATION

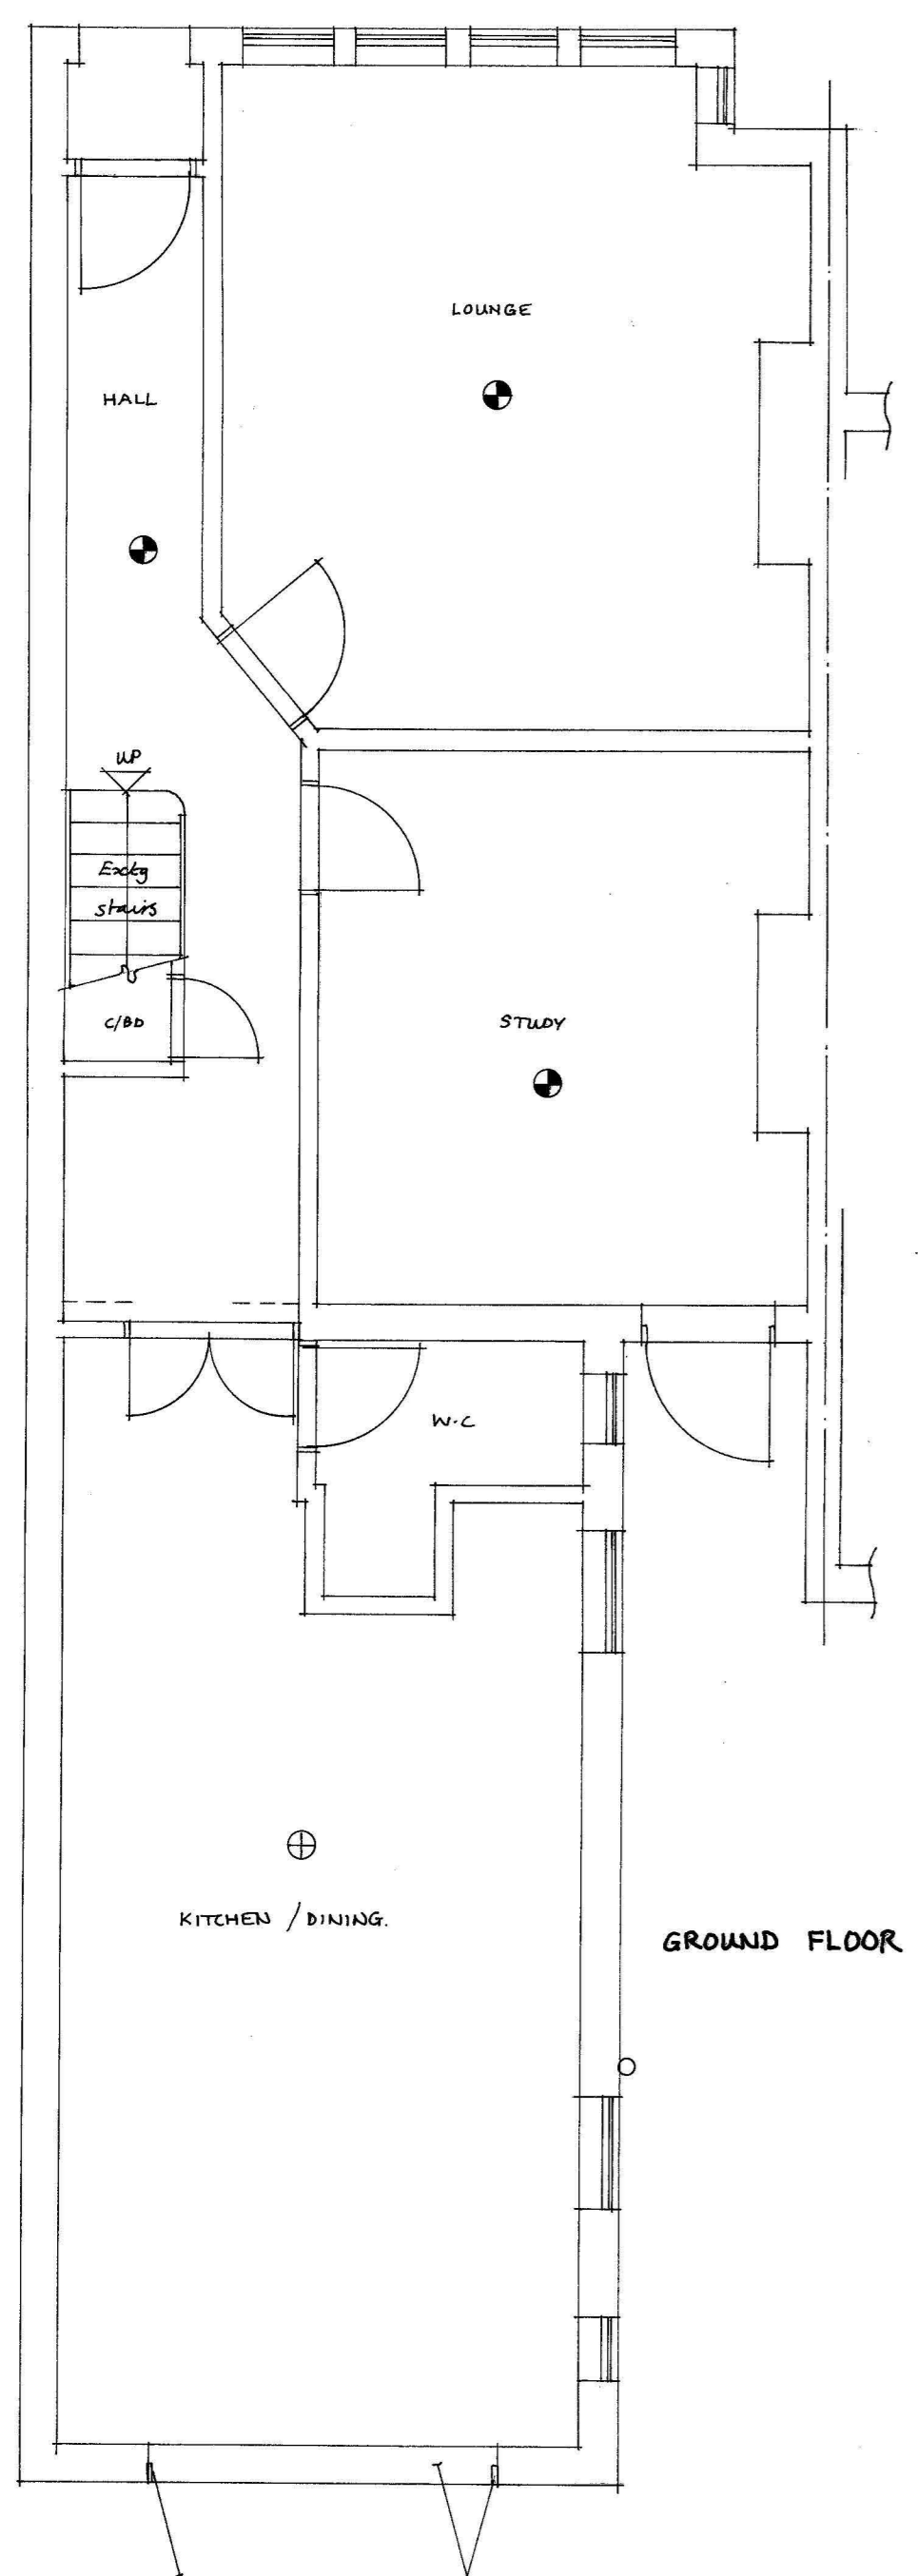

GROUND FLOOR PLAN

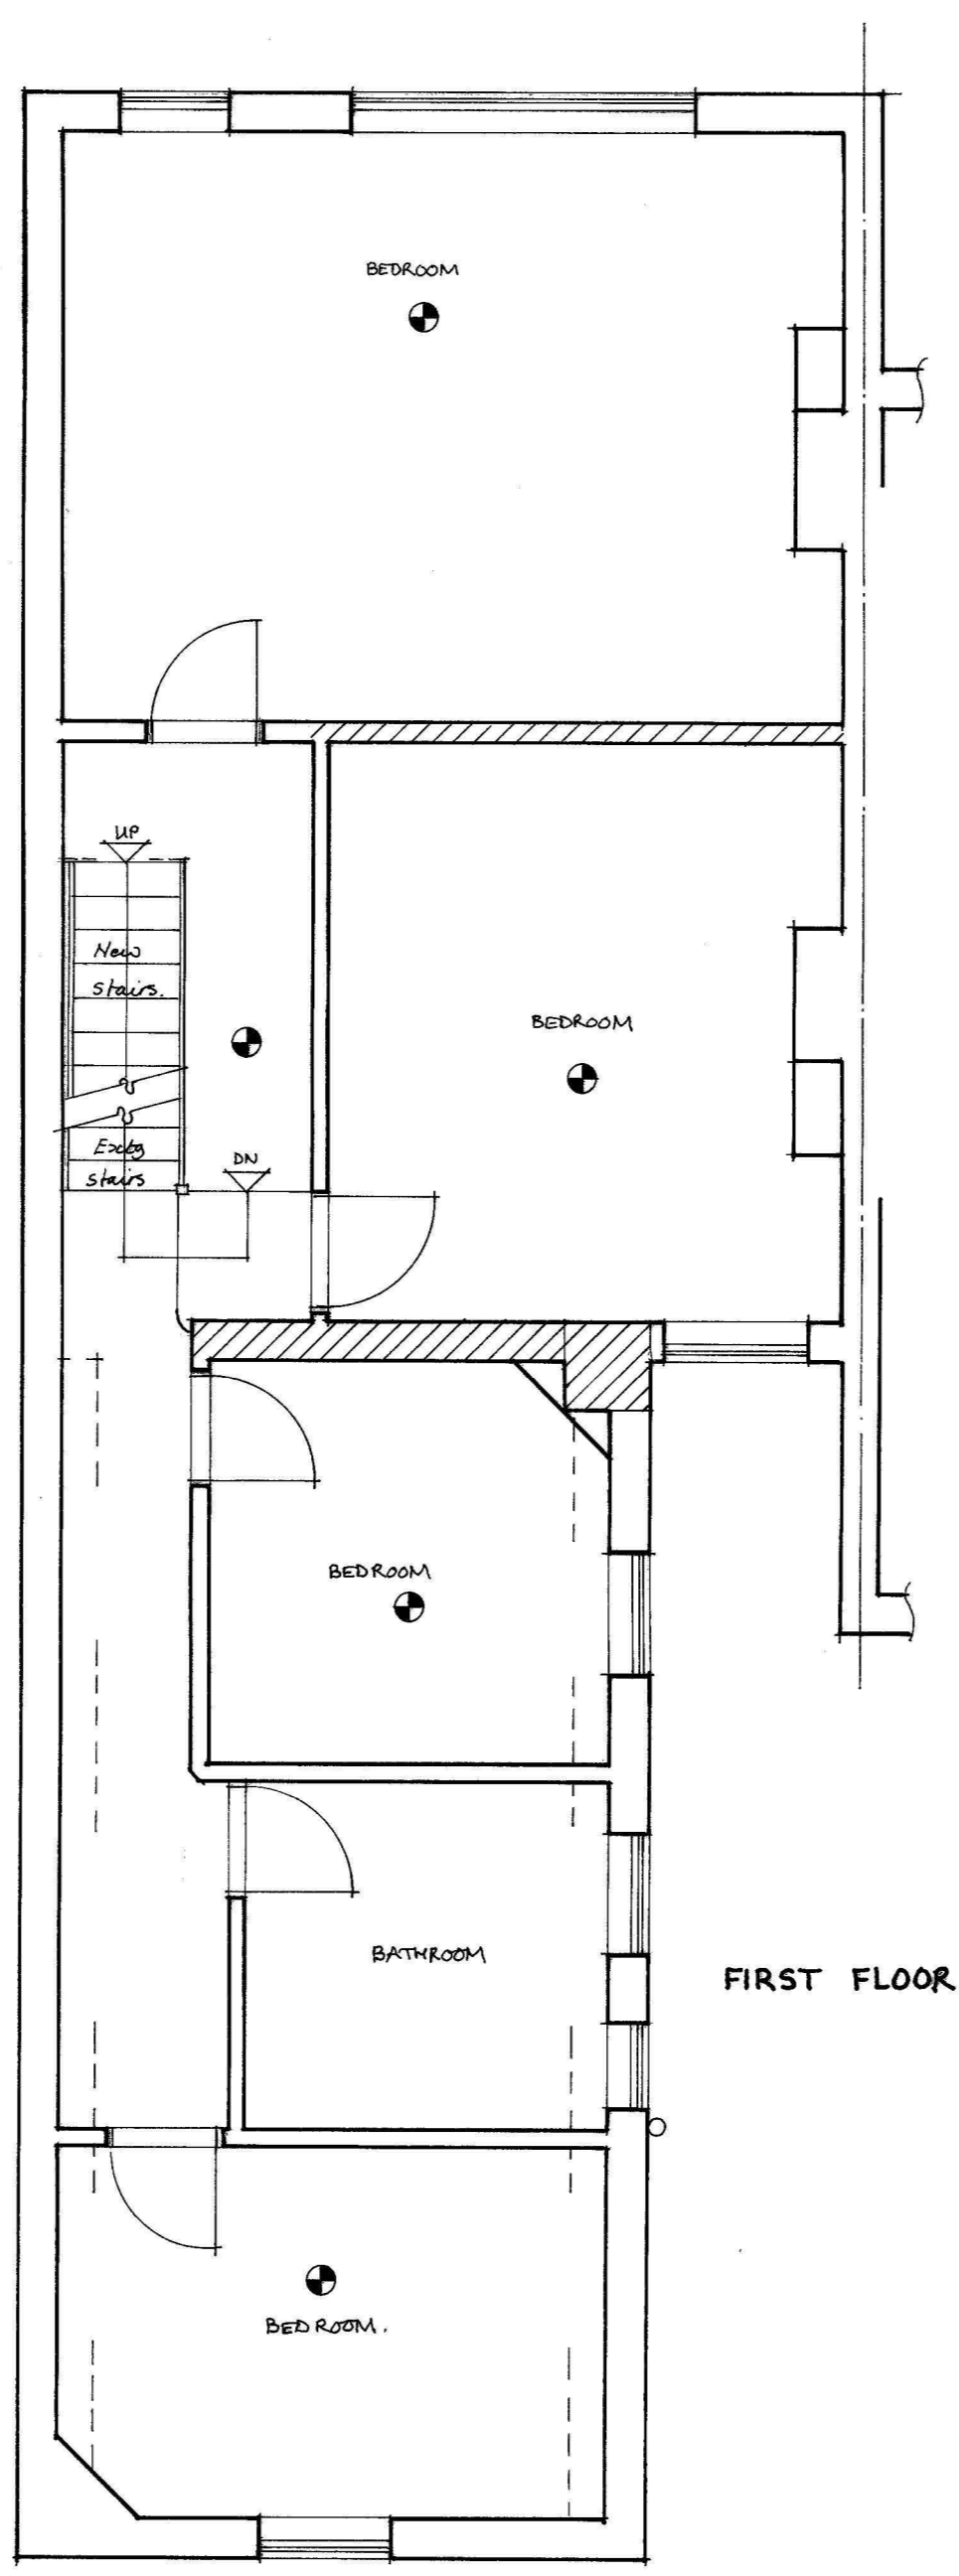

FIRST FLOOR PLAN

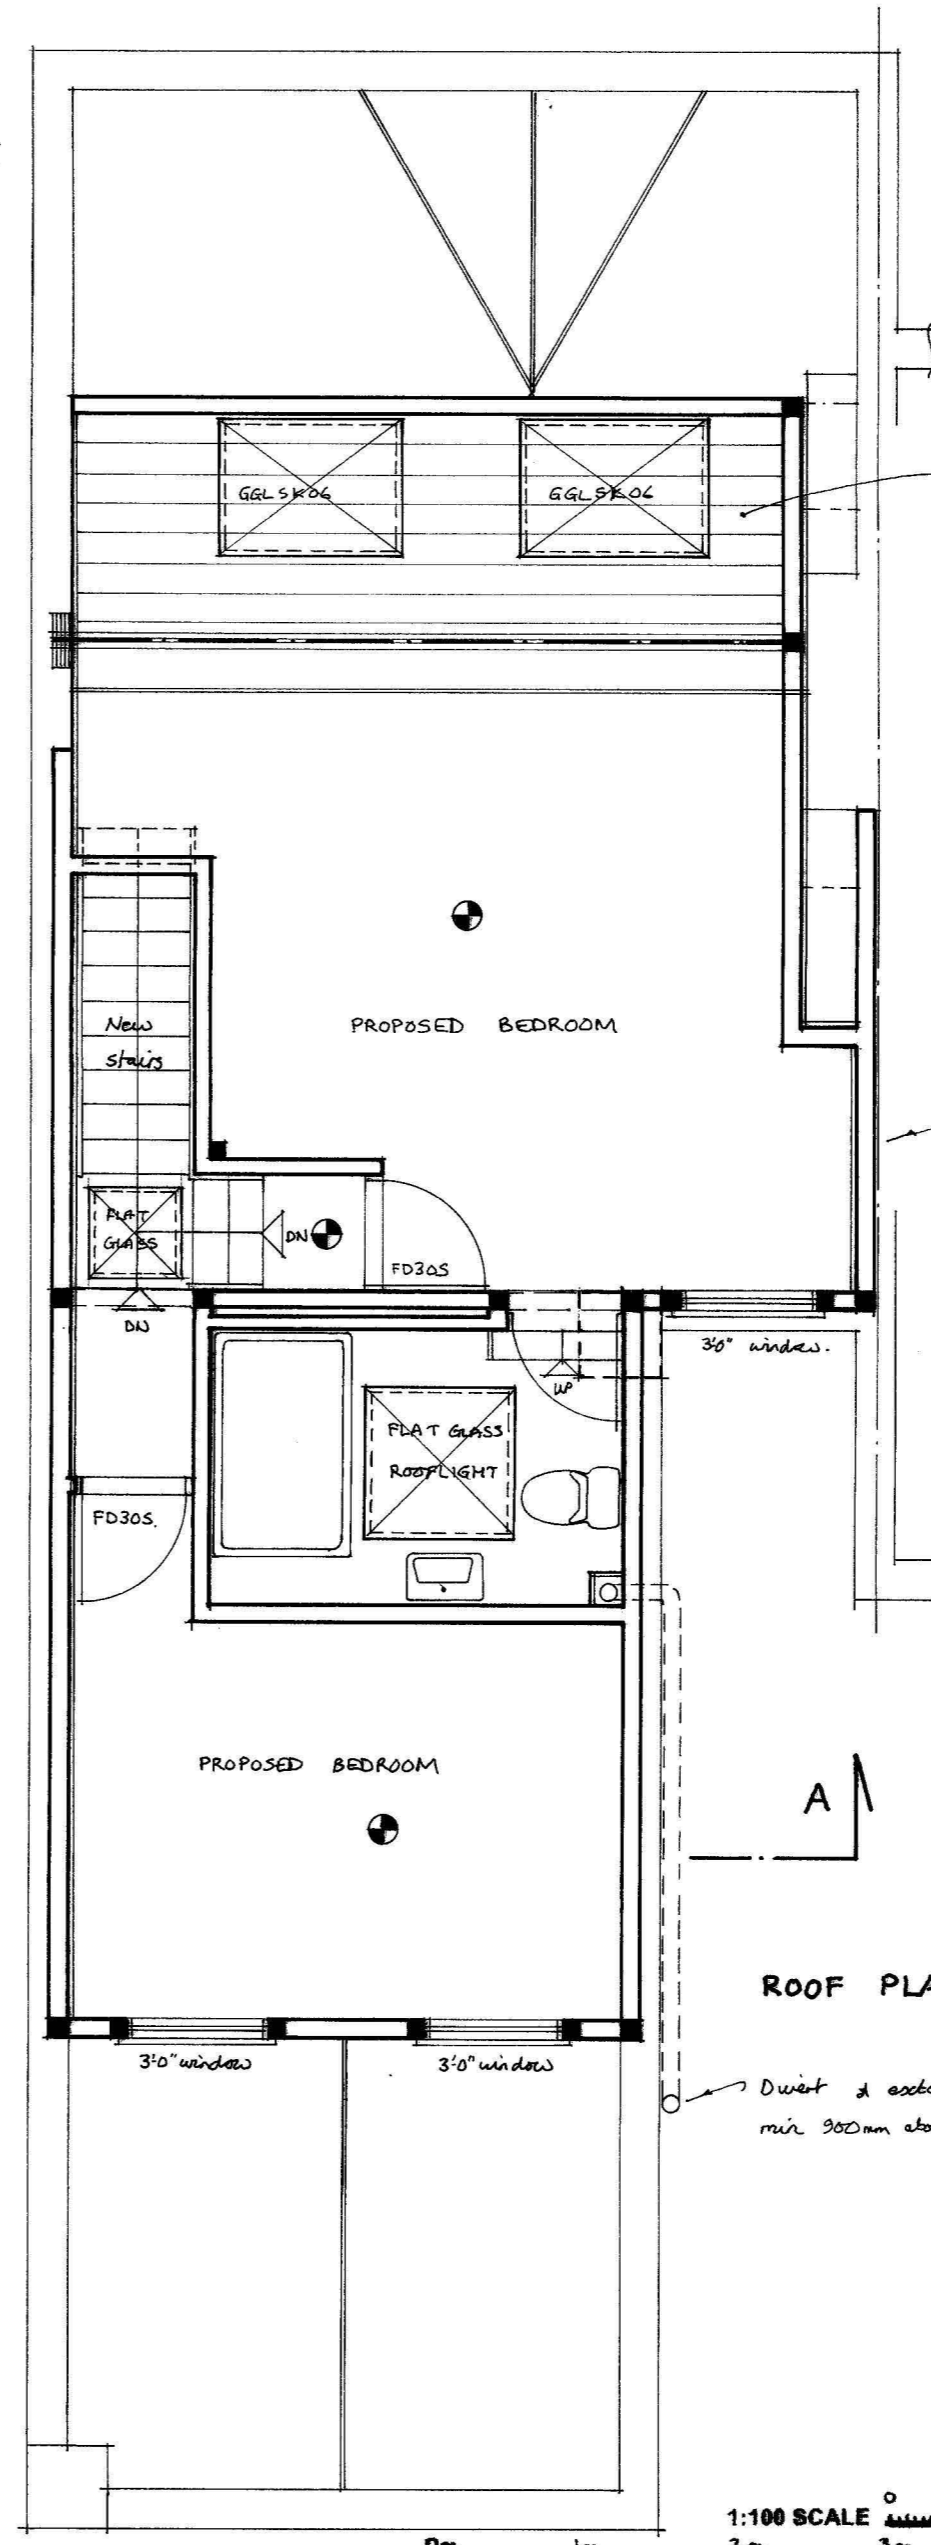

ROOF PLAN

SPECIFICATION

DORMER ROOF CONSTRUCTION (U=0.15W/m2K)
 12.5mm chippings on 3 layers bituminous felt on 18mm plywood on 50 x 50 s.w. battens across firings (1 in 40) on s.w. joists @ 400mm crs. 100mm Celotex insulation and 30mm Actis Hybris H Control insulation / vapour barrier across underside of joists. Fixed with 38x25mm counter battens @ 600 crs with 12.5mm duplex plasterboard & 5mm plaster skim ceiling.

DORMER CHIEK CONSTRUCTION (U=0.18W/m2K)
 (Half hour fire resistant from both sides). Vertical tile/plane hanging to match existing on s.w. battens on building paper on 12.5mm plywood bracing (9mm masterboard within 1m of boundary) on 100x50mm studs @ 400mm crs (cross braced). 70mm Celotex insulation between studs and 30mm Actis Hybris H Control insulation vapour barrier across inside of studs fixed with 38x25mm counter battens @ 600 crs with 12.5mm duplex plasterboard & 5mm skin ceiling.

STAIRCASE
 Rise=200mm, Going=225mm, Tread=250mm, Pitch=42, 2m clear Headroom. 900mm handrail, 900mm balustrade housed into newels or returned to adjacent wall. (100mm max gaps to risers & handrails). Artificial lighting with 2 way switch top and bottom. Any tapered Treads to comply with Part K. 50mm min going.

HALF HOUR PARTITION AROUND NEW STAIRCASE
 75x50mm studling with 12.5mm duplex plasterboard & 5mm skin to both sides to give full half hour fire resistance.

FIRE REGULATIONS
 All doors to ground and first floor off-staircase enclosure to be 30-sec fire resistant (FD30S). Any glazing to be wired glass (max 0.36m area). Steel beams to be encased in 2 layers of 12.5mm plasterboard (staggered joints) to give full half hour fire resistance. Timber beams have half hour fire resistance to BS5268 part 4 section 41.1078 (sacrificial design method).

WINDOWS & ESCAPE WINDOWS
 Escape window to be 750x450mm min clear opening (min 0.23m opening area) max 1.1m above floor level. All new windows and Rooflights to be double glazed with min 16mm gap, low E glass N=0.15 for windows, n=0.05 for rooflights. Windows to achieve Purge Ventilation rate of not less than 1/20th of floor area. Window U-Value to achieve min 1.4W/m2K

STRUCTURAL
 Multiple timber trimmers to be bolted together @ 600mm crs using M12 bolts and 64mm dia tooth plate connectors.

VENTILATION
 Provide 8000mm background Ventilation to new habitable rooms and 5000mm to new bathroom/En-suites areas. New windows and French doors to achieve a purge ventilation rate of not less than 1/20th of the new floor area.

SMOKE DETECTORS
 Ⓢ Denotes heat detector. Ⓢ Denotes mains wired interconnected smoke detectors with battery back up to BS5839:6:2004.

LIGHTING AND HEATING
 Three in four lights to be energy efficient type. Extend existing Heating system to new rooms with zone and boiler interlock controls (Thermostatic Valves).

ELECTRICAL
 All new electrical work to be in accordance with Part P 'Competent Person Scheme' to BS7671. Certification to be provided upon completion.

PROJECT
 Formation of habitable rooms in roofspace with Rear dormers and front value rooflights.

CLIENT
 Mr Wenban-Smith & Ms Collins,
 36, Divinity Road,
 Oxford,
 OX4 1LN.

PROPOSED PLAN 01.

SCALE 1:50 & 1:100 DATE DEC 2023.

DRAWN BY CONTRACT NO.

THE ACCURACY OF THIS DRAWING FOR FINISHED SIZES IS NOT GUARANTEED AS IT IS SUBJECT TO ON SITE LEVELS, THEREFORE IT DOES NOT FORM PART OF YOUR CONTRACT



© COPYRIGHT

COUNCIL Oxford C.C. 01865 - 249811.

