



OVERALL BLOCK PLAN OF MITSUBISHI  
EAHV-M1500YCL(N)AIR SOURCE HEAT PUMP  
(1No. HEAT PUMP ONLY)

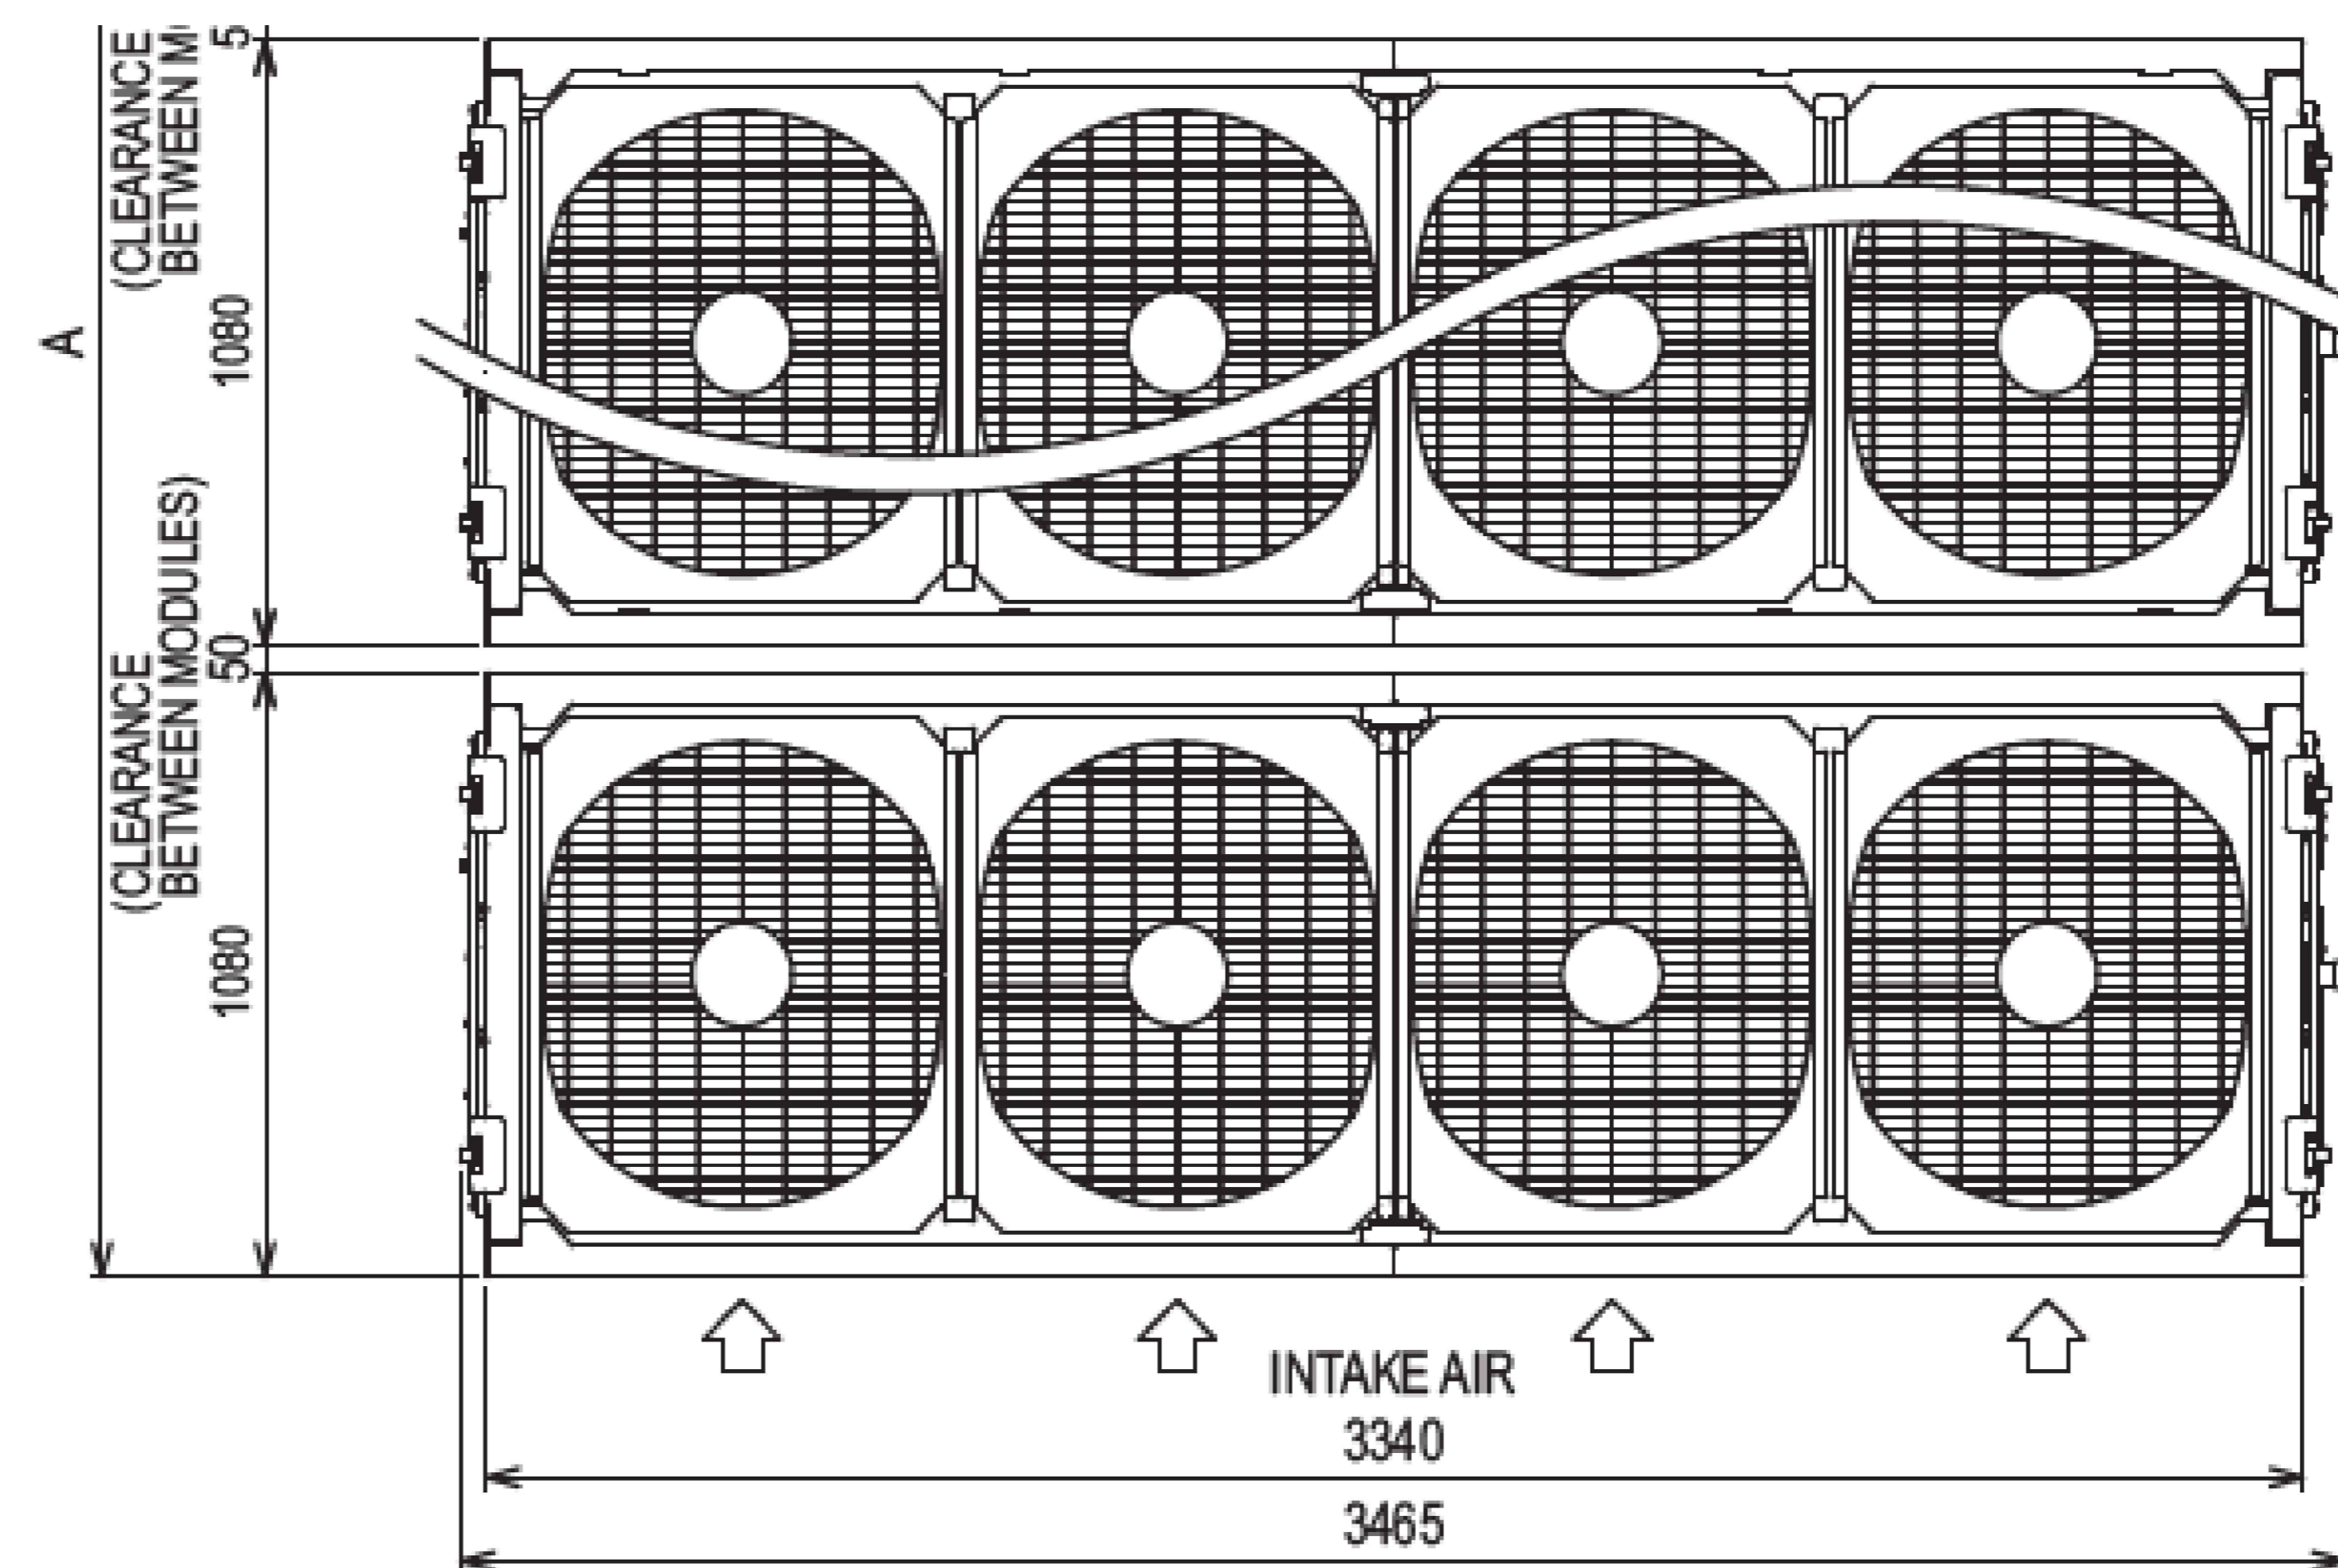

OVERALL BLOCK PLAN OF MITSUBISHI  
EAHV-M1500YCL(N)AIR SOURCE HEAT PUMP  
(2No. HEAT PUMPS - PROPOSED  
CONFIGURATION)

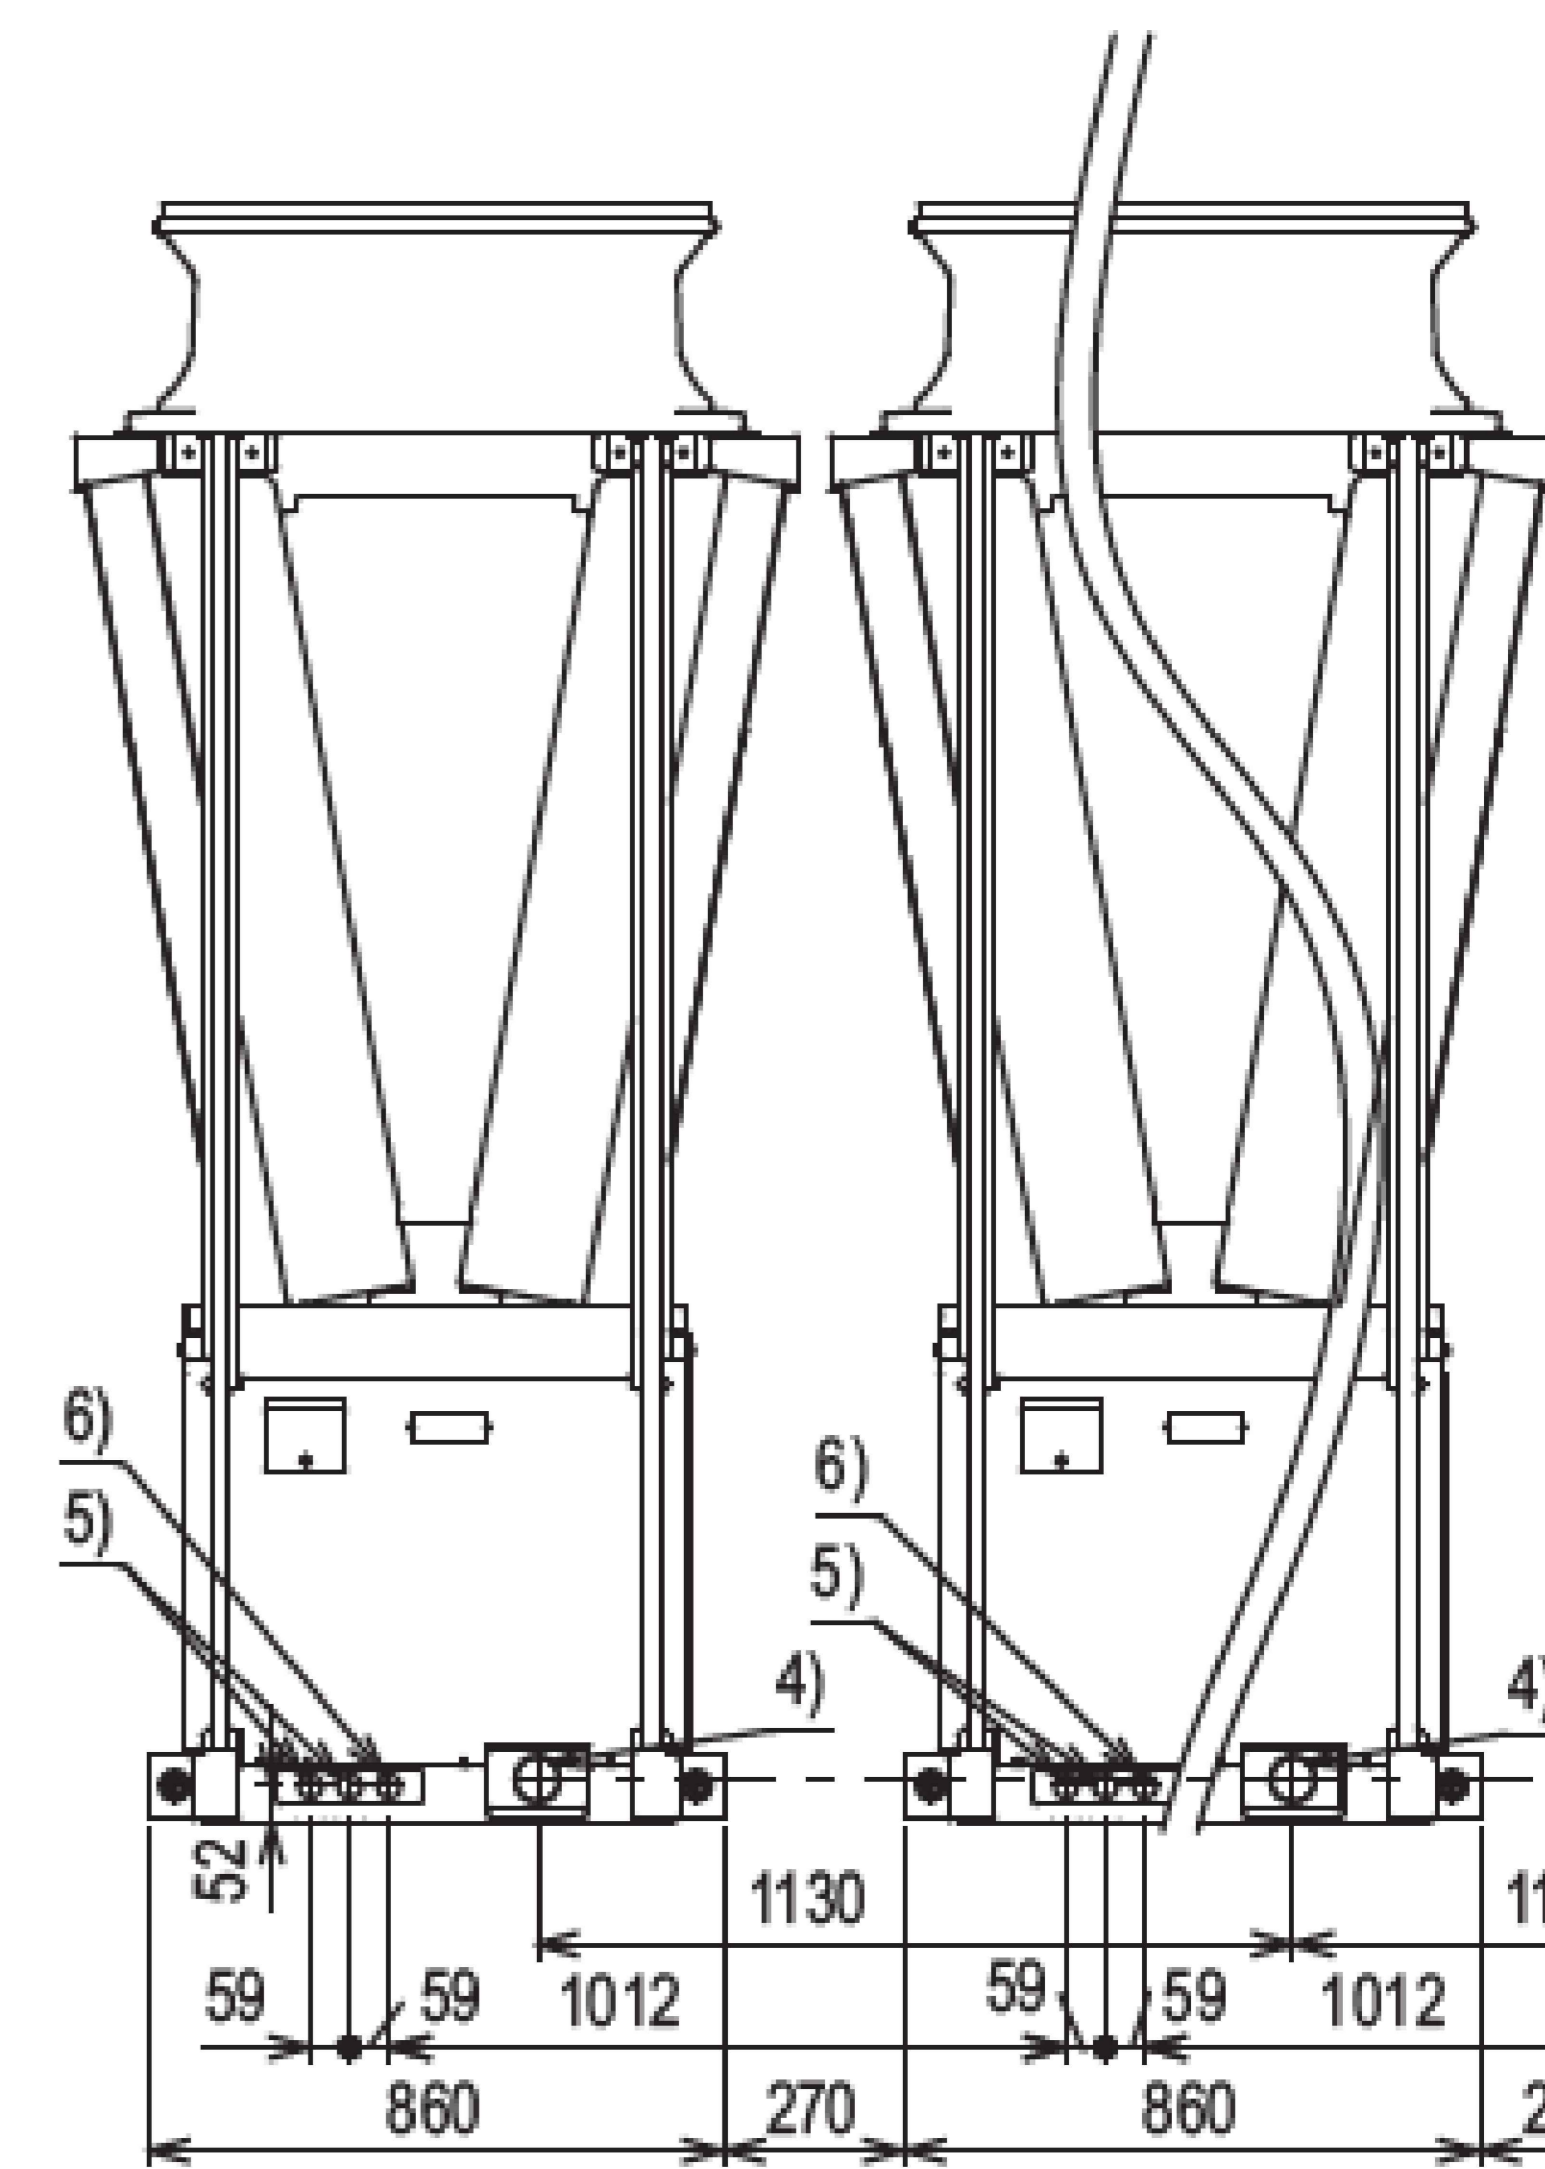

SIDE ELEVATION OF MITSUBISHI 2No.  
EAHV-M1500YCL(N)AIR SOURCE HEAT PUMP



3d VISUAL OF 1No. EAHV-M1500YCL(N)  
AIR SOURCE HEAT PUMP

CONSTRUCTION (DESIGN AND MANAGEMENT)  
REGULATIONS 2015

DESIGNERS HAZARD INFORMATION FOR CONSTRUCTION  
IF YOU DO NOT FULLY UNDERSTAND THE RISK FROM THE CONSTRUCTION OF THE  
UNIT INDICATED ON THE DRAWING AIR, THE PROJECT MANAGER, HEALTH & SAFETY ADVISOR  
OR A MEMBER OF THE DESIGN TEAM BEFORE PROCEEDING.

THE ABOVE HAZARD REFERS SPECIFICALLY TO THE INFORMATION SHOWN ON THIS DRAWING.  
REFER TO THE HEALTH & SAFETY PLAN FOR FURTHER INFORMATION.

NOTES		REF	DESCRIPTION	DATE	BY	CLIENT														
1.	THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL & STRUCTURAL DRAWINGS.					<p>MAC</p> <p>ARCHBISHOP CRANMER CE PRIMARY SCHOOL</p> <p>ELEVATIONS OF PROPOSED AIR SOURCE HEAT PUMP</p>														
2.	THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT BUILDING SERVICES DRAWINGS & THE RELEVANT SECTIONS OF THE SPECIFICATIONS & SCHEDULES.																			
3.	THIS DRAWING IS NOT TO BE SCALED.																			
4.	ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.																			
<p>THIS DRAWING IS A STAGE 3 INDICATIVE DRAWING. CONTRACTOR TO DEVELOP THE DESIGN INTENT TO FULL DETAILED DESIGN. ANY SIZING INFORMATION PROVIDED IS TO BE VERIFIED BY THE CONTRACTOR.</p>																				
<table border="1"> <thead> <tr> <th>DRN</th> <th>CHKD</th> <th>SCALE</th> <th>SHEET</th> <th>PROJECT No.</th> <th>MECHANICAL</th> <th>ELECTRICAL</th> </tr> </thead> <tbody> <tr> <td>KG</td> <td>KG</td> <td>NTS</td> <td>A0</td> <td>230524</td> <td>KG</td> <td>KG</td> </tr> </tbody> </table>							DRN	CHKD	SCALE	SHEET	PROJECT No.	MECHANICAL	ELECTRICAL	KG	KG	NTS	A0	230524	KG	KG
DRN	CHKD	SCALE	SHEET	PROJECT No.	MECHANICAL	ELECTRICAL														
KG	KG	NTS	A0	230524	KG	KG														
<table border="1"> <thead> <tr> <th>DR A W I N G T I T L E</th> <th>F I R S T I S S U E D A T E</th> <th>P R O J E C T S T A G E</th> <th>S T A T U S</th> </tr> </thead> <tbody> <tr> <td>ELEVATIONS OF PROPOSED AIR SOURCE HEAT PUMP</td> <td>JAN 24</td> <td>STAGE 3</td> <td>S3 - SUITABLE FOR REVIEW &amp; COMMENT</td> </tr> </tbody> </table>							DR A W I N G T I T L E	F I R S T I S S U E D A T E	P R O J E C T S T A G E	S T A T U S	ELEVATIONS OF PROPOSED AIR SOURCE HEAT PUMP	JAN 24	STAGE 3	S3 - SUITABLE FOR REVIEW & COMMENT						
DR A W I N G T I T L E	F I R S T I S S U E D A T E	P R O J E C T S T A G E	S T A T U S																	
ELEVATIONS OF PROPOSED AIR SOURCE HEAT PUMP	JAN 24	STAGE 3	S3 - SUITABLE FOR REVIEW & COMMENT																	
<p>230524-G&amp;G-XX-XX-M-DR-3001 101</p>																				