


SOUTH EAST ELEVATION SCALE 1:100

AS EXISTING



NORTH EAST ELEVATION SCALE 1:100 **AS EXISTING**

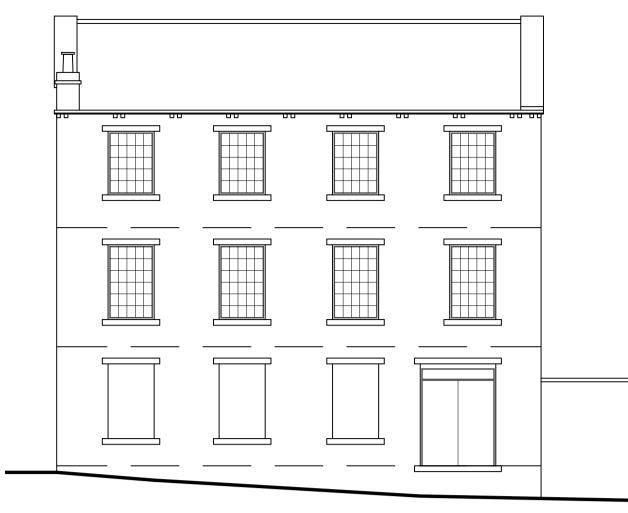


NORTH WEST ELEVATION SCALE 1:100 AS EXISTING



SOUTH WEST ELEVATION SCALE 1:100

AS EXISTING

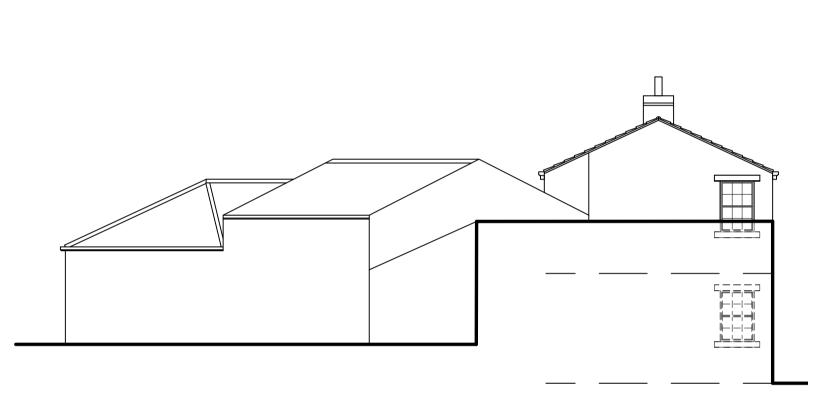


SOUTH EAST ELEVATION

ELEVATION "A" SCALE 1:100 AS EXISTING



NORTH EAST ELEVATION

ELEVATION "B" SCALE 1:100 AS EXISTING

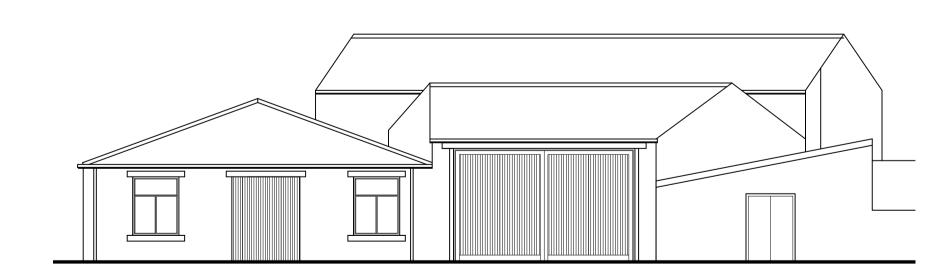

SOUTH ELEVATION

ELEVATION "C" SCALE 1:100 AS EXISTING

ANY DEVIATION FROM APPROVED DRAWINGS
MUST BE AGREED WITH THE BUILDING CONTROL
OFFICER, PLANNING DEPT. AND THIS OFFICE BEFORE WORK COMMENCES.

GENERAL NOTES

NO CONDITION, BUILDING DEFECT OR ASBESTOS SURVEY HAS BEEN UNDERTAKEN BY JBW

DIMENSIONS OTHER THAN THOSE FIGURED ON THE DRAWINGS MUST BE VERIFIED BY THIS OFFICE. ALL SETTING OUT ON SITE MUST BE VERIFIED BEFORE MANUFACTURE OF COMPONENTS. ALL DISCREPANCIES MUST BE REPORTED TO THE OFFICE BEFORE WORKS COMMENCE. BOUNDAMED SAFED RIGHTS OF WAY MUST BE ASCERTAINED BEFORE WORKS

WRITTEN APPROVAL SHOULD BE OBTAINED FROM ADJOINING OWNERS BEFORE WORK COMMENCES ON THE PARTY WALL OR OVER BOUNDARIES OR WITHIN 3m OF EITHER. UNDER THE PARTY WALL ETC. ACT 1996 A STATUTORY NOTICE MUST BE SERVED AS REQUIRED.

ALL WORK AND MATERIALS TO COMPLY WITH RELEVANT B.S. AND C.E. STANDARDS AND CODES OF PRACTICE AND TO BE IN ACCORDANCE WITH BUILDING REGULATIONS.

DOOR AND WINDOW SIZES SHOWN ARE NOMINAL. ACTUAL SIZE OF DOOR AND WINDOW FRAMES SHOULD BE CHECKED BEFORE CONSTRUCTING OPENINGS.

TOUGHENED OR LAMINATED GLASS MUST BE USED IN THE FOLLOWING AREAS (TO BS 6262: PART 4: 1994 CODE OF PRACTICE FOR GLAZING FOR BUILDINGS)

ANY GLAZING BETWEEN FLOOR LEVEL AND 800mm ABOVE FLOOR LEVEL IN WINDOWS.

ANY GLAZING BETWEEN FLOOR LEVEL AND 1500mm ABOVE FLOOR LEVEL IN A DOOR.

ANY GLAZING IN SIDE FRAMES TO DOORS WITHIN 300mm OF THE DOOR UP TO A HEIGHT OF 1500mm AND ABOVE FLOOR LEVEL.

DETAILS AND CALCULATIONS FOR STRUCTURAL STEELWORK AND TIMBER MEMBERS TO BE APPROVED BY BUILDING CONTROL BEFORE WORK COMMENCES. ALL STRUCTURAL ROOF TIMBERS TO BE PRESSURE IMPREGNATED OR SIMILARLY TREATED.

STRUCTURE TIMBER GENERALLY TO BE C16 GRADE, BUT WHERE MARKED, TIMBER BEAMS AND PURLINS TO BE C24 GRADE AS DEFINED IN

DESIGN RISK ASSESSMENT UNDERGROUND SERVICES


THERE ARE UNDERGROUND GAS AND ELECTRICITY SERVICES ON THE SITE. ACCURATELY POSITION ALL UNDERGROUND SERVICES WITHIN THE SITE BEFORE
COMMENCEMENT OF ANY EXCAVATIONS FOR
FOUNDATIONS, DRAINAGE, ETC. SEE HSE GUIDANCE NOTES HS (G) 47 AVOIDING DANGER FROM UNDERGROUND SÉRVICES, BT GUIDANCE NOTES APPENDIX 1, NW CABLE PRECAUTIONS TO PROTECT COMMUNICATIONS APPARATUS, NW WATER PROTECTION OF MAINS AND SERVICES, BRITISH GAS TRANSCO MEASURES TO PROTECT APPARATUS

OVERHEAD CABLES THE SITE. THERE IS A RISK OF ELECTROCUTION. SEE BT GUIDANCE NOTES APPENDIX 1 AND HSE

GUIDANCE NOTES 6. HEAVY COMPONENTS

THERE IS A RISK OF INJURY TO OPERATIVES
LIFTING HEAVY COMPONENTS. ARRANGE
APPROPRIATE HANDLING AND LIFTING EQUIPMENT.

CHECK FOR EXISTING ASBESTOS SHEETING TO SOFFITS/LININGS/ETC. ANY ASBESTOS FOUND TO BE REMOVED BY AN APPROVED CONTRACTOR AND DISPOSED OF IN A SAFE MANNER.

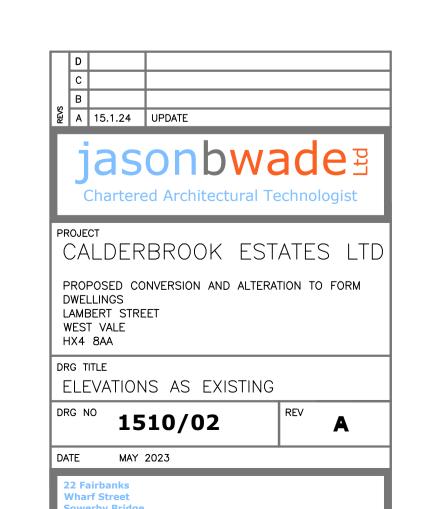

01422 831114

CIAT