


ALL DIMENSIONS IN MILLIMETRES  
 FIGURED DIMENSIONS ONLY TO BE USED FROM  
 THIS DRAWING UNLESS STATED OTHERWISE  
 READ IN CONJUNCTION WITH ENGINEERS  
 DRAWINGS AND SPECIFICATION  
 ALL SIZES TO BE CHECKED ON SITE  
 BY CONTRACTOR PRIOR TO ORDERING MATERIALS  
 THIS DRAWING IS COPYRIGHT

# WARRANT

REVISION	DESCRIPTION	DATE

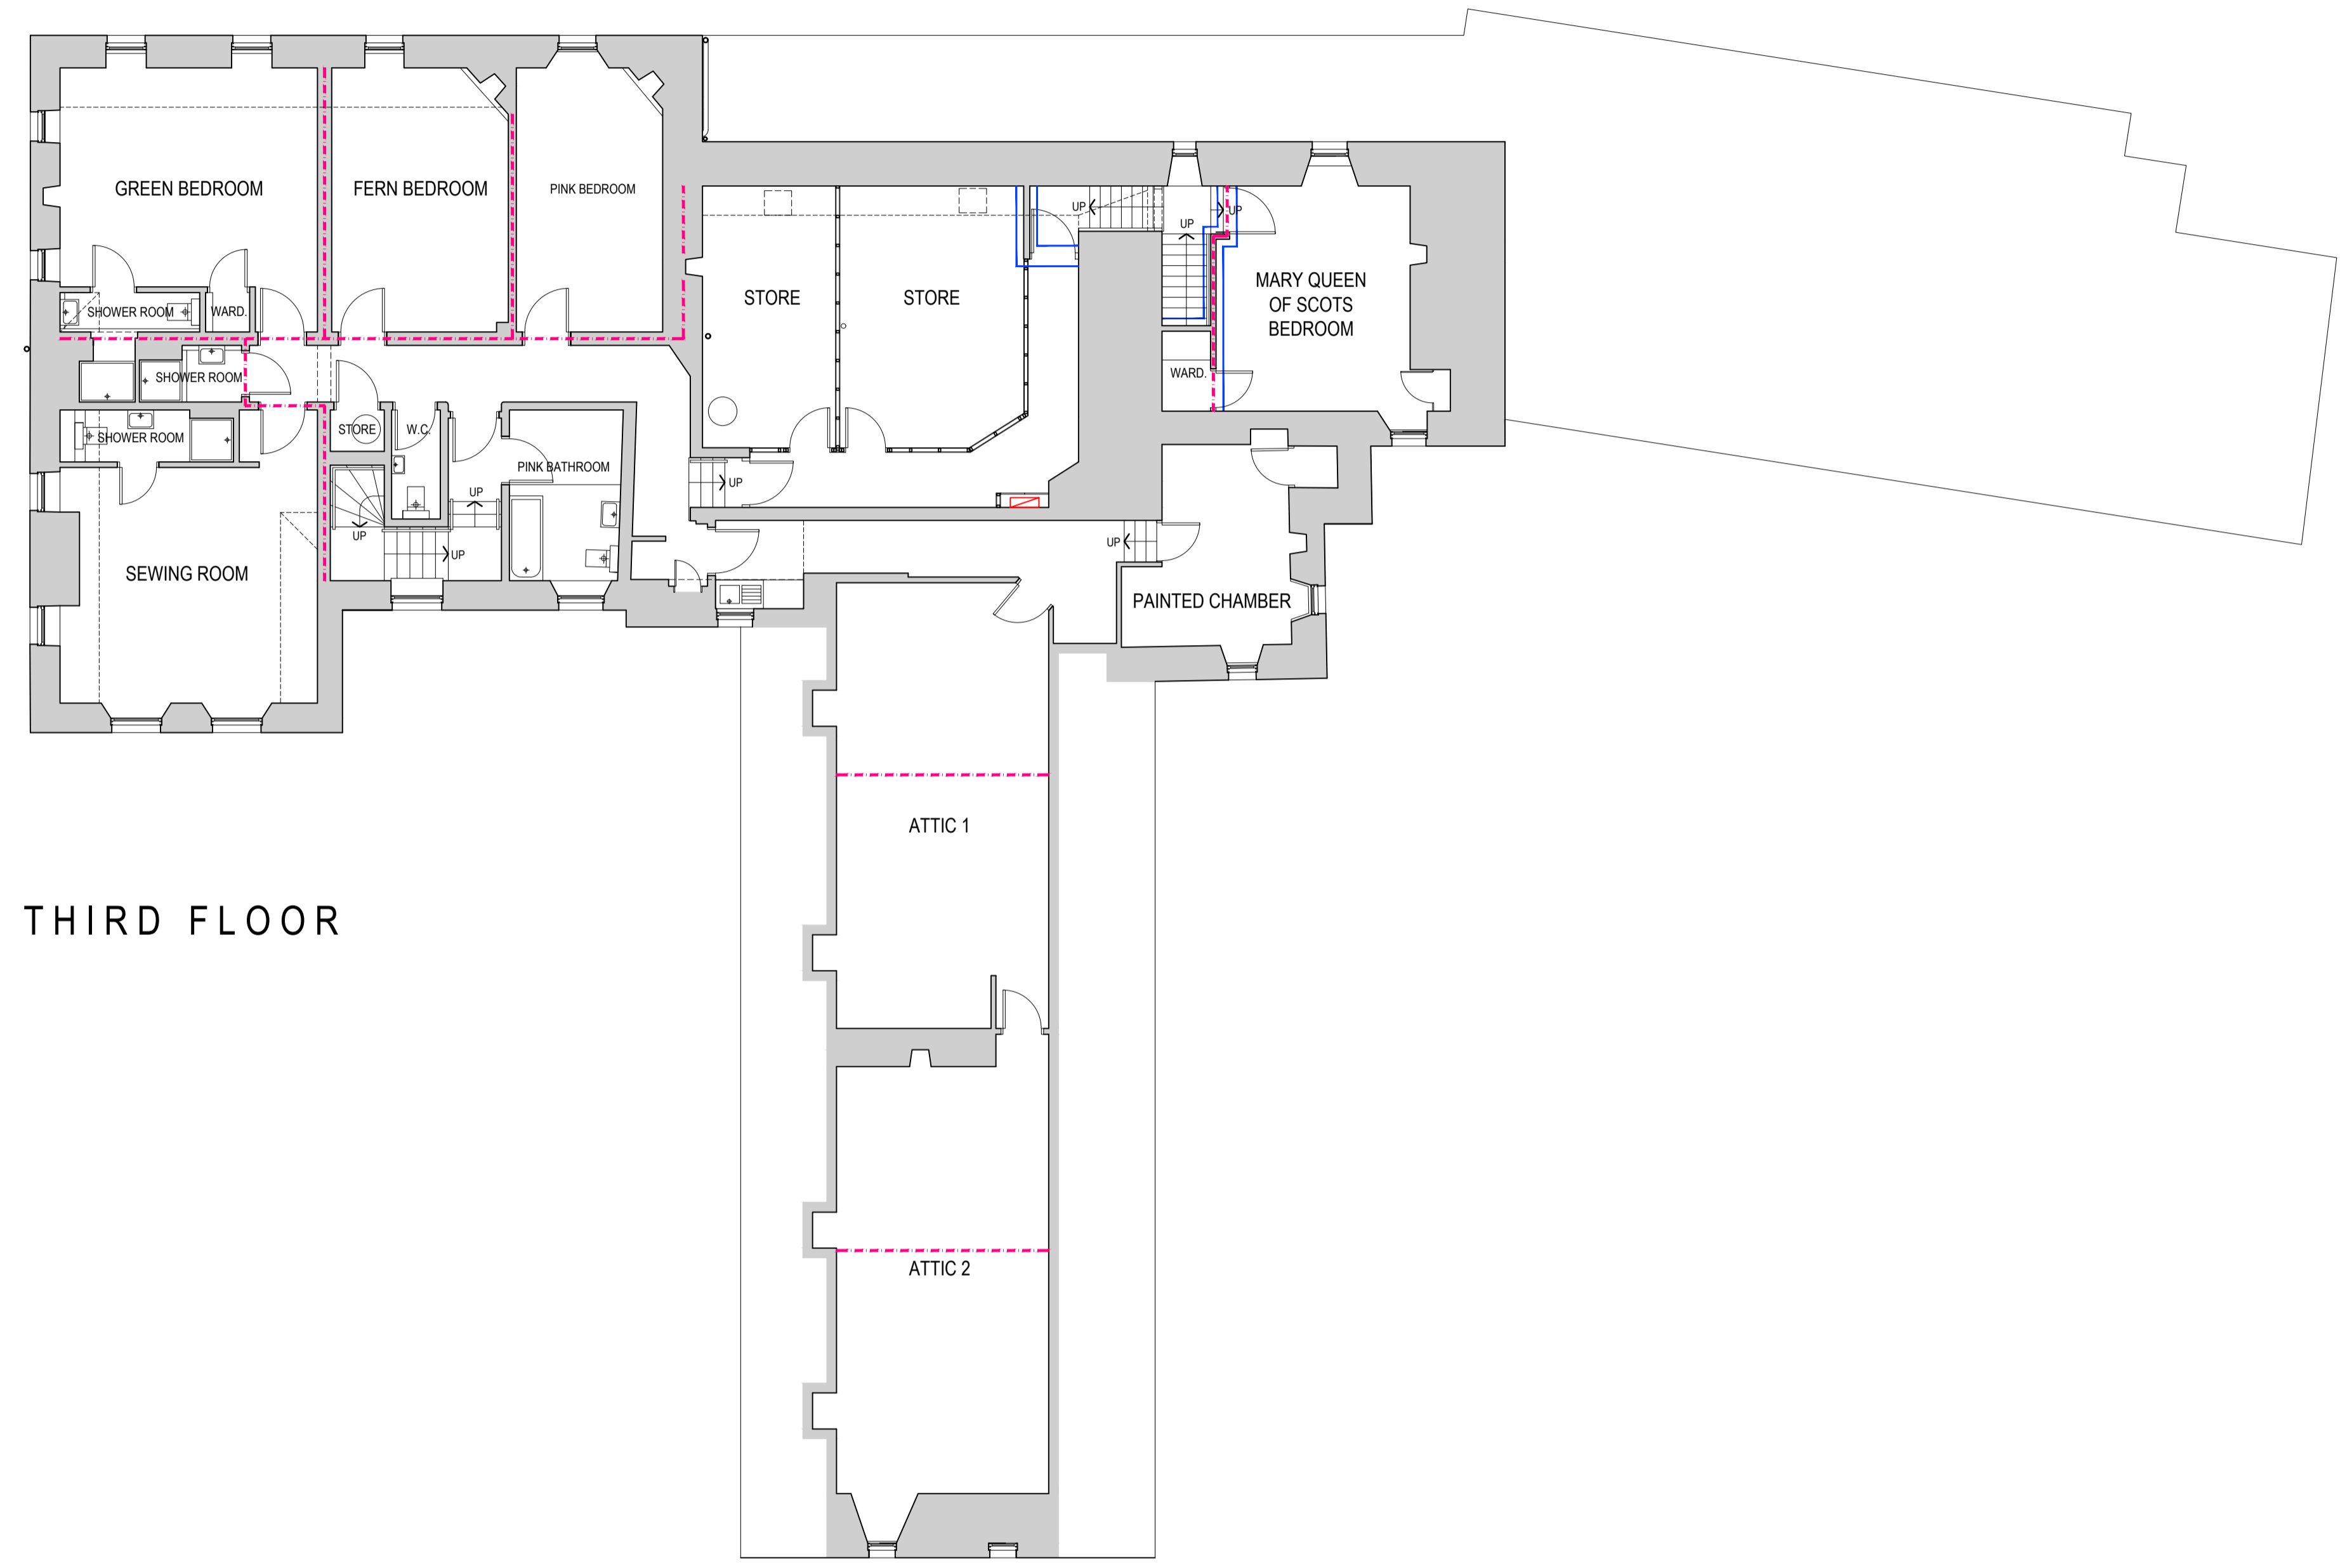


THIRD FLOOR

### NOTES

- ALL SERVICES PENETRATING COMPARTMENT WALLS AND FLOORS ARE TO BE FIRE STOPPED TO PROVIDE MEDIUM DURATION FIRE RESISTANCE.
- ALL RECESSED DOWNLIGHTS WITHIN COMPARTMENT FLOORS ARE TO HAVE 60-MINUTE RATED FIRE HOODS INSTALLED.

### LEGEND

- DENOTES CEILINGS AND STAIR SOFFITS TO BE COATED WITH FIRE RESISTANT INTUMESCENT COATING AS NOTE 2.14 TO PROVIDE MEDIUM DURATION FIRE RESISTANCE
- DENOTES CEILING TO BE PLATED WITH 12.5mm PLASTERBOARD PRIOR TO APPLICATION OF FIRE RESISTANT INTUMESCENT COATING AS NOTE 2.14 TO PROVIDE MEDIUM DURATION FIRE RESISTANCE
- DENOTES DOWNSTANDS TO BE COATED WITH FIRE RESISTANT INTUMESCENT COATING (TO SOFFIT AND VERTICAL FACES) AS NOTE 2.14 TO PROVIDE MEDIUM DURATION FIRE RESISTANCE
- DENOTES PARTITIONS TO BE COATED WITH FIRE RESISTANT INTUMESCENT COATING AS NOTE 2.16 TO PROVIDE MEDIUM DURATION FIRE RESISTANCE
- DENOTES TIMBER WALL LININGS TO RECEIVE FIRE RETARDANT COATING SYSTEM AS NOTE 2.15 TO UPGRADE REACTION TO FIRE CLASSIFICATION
- DENOTES CAVITY BARRIER TO BE INSTALLED AS NOTE 2.17



**STEWART ASSOCIATES**  
 Architects & Development Consultants

23 BATH STREET  
 LARGS  
 AYRSHIRE  
 tel : 01475 670033  
 fax : 01475 673103  
 email: info@stewart-associates.com



TITLE	BLAIR CASTLE, DALRY
CLIENT	THE HUNTER FOUNDATION
DRAWING	THIRD FLOOR - FIRE RETARDANT COATINGS AND CAVITY BARRIERS
SCALE	1:100@A1
DATE	01/24
DRAWN	AMK
CHECKED	BAS
NUMBER	2222/W21