


ALL DIMENSIONS IN MILLIMETRES
 FIGURED DIMENSIONS ONLY TO BE USED FROM
 THIS DRAWING ONLY UNLESS STATED OTHERWISE
 READ IN CONJUNCTION WITH ENGINEERS
 DRAWINGS AND SPECIFICATION
 ALL SIZES TO BE CHECKED ON SITE
 BY CONTRACTOR PRIOR TO ORDERING MATERIALS
 THIS DRAWING IS COPYRIGHT

WARRANT

REVISION DESCRIPTION DATE

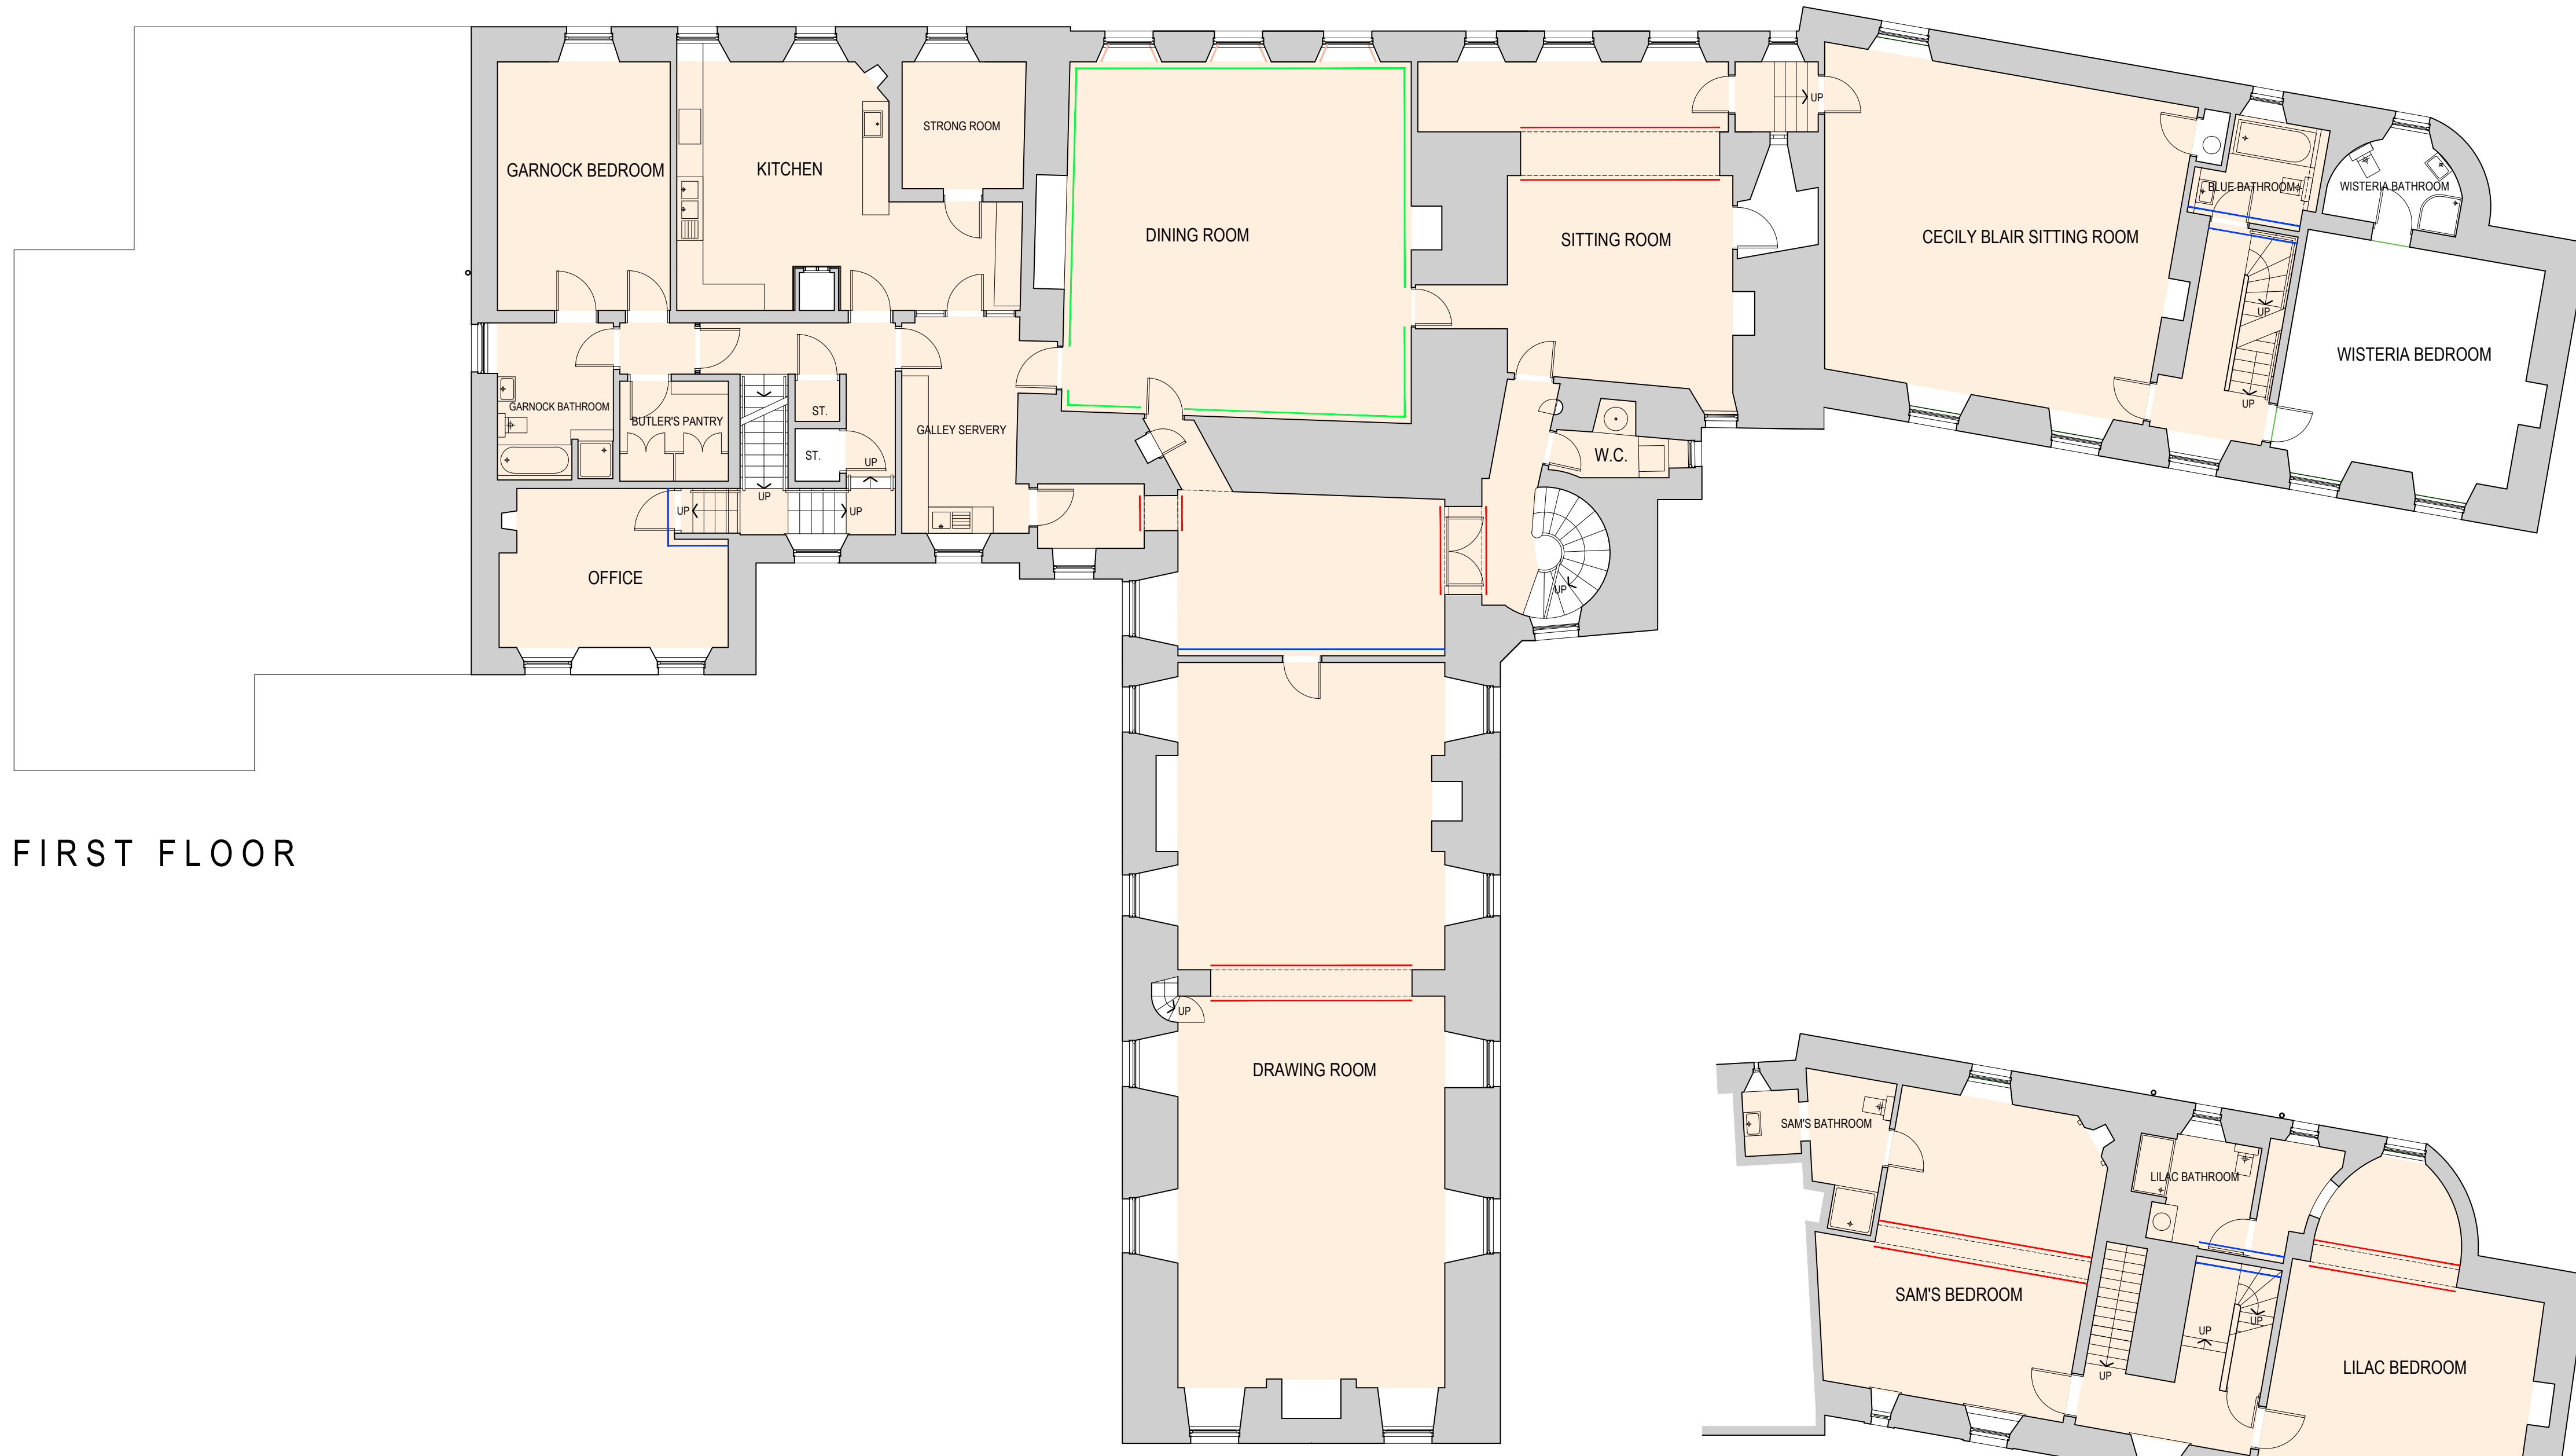

FIRST FLOOR


MEZZANINE FLOOR

NOTES

1. ALL SERVICES PENETRATING COMPARTMENT WALLS AND FLOORS ARE TO BE FIRESTOPPED TO PROVIDE MEDIUM DURATION FIRE RESISTANCE.
2. ALL RECESSED DOWNLIGHTS WITHIN COMPARTMENT FLOORS ARE TO HAVE 60-MINUTE RATED FIRE HOODS INSTALLED.

LEGEND

- DENOTES CEILINGS AND STAIR SOFFITS TO BE COATED WITH FIRE RESISTANT INTUMESCENT COATING AS NOTE 2.14 TO PROVIDE MEDIUM DURATION FIRE RESISTANCE
- DENOTES CEILING TO BE PLATED WITH 12.5mm PLASTERBOARD PRIOR TO APPLICATION OF FIRE RESISTANT INTUMESCENT COATING AS NOTE 2.14 TO PROVIDE MEDIUM DURATION FIRE RESISTANCE
- DENOTES DOWNSTANDS TO BE COATED WITH FIRE RESISTANT INTUMESCENT COATING (TO SOFFIT AND VERTICAL FACES) AS NOTE 2.14 TO PROVIDE MEDIUM DURATION FIRE RESISTANCE
- DENOTES PARTITIONS TO BE COATED WITH FIRE RESISTANT INTUMESCENT COATING AS NOTE 2.16 TO PROVIDE MEDIUM DURATION FIRE RESISTANCE
- DENOTES TIMBER WALL LININGS TO RECEIVE FIRE RETARDANT COATING SYSTEM AS NOTE 2.15 TO UPGRADE REACTION TO FIRE CLASSIFICATION
- DENOTES CAVITY BARRIER TO BE INSTALLED AS NOTE 2.17



STEWART ASSOCIATES
 Architects & Development Consultants

23 BATH STREET
 LARGS
 AYRSHIRE
 tel : 01475 670033
 fax : 01475 673103
 email: info@stewart-associates.com



TITLE	BLAIR CASTLE, DALRY
CLIENT	THE HUNTER FOUNDATION
DRAWING	FIRST AND MEZZANINE FLOORS - FIRE RETARDANT COATINGS AND CAVITY BARRIERS
SCALE	1:100
DATE	01/24
DRAWN	AMK
CHECKED	BAS
NUMBER	2222/W19