V13 Drawing Register						
Sheet Number	Sheet Name	Rev	Revision Date			
1190-1300	Cover Page & Design Risk Register	Α	Feb 2024			
1190-1310	Foundation & Sub-Floor Plans	A	Feb 2024			
1190-1320	Floor Plans	A	Feb 2024			
1190-1330	MEP Plans	Α	Feb 2024			
1190-1340	Elevations	Α	Feb 2024			
1190-1350	Sections	Α	Feb 2024			



Design Risk Register					
Element	Comments				
Lifting Operations	To avoid injury when handling heavy components, specialist handling equipment is to be utilised for the positioning of heavy objects/materials. Large glazing to be installed with specialist lifting equipment by trained personnel. Protection barriers to be provided to prevent mechanical damage following installation.				
Craneage	Crane supplier to be satisfied of adequate support to outriggers, correct lifting positions to be established to avoid slippage of sheet materials during lifting and placement. Sub-contractors and suppliers to 'design in' lifting eyes and identify weights of heavy items at drawing approval stage. All RAMS to be obtained and approved prior to any lifting operations being carried out.				
Ground Floor Construction	Mechanical Lifting equipment to be utilised to position pre-cast concrete floor planks. Manual handling assessment to be carried out.				
Working at Height	Install temporary scaffolding barrier to exposed edges of upper floors including toe boards throughout the build period. Provide scaffolding to all areas requiring placement of materials and finishing to all areas above ground level. Scaffolding to be positioned to avoid the need to overreach causing strain injury when placing materials. Protect areas below high level working from falling debris. Ensure space required for crane is achievable and suitable hard standing is provided. Ensure maximum fall height when fixing trusses into position is 2 metres by utilising appropriate safety measures and equipment.				
Stairs	To prevent falls provide temporary guarding and edge protection to open well areas and keep clear during construction, eliminating the possibility of trip hazards. Stairs to be erected as early as possible during the construction process to provide vertical circulation and means of escape in case of fire.				
Masonry Construction	When working at height mechanical lifting measures required to lift brick and block packs into position to reduce manual handling.				
Lintels	Manual Handling Assessments to be carried out for all lintels, light craneage to be utilised for lintels considered too heavy for manual handling.				
Structural Steelwork	Mechanical lifting measures required to reduce manual handling. Ensure required space for crane is achievable and suitable hard standing is provided.				
Windows / Structural Openings	Any structural apertures below 800mm to be fitted with temporary guarding to prevent falls. Any structural apertures below 800mm and extending to floor level to be fitted with temporary guarding and edge protection to prevent falls. Mechanical lifting measures and frame and glazing fitted separately to be considered for installation.				
Window Cleaning & Maintanence	'Easy Clean' hinges are not an option due to the top hung design to a majority of the windows, as such windows should be cleaned from ground level using a telescopic 'reach & wash' system. All windows used to be Aluminium or UPVC frames to eliminate the need for future decoration.				
Roof Construction	Ensure space required for crane is achievable and suitable hard standing is provided. Ensure maximum fall beight when fixing trusses into position is 2 metres by utilising appropriate safety measures and equipment				

1190-V13-S (As)

General updates as detailed within issue email dated 02.02.2024	Feb 202
Construction Issue	July 202

# NORTHSTONE

Peel L&P Salford M50 2TG

### **CONSTRUCTION**

PROJECT

#### Gen2 House Type Portfolio

DRAWING NAME

#### 1190-V13-S (As) Cover Page & Design Risk Register

DRAWING NUMBER		DESIGNATION	DRAWN BY
1190-1300		AR	Design
DATE	SCALE (@ A3	3)	REV
June 2023			Α

#### lotes:

- All dimensions to structure unless otherwise stated.
- Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.
- other project related design information and drawings.
  Any discrepancies to be reported to Northstone Technical prior to commencement of works.
- All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.

DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.

## FOUNDATION & SUB-FLOOR LEGEND Brick Face External Wall OUTSIDE - 102.5mm clay facing brickwork as site specific - 125mm clear cavity - 100mm block as specification INSIDE 100mm Sleeper Wall - 100mm concrete block as engineers details 215mm Sleeper Wall - 100mm concrete block as engineers details - 15mm cavity fully filled with mortar - 100mm concrete block as engineers details Trench Block - 350mm concrete trench block as engineers details Services & Ventilation O<sup>SVP</sup> 110mm Soil and Vent Pipe ORWP Rainwater pipe as specification OGULLY Sealed floor gully for level access shower → <sup>Water</sup> Water Entry Point Data Lead In Data Entry Point E —— Electric Entry Point G — Gas Entry Point Sub-Floor Telescopic Vent Floor Finish & Span Extent of Floor Screed Span of Ground Floor Construction

Refer to engineers details and specification for all block strengths.
 Key to be read in conjunction with construction specification.
 Expansion and movement joints, bed reinforcement and wind posts to engineers details.


posts to engineers details.

4. Always refer to site investigation report and engineers details for any gas membrane requirements.

Sub-Floor Void Ventilation Schedule


Building Building Ventilation Minimum Number of Vents Required of Vents Required Vents Provided


77.89 m² | 39.03 | 58543 mm² | 12 \* Based on 500mm2/m2 of Floor Area

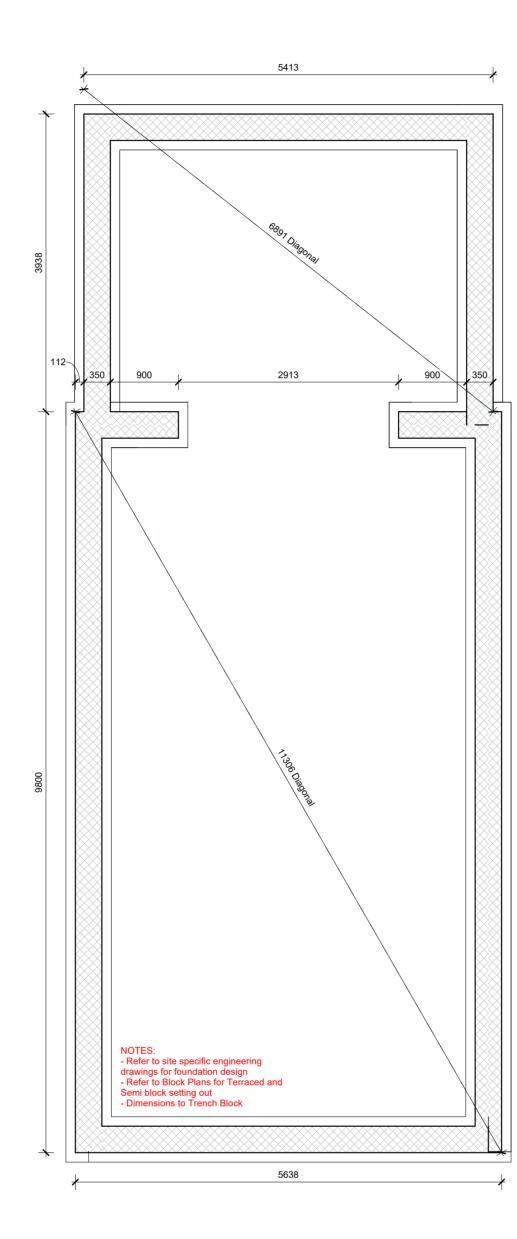

1210. Foundation Plan

1:50

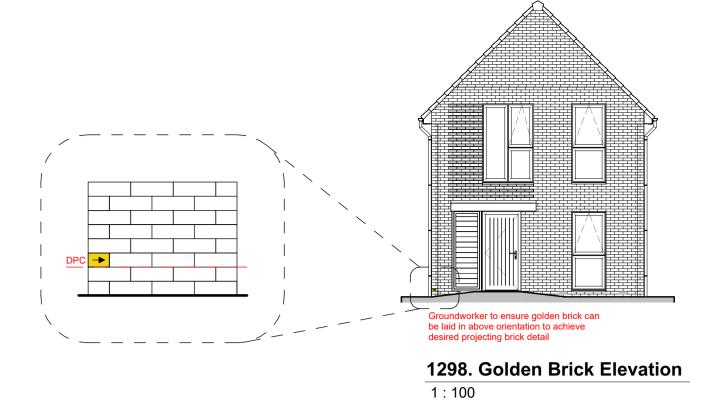

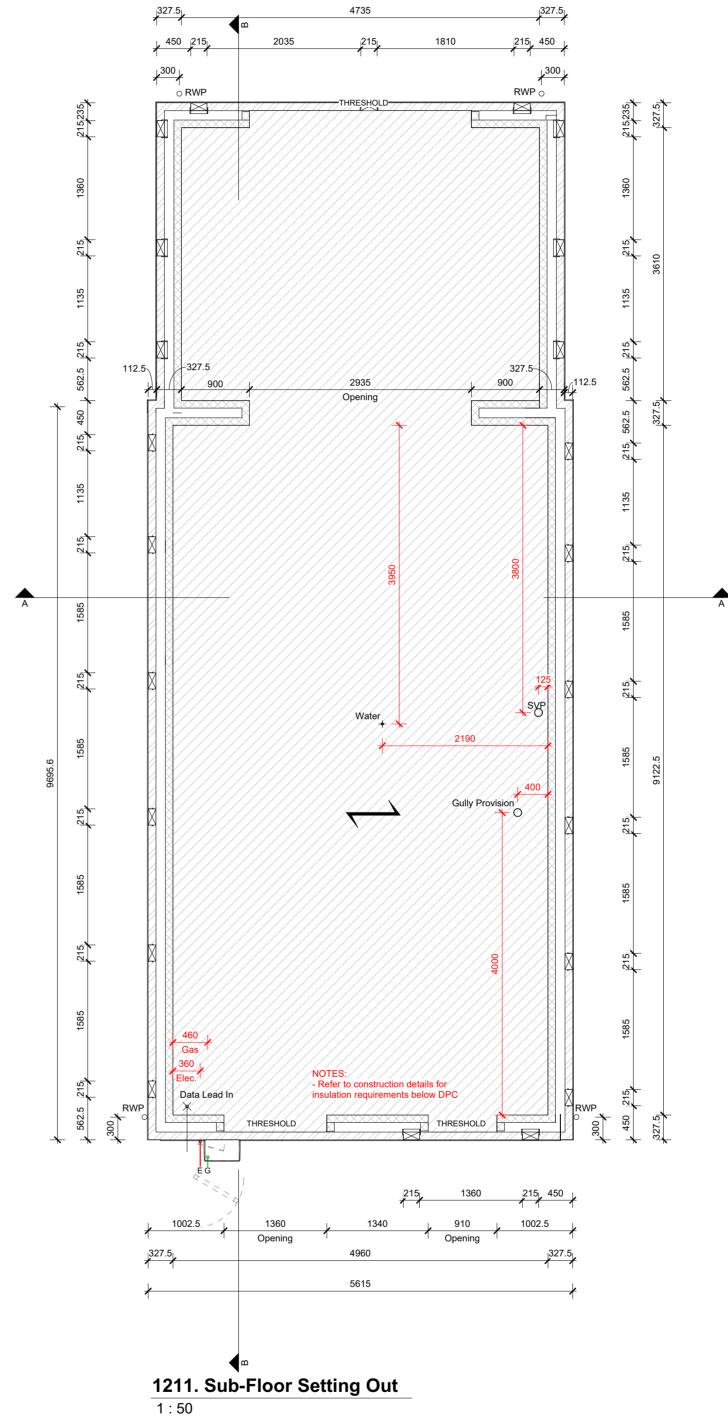

A General updates as detailed within issue email dated 02.02.2024
- Construction Issue July 2023
Rev Description Date

Peel L&P Salford M50 2TG

CONSTRUCTION

Gen2 House Type Portfolio

1190-V13-S (As)
Foundation & Sub-Floor Plans

DRAWING NUMBER
1190-1310


DATE
June 2023

DESIGNATION DRAWN BY
AR
Design


REV
As indicated
A


Notes:
All dimensions to structure unless otherwise stated.
Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.
Any discrepancies to be reported to Northstone Technical prior to commencement of works.
All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.


DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.

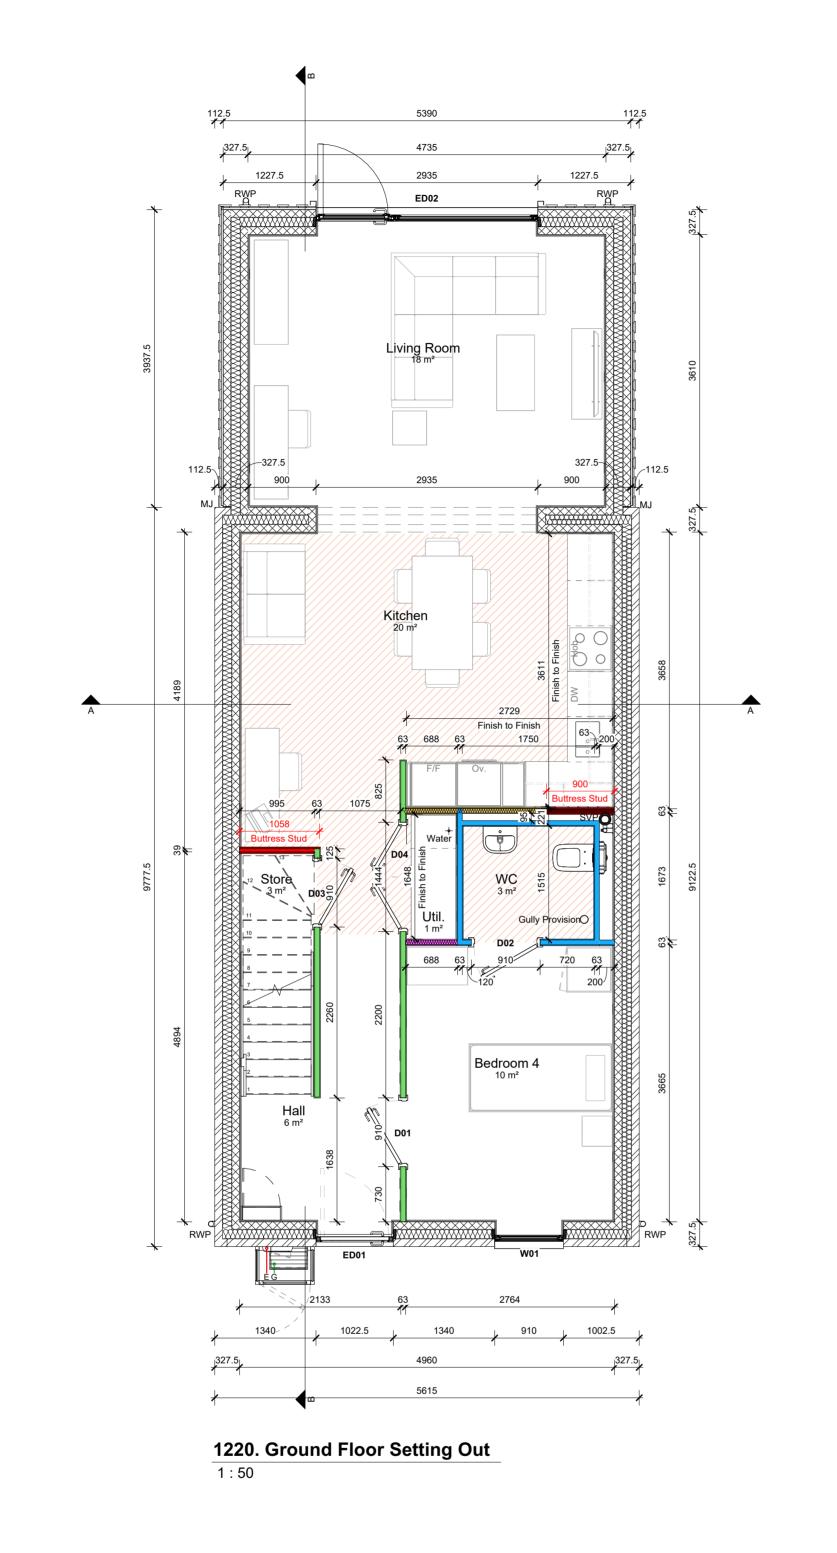




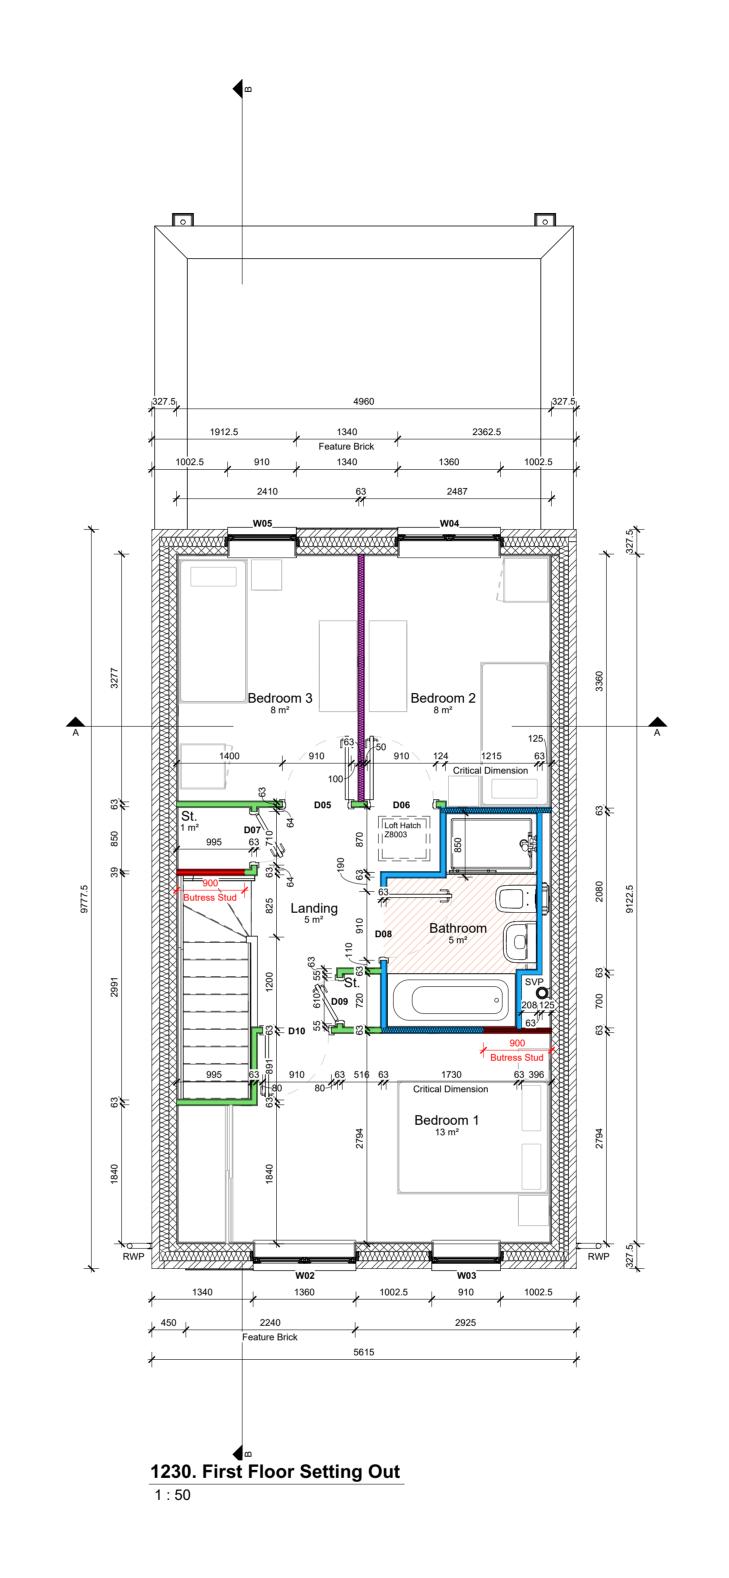

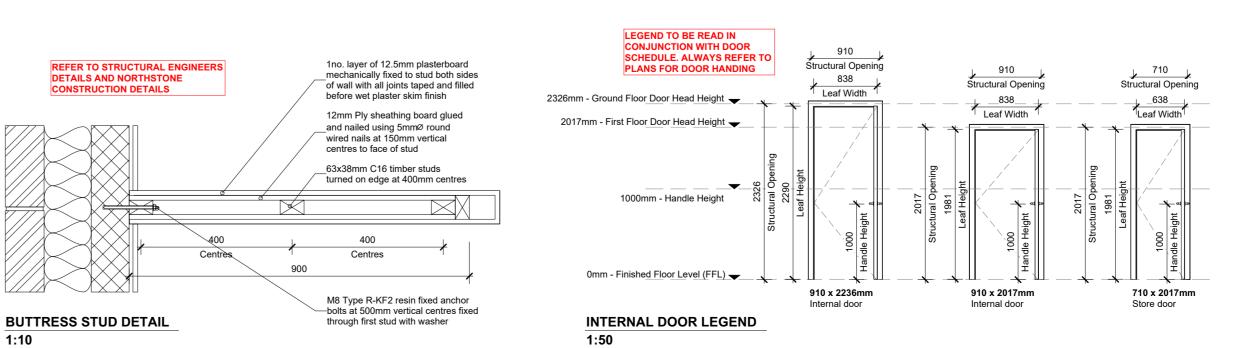

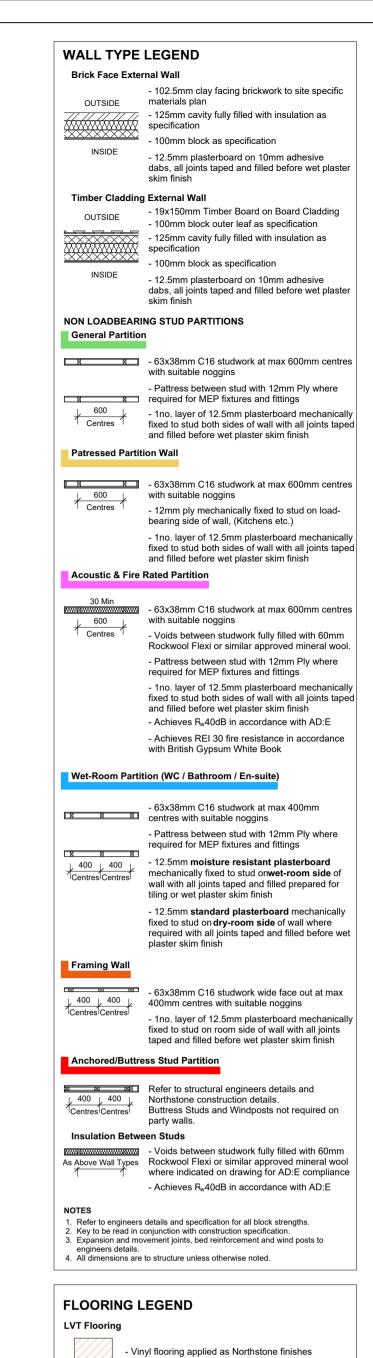

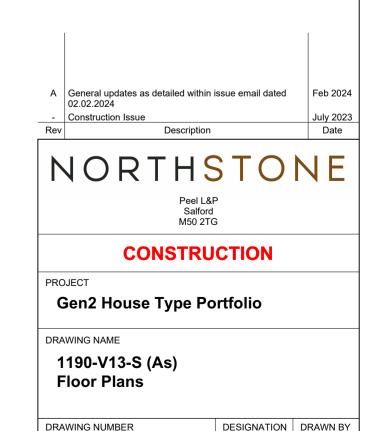

AR

SCALE (@ A1)

Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.

And discrepance of the specific state of the

All materials and workmanship to be in accordance with current NHBC

DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.

Any discrepancies to be reported to Northstone Technical prior to

June 2023 As indicated

All dimensions to structure unless otherwise stated.

Technical Standards and Building Regulations.


Design


DRAWING NUMBER


1190-1320


commencement of works


specification and relevant customer options

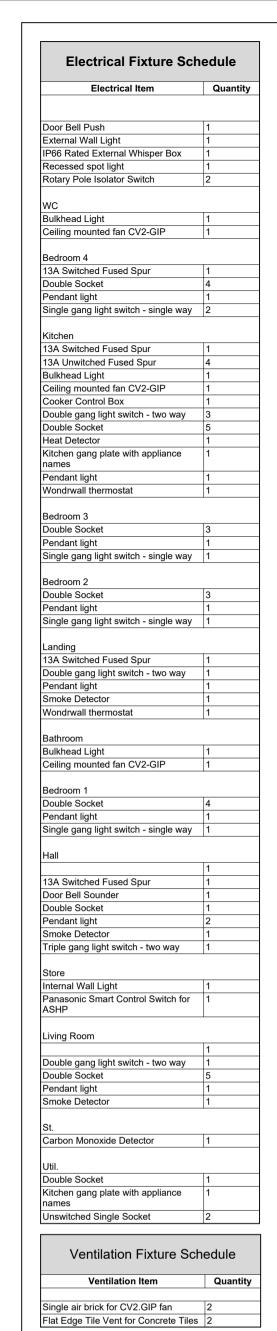

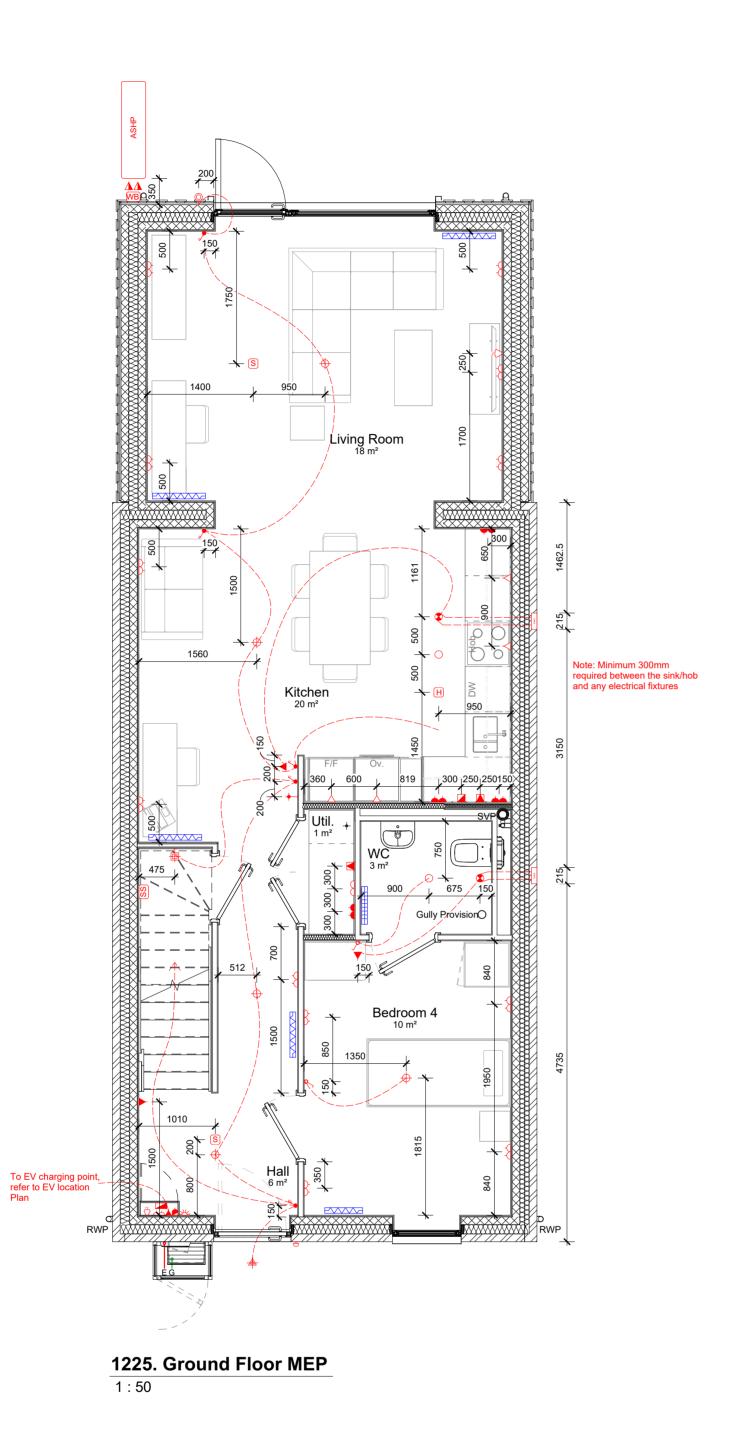

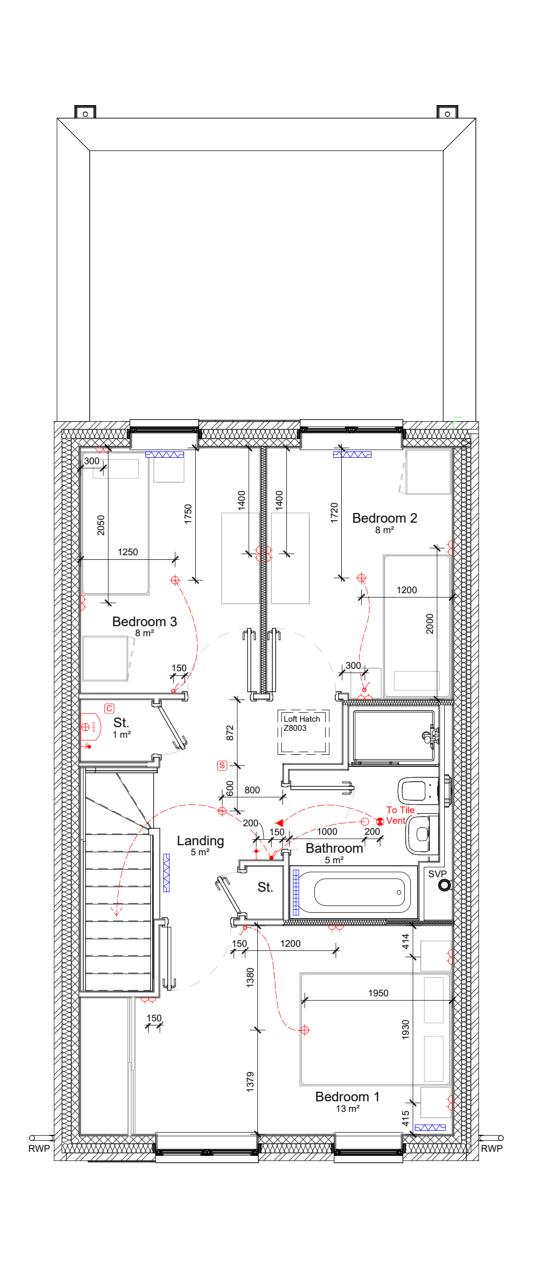

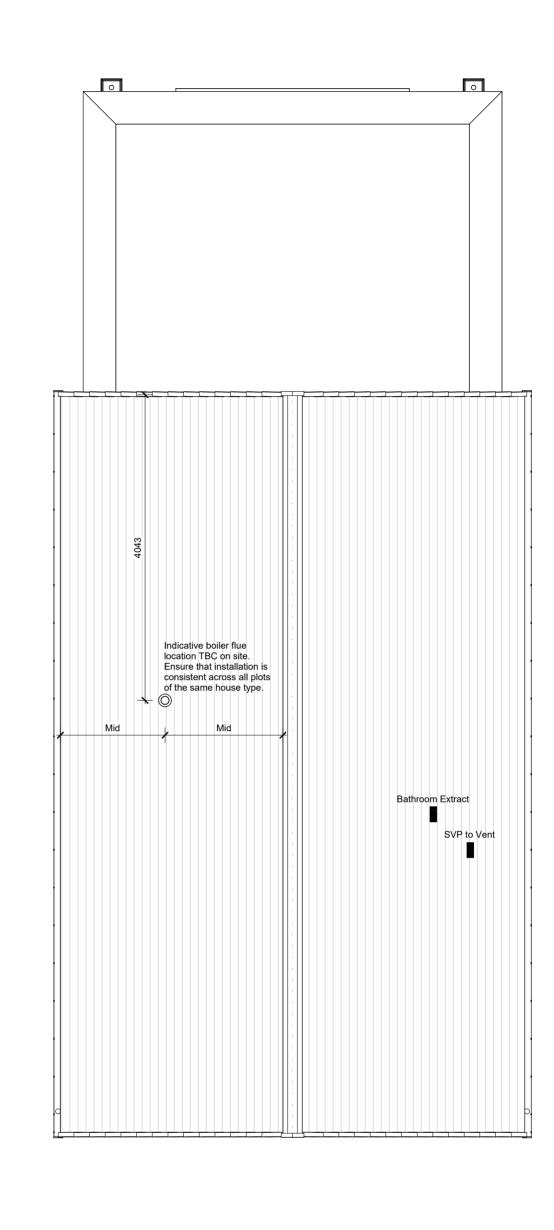

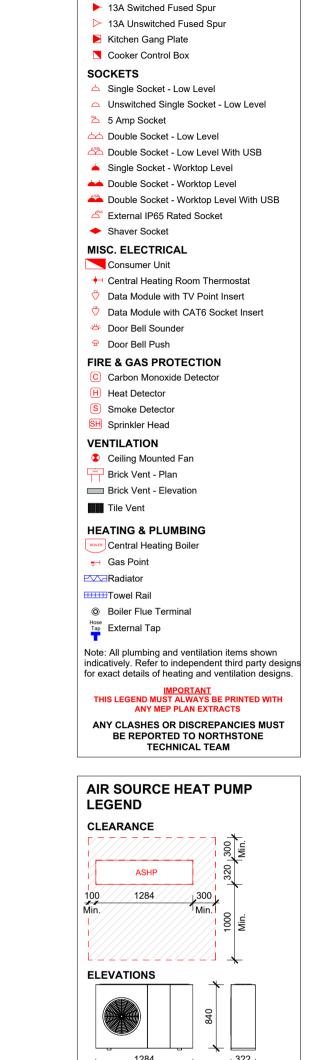

ANCILLARY EQUIPMENT

▲ IP67 Rated Rotary Pole Isolator Switch

WB IP66 Rated External Whisper Box

Note: Air Source Heat Pump, (ASHP), and ancillary equipment shown indicatively. Refer to independent third party designs for exact details of ASHP System

SS Panasonic Smart Control Switch

**M&E LEGEND** 

Recessed Spot Light

Single Gang Switch
 Double Gang Switch
 Triple Gang Switch
 Single Two-Way Switch
 Double Two-Way Switch
 Triple Two-Way Switch

Wondrwall Switch


Bulkhead Light


SWITCHES

**LIGHTING**○H External Wall Light

1235. First Floor MEP
1:50


1239. Roof Plan
1:50

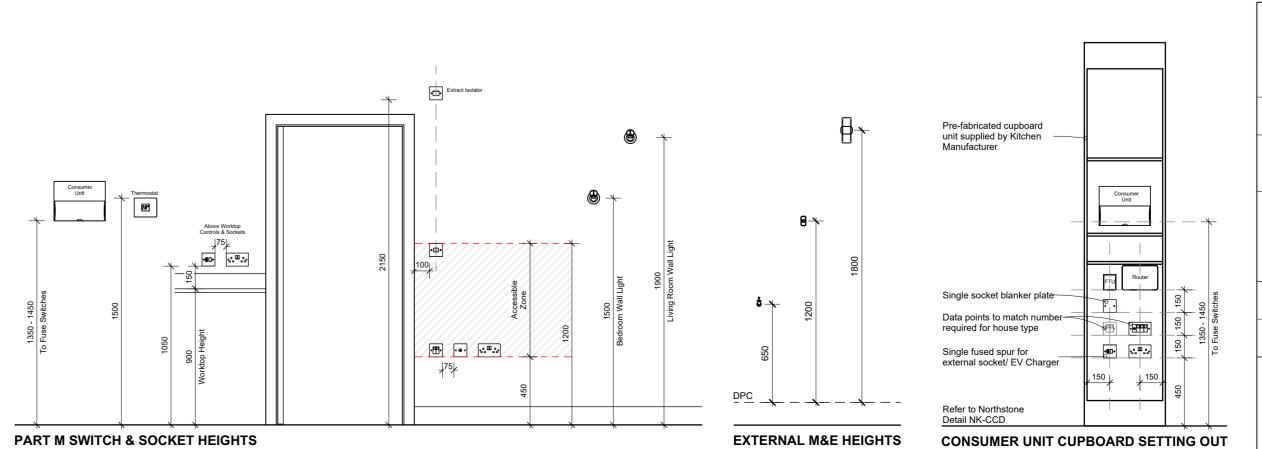

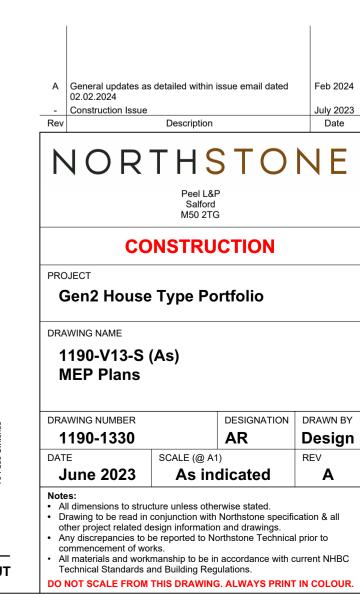



1240. Front Elevation 1:50

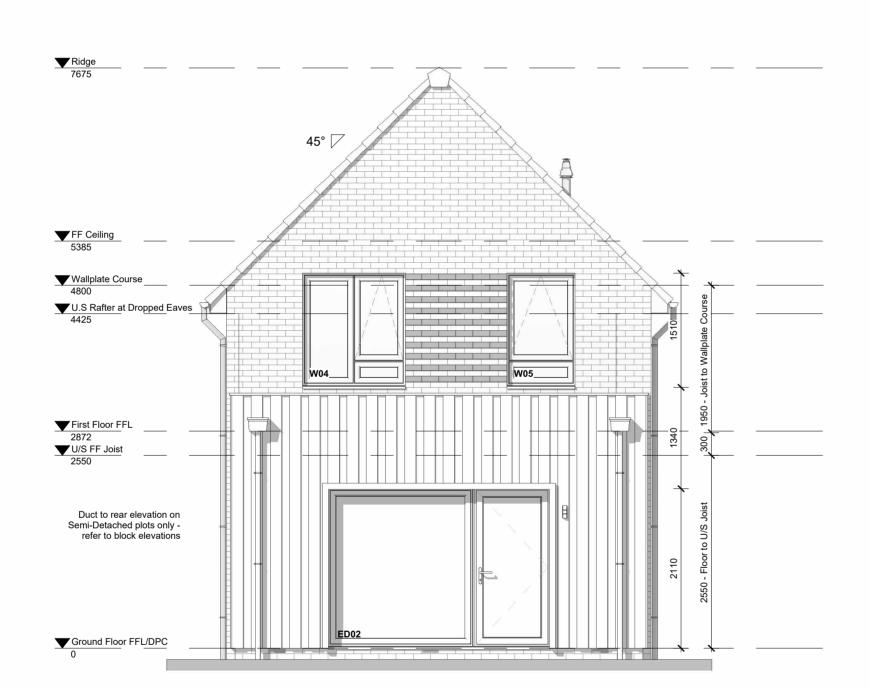

1242. Rear Elevation 1:50

Critical glazing locations in internal and external walls for windows, doors and side lights in accordance with BS 6206 and all current building regulations. Shaded area indicates critical locations to which the requirements of Approved Document K(4) applies, (i.e. glazing falling within zones 1, 2, 3, 4, 5, 6 & 8).


Unobstructed opening casement area to be at least 0.33M² and at least 450mm high and 450mm wide. Bottom of windows to be not more than 1100mm and not less than 800mm above the floor. Escape windows to have non lockable fasteners and hinged to achieve the minimum required opening.

All glazing in critical locations should:
a) If broken, will break safely.
b) Be sufficiently robust to resist breaking.


**EXTERNAL M&E HEIGHTS** 

tes:
Schedules to be read in conjunction with all project specification documents, floor plans and elevations
Structural opening size includes any sidelights
Frame set back is taken from front face of brick
Refer to manufactures information for detailed lintel schedules
All accessible windows and doors to be PAS24 tested to comply with Part Q of building regulations
All dimensions to be checked on site prior to manufacture


Escape from upper storey a maximum of 4.5m above ground level: ALL inner rooms where applicable and all first floor habitable rooms (excluding kitchens) to be provided with an escape window (or external door) which complies with Approved Document B1 Section 2 Paragraph 2.2. Dwellings with one storey more than 4.5m above ground level: A protected stairway should be provided with minimum 30 minute fire resisting construction at all storey's to comply with Approved Document B1 Section 2 Paragraphs 2.5.

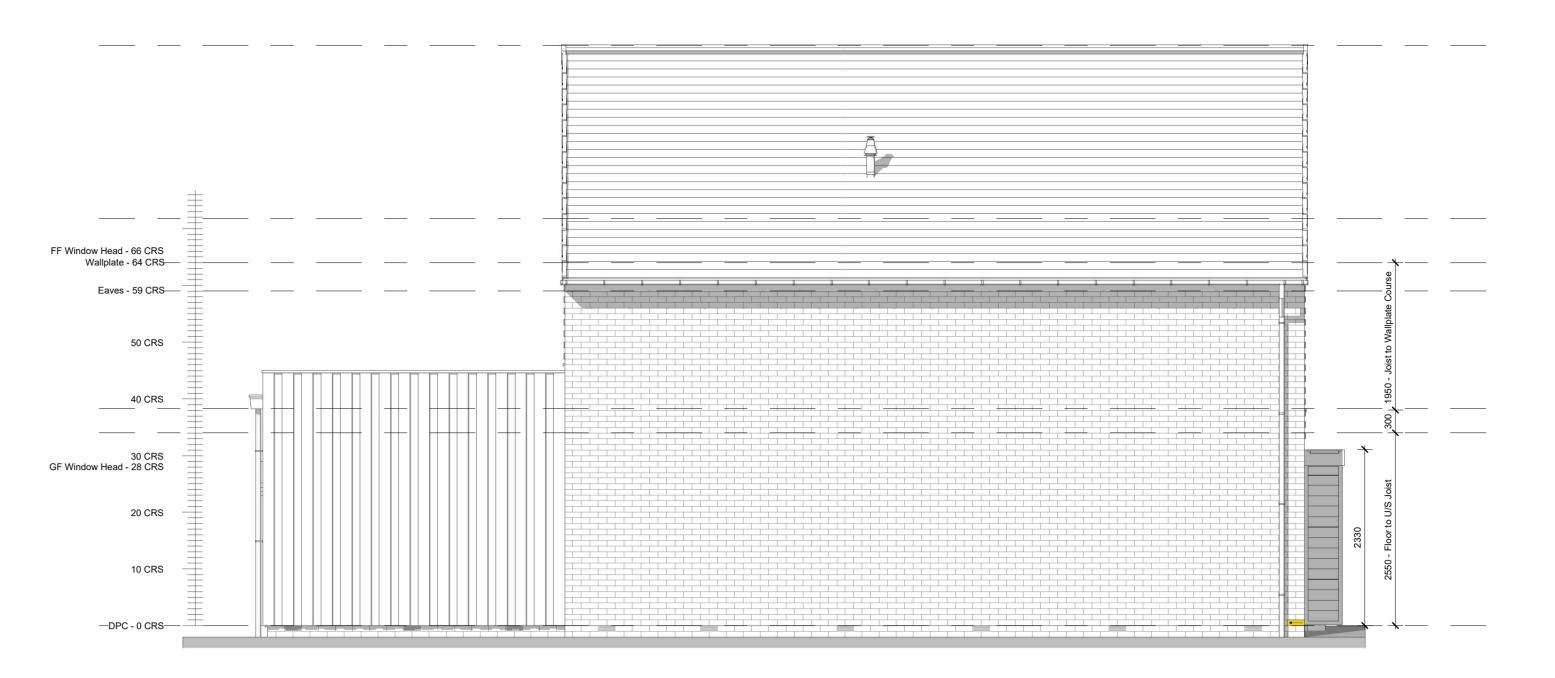

1241. LHS Elevation 1:50

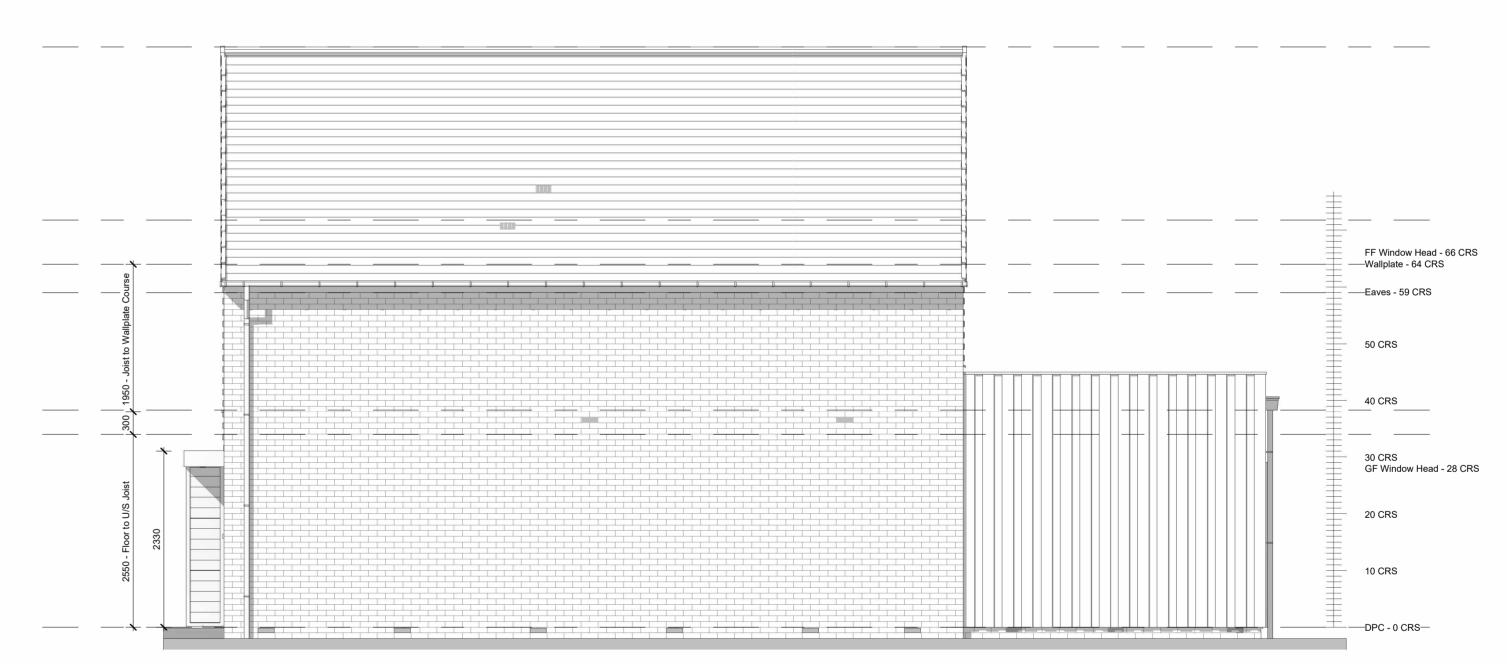

1243. RHS Elevation 1:50

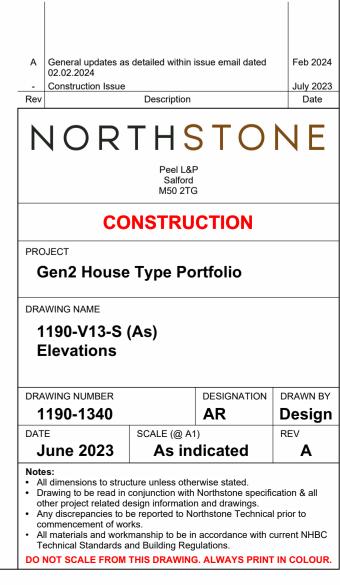

MEMBRANE KEY

Damp Proof Course (DPC)
Damp Proof Membrane (DPM)
Roof Underlay
Breather Membrane

