


### V7 Drawing Register

Sheet Number	Sheet Name	Rev	Revision Date
544/633-700	Cover Page & Design Risk Register	A	Feb 2024
544/633-710	Foundation & Sub-Floor Plans	A	Feb 2024
544/633-720	Floor Plans	A	Feb 2024
544/633-730	MEP Plans	A	Feb 2024
544/633-740	Elevations	A	Feb 2024
544/633-750	Sections	A	Feb 2024

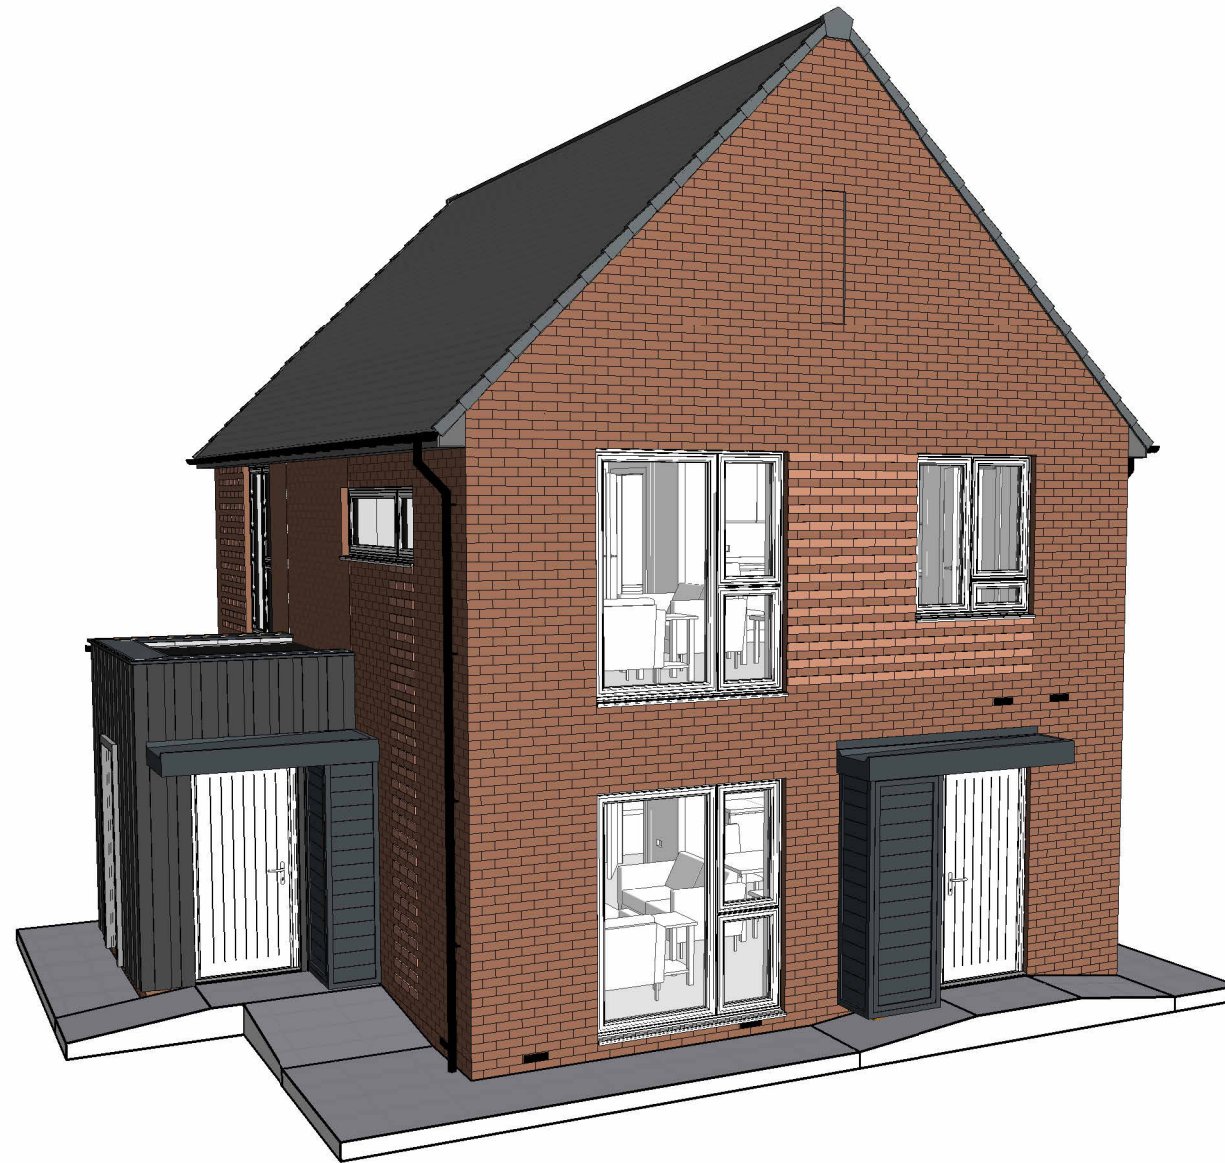

Rev	Description	Date
A	General updates as detailed within issue email dated 02.02.2024	Feb 2024
-	Construction Issue	July 2023

**NORTHSTONE**

Peel L&P  
Salford  
M50 2TG

**CONSTRUCTION**

PROJECT  
**Gen2 House Type Portfolio**

DRAWING NAME  
**544/633-V7-AR (As) - Affordable Rented  
Cover Page & Design Risk Register**

DRAWING NUMBER <b>544/633-700</b>	DESIGNATION <b>AR</b>	DRAWN BY <b>Design</b>
DATE <b>June 2023</b>	SCALE (@ A3)	REV <b>A</b>

- Notes:**
- All dimensions to structure unless otherwise stated.
  - Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.
  - Any discrepancies to be reported to Northstone Technical prior to commencement of works.
  - All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.

**DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.**

### Design Risk Register

Element	Comments
Lifting Operations	To avoid injury when handling heavy components, specialist handling equipment is to be utilised for the positioning of heavy objects/materials. Large glazing to be installed with specialist lifting equipment by trained personnel. Protection barriers to be provided to prevent mechanical damage following installation.
Craneage	Crane supplier to be satisfied of adequate support to outriggers, correct lifting positions to be established to avoid slippage of sheet materials during lifting and placement. Sub-contractors and suppliers to 'design in' lifting eyes and identify weights of heavy items at drawing approval stage. All RAMS to be obtained and approved prior to any lifting operations being carried out.
Ground Floor Construction	Mechanical Lifting equipment to be utilised to position pre-cast concrete floor planks. Manual handling assessment to be carried out.
Working at Height	Install temporary scaffolding barrier to exposed edges of upper floors including toe boards throughout the build period. Provide scaffolding to all areas requiring placement of materials and finishing to all areas above ground level. Scaffolding to be positioned to avoid the need to overreach causing strain injury when placing materials. Protect areas below high level working from falling debris. Ensure space required for crane is achievable and suitable hard standing is provided. Ensure maximum fall height when fixing trusses into position is 2 metres by utilising appropriate safety measures and equipment.
Stairs	To prevent falls provide temporary guarding and edge protection to open well areas and keep clear during construction, eliminating the possibility of trip hazards. Stairs to be erected as early as possible during the construction process to provide vertical circulation and means of escape in case of fire.
Masonry Construction	When working at height mechanical lifting measures required to lift brick and block packs into position to reduce manual handling.
Lintels	Manual Handling Assessments to be carried out for all lintels, light craneage to be utilised for lintels considered too heavy for manual handling.
Structural Steelwork	Mechanical lifting measures required to reduce manual handling. Ensure required space for crane is achievable and suitable hard standing is provided.
Windows / Structural Openings	Any structural apertures below 800mm to be fitted with temporary guarding to prevent falls. Any structural apertures below 800mm and extending to floor level to be fitted with temporary guarding and edge protection to prevent falls. Mechanical lifting measures and frame and glazing fitted separately to be considered for installation of large windows and combination door & window frames. Window manufacturer to be consulted regarding best means of installation.
Window Cleaning & Maintenance	'Easy Clean' hinges are not an option due to the top hung design to a majority of the windows, as such windows should be cleaned from ground level using a telescopic 'reach & wash' system. All windows used to be Aluminium or UPVC frames to eliminate the need for future decoration.
Roof Construction	Ensure space required for crane is achievable and suitable hard standing is provided. Ensure maximum fall height when fixing trusses into position is 2 metres by utilising appropriate safety measures and equipment.

# 544/633-V7-AR (As) - Affordable Rented

### FOUNDATION & SUB-FLOOR LEGEND

**Brick Face External Wall**

OUTSIDE - 102.5mm clay facing brickwork as site specific materials plan  
 - 125mm clear cavity  
 - 100mm block as specification

INSIDE - 100mm concrete block as engineers details

**100mm Sleeper Wall**

- 100mm concrete block as engineers details

**215mm Sleeper Wall**

- 100mm concrete block as engineers details  
 - 15mm cavity fully filled with mortar  
 - 100mm concrete block as engineers details

**Trench Block**

- 350mm concrete trench block as engineers details

**Services & Ventilation**

SVP 110mm Soil and Vent Pipe  
 RWP Rainwater pipe as specification  
 GULLY Sealed floor gully for level access shower  
 Water Water Entry Point  
 Data Lead In Data Entry Point  
 E Electric Entry Point  
 G Gas Entry Point  
 Sub-Floor Telescopic Vent


**Floor Finish & Span**

Extent of Floor Screenshot  
 Span of Ground Floor Construction


**NOTES**

1. Refer to engineers details and specification for all block strengths.
2. Key to be read in conjunction with construction specification.
3. Expansion and movement joints, bed reinforcement and wind posts to engineers details.
4. Always refer to site investigation report and engineers details for any gas membrane requirements.


Sub-Floor Void Ventilation Schedule				
Building Area (m <sup>2</sup> )	Building Perimeter (m)	Ventilation Required	Minimum Number of Vents Required	Number of Vents Provided
70.59 m <sup>2</sup>	36.69	55029 mm <sup>2</sup>	12	18
* Based on 500mm <sup>2</sup> /m <sup>2</sup> of Floor Area				

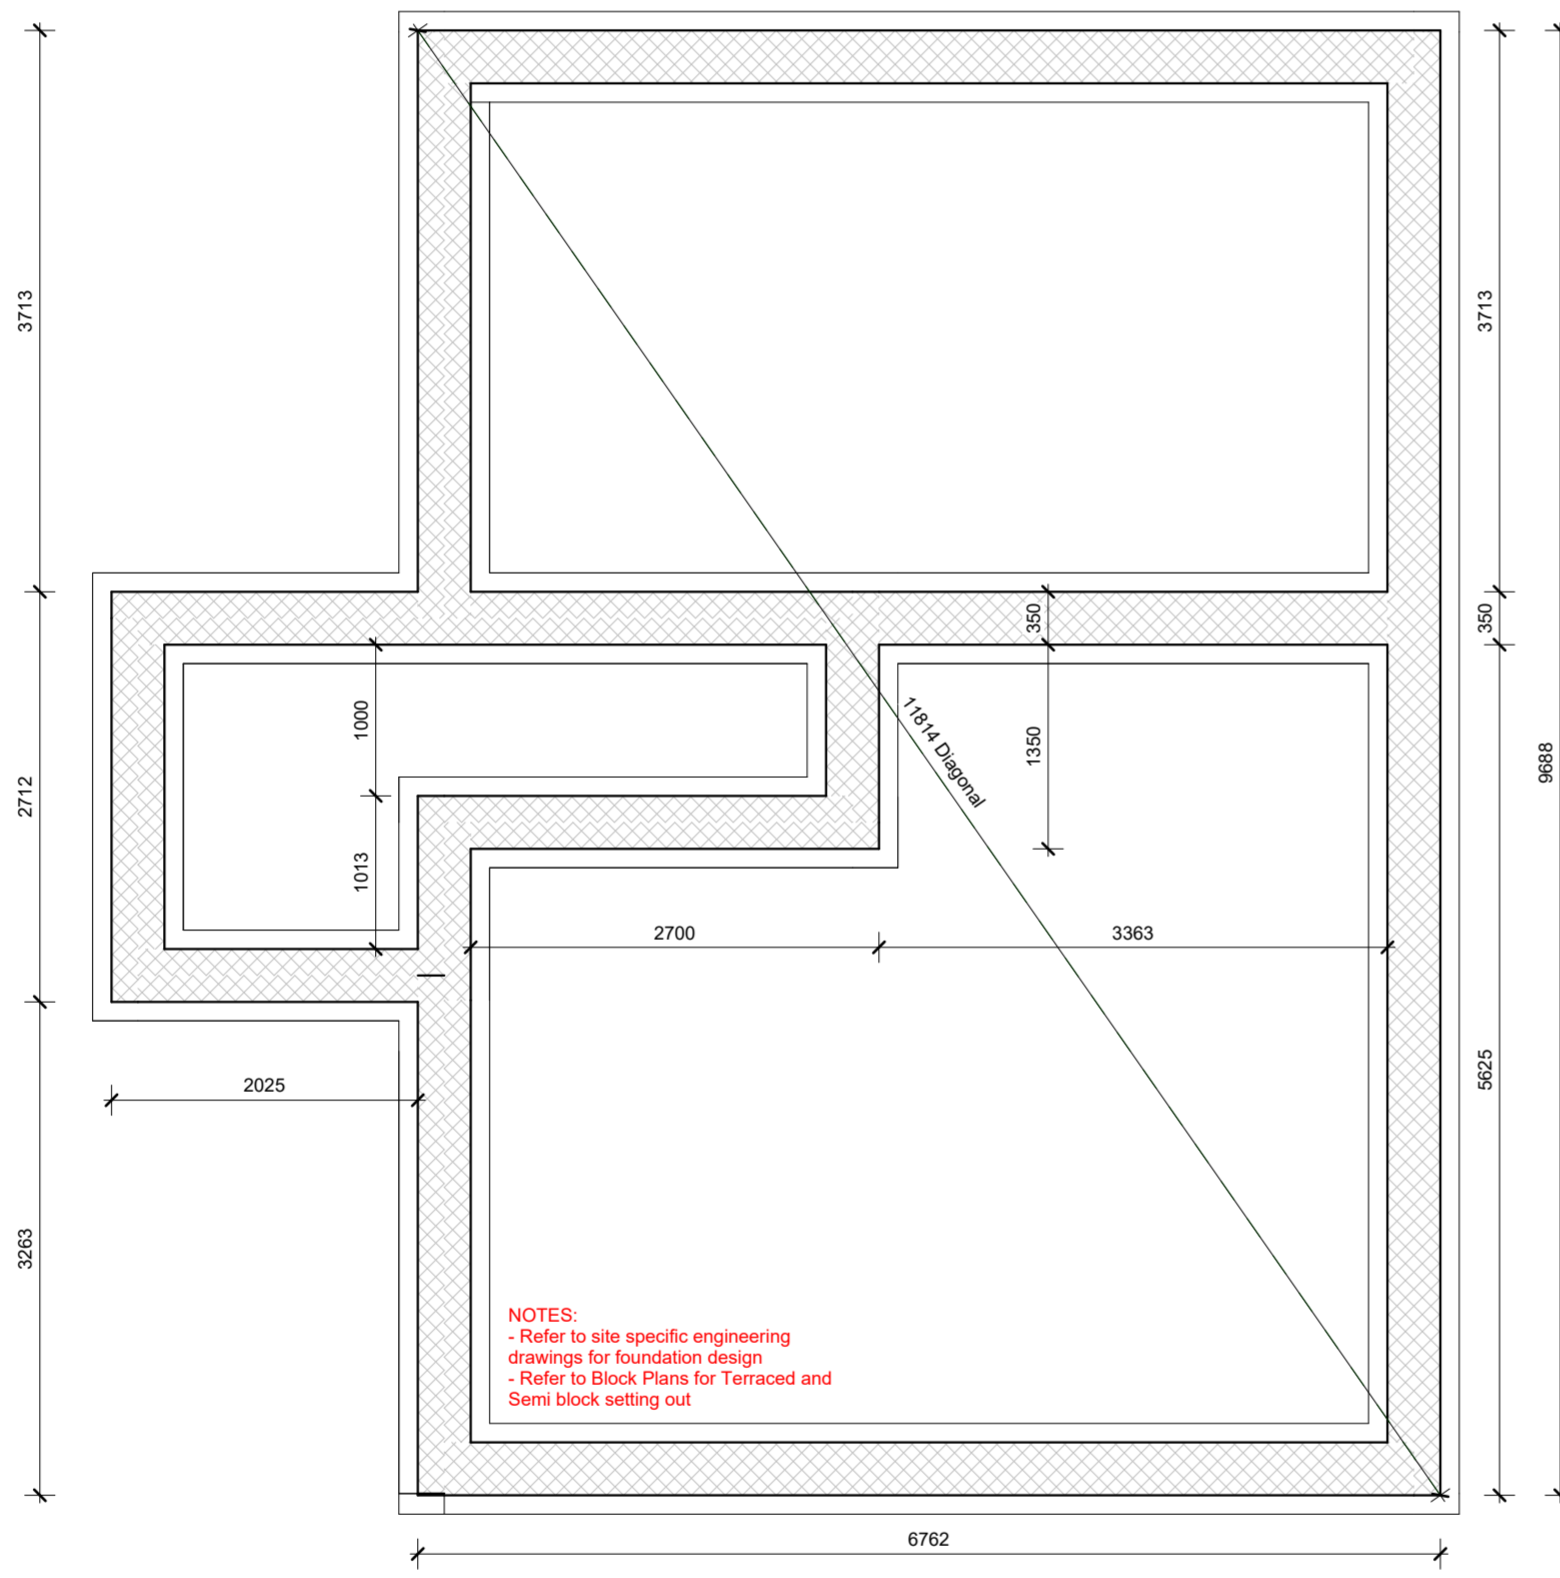

**710. Foundation Plan**  
1 : 50

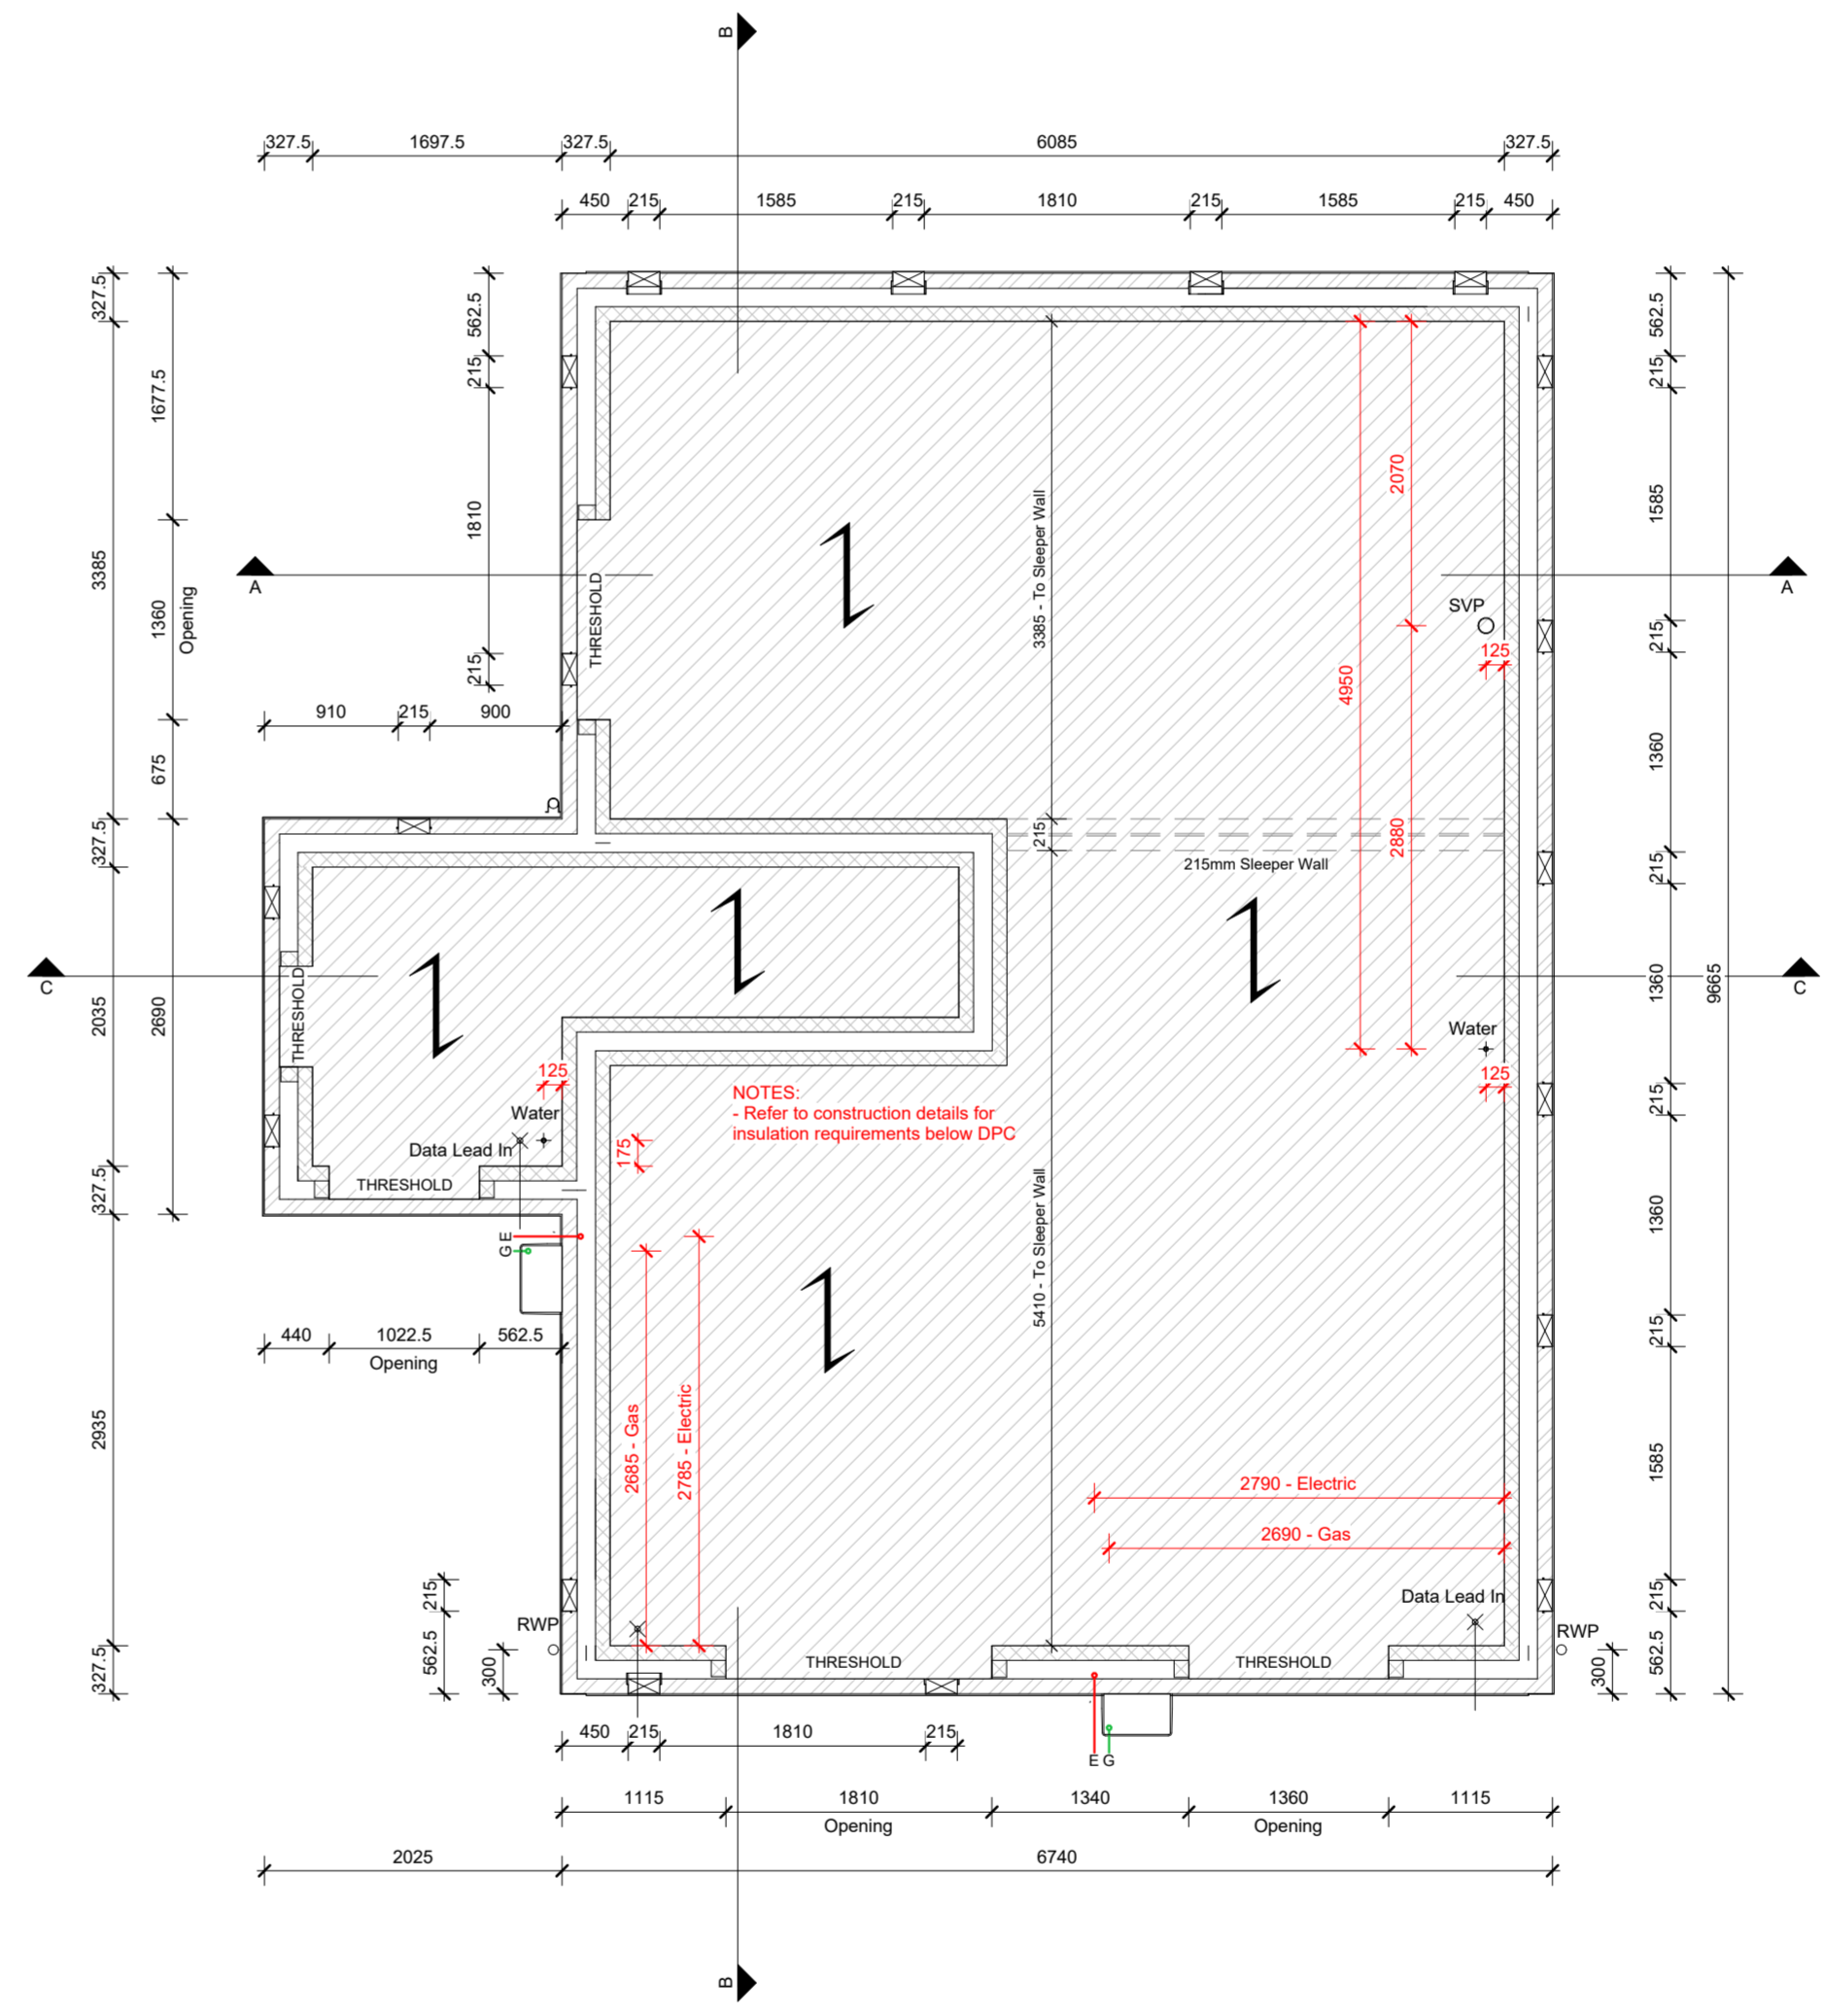

**711. Sub-Floor Setting Out**  
1 : 50

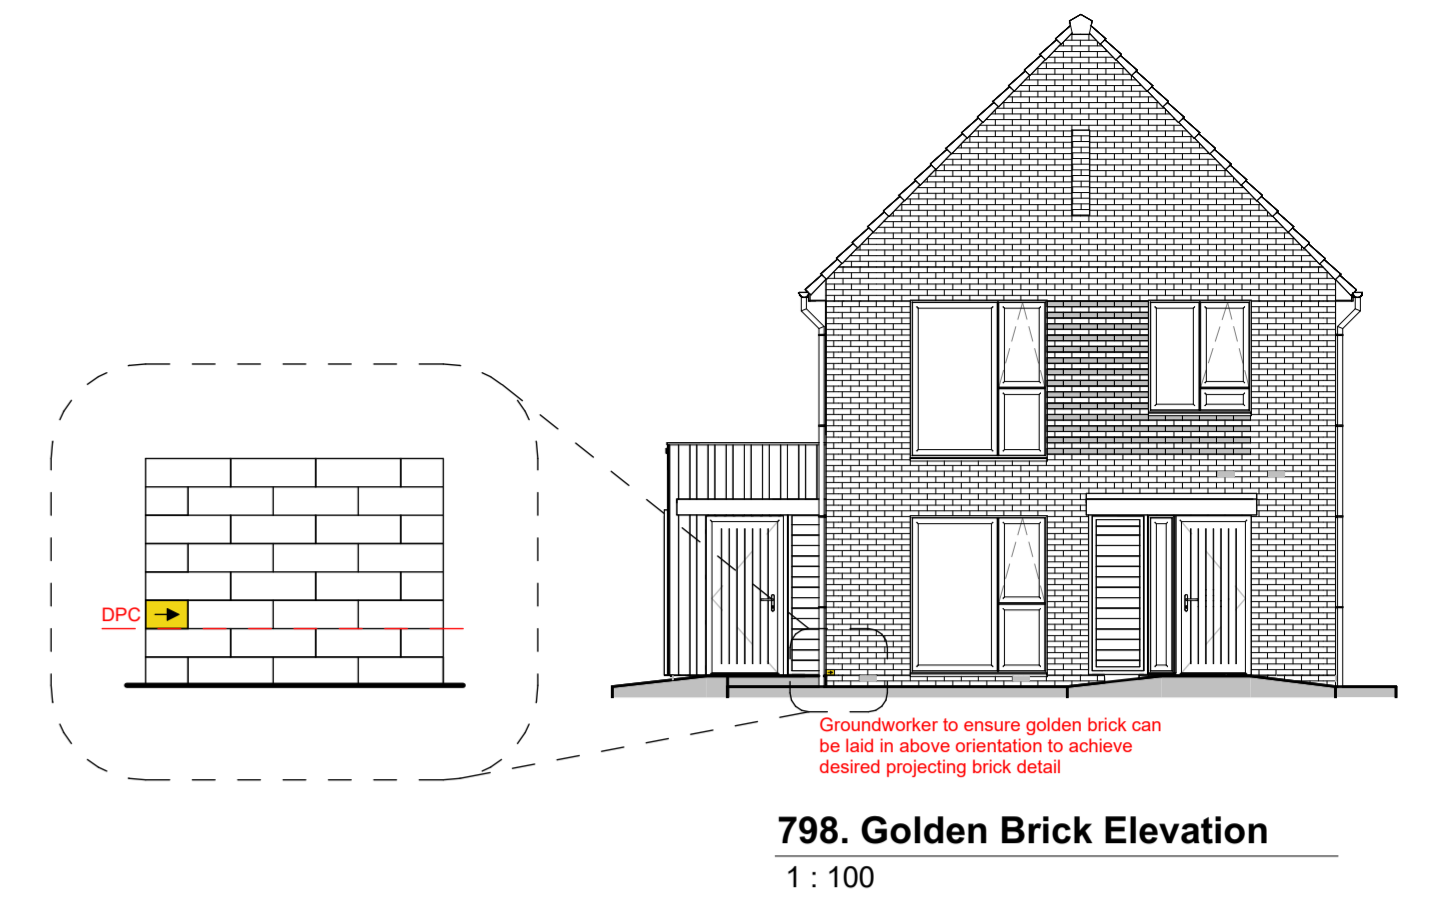


A	General updates as detailed within issue email dated 02.02.2024	Feb 2024
-	Construction Issue	July 2023

Rev	Description	Date
<b>NORTHSTONE</b>		
Peel L&P Salford M50 2TG		
<b>CONSTRUCTION</b>		
PROJECT <b>Gen2 House Type Portfolio</b>		
DRAWING NAME <b>544/633-V7-AR (As) - Affordable Rented Foundation &amp; Sub-Floor Plans</b>		
DRAWING NUMBER <b>544/633-710</b>	DESIGNATION <b>AR</b>	DRAWN BY <b>Design</b>
DATE <b>June 2023</b>	SCALE (@ A1) <b>As indicated</b>	REV <b>A</b>


**Notes:**

- All dimensions to structure unless otherwise stated.
- Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.
- Any discrepancies to be reported to Northstone Technical prior to commencement of works.
- All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.

**DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.**

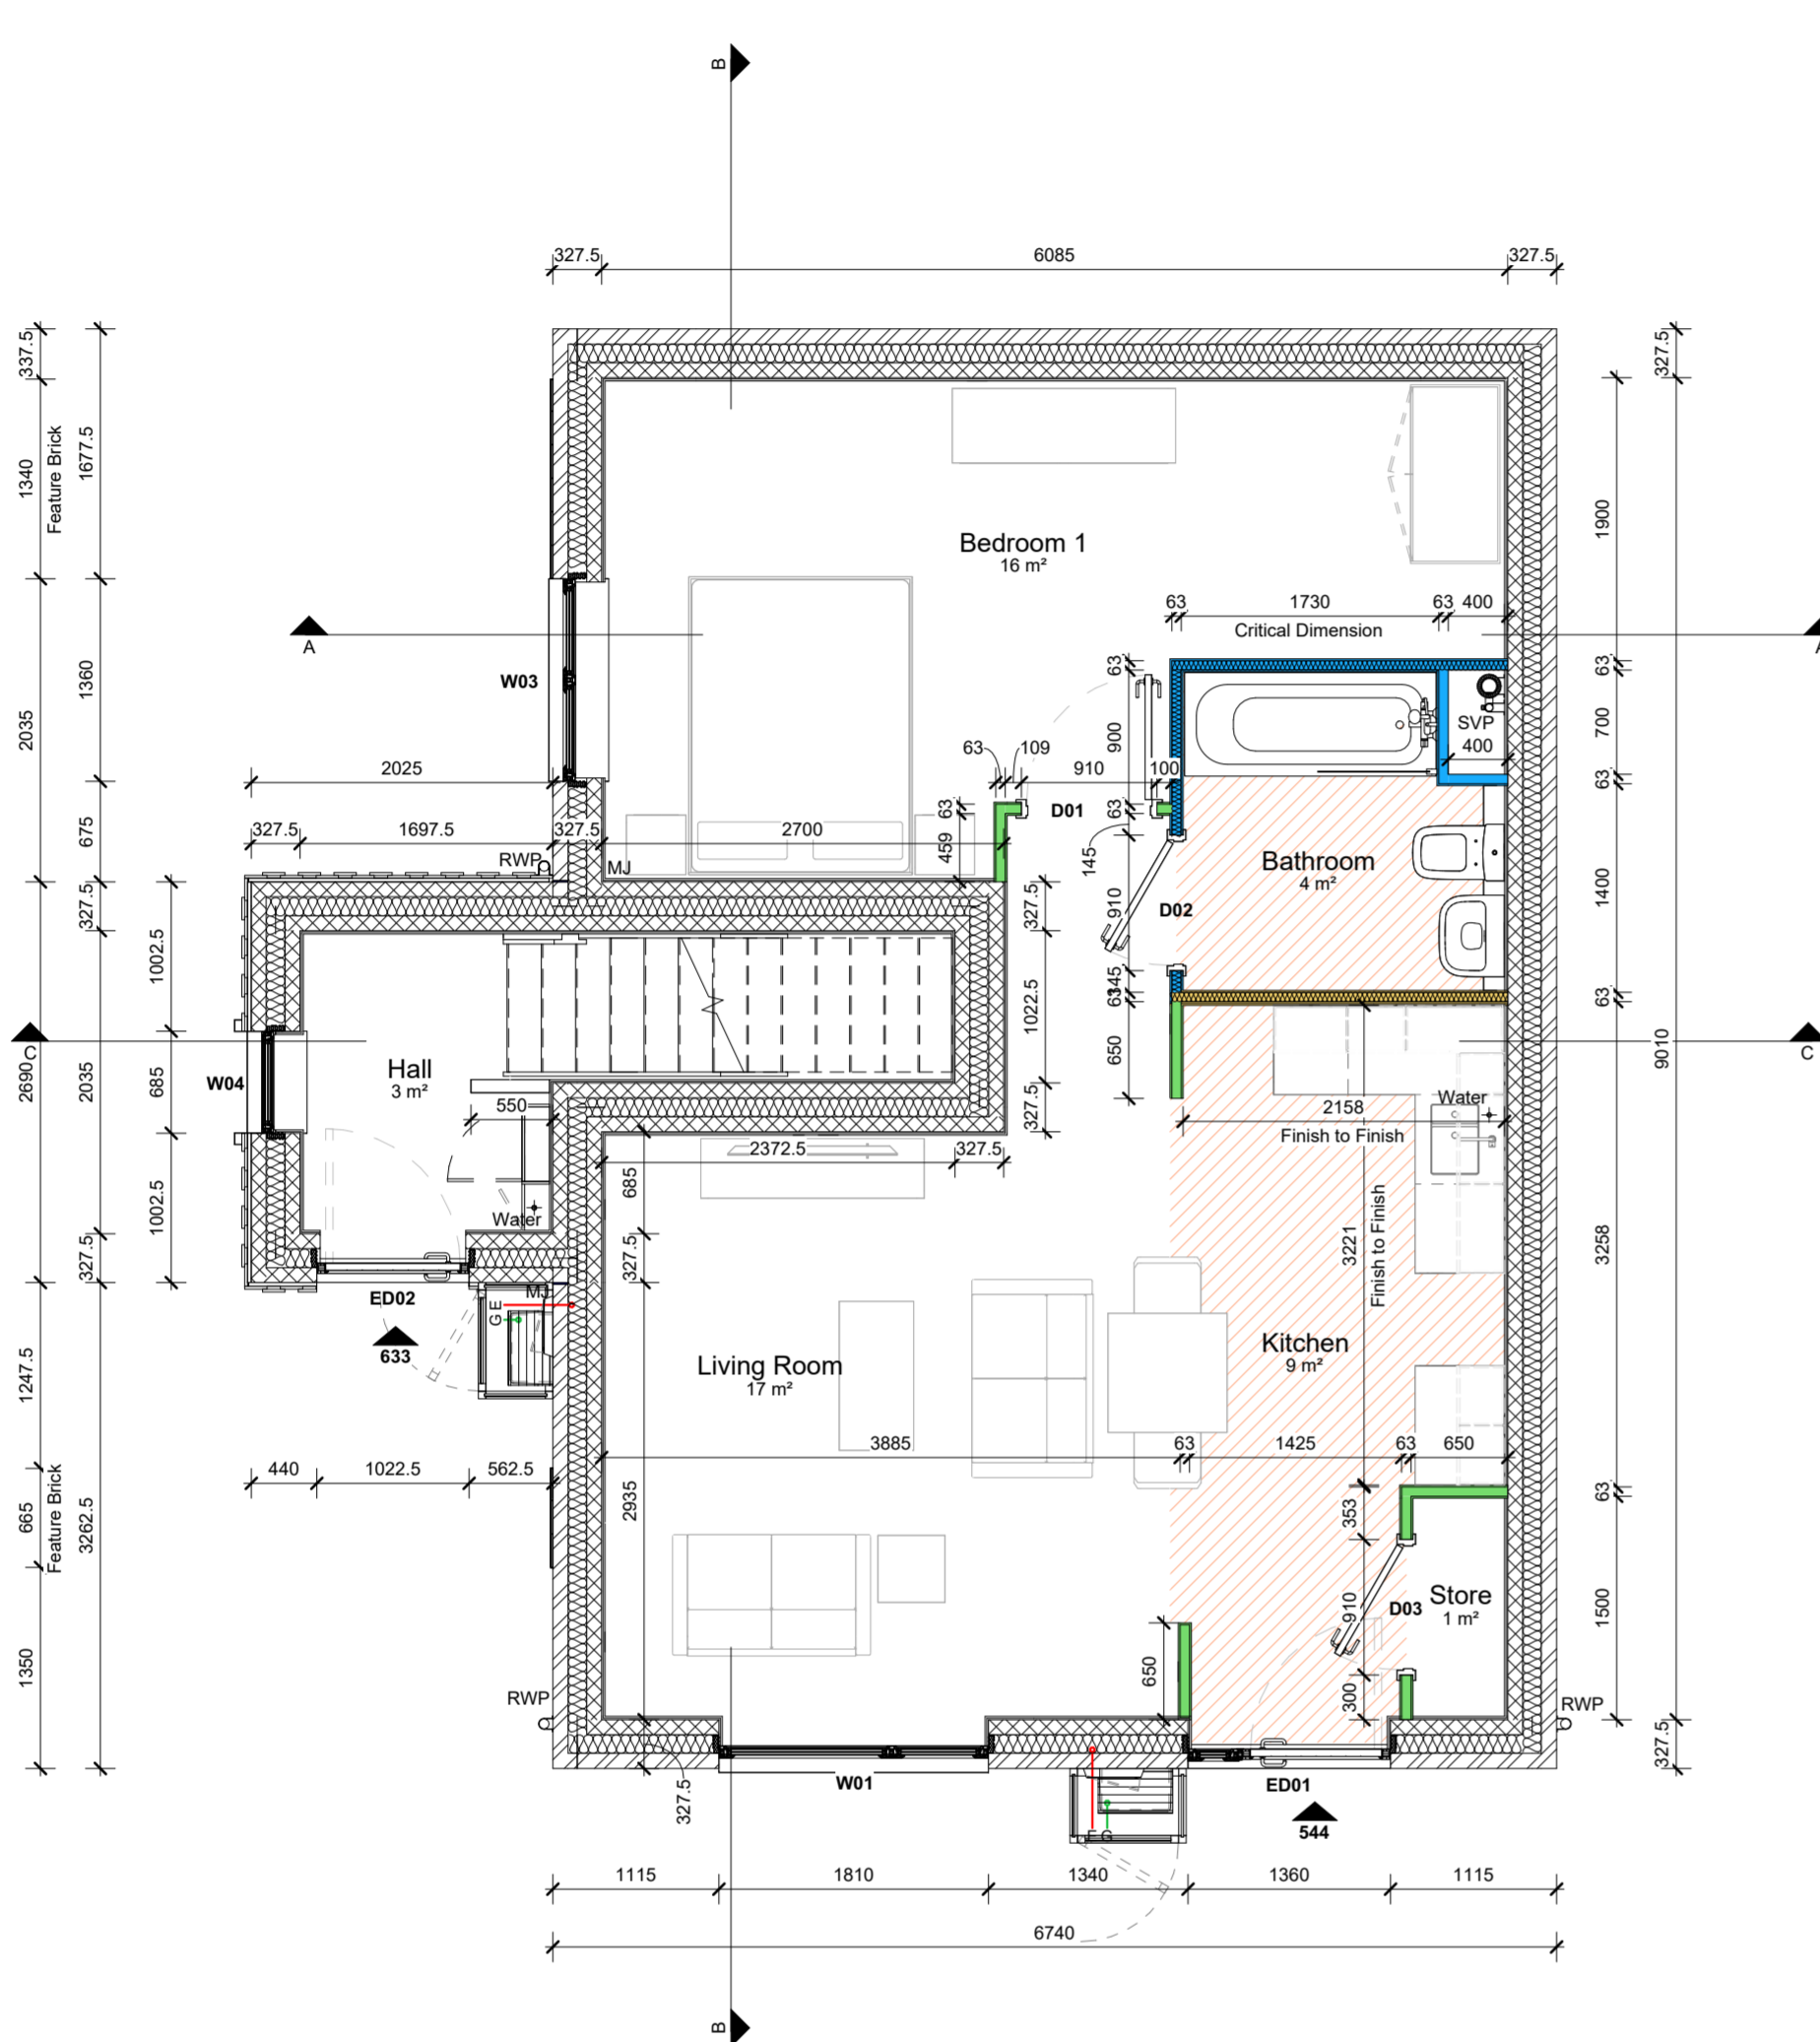

**720. Ground Floor Setting Out**  
1 : 50

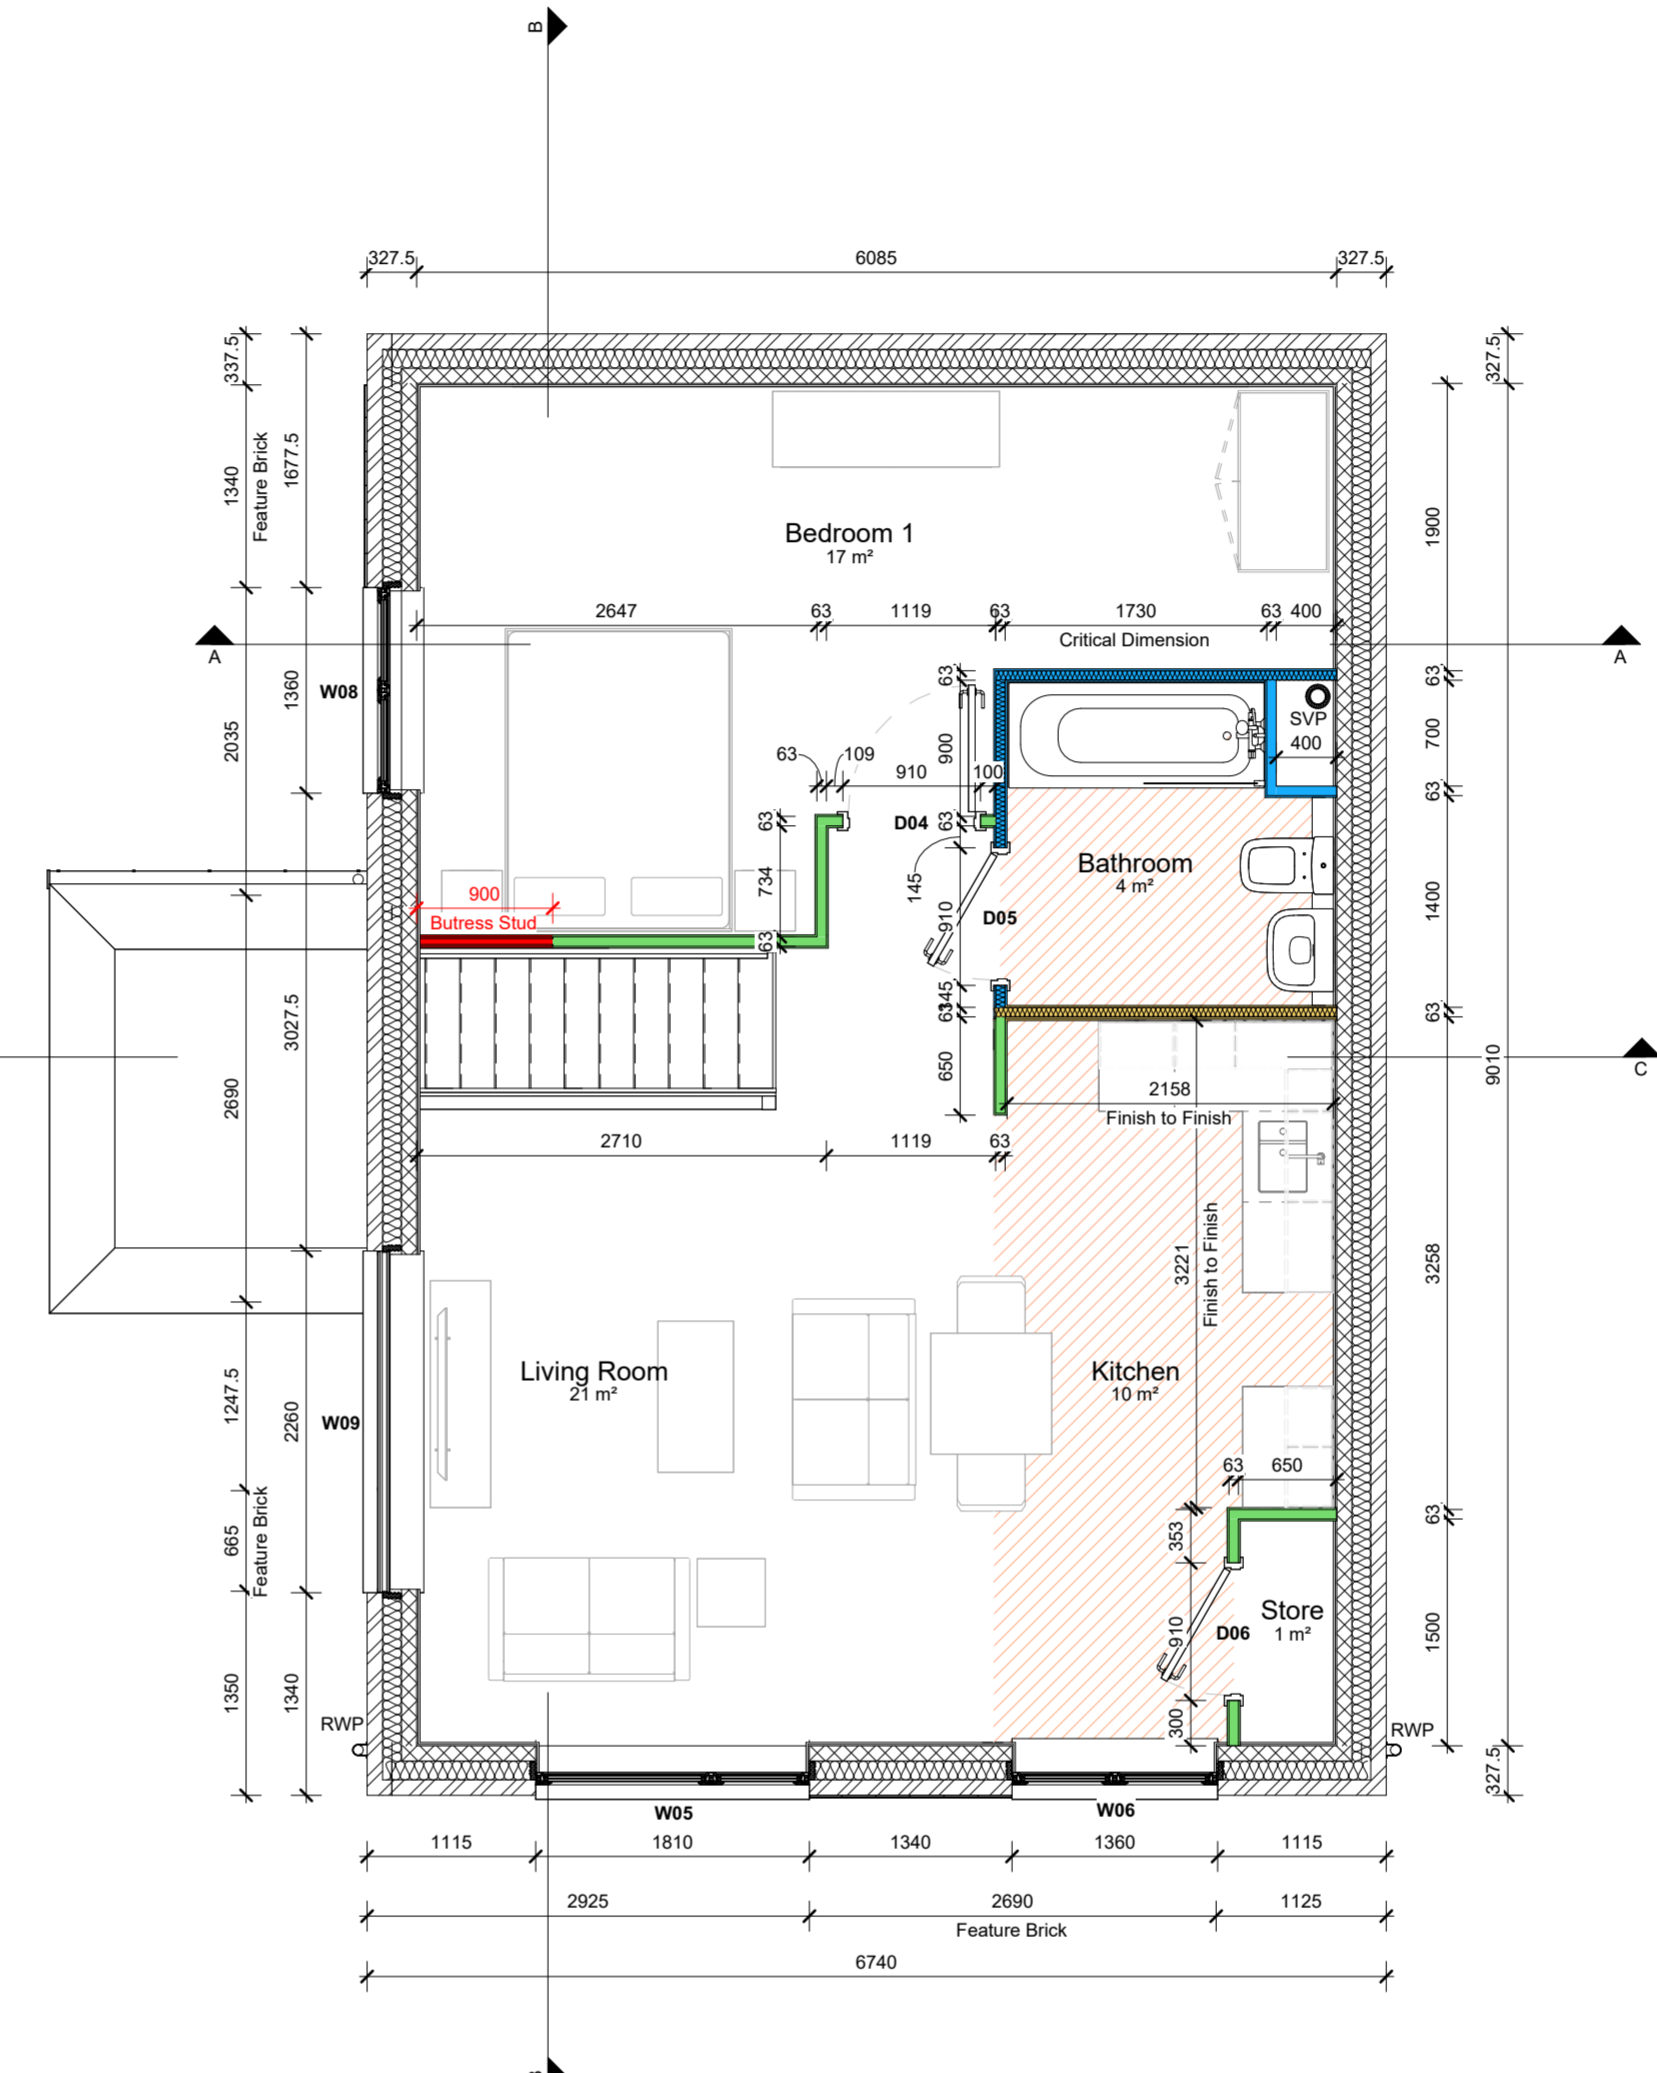

**730. First Floor Setting Out**  
1 : 50

**WALL TYPE LEGEND**

**Brick Face External Wall**

- OUTSIDE - 102.5mm clay facing brickwork to site specific materials plan
- 125mm cavity fully filled with insulation as specification
- INSIDE - 100mm block as specification
- 12.5mm plasterboard on 10mm adhesive dabs, all joints taped and filled before wet plaster skim finish

**Timber Cladding External Wall**

- OUTSIDE - 19x150mm Timber Board on Board Cladding
- 100mm block outer leaf as specification
- 125mm cavity fully filled with insulation as specification
- INSIDE - 100mm block as specification
- 12.5mm plasterboard on 10mm adhesive dabs, all joints taped and filled before wet plaster skim finish

**NON LOADBEARING STUD PARTITIONS**

**General Partition**

- 63x38mm C16 studwork at max 600mm centres with suitable noggins
- Pattress between stud with 12mm Ply where required for MEP fixtures and fittings
- 1no. layer of 12.5mm plasterboard mechanically fixed to stud both sides of wall with all joints taped and filled before wet plaster skim finish

**Pattressed Partition Wall**

- 63x38mm C16 studwork at max 600mm centres with suitable noggins
- 12mm ply mechanically fixed to stud on load-bearing side of wall, (Kitchens etc.)
- 1no. layer of 12.5mm plasterboard mechanically fixed to stud both sides of wall with all joints taped and filled before wet plaster skim finish

**Acoustic & Fire Rated Partition**

- 63x38mm C16 studwork at max 600mm centres with suitable noggins
- Voids between studwork fully filled with 60mm Rockwool Flex or similar approved mineral wool
- Pattress between stud with 12mm Ply where required for MEP fixtures and fittings
- 1no. layer of 12.5mm plasterboard mechanically fixed to stud both sides of wall with all joints taped and filled before wet plaster skim finish
- Achieves R<sub>w</sub>40dB in accordance with AD-E
- Achieves REI 30 fire resistance in accordance with British Gypsum White Book

**Wet-Room Partition (WC / Bathroom / En-suite)**

- 63x38mm C16 studwork at max 400mm centres with suitable noggins
- Pattress between stud with 12mm Ply where required for MEP fixtures and fittings
- 12.5mm moisture resistant plasterboard mechanically fixed to stud on wet-room side of wall with all joints taped and filled before wet plaster skim finish
- 12.5mm standard plasterboard mechanically fixed to stud on dry-room side of wall where required with all joints taped and filled before wet plaster skim finish

**Framing Wall**

- 63x38mm C16 studwork wide face out at max 400mm centres with suitable noggins
- 1no. layer of 12.5mm plasterboard mechanically fixed to stud on room side of wall with all joints taped and filled before wet plaster skim finish

**Anchored/Butress Stud Partition**

- Refer to structural engineers details and Northstone construction details. Butress Studs and Windposts not required on party walls.

**Insulation Between Studs**

- Voids between studwork fully filled with 60mm Rockwool Flex or similar approved mineral wool where indicated on drawing for AD-E compliance
- Achieves R<sub>w</sub>40dB in accordance with AD-E
- Achieves REI 30 fire resistance in accordance with British Gypsum White Book

**NOTES**

1. Refer to engineers details and specification for all block strengths.
2. Key to be read in conjunction with construction specification.
3. Expansion and movement joints, bed reinforcement and wind posts to engineers details.
4. All dimensions are to structure unless otherwise noted.

**FLOORING LEGEND**

**LVT Flooring**

- Vinyl flooring applied as Northstone finishes specification and relevant customer options

**Carpet**

- Carpet per Northstone finishes specification

**External Door Schedule**



Floor	Door Ref	Width	Height	Door Width	Reveal Depth	U-Value (Door / Sidelight)	Toughened Glass	Glazing Specification	MF Width	Sidelight MF Width	MF Height	Area of Glazing	Notes
Ground Floor FFL/DPC	ED01	1360	2110	1000	50	0.45W/m²K / 0.55W/m²K	Yes	Triple Glazed	984	344	2061	0.451 m²	
Ground Floor FFL/DPC	ED02	1022.5	2110	1022.5	60	0.45W/m²K / 1.15W/m²K	Yes	None	1006.5	344	2061	0.000 m²	

**V7 Window Schedule**

Floor	Window Ref	Width	Height	Toughened Glass	U-Value	Reveal Depth	Obscure Glazing	Escape Window	Trickle Vents	Glazing Specification	Area of Glazing	Notes
Ground Floor FFL/DPC	W01	1810	2110	Yes	0.55W/m²K	70	No	No	Yes	Triple Glazed	2.990 m²	
Ground Floor FFL/DPC	W03	1360	2110	Yes	0.55W/m²K	70	No	Yes	Yes	Triple Glazed	2.096 m²	
Ground Floor FFL/DPC	W04	685	2110	Yes	0.55W/m²K	70	No	No	Yes	Triple Glazed	1.021 m²	
First Floor FFL	W05	1810	2110	Yes	0.55W/m²K	70	No	Yes	Yes	Triple Glazed	2.990 m²	
First Floor FFL	W06	1360	1510	Yes	0.55W/m²K	70	No	Yes	Yes	Triple Glazed	1.438 m²	
First Floor FFL	W08	1360	2110	Yes	0.55W/m²K	70	No	Yes	Yes	Triple Glazed	2.096 m²	
First Floor FFL	W09	2260	685	Yes	0.55W/m²K	70	No	No	Yes	Triple Glazed	1.104 m²	

**Internal Door Schedule**

Floor	Door Ref	From Room	To Room	Structural Width	Structural Height	Leaf Width	Casing Depth	Fire Rating	Self Closer	Notes
Ground Floor FFL/DPC	D01	Bedroom 1	Living Room	910	2017	838	96	Not Fire Rated	No	
Ground Floor FFL/DPC	D02	Living Room	Bathroom	910	2017	838	96	Not Fire Rated	No	
Ground Floor FFL/DPC	D03	Kitchen	Store	910	2017	838	96	Not Fire Rated	No	
First Floor FFL	D04	Bedroom 1	Living Room	910	2017	838	96	Not Fire Rated	No	
First Floor FFL	D05	Living Room	Bathroom	910	2017	838	96	Not Fire Rated	No	
First Floor FFL	D06	Kitchen	Store	910	2017	838	96	Not Fire Rated	No	

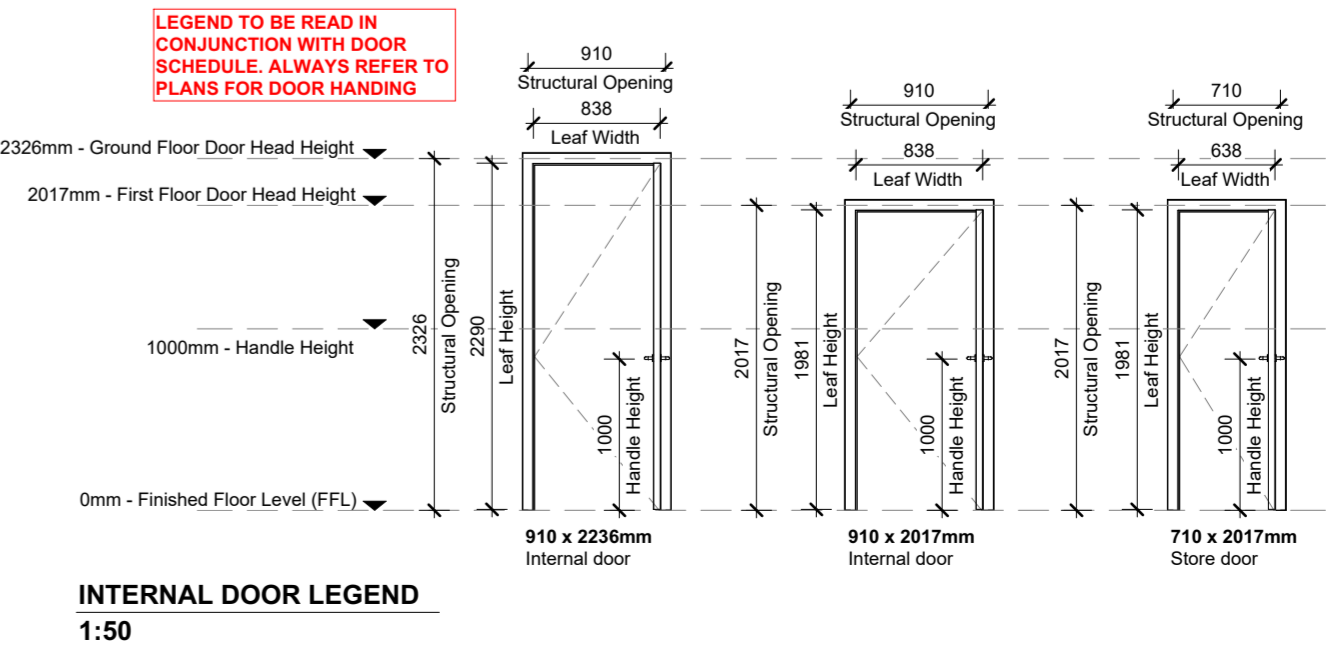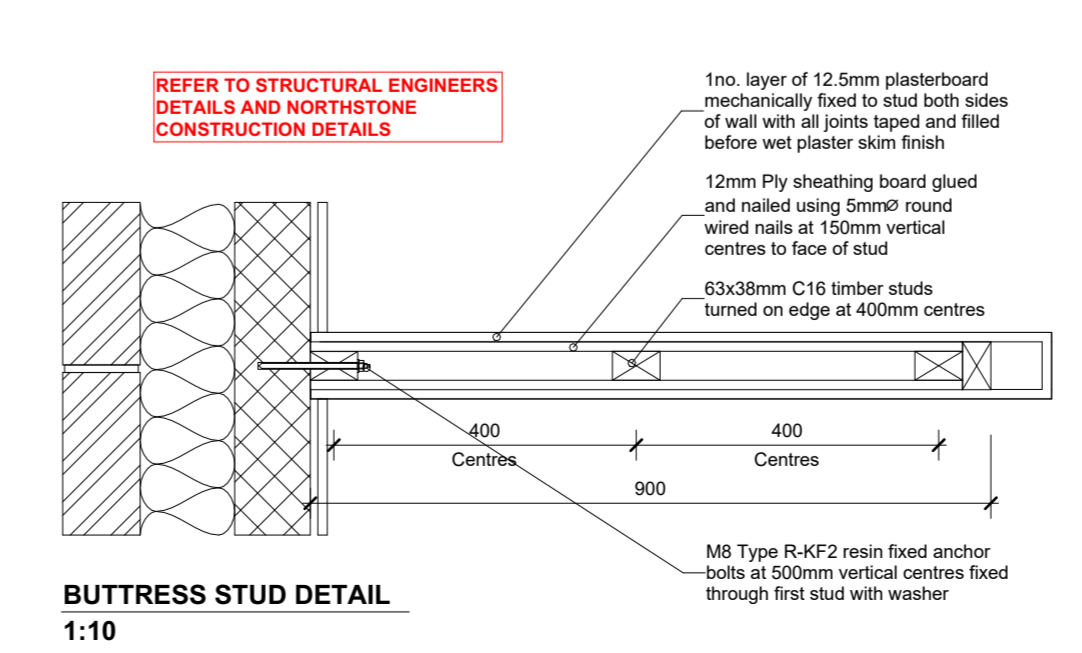

General updates as detailed within issue email dated 02.02.2024  
Construction Issue

Rev	Description	Date
1	Construction Issue	July 2023

**NORTHSTONE**  
Peel L&P  
Salford  
M50 2TG

**CONSTRUCTION**

PROJECT  
**Gen2 House Type Portfolio**

DRAWING NAME  
**544/633-V7-AR (As) - Affordable Rented Floor Plans**

DRAWING NUMBER	DESIGNATION	DRAWN BY
<b>544/633-720</b>	<b>AR</b>	<b>Design</b>

DATE	SCALE (@ A1)	REV
<b>June 2023</b>	<b>As indicated</b>	<b>A</b>


**Notes:**

- All dimensions to structure unless otherwise stated.
- Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.
- Any discrepancies to be reported to Northstone Technical prior to commencement of works.
- All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.


**DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.**

Electrical Fixture Schedule	
Electrical Item	Quantity
Door Bell Push	3
Recessed spot light	2
544 - Ground Floor	
Kitchen	
13A Unswitched Fused Spur	3
Bulkhead Light	1
Ceiling mounted fan CV2-GIP	1
Cooker Control Box	1
Door Bell Sounder	1
Double gang light switch - single way	1
Double gang light switch - two way	1
Double Socket	3
Heat Detector	1
Kitchen gang plate with appliance names	1
Pendant light	1
Living Room	
13A Switched Fused Spur	1
Double Socket	2
Pendant light	2
Single gang light switch - single way	1
Smoke Detector	1
Triple gang light switch - two way	1
Wondwall thermostat	1
Bathroom	
Bulkhead Light	1
Ceiling mounted fan CV2-GIP	1
Bedroom 1	
13A Switched Fused Spur	1
Ceiling mounted fan CV2-GIP	1
Double gang light switch - two way	1
Double Socket	4
Pendant light	2
Triple gang light switch - two way	1
Store	
Carbon Monoxide Detector	1
Consumer Unit M&E - Refer to Detail	1
633 - First Floor	
Hall	
Consumer Unit M&E - Refer to Detail	1
Double gang light switch - two way	1
Pendant light	1
Kitchen	
13A Unswitched Fused Spur	3
Bulkhead Light	1
Ceiling mounted fan CV2-GIP	1
Cooker Control Box	1
Double Socket	3
Heat Detector	1
Kitchen gang plate with appliance names	1
Living Room	
13A Switched Fused Spur	2
Door Bell Sounder	1
Double gang light switch - single way	1
Double Socket	5
Pendant light	3
Single gang light switch - single way	1
Smoke Detector	1
Triple gang light switch - two way	1
Wondwall thermostat	1
Bedroom 1	
Double gang light switch - two way	2
Double Socket	4
Pendant light	2
Bathroom	
Bulkhead Light	1
Ceiling mounted fan CV2-GIP	1
Store	
Carbon Monoxide Detector	1


Ventilation Fixture Schedule	
Ventilation Item	Quantity
Single air brick for CV2-GIP fan	4
Flat Edge Tie Vent for Concrete Tiles	2
Boiler Flue Terminal and Flashing Kit	1

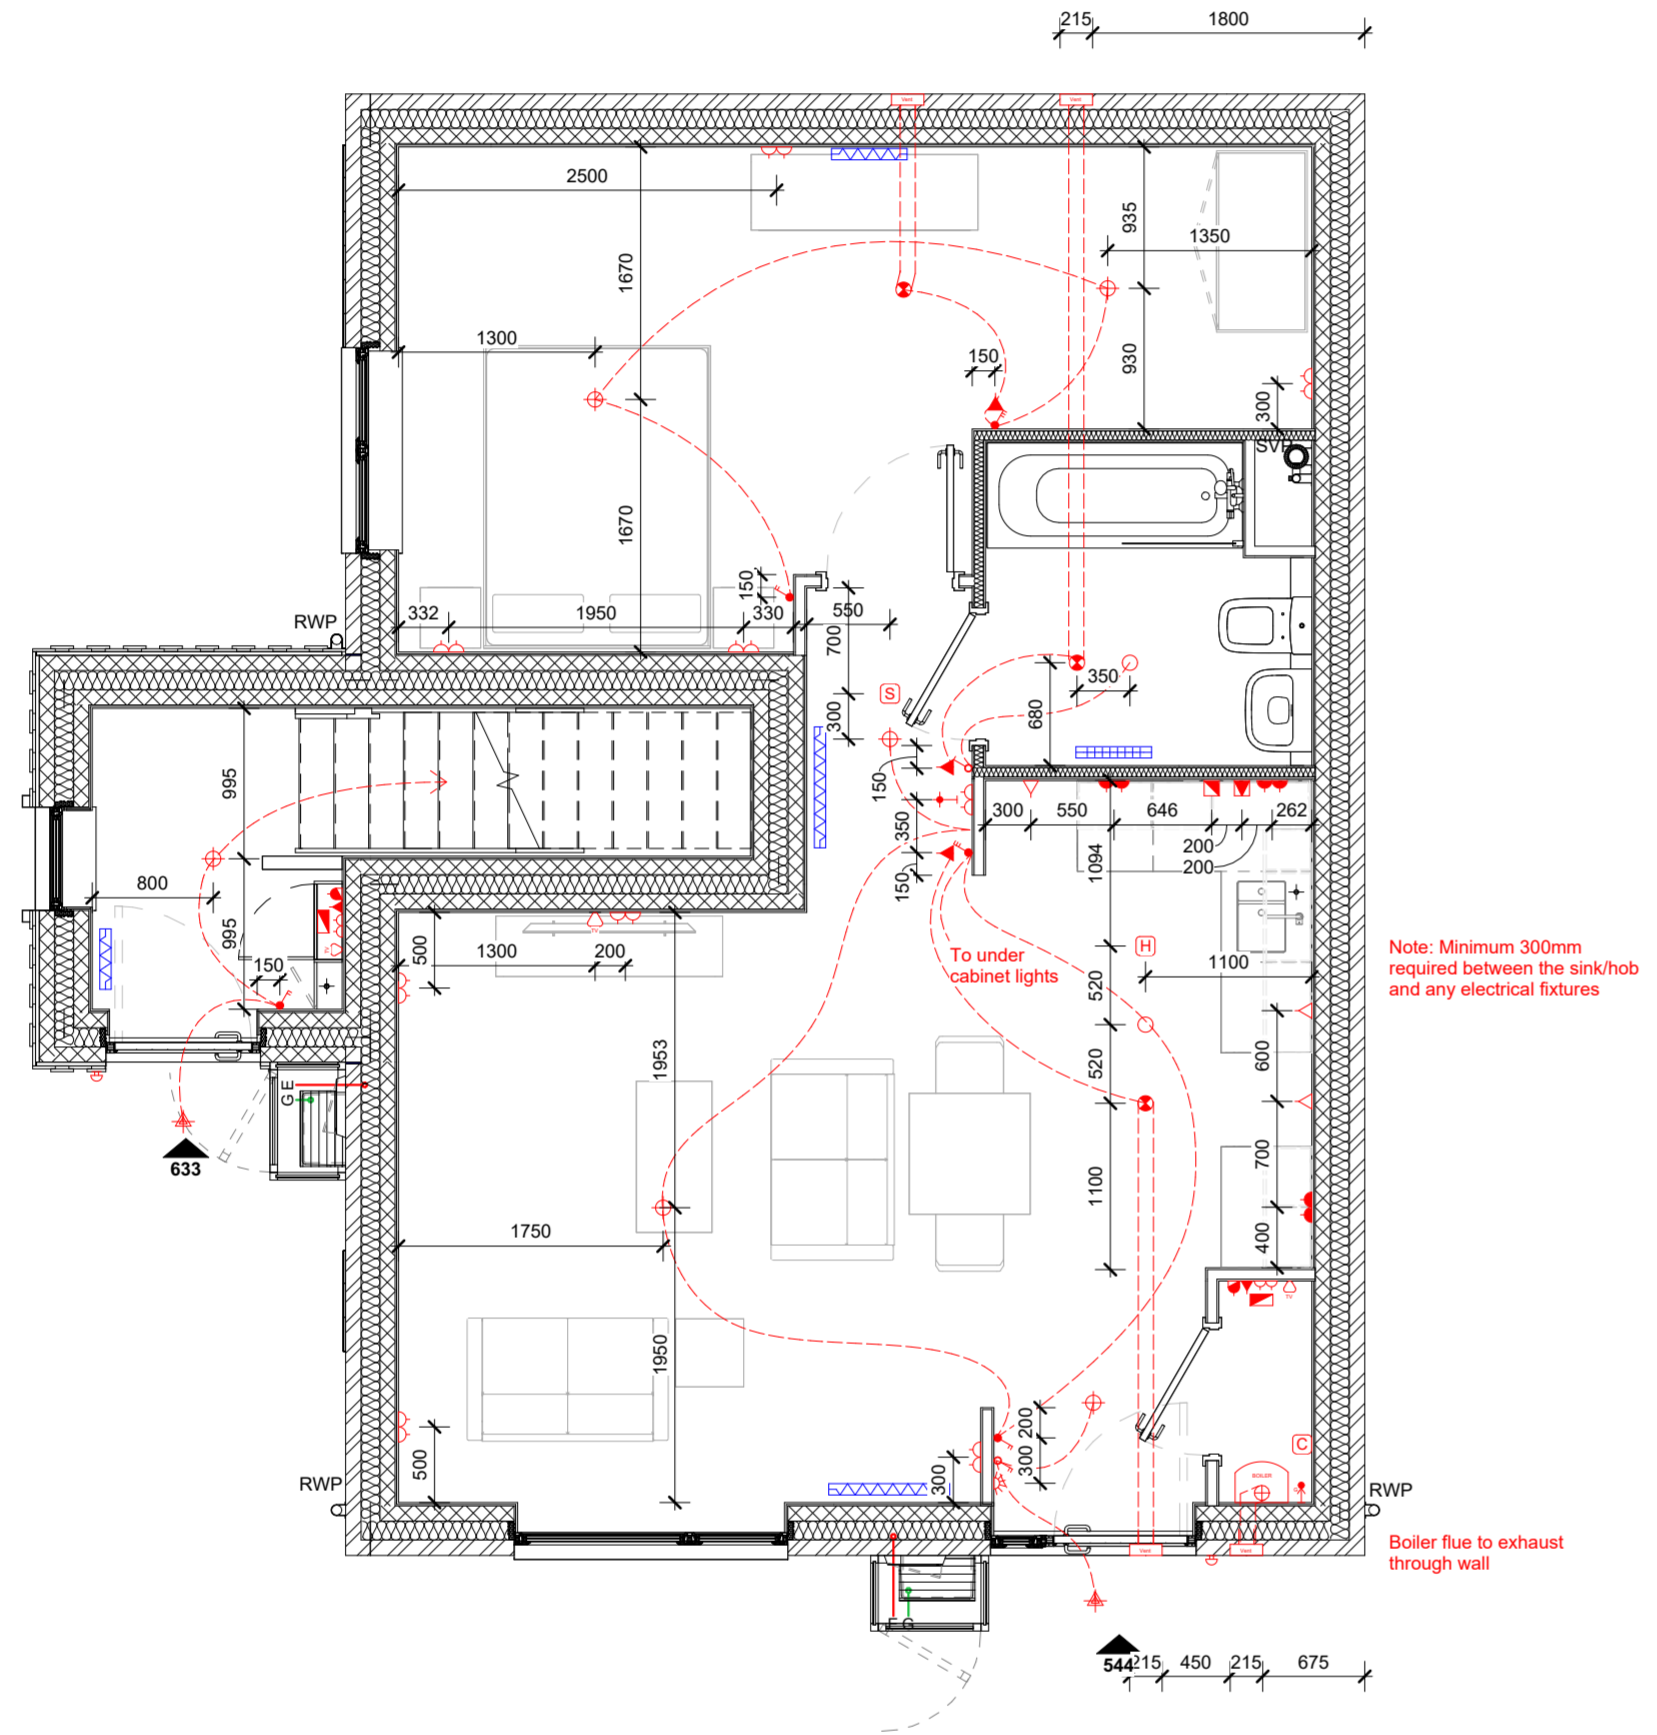

725. Ground Floor MEP  
1 : 50

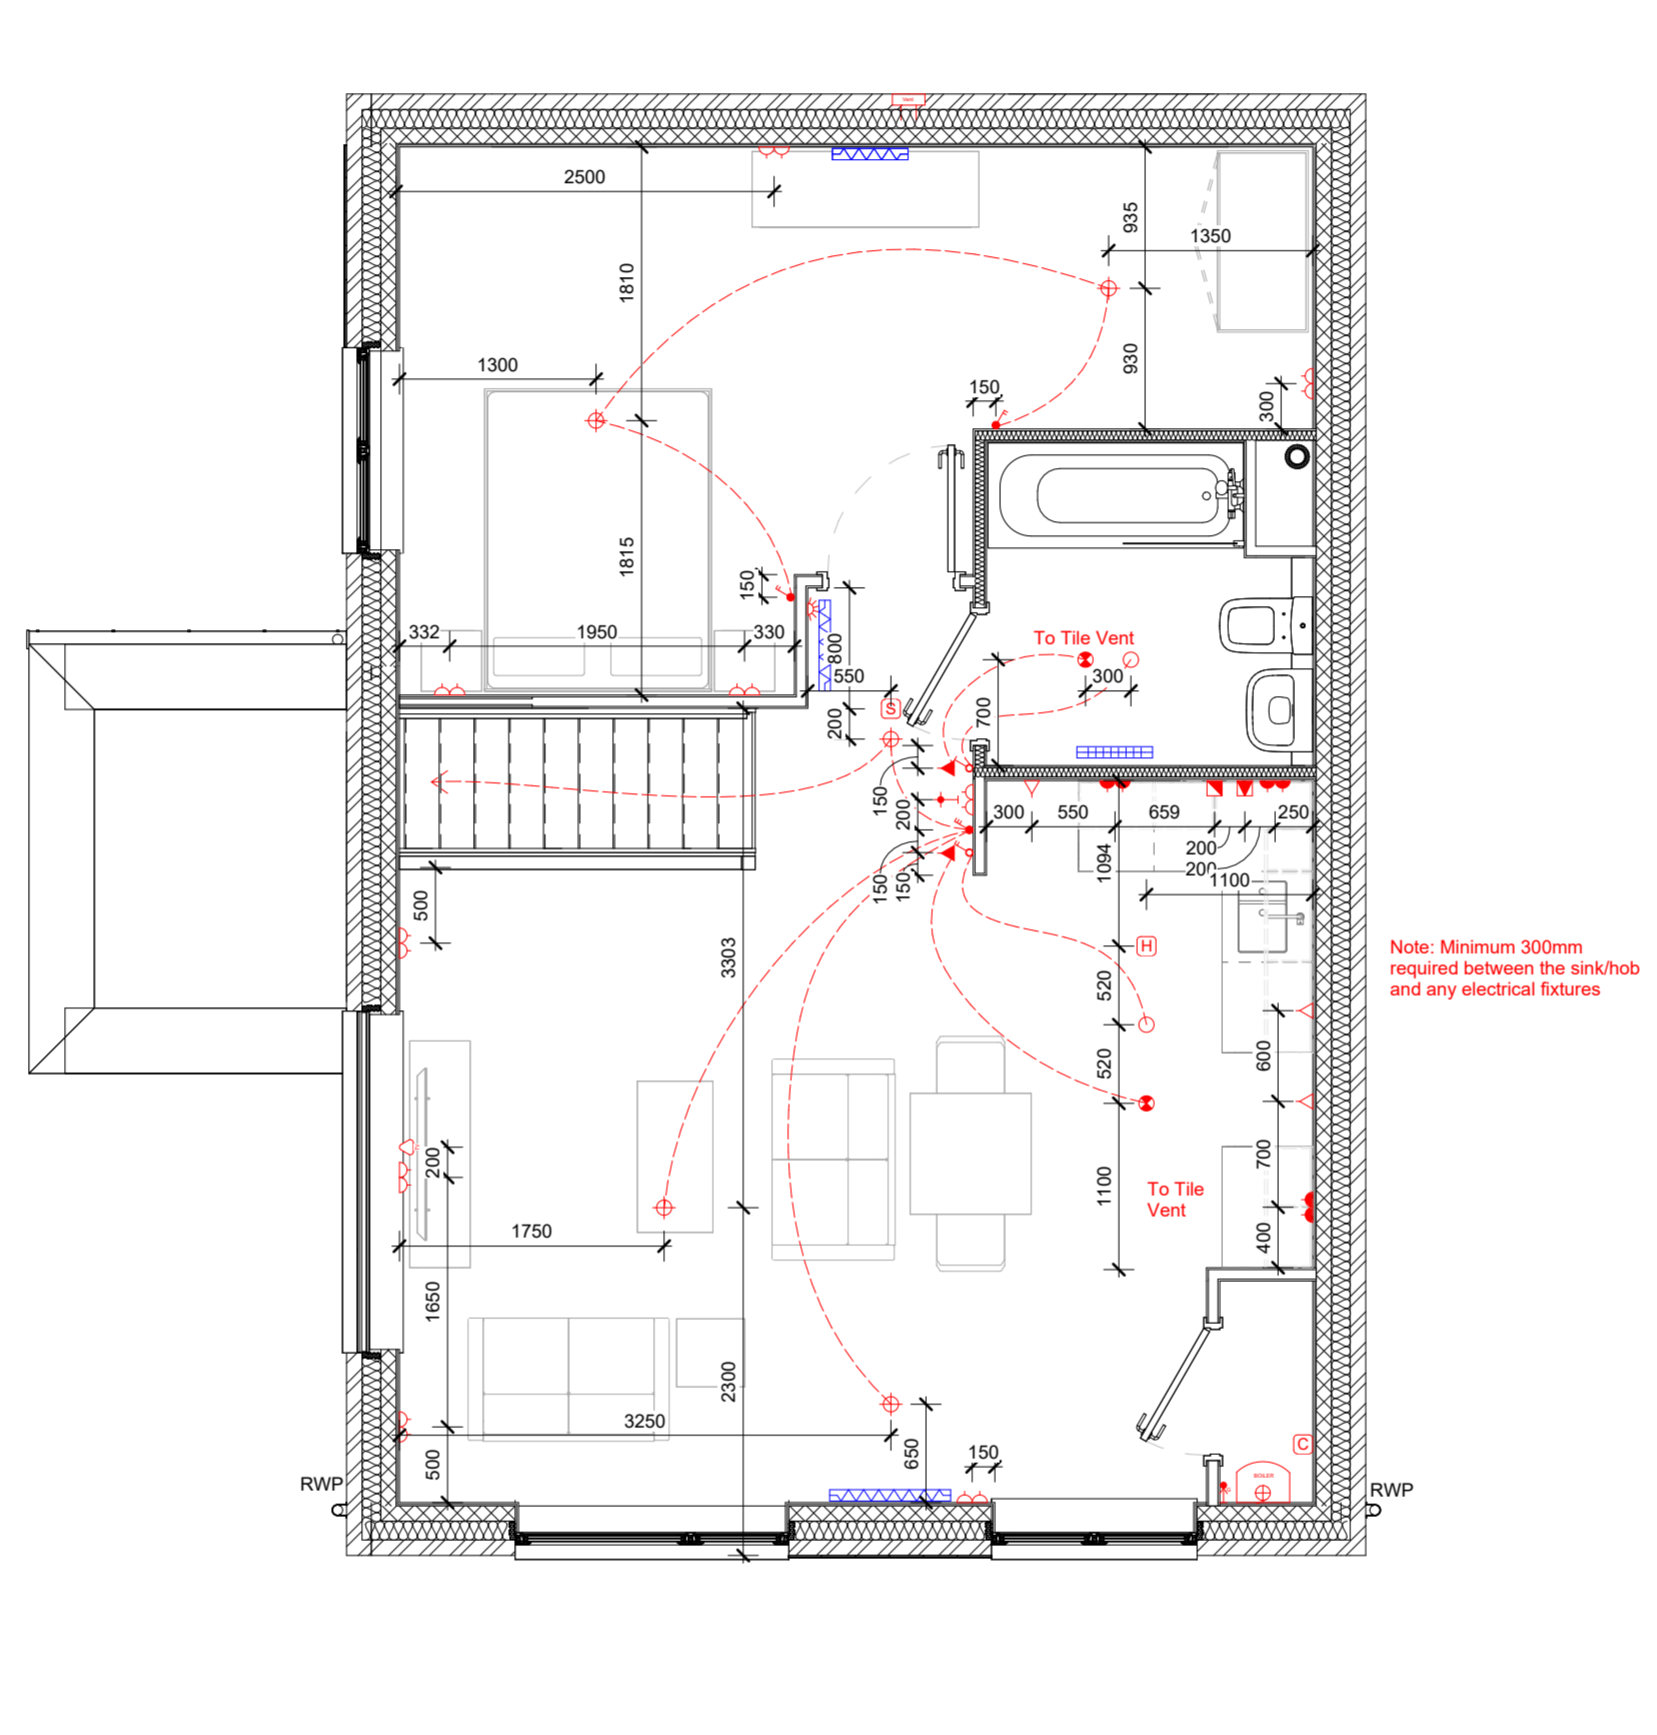

735. First Floor MEP  
1 : 50

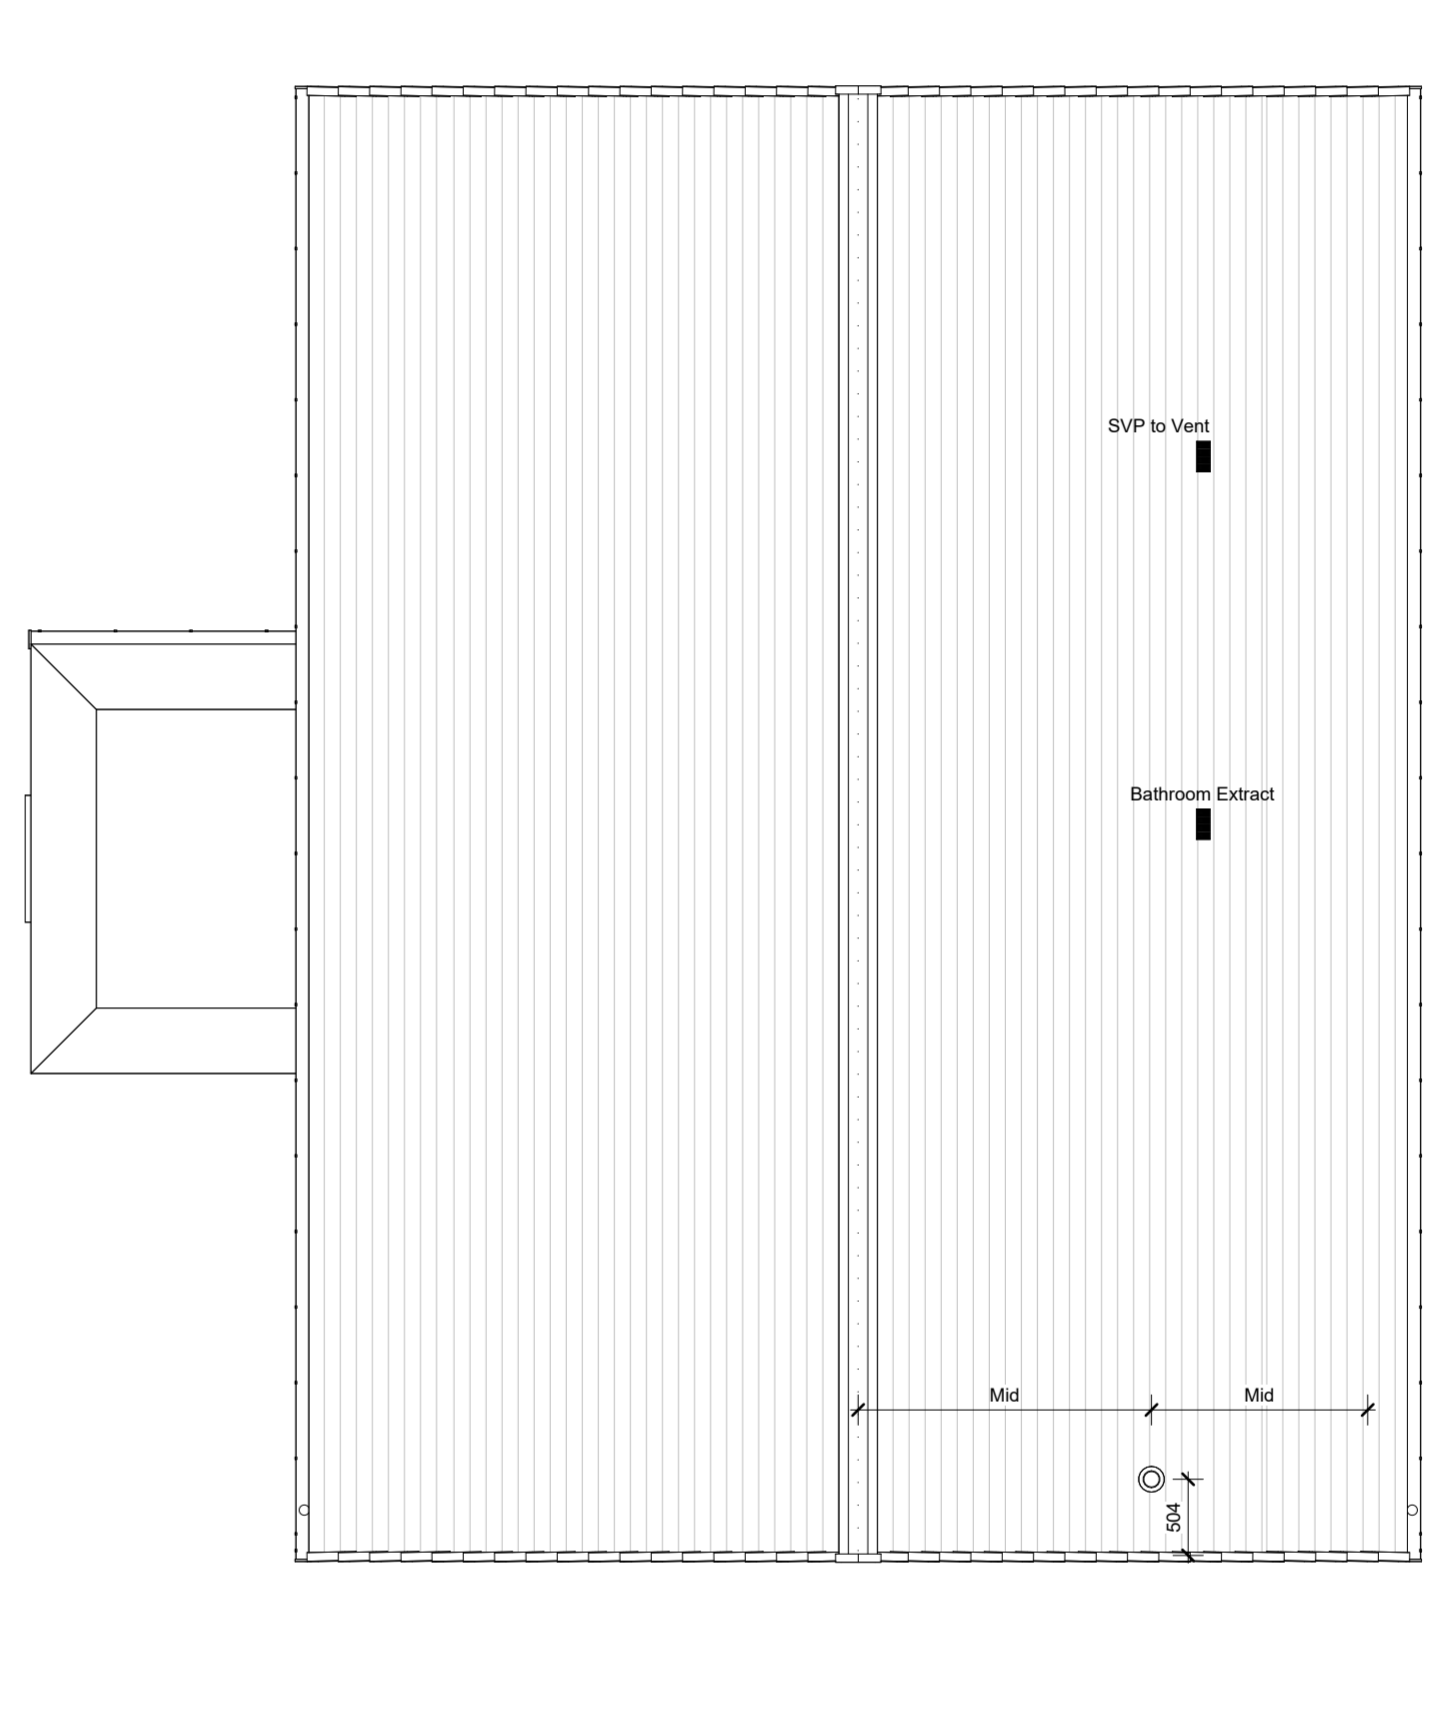

739. Roof Plan  
1 : 50

M&E LEGEND	
<b>LIGHTING</b>	
External Wall Light	External Wall Light
Internal Wall Light	Internal Wall Light
Pendant Light	Pendant Light
Recessed Spot Light	Recessed Spot Light
Bulkhead Light	Bulkhead Light
<b>SWITCHES</b>	
Single Gang Switch	Single Gang Switch
Double Gang Switch	Double Gang Switch
Triple Gang Switch	Triple Gang Switch
Single Two-Way Switch	Single Two-Way Switch
Double Two-Way Switch	Double Two-Way Switch
Triple Two-Way Switch	Triple Two-Way Switch
Wondwall Switch	Wondwall Switch
13A Switched Fused Spur	13A Switched Fused Spur
13A Unswitched Fused Spur	13A Unswitched Fused Spur
Kitchen Gang Plate	Kitchen Gang Plate
Cooker Control Box	Cooker Control Box
<b>SOCKETS</b>	
Single Socket - Low Level	Single Socket - Low Level
Unswitched Single Socket - Low Level	Unswitched Single Socket - Low Level
5 Amp Socket	5 Amp Socket
Double Socket - Low Level	Double Socket - Low Level
Double Socket - Low Level With USB	Double Socket - Low Level With USB
Single Socket - Worktop Level	Single Socket - Worktop Level
Double Socket - Worktop Level	Double Socket - Worktop Level
Double Socket - Worktop Level With USB	Double Socket - Worktop Level With USB
External IP65 Rated Socket	External IP65 Rated Socket
Shaver Socket	Shaver Socket
<b>MISC. ELECTRICAL</b>	
Consumer Unit	Consumer Unit
Central Heating Room Thermostat	Central Heating Room Thermostat
Data Module with TV Point Inset	Data Module with TV Point Inset
Data Module with CAT6 Socket Inset	Data Module with CAT6 Socket Inset
Door Bell Sounder	Door Bell Sounder
Door Bell Push	Door Bell Push
<b>FIRE &amp; GAS PROTECTION</b>	
Carbon Monoxide Detector	Carbon Monoxide Detector
Heat Detector	Heat Detector
Smoke Detector	Smoke Detector
Sprinkler Head	Sprinkler Head
<b>VENTILATION</b>	
Ceiling Mounted Fan	Ceiling Mounted Fan
Brick Vent - Plan	Brick Vent - Plan
Brick Vent - Elevation	Brick Vent - Elevation
Tile Vent	Tile Vent
<b>HEATING &amp; PLUMBING</b>	
Central Heating Boiler	Central Heating Boiler
Gas Point	Gas Point
Radiator	Radiator
Towel Rail	Towel Rail
Boiler Flue Terminal	Boiler Flue Terminal
External Tap	External Tap




Note: All plumbing and ventilation items shown indicatively. Refer to independent third party designs for exact details of heating and ventilation designs.

**IMPORTANT**  
THIS LEGEND MUST ALWAYS BE PRINTED WITH ANY MEP PLAN EXTRACTS

ANY CLASHES OR DISCREPANCIES MUST BE REPORTED TO NORTHSTONE TECHNICAL TEAM

AIR SOURCE HEAT PUMP LEGEND	
<b>CLEARANCE</b>	
ASHP	ASHP
Min. 1000	Min. 1000
Min. 300	Min. 300
Min. 300	Min. 300
Min. 300	Min. 300
<b>ELEVATIONS</b>	
ASHP	ASHP
840	840
1284	1284
322	322
<b>ANCILLARY EQUIPMENT</b>	
IP67 Rated Rotary Pole Isolator Switch	IP67 Rated Rotary Pole Isolator Switch
IP66 Rated External Whisper Box	IP66 Rated External Whisper Box
Panasonic Smart Control Switch	Panasonic Smart Control Switch


Note: Air Source Heat Pump, (ASHP), and ancillary equipment shown indicatively. Refer to independent third party designs for exact details of ASHP System

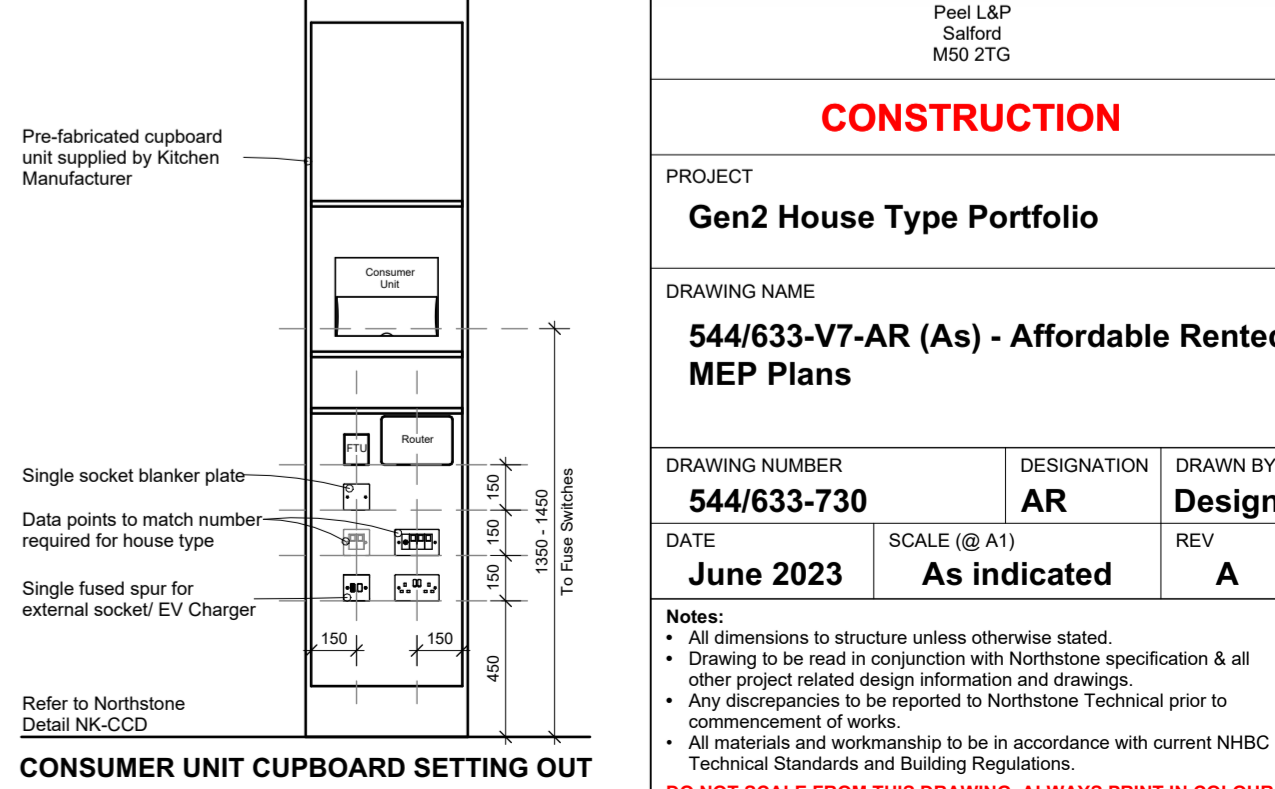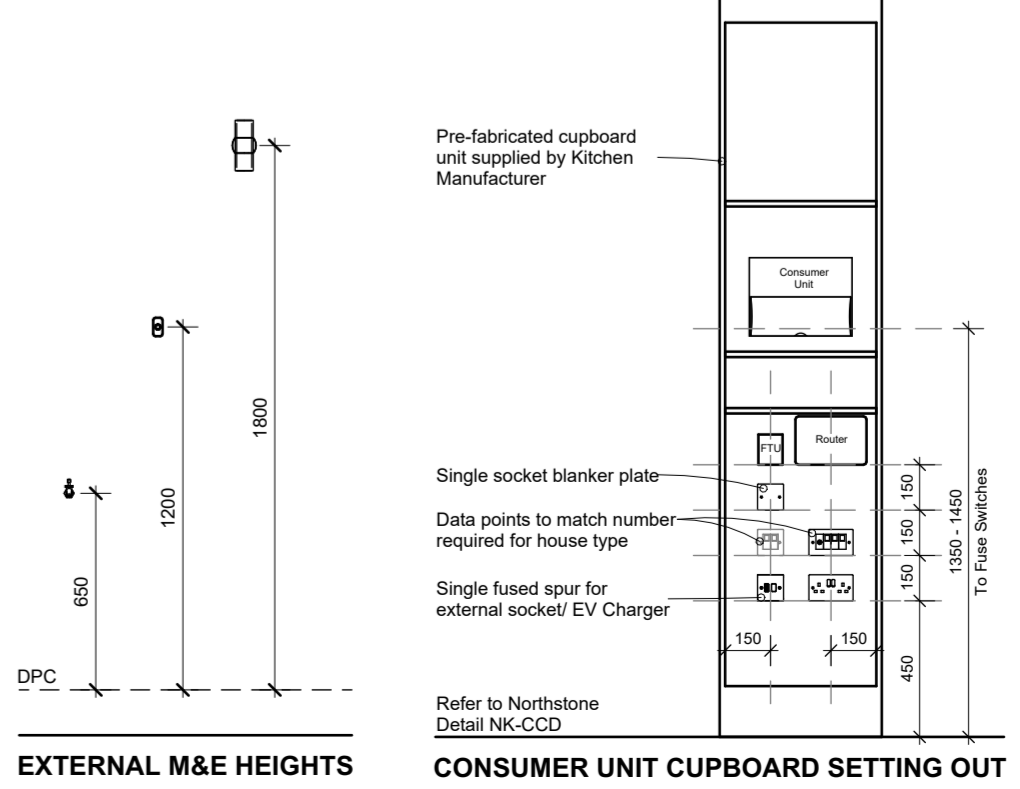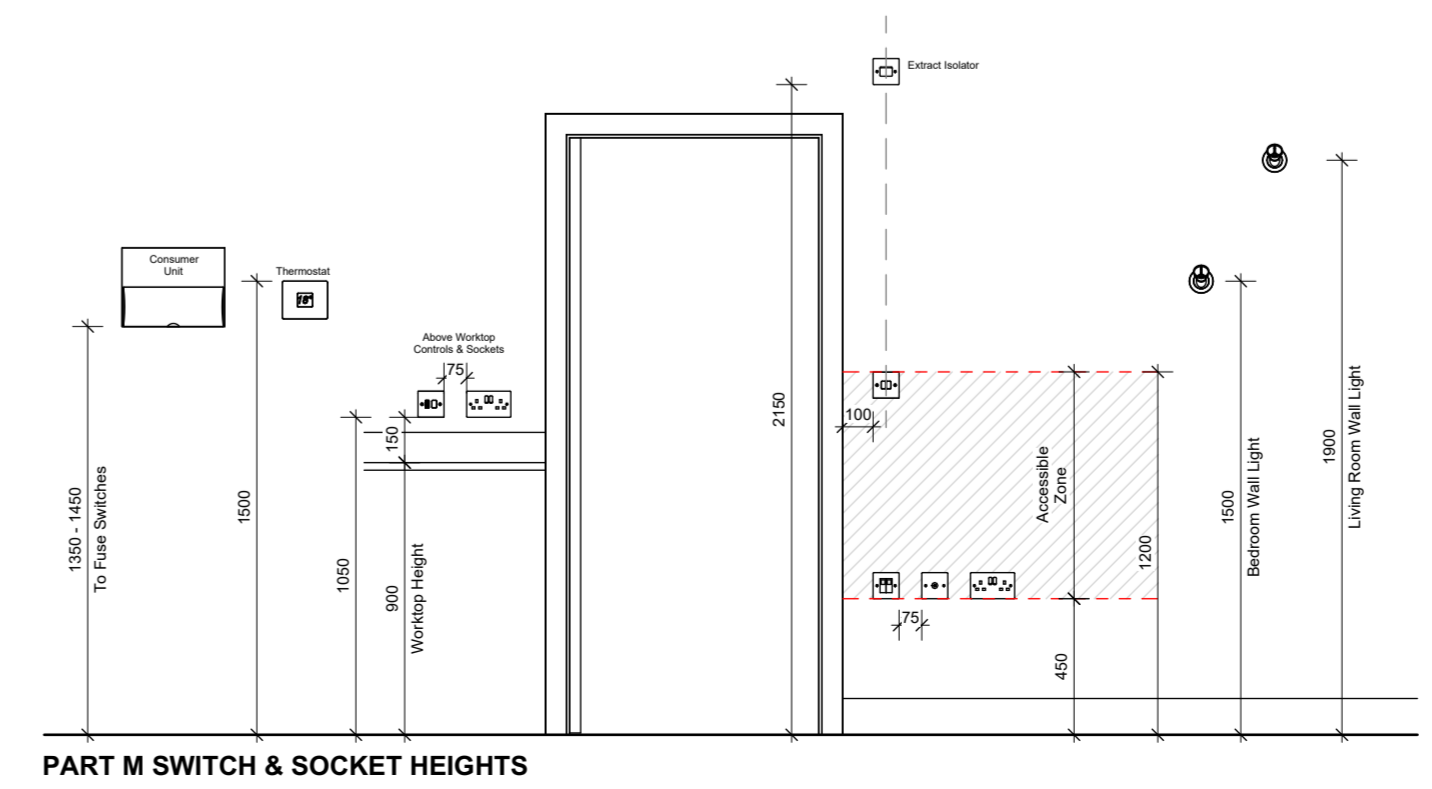


A General updates as detailed within issue email dated 02.02.2024		Feb 2024
- Construction Issue		July 2023
Rev	Description	Date
<b>NORTHSTONE</b>		
Peel L&P Salford M50 2TG		
<b>CONSTRUCTION</b>		
PROJECT <b>Gen2 House Type Portfolio</b>		
DRAWING NAME <b>544/633-V7-AR (As) - Affordable Rented MEP Plans</b>		
DRAWING NUMBER <b>544/633-730</b>	DESIGNATION <b>AR</b>	DRAWN BY <b>Design</b>
DATE <b>June 2023</b>	SCALE (@ A1) <b>As indicated</b>	REV <b>A</b>
<b>Notes:</b> <ul style="list-style-type: none"> <li>All dimensions to structure unless otherwise stated.</li> <li>Drawing to be read in conjunction with Northstone specification &amp; all other project related design information and drawings.</li> <li>Any discrepancies to be reported to Northstone Technical prior to commencement of works.</li> <li>All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.</li> </ul>		
<b>DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.</b>		




**740. Front Elevation**  
1 : 50

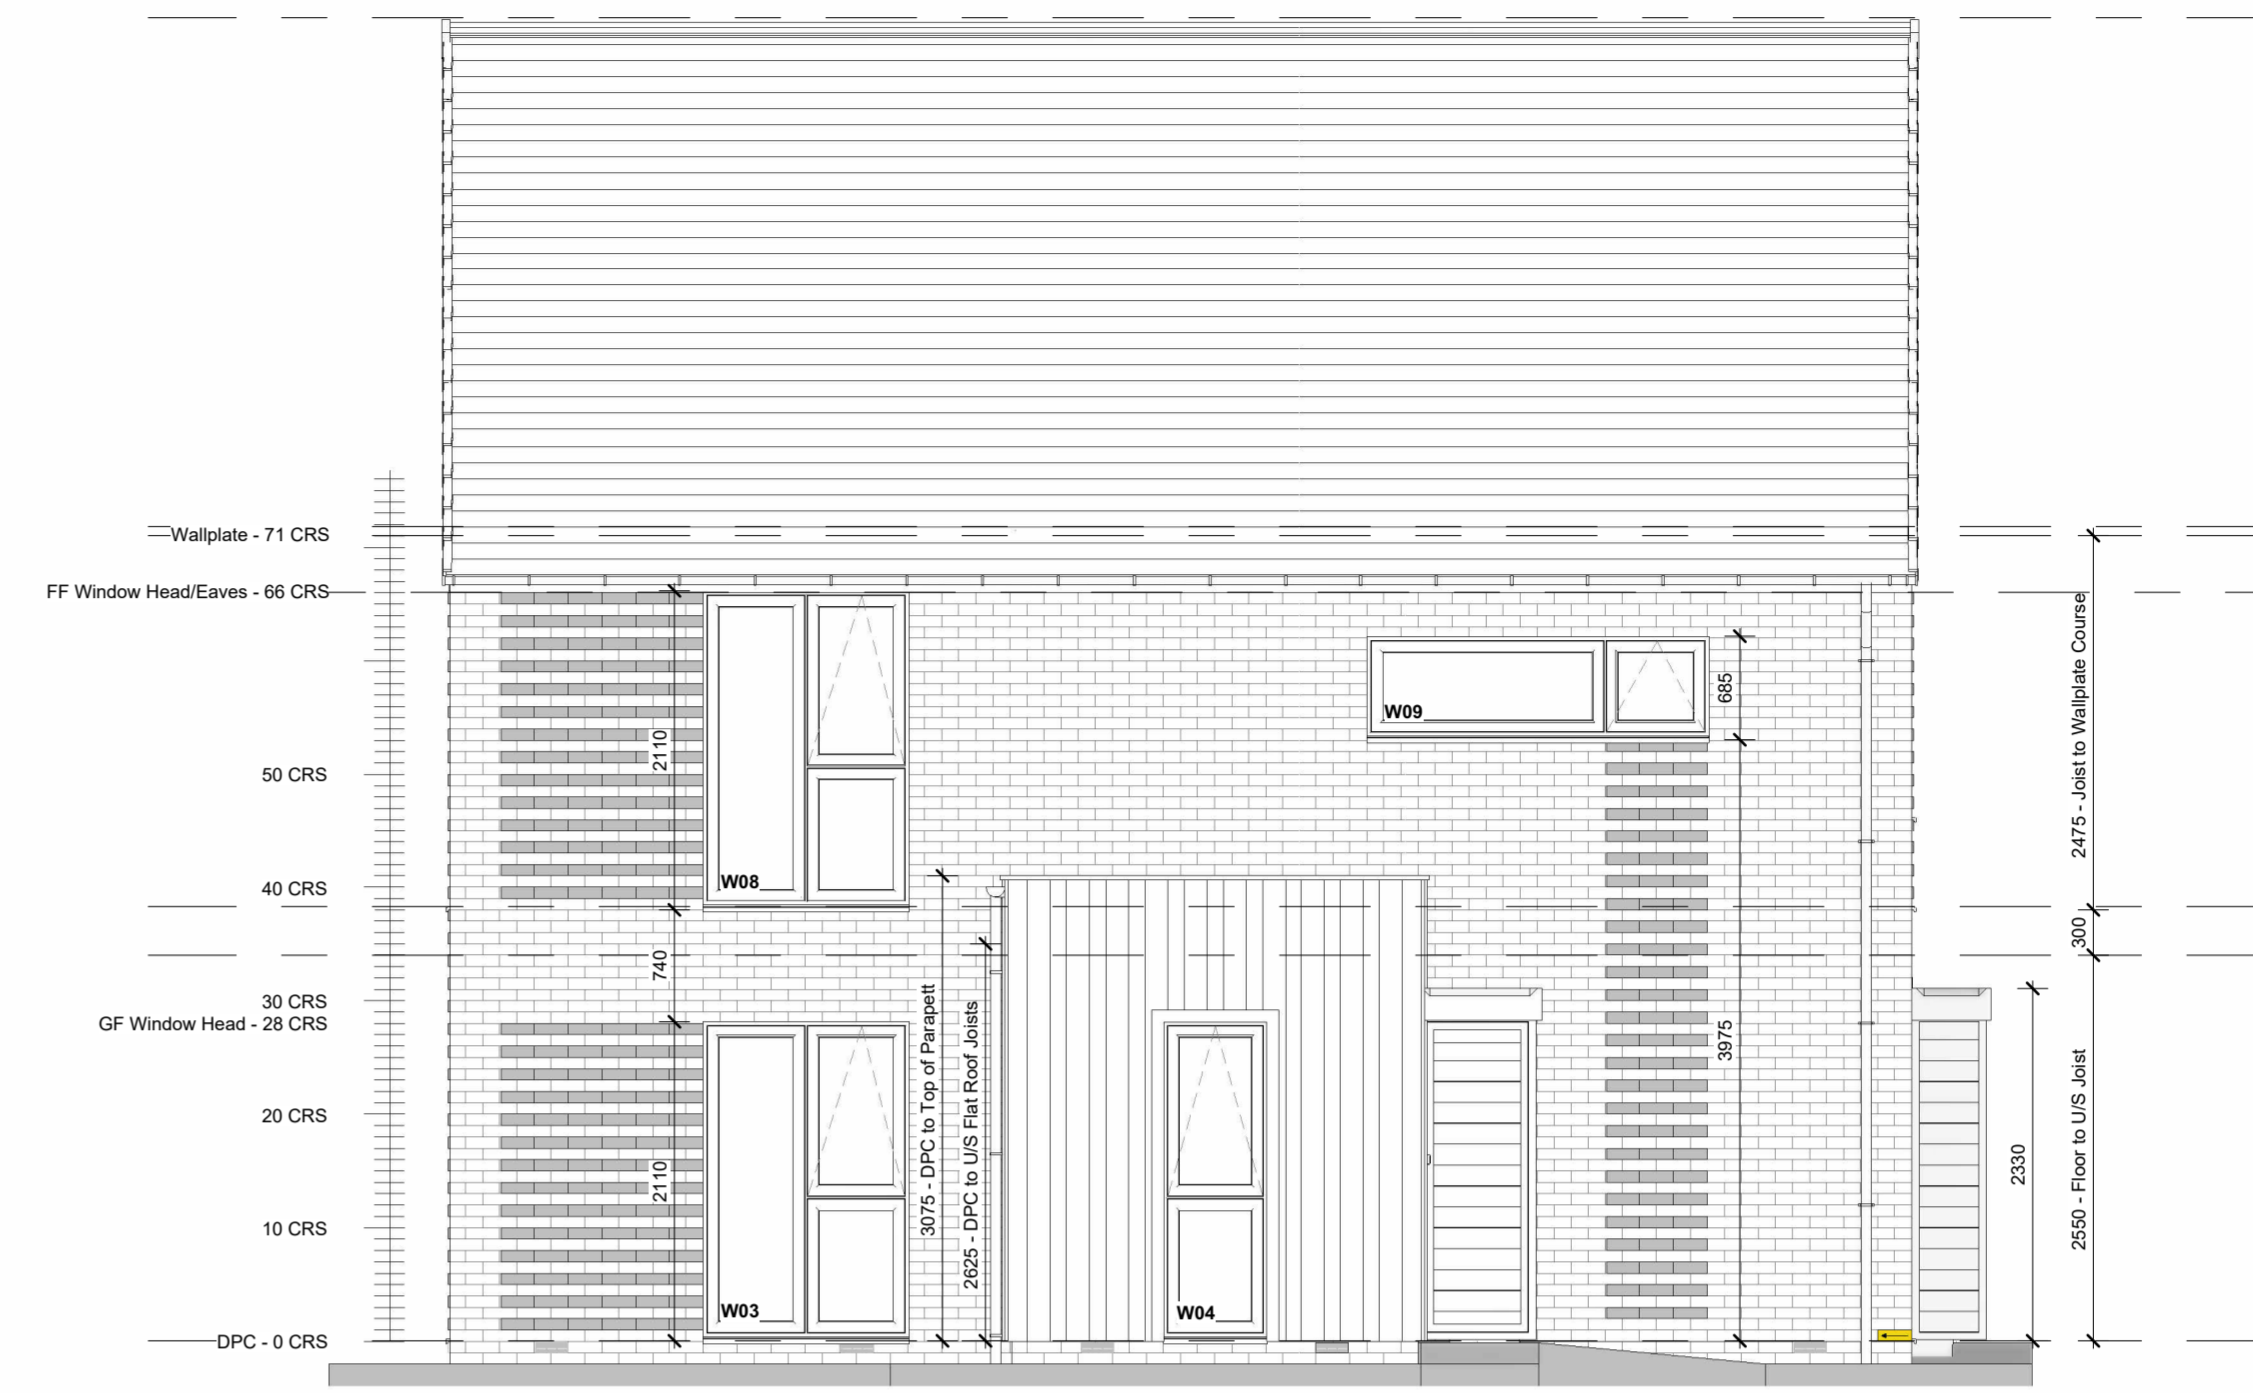


**741. LHS Elevation**  
1 : 50

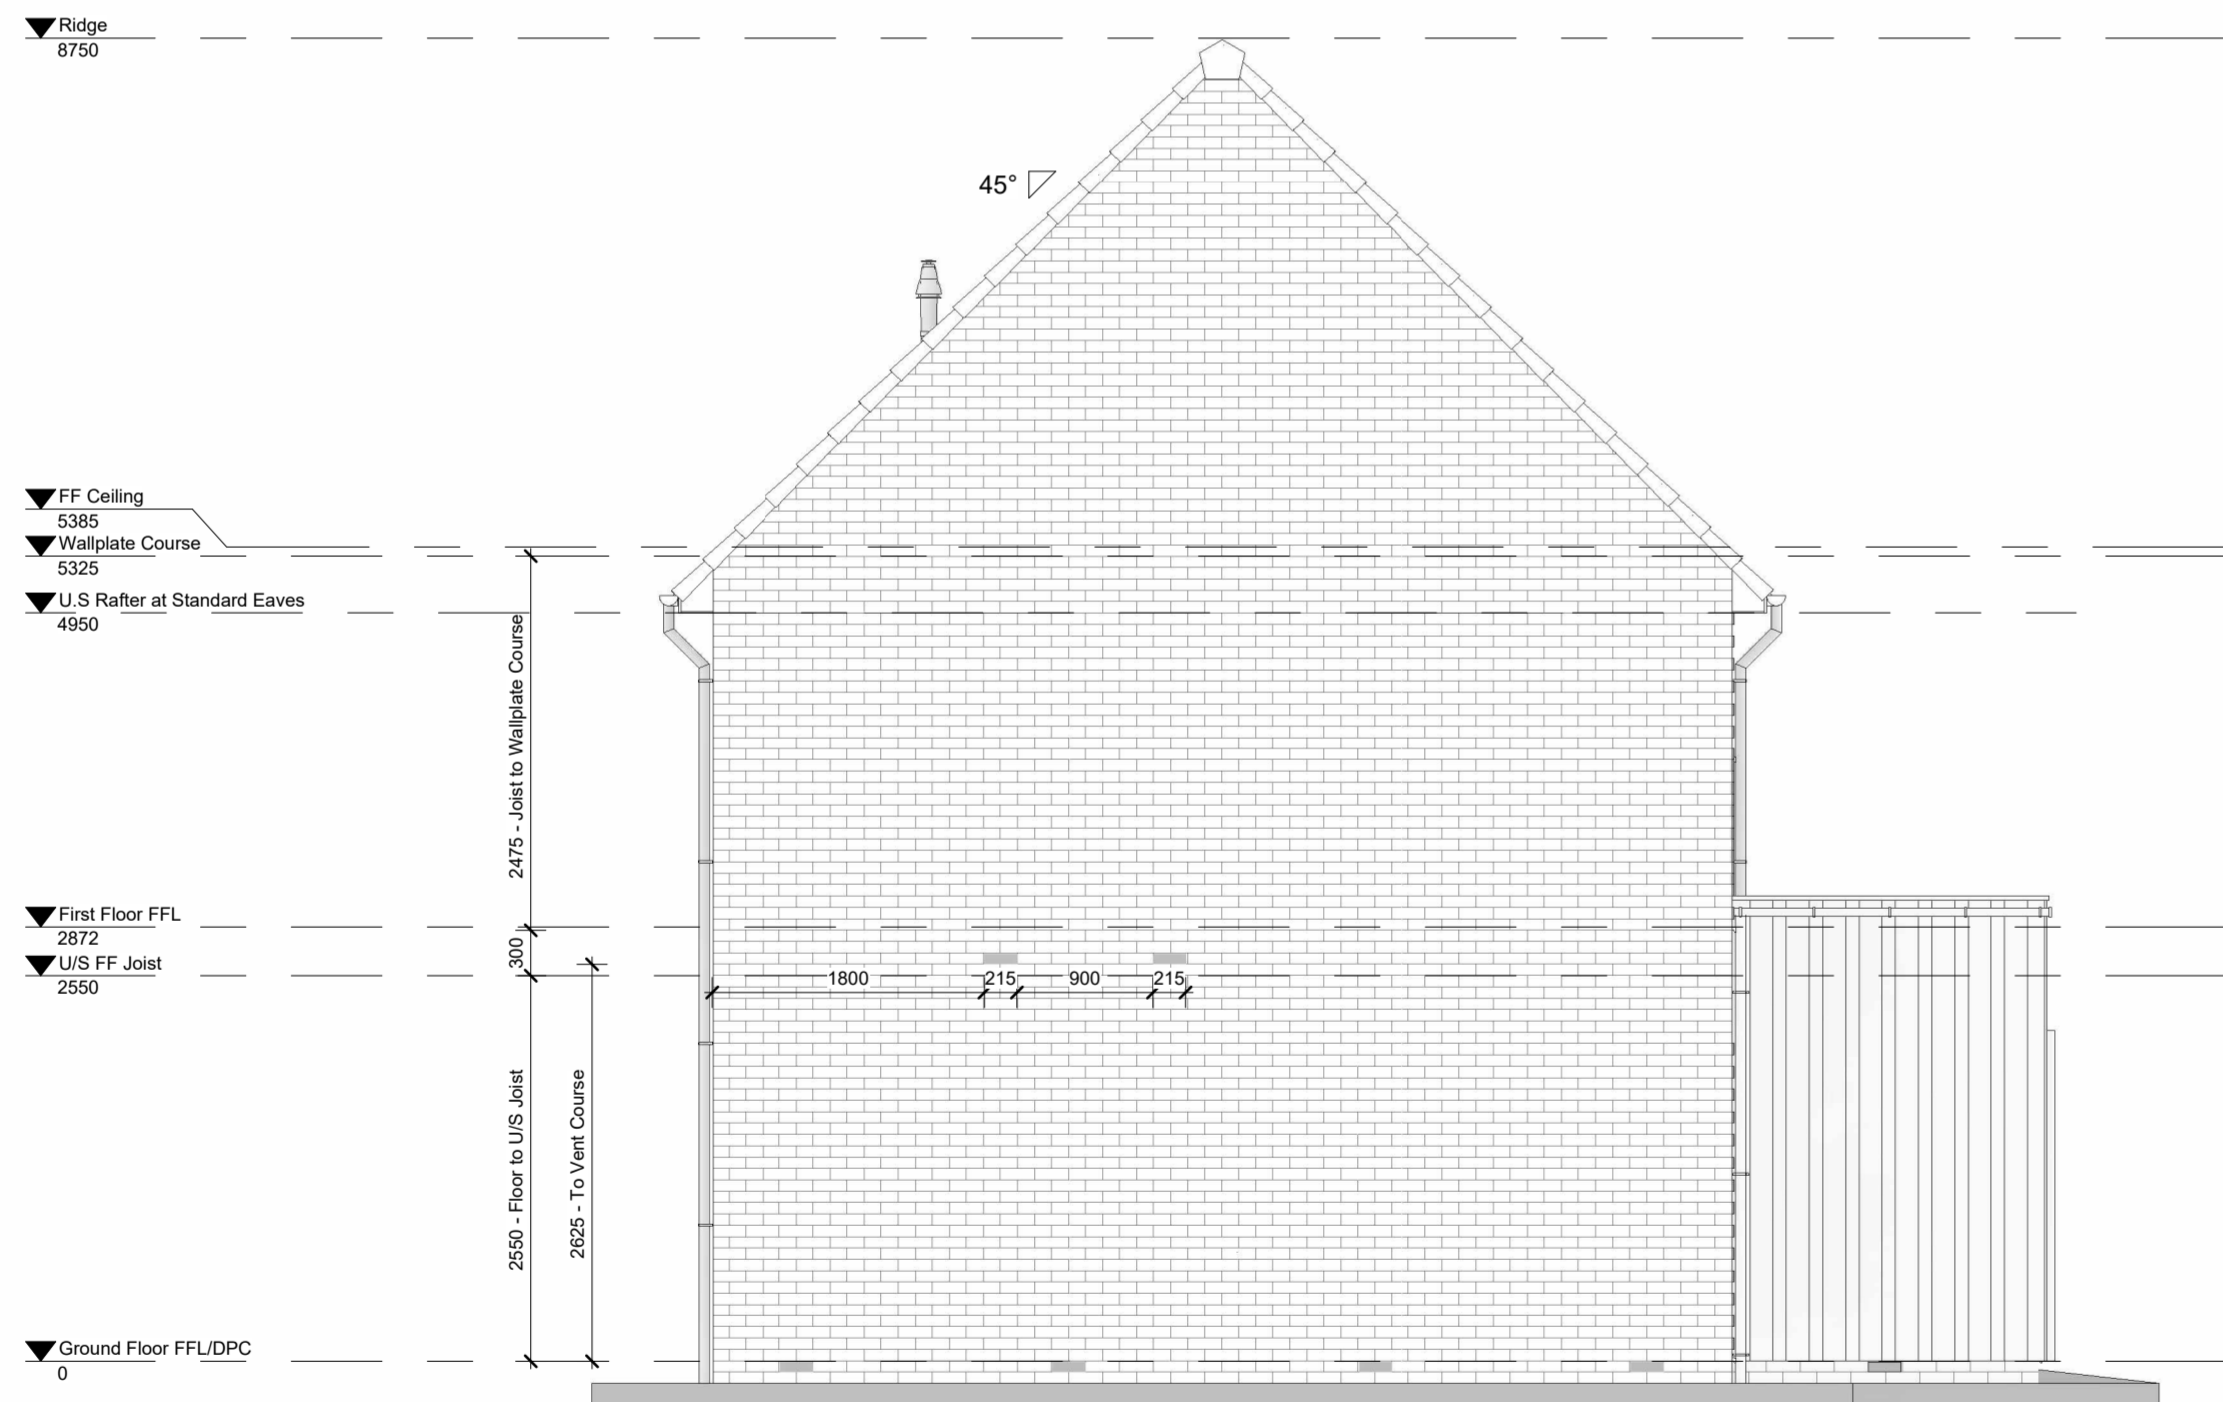

**742. Rear Elevation**  
1 : 50

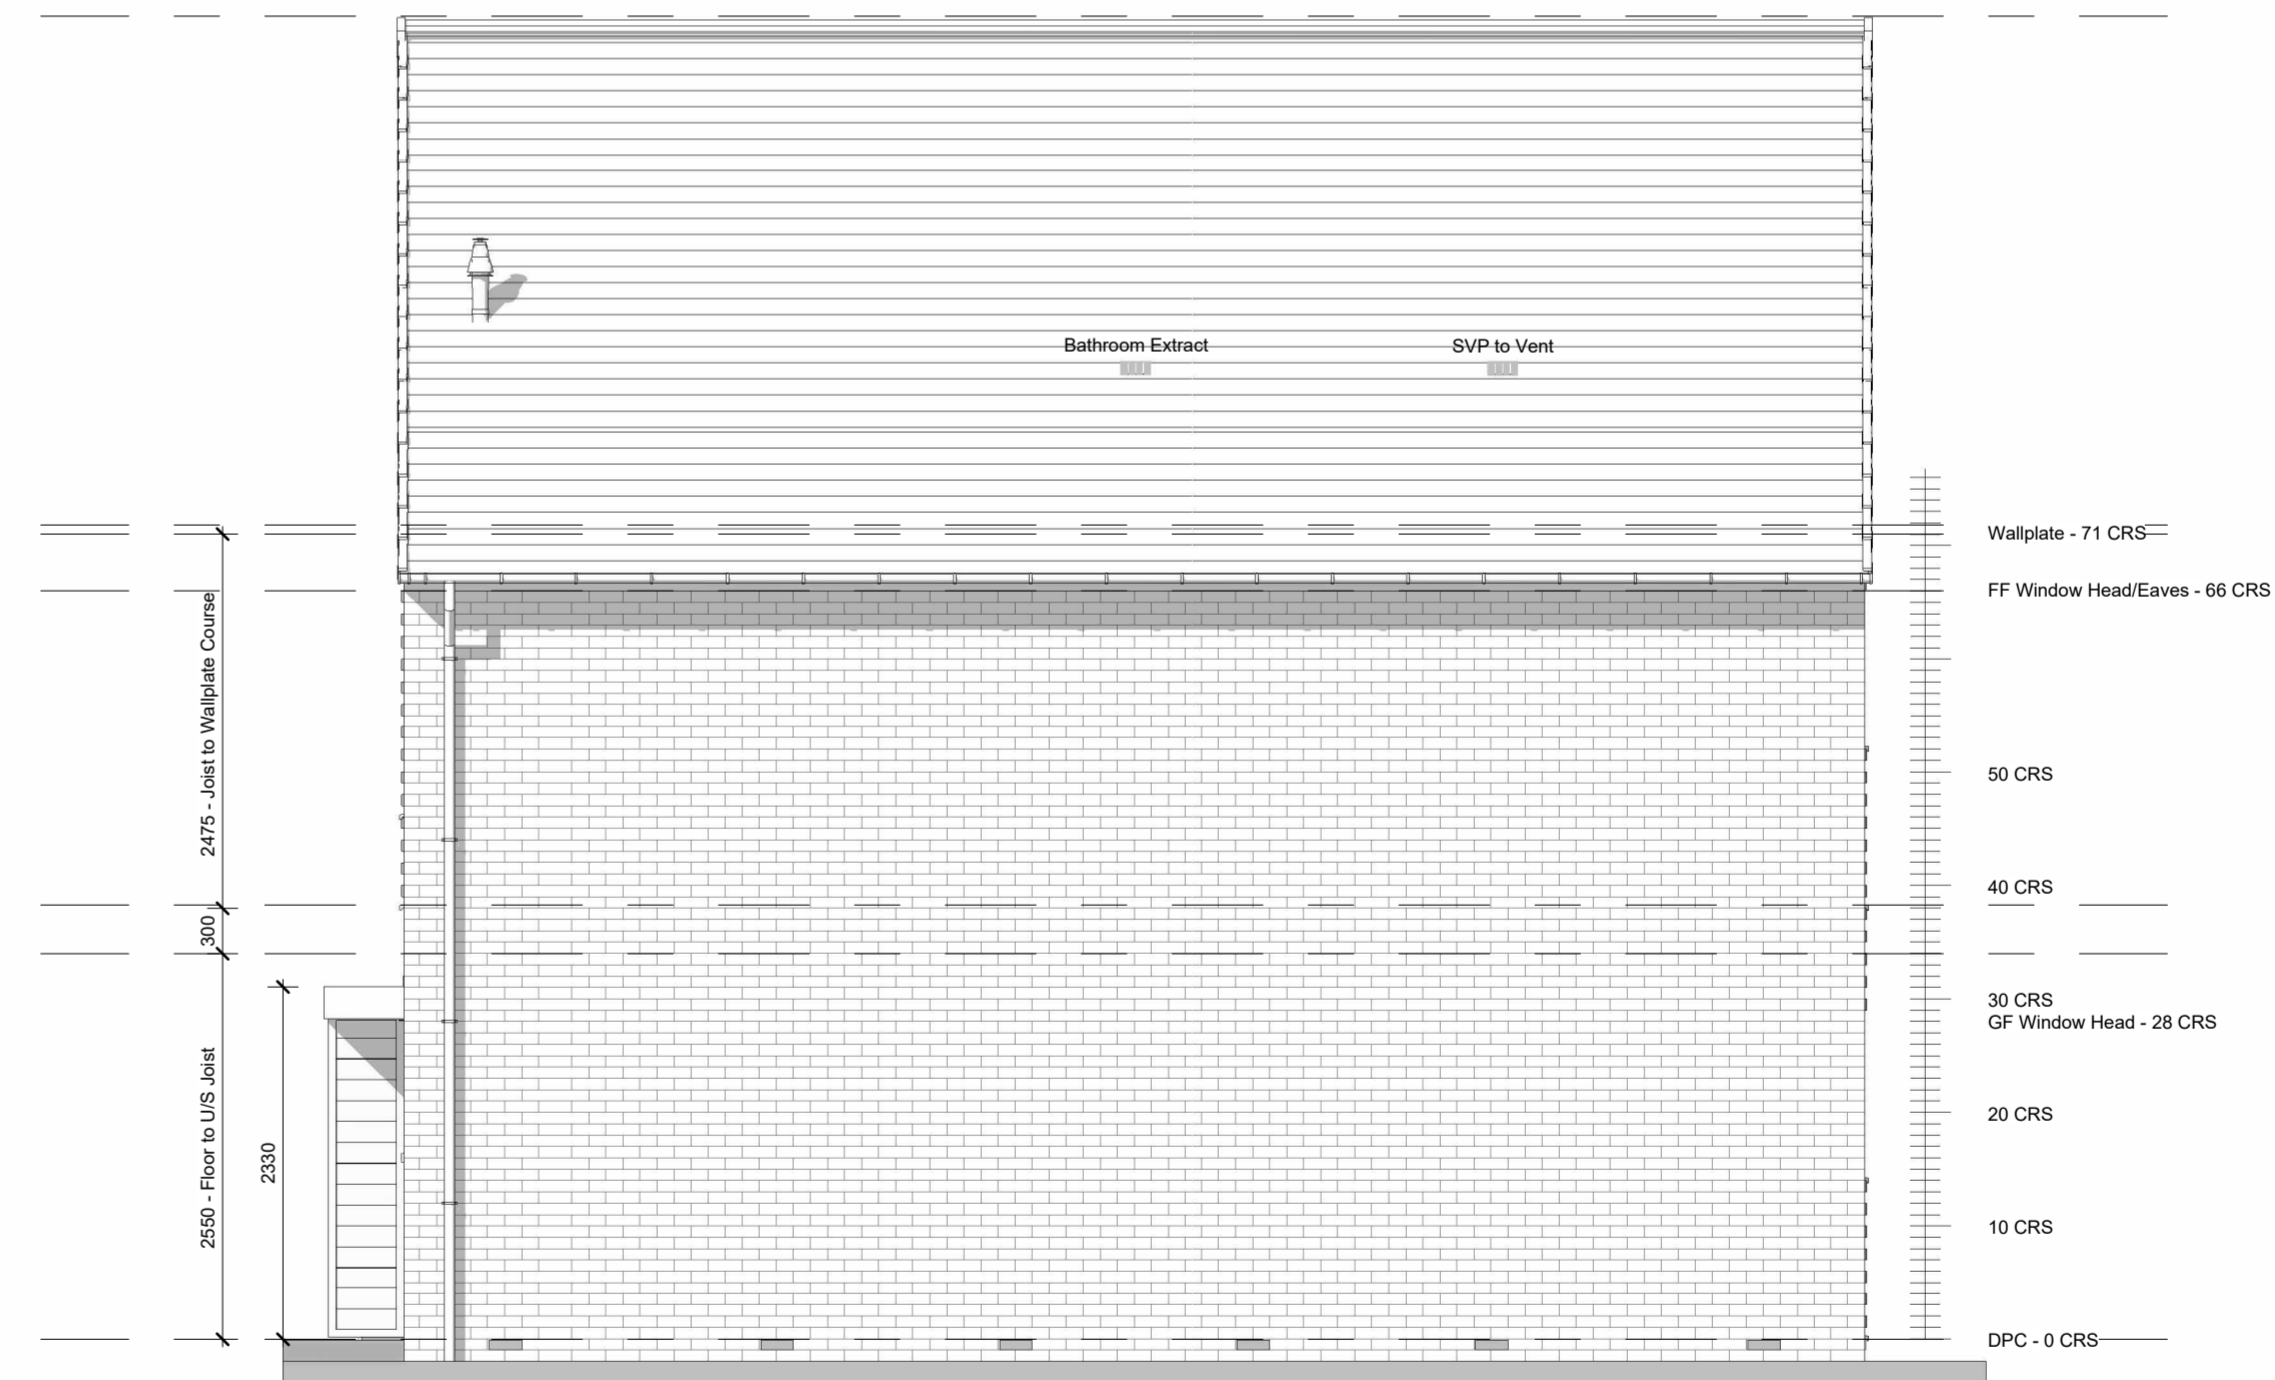

**743. RHS Elevation**  
1 : 50

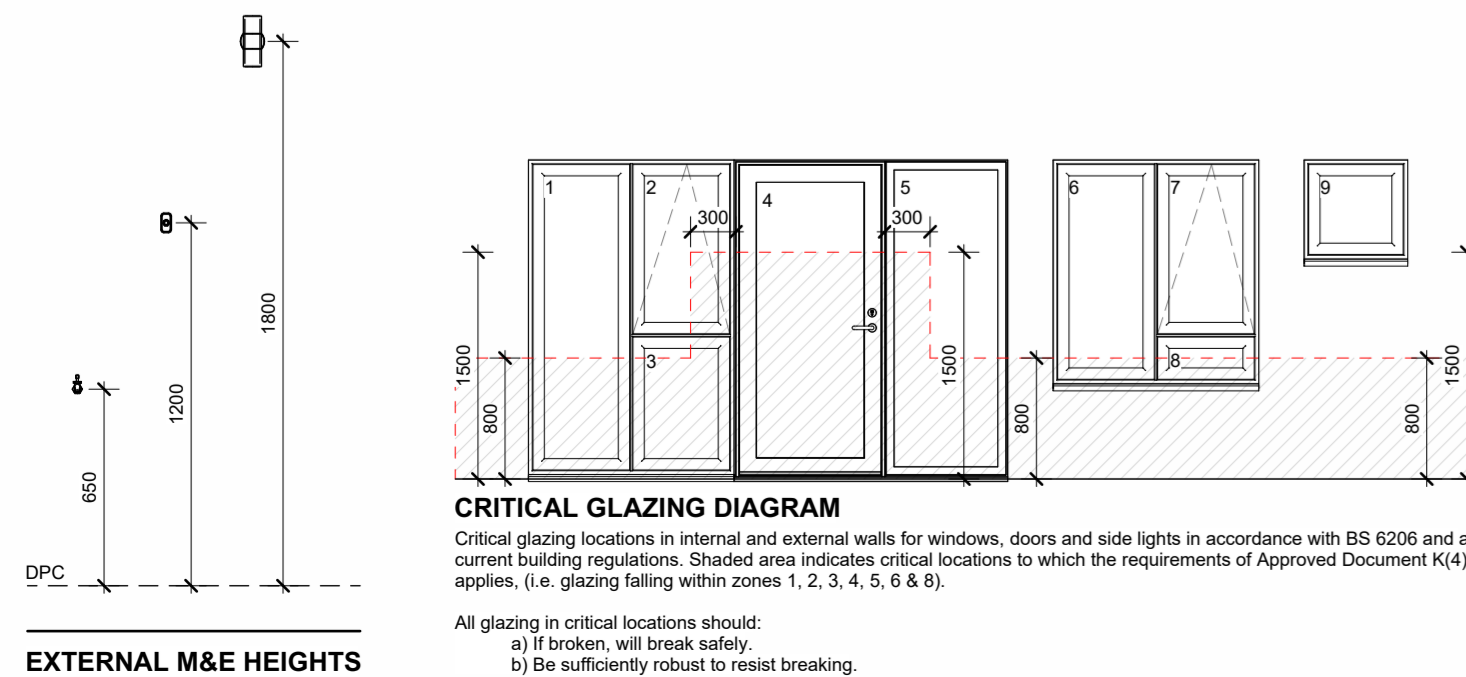

- Notes:**
- Schedules to be read in conjunction with all project specification documents, floor plans and elevations
  - Structural opening size includes any sidelights
  - Frame set back is taken from front face of brick
  - Refer to manufacturers information for detailed intel schedules
  - All accessible windows and doors to be PAS24 tested to comply with Part Q of building regulations
  - All dimensions to be checked on site prior to manufacture

Escape from upper storey a maximum of 4.5m above ground level: ALL inner rooms where applicable and all first floor habitable rooms (excluding kitchens) to be provided with an escape window (or external door) which complies with Approved Document B1 Section 2 Paragraph 2.2.

Dwellings with one storey more than 4.5m above ground level: A protected stairway should be provided with minimum 30 minute fire resisting construction at all storeys to comply with Approved Document B1 Section 2 Paragraph 2.5.

Unobstructed opening egress area to be at least 0.33M<sup>2</sup> and at least 450mm high and 450mm wide. Bottom of windows to be not more than 1100mm and not less than 800mm above the floor. Escape windows to have non lockable fasteners and hinged to achieve the minimum required opening.

General updates as detailed within issue email dated 02.02.2024	Feb 2024
Construction Issue	July 2023

Rev	Description	Date
-----	-------------	------

**NORTHSTONE**  
Peel L&P  
Salford  
M50 2TG

**CONSTRUCTION**

PROJECT  
**Gen2 House Type Portfolio**


DRAWING NAME  
**544/633-V7-AR (As) - Affordable Rented Elevations**

DRAWING NUMBER <b>544/633-740</b>	DESIGNATION <b>AR</b>	DRAWN BY <b>Design</b>
--------------------------------------	--------------------------	---------------------------

DATE <b>June 2023</b>	SCALE (@ A1) <b>As indicated</b>	REV <b>A</b>
--------------------------	-------------------------------------	-----------------


- Notes:**
- All dimensions to structure unless otherwise stated.
  - Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.
  - Any discrepancies to be reported to Northstone Technical prior to commencement of works.
  - All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.
- DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.**

MEMBRANE KEY	
	Damp Proof Course (DPC)
	Damp Proof Membrane (DPM)
	Roof Underlay
	Breather Membrane

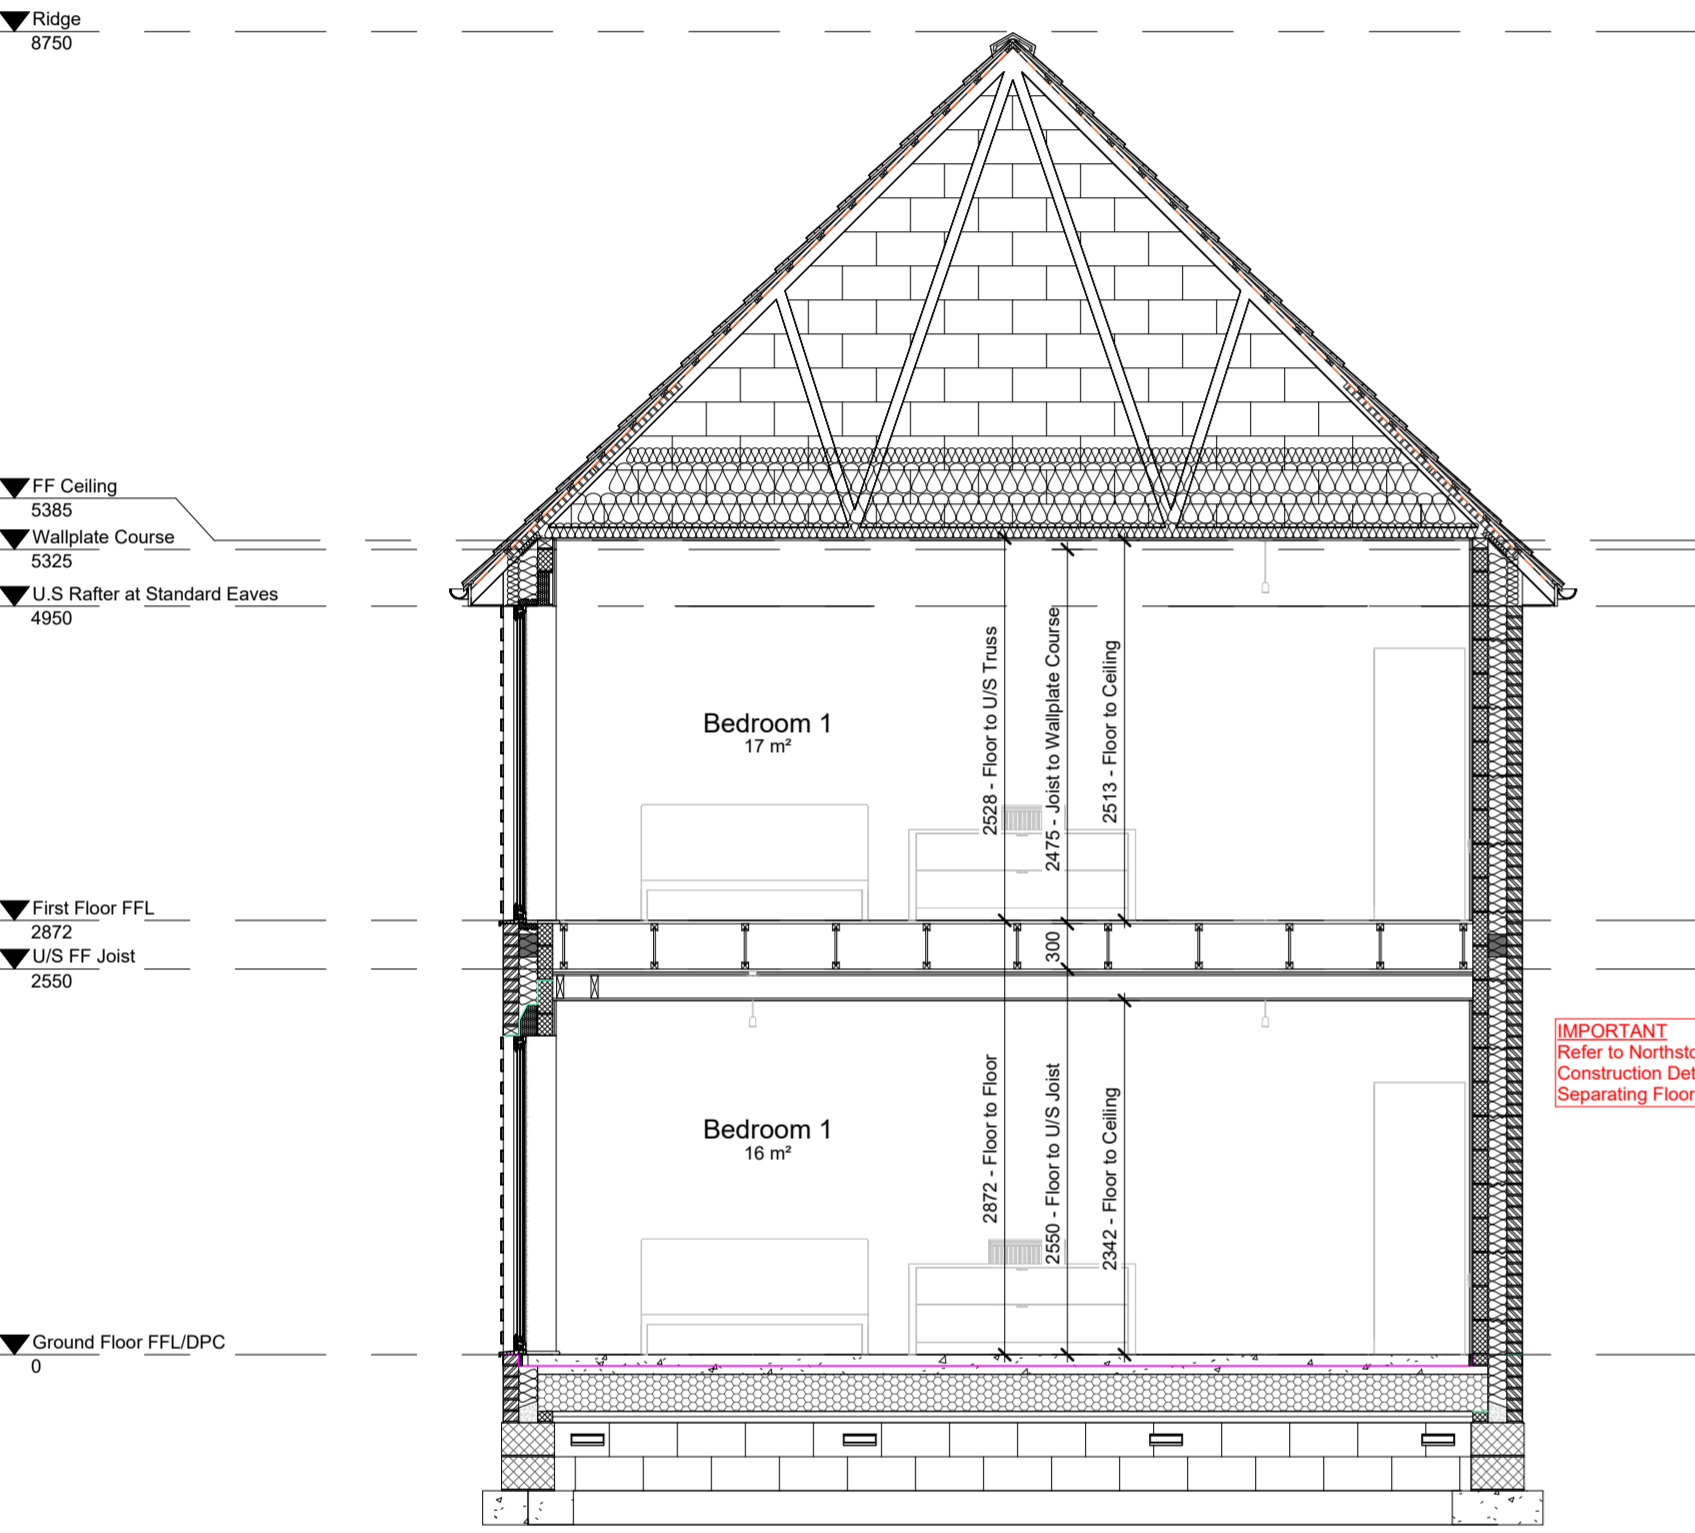


**750. Section A-A**  
1 : 50

**IMPORTANT**  
Refer to Northstone  
Construction Details for  
Separating Floor details.

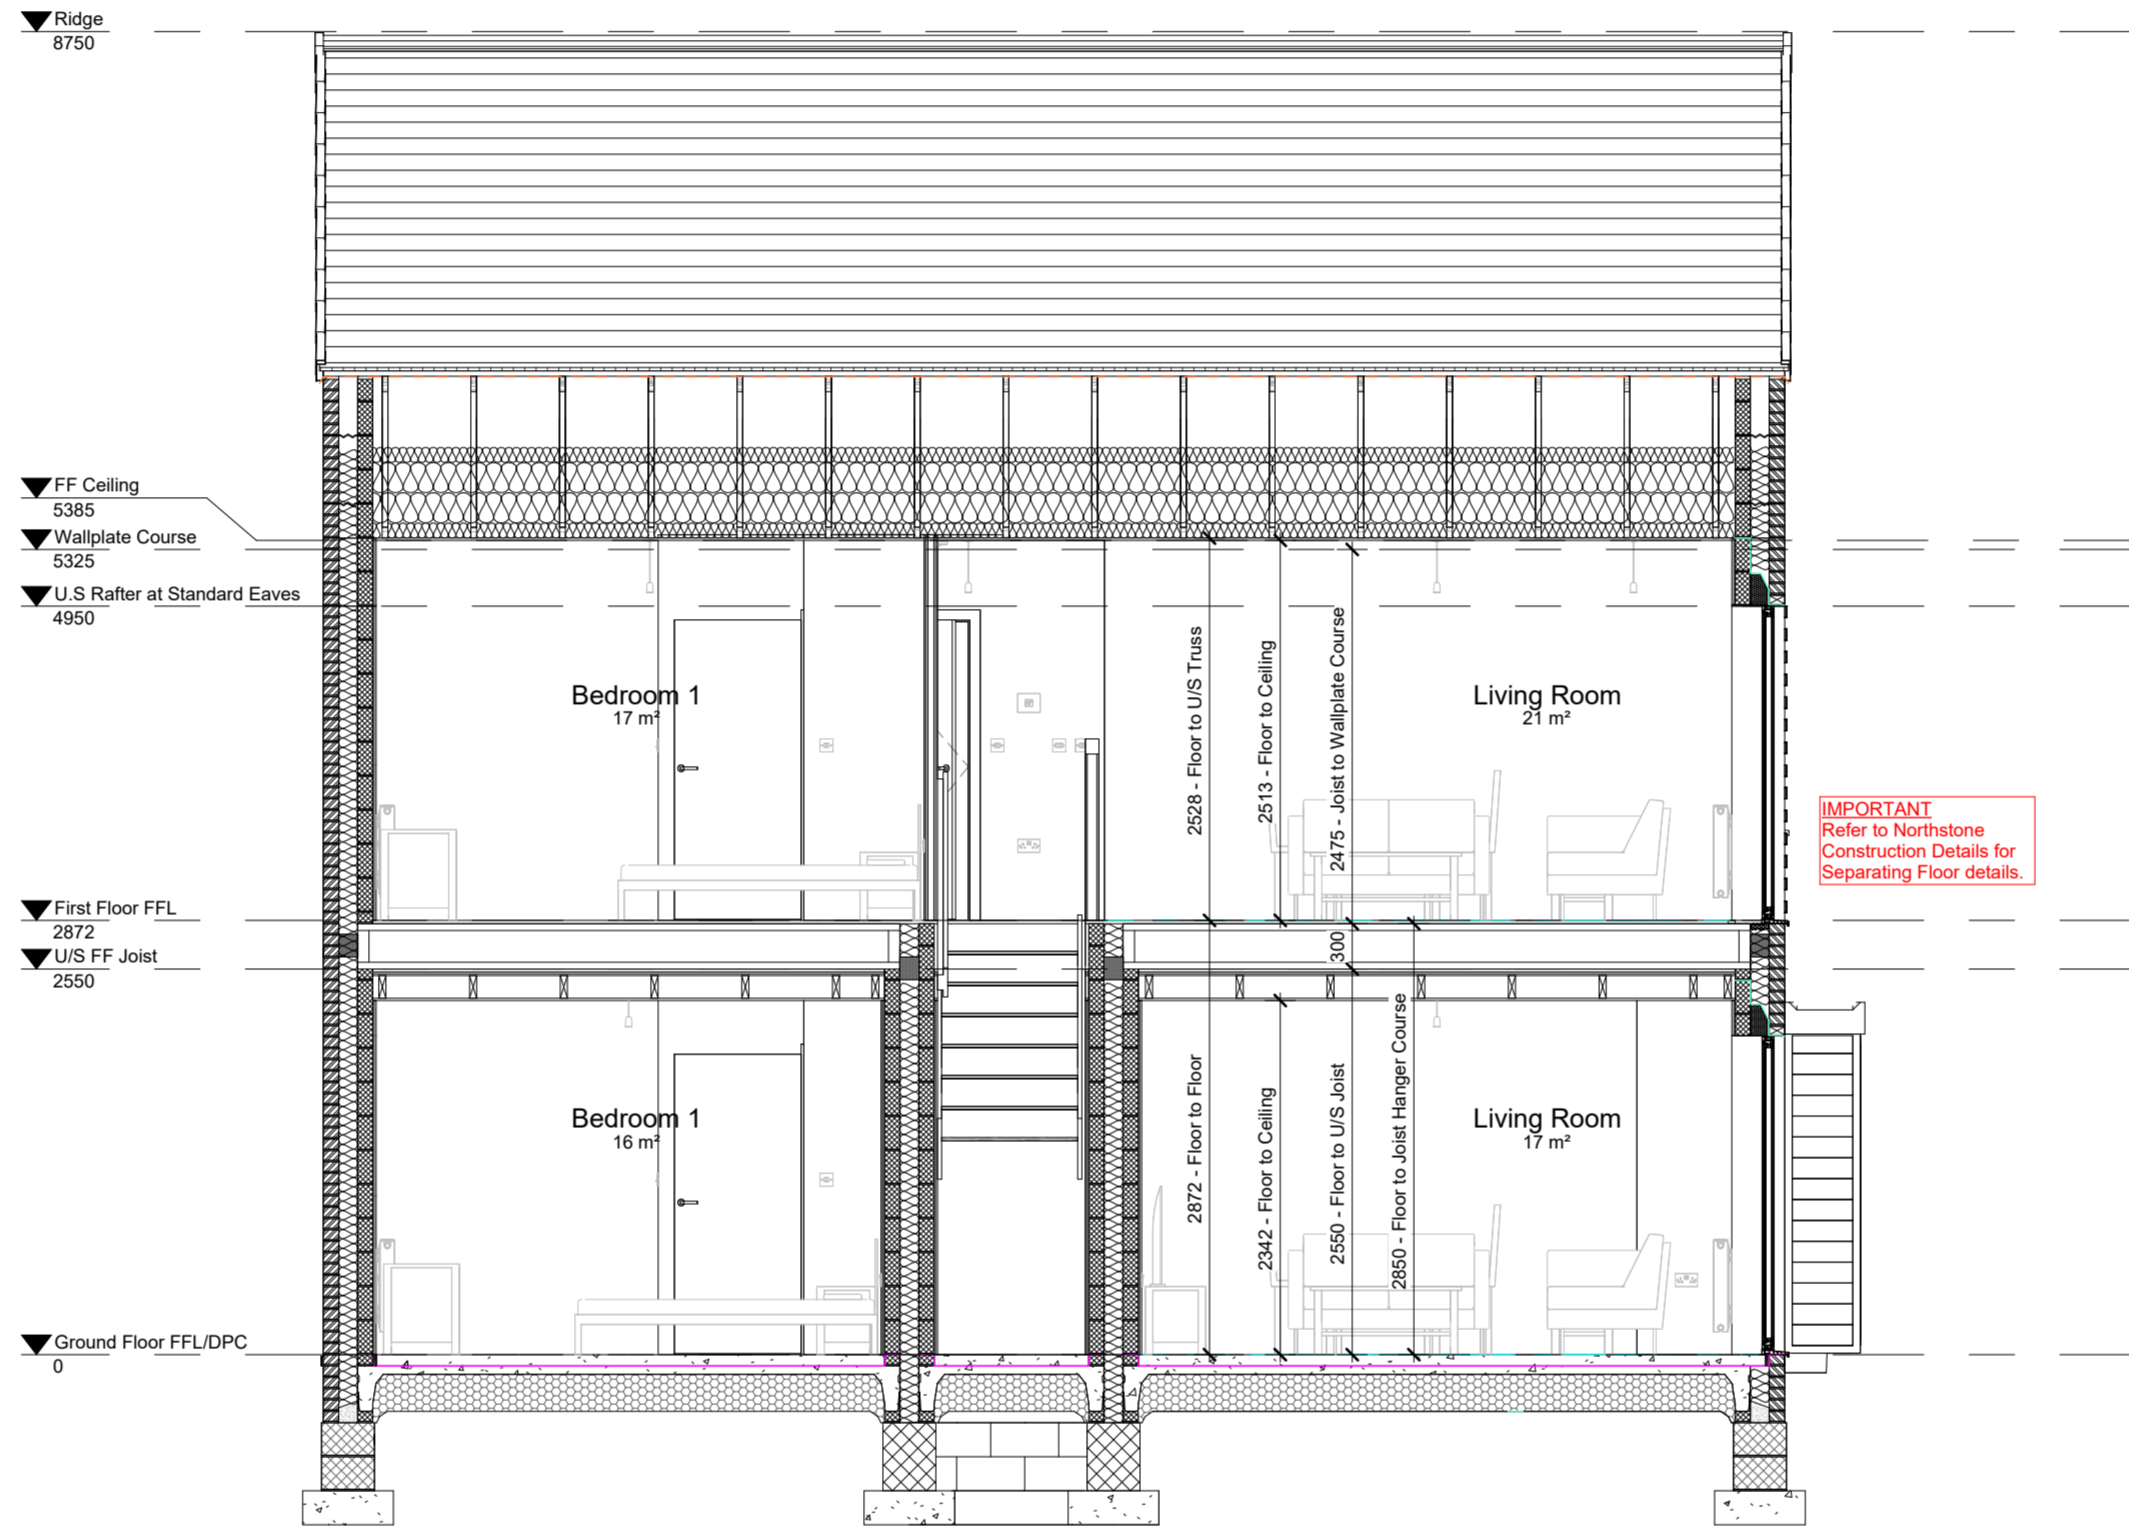

**751. Section B-B**  
1 : 50

**IMPORTANT**  
Refer to Northstone  
Construction Details for  
Separating Floor details.

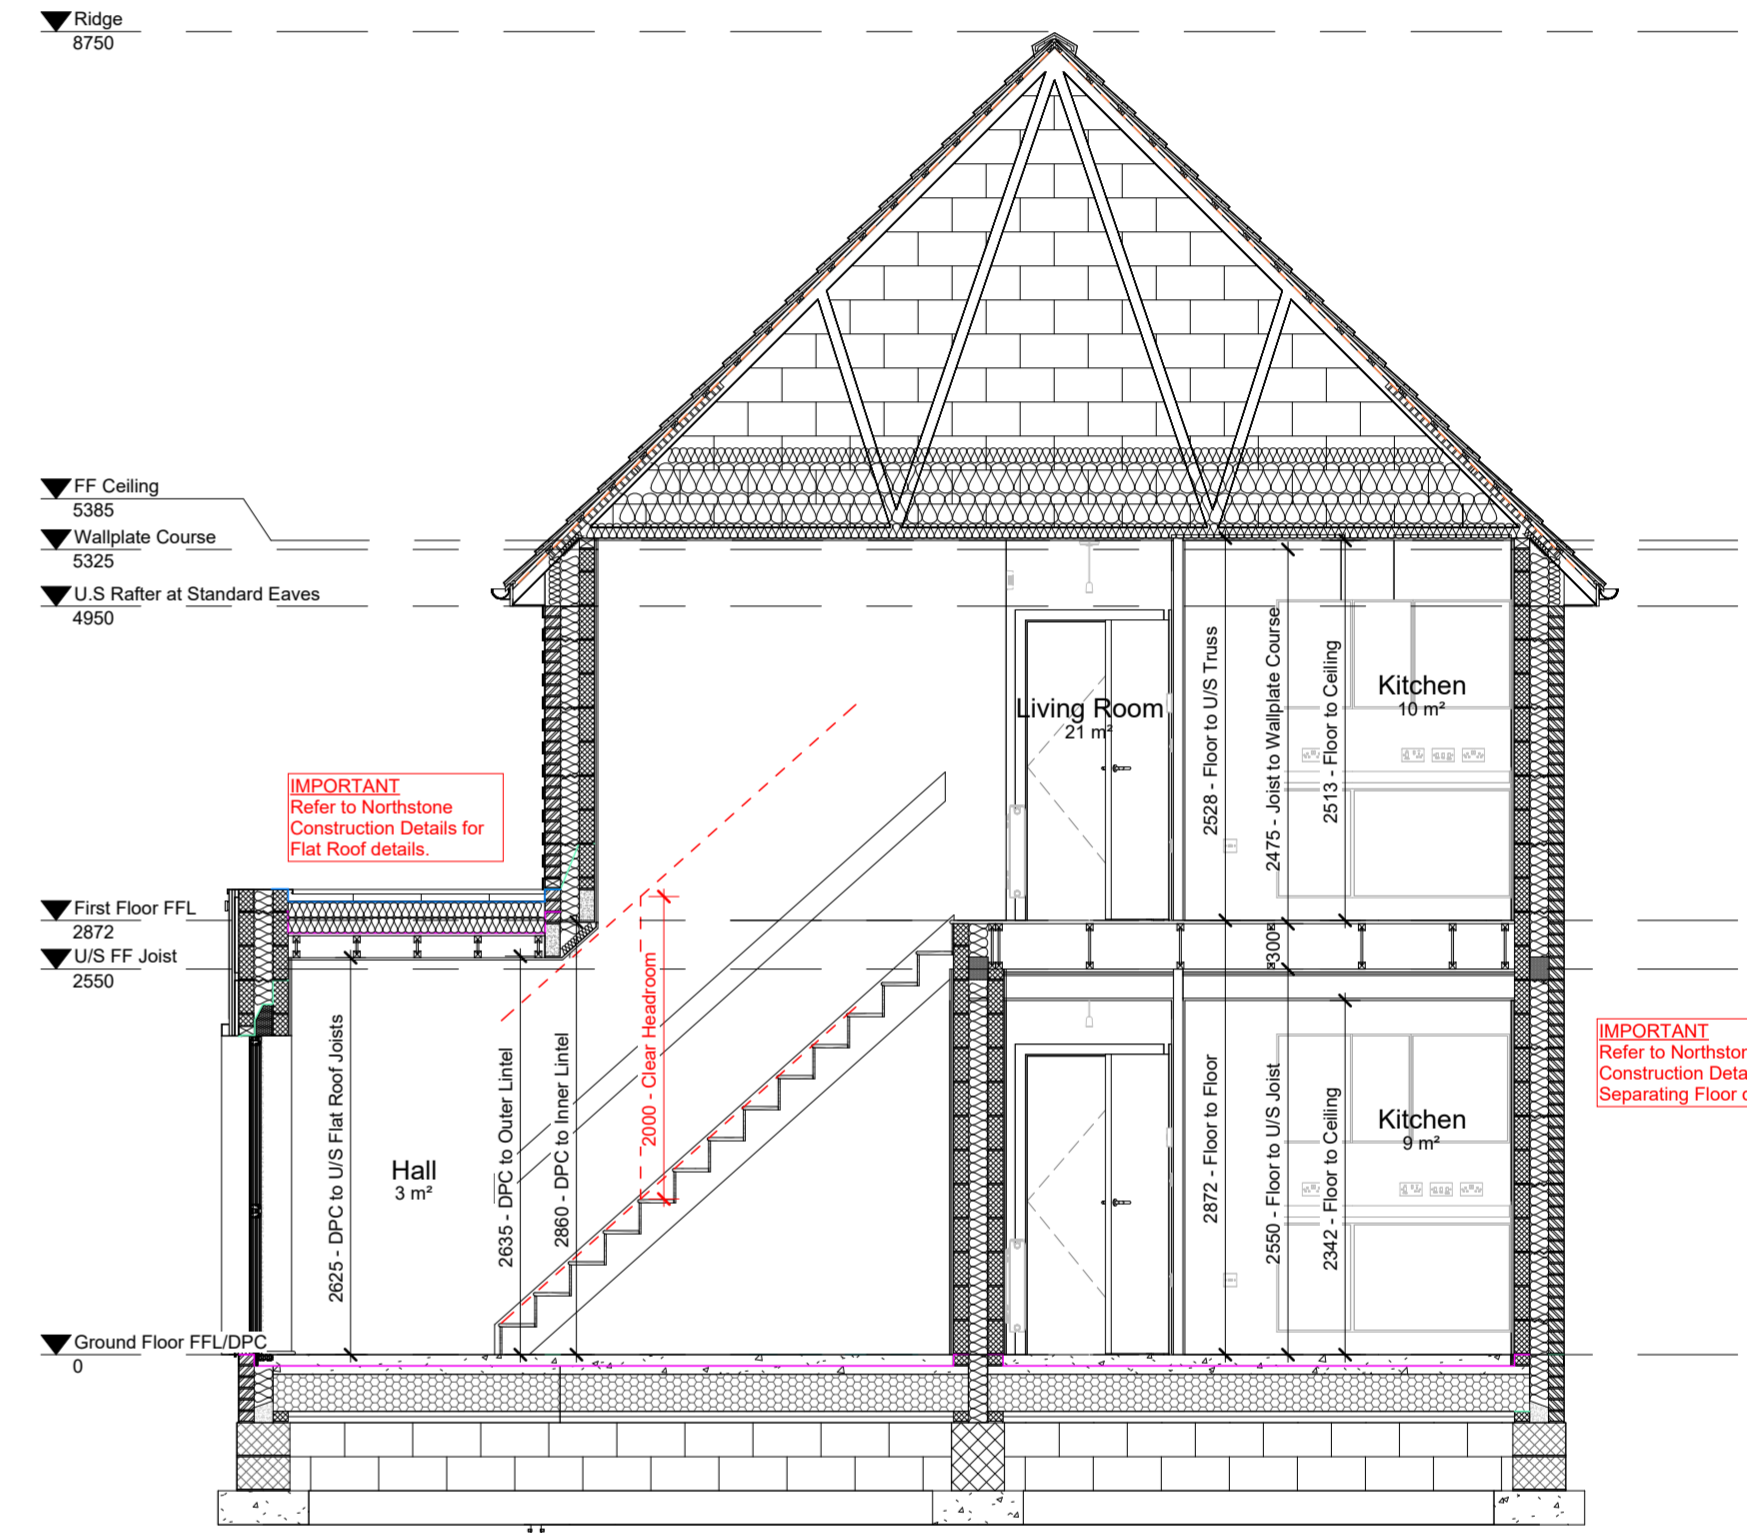

**752. Section C-C**  
1 : 50

**IMPORTANT**  
Refer to Northstone  
Construction Details for  
Separating Floor details.

A	General updates as detailed within issue email dated 02.02.2024	Feb 2024
-	Construction Issue	July 2023

Rev	Description	Date
-----	-------------	------

**NORTHSTONE**  
Peel L&P  
Salford  
M50 2TG

**CONSTRUCTION**

PROJECT  
**Gen2 House Type Portfolio**

DRAWING NAME  
**544/633-V7-AR (As) - Affordable Rented Sections**

DRAWING NUMBER <b>544/633-750</b>	DESIGNATION <b>AR</b>	DRAWN BY <b>Design</b>
DATE <b>June 2023</b>	SCALE (@ A1) <b>1 : 50</b>	REV <b>A</b>

**Notes:**

- All dimensions to structure unless otherwise stated.
- Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.
- Any discrepancies to be reported to Northstone Technical prior to commencement of works.
- All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.

**DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.**