V0 Drawing Register						
Sheet Number	Sheet Name	Rev	Revision Date			
544/633-000	Cover Page & Design Risk Register	Α	Feb 2024			
544/633-010	Foundation & Sub-Floor Plans	Α	Feb 2024			
544/633-020	Floor Plans	Α	Feb 2024			
544/633-030	MEP Plans	А	Feb 2024			
544/633-040	Elevations	Α	Feb 2024			
544/633-050	Sections	А	Feb 2024			



Design Risk Register							
Element Comments							
Lifting Operations	To avoid injury when handling heavy components, specialist handling equipment is to be utilised for the positioning of heavy objects/materials. Large glazing to be installed with specialist lifting equipment by trained personnel. Protection barriers to be provided to prevent mechanical damage following installation.						
Craneage	Crane supplier to be satisfied of adequate support to outriggers, correct lifting positions to be established to avoid slippage of sheet materials during lifting and placement. Sub-contractors and suppliers to 'design in' lifting eyes and identify weights of heavy items at drawing approval stage. All RAMS to be obtained and approved prior to any lifting operations being carried out.						
Ground Floor Construction	Mechanical Lifting equipment to be utilised to position pre-cast concrete floor planks. Manual handling assessment to be carried out.						
Working at Height	Install temporary scaffolding barrier to exposed edges of upper floors including toe boards throughout the build period. Provide scaffolding to all areas requiring placement of materials and finishing to all areas above ground level. Scaffolding to be positioned to avoid the need to overreach causing strain injury when placing materials. Protect areas below high level working from falling debris. Ensure space required for crane is achievable and suitable hard standing is provided. Ensure maximum fall height when fixing trusses into position is 2 metres by utilising appropriate safety measures and equipment.						
Stairs	To prevent falls provide temporary guarding and edge protection to open well areas and keep clear during construction, eliminating the possibility of trip hazards. Stairs to be erected as early as possible during the construction process to provide vertical circulation and means of escape in case of fire.						
Masonry Construction	When working at height mechanical lifting measures required to lift brick and block packs into position to reduce manual handling.						
Lintels	Manual Handling Assessments to be carried out for all lintels, light craneage to be utilised for lintels considered too heavy for manual handling.						
Structural Steelwork	Mechanical lifting measures required to reduce manual handling. Ensure required space for crane is achievable and suitable hard standing is provided.						
Windows / Structural Openings	Any structural apertures below 800mm to be fitted with temporary guarding to prevent falls. Any structural apertures below 800mm and extending to floor level to be fitted with temporary guarding and edge protection to prevent falls. Mechanical lifting measures and frame and glazing fitted separately to be considered for installation of large windows and combination door & window frames. Window manufacturer to be consulted regarding best means of installation.						
Window Cleaning & Maintanence	'Easy Clean' hinges are not an option due to the top hung design to a majority of the windows, as such windows should be cleaned from ground level using a telescopic 'reach & wash' system. All windows used to be Aluminium or UPVC frames to eliminate the need for future decoration.						
Roof Construction	Ensure space required for crane is achievable and suitable hard standing is provided. Ensure maximum fall height when fixing trusses into position is 2 metres by utilising appropriate safety measures and equipment						

544/633-V0-AR (As) - Affordable Rented

General updates as detailed within issue email dated 02.02.2024	Feb 2024
Construction Issue	July 2023
Description	Data

NORTHSTONE

Peel L& Salford M50 2T0

CONSTRUCTION

PROJECT

Gen2 House Type Portfolio

DRAWING NAME

544/633-V0-AR (As) - Affordable Rented Cover Page & Design Risk Register

DRAWING NUMBER		DESIGNATION	DRAWN BY
544/633-000		AR	Design
DATE	SCALE (@ A3	3)	REV
June 2023			Α

lotes:

- All dimensions to structure unless otherwise stated.
- Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.
- Any discrepancies to be reported to Northstone Technical prior to commencement of works.
- All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.

DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.

FOUNDATION & SUB-FLOOR LEGEND Brick Face External Wall OUTSIDE - 102.5mm clay facing brickwork as site specific materials plan - 125mm clear cavity - 100mm block as specification INSIDE 100mm Sleeper Wall - 100mm concrete block as engineers details 215mm Sleeper Wall - 100mm concrete block as engineers details - 15mm cavity fully filled with mortar - 100mm concrete block as engineers details Trench Block - 350mm concrete trench block as engineers details Services & Ventilation OSVP 110mm Soil and Vent Pipe ORWP Rainwater pipe as specification OGULLY Sealed floor gully for level access shower → ^{Water} Water Entry Point Data Lead In Data Entry Point E ── Electric Entry Point G — Gas Entry Point Sub-Floor Telescopic Vent Floor Finish & Span Extent of Floor Screed Span of Ground Floor Construction


Always refer to site investigation report and engineers details for any gas membrane requirements. **Sub-Floor Void Ventilation Schedule** Building Building Ventilation Minimum Number of Vents Required of Vents Required Vents Provided 70.59 m² | 36.69 | 55029 mm² | 12 * Based on 500mm2/m2 of Floor Area

1. Refer to engineers details and specification for all block

strengths.

Key to be read in conjunction with construction specification.

Expansion and movement joints, bed reinforcement and wind posts to engineers details.

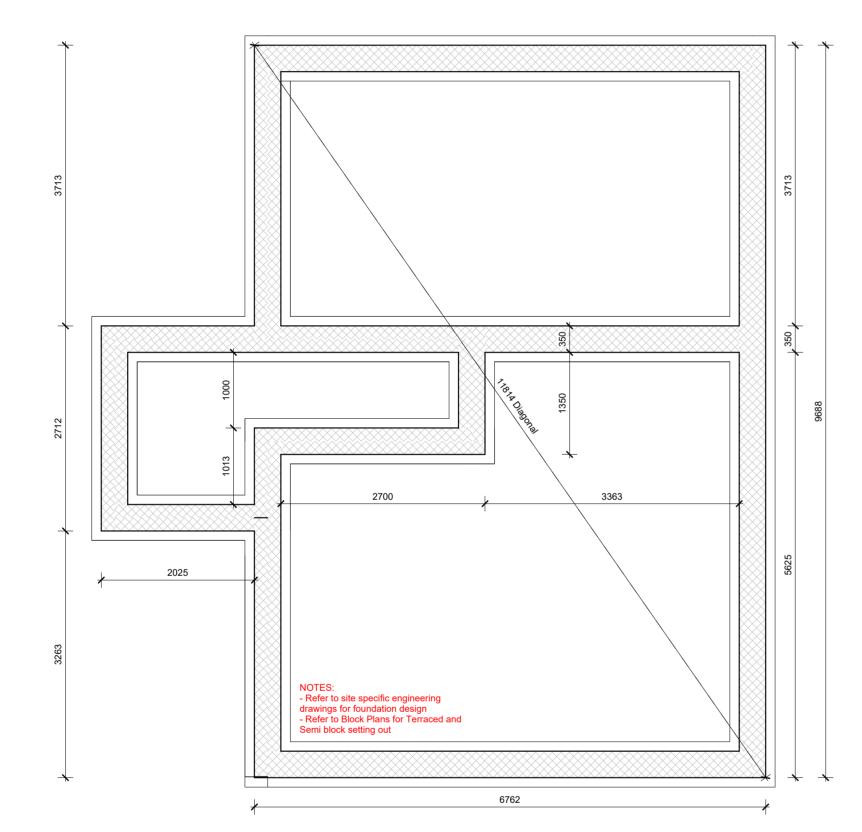


1:50

010. Foundation Plan





098. Golden Brick Elevation

1:100

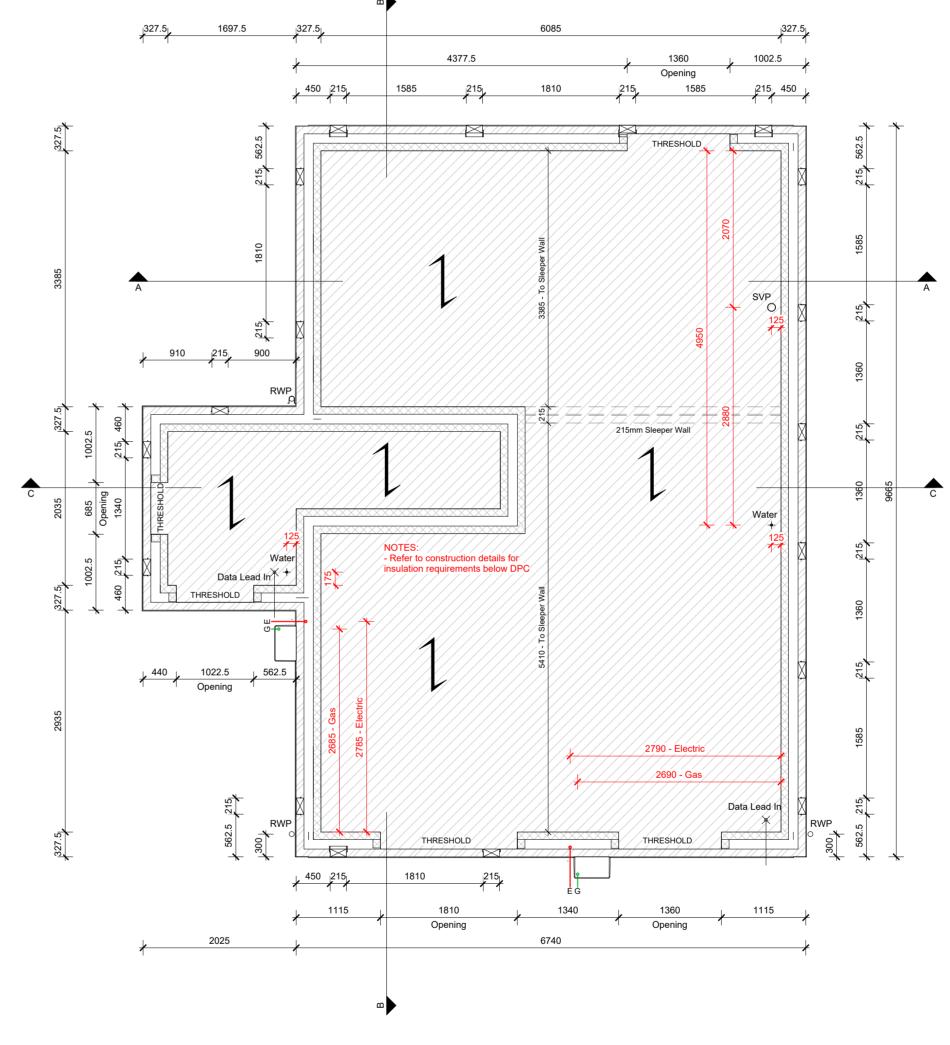


011. Sub-Floor Setting Out 1:50

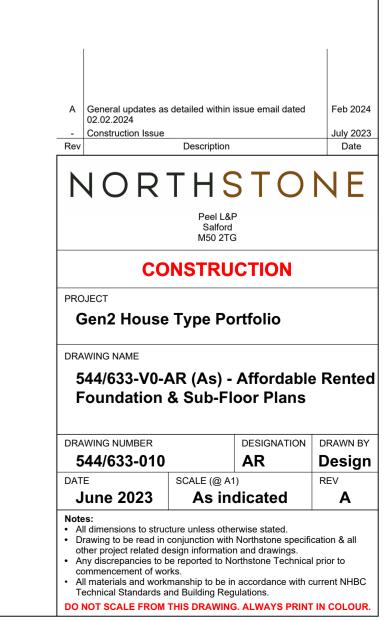

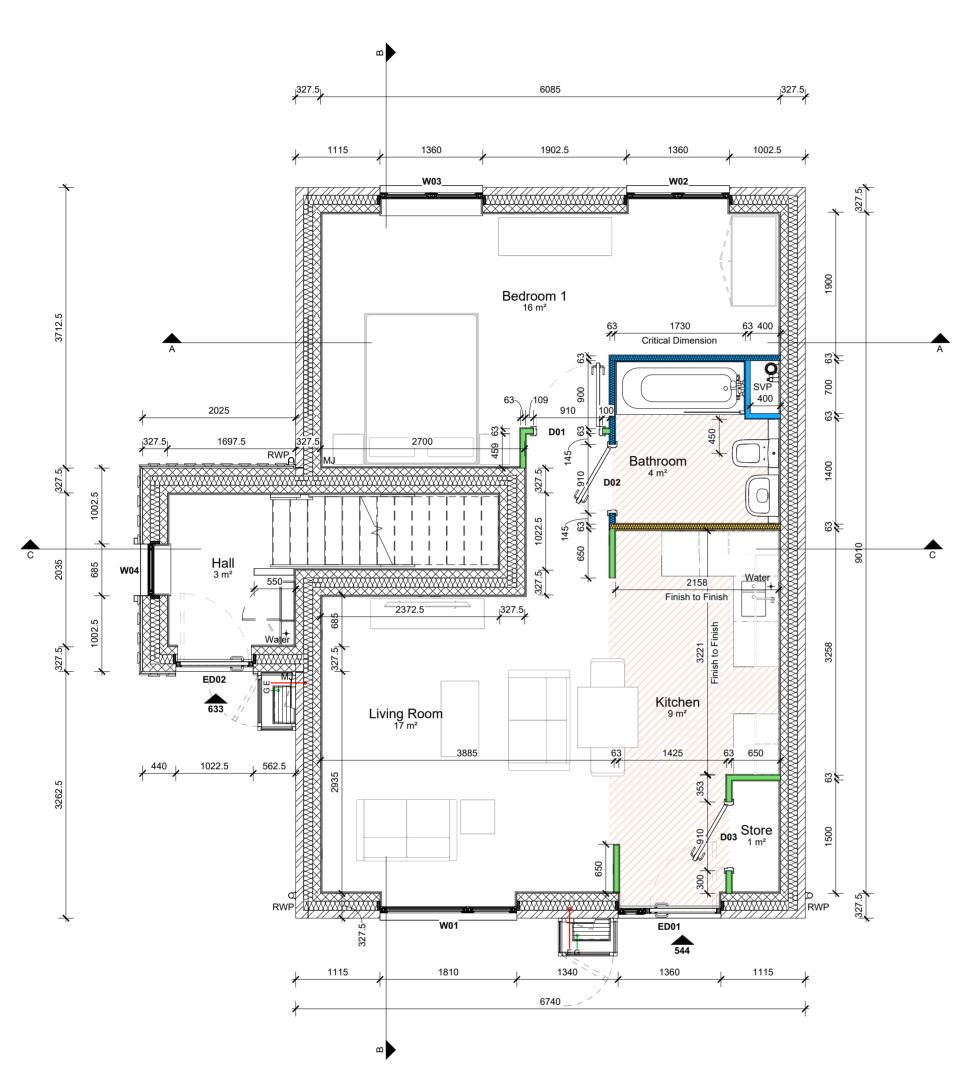

020. Ground Floor Setting Out 1:50

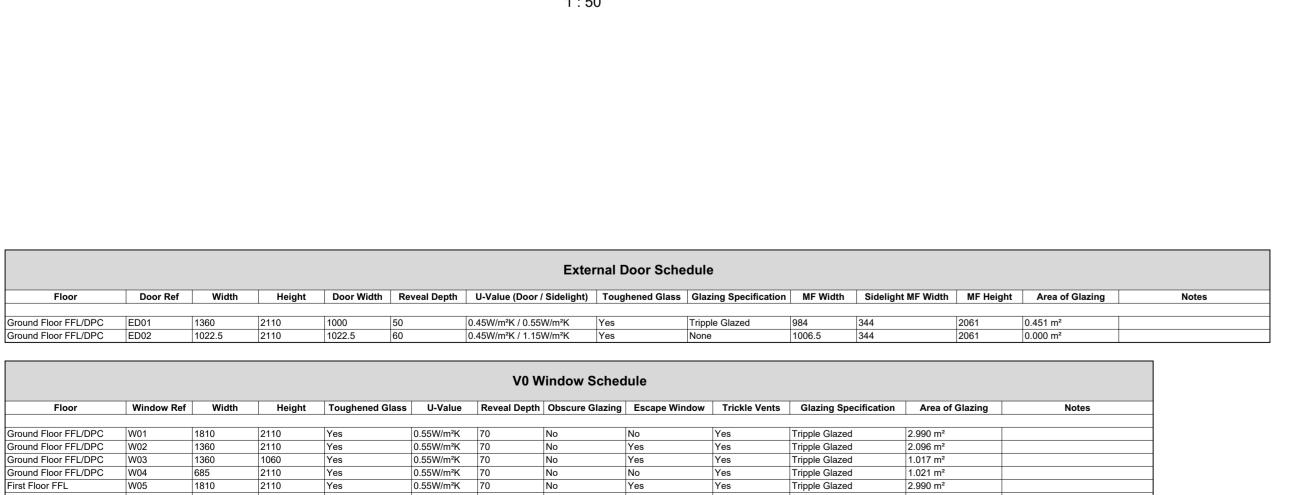

1.017 m²

1.021 m²

2.990 m²

2.096 m²

1.438 m²

Tripple Glazed


Tripple Glazed


11101110011112	1100	1000	1000	0.00	77,1111	110	100	1100	TTIPPIO GIUZOU	1.017 111
Internal Door Schedule										
Floor	Door Ref	From Room	To Room	Structural Width	Structural Height	Leaf Width	Casing Depth	Fire Rating	Self Closer	Notes
Ground Floor FFL/DPC	D01	Bedroom 1	Living Room	910	2017	838	96	Not Fire Rated	No	
Ground Floor FFL/DPC	D02	Living Room	Bathroom	910	2017	838	96	Not Fire Rated	No	
Ground Floor FFL/DPC	D03	Kitchen	Store	910	2017	838	96	Not Fire Rated	No	
First Floor FFL	D04	Bedroom 1	Living Room	910	2017	838	96	Not Fire Rated	No	
First Floor FFL	D05	Living Room	Bathroom	910	2017	838	96	Not Fire Rated	No	
First Floor FFL	D06	Kitchen	Store	910	2017	838	96	Not Fire Rated	No	

0.55W/m²K

0.55W/m²K

0.55W/m²K 0.55W/m²K

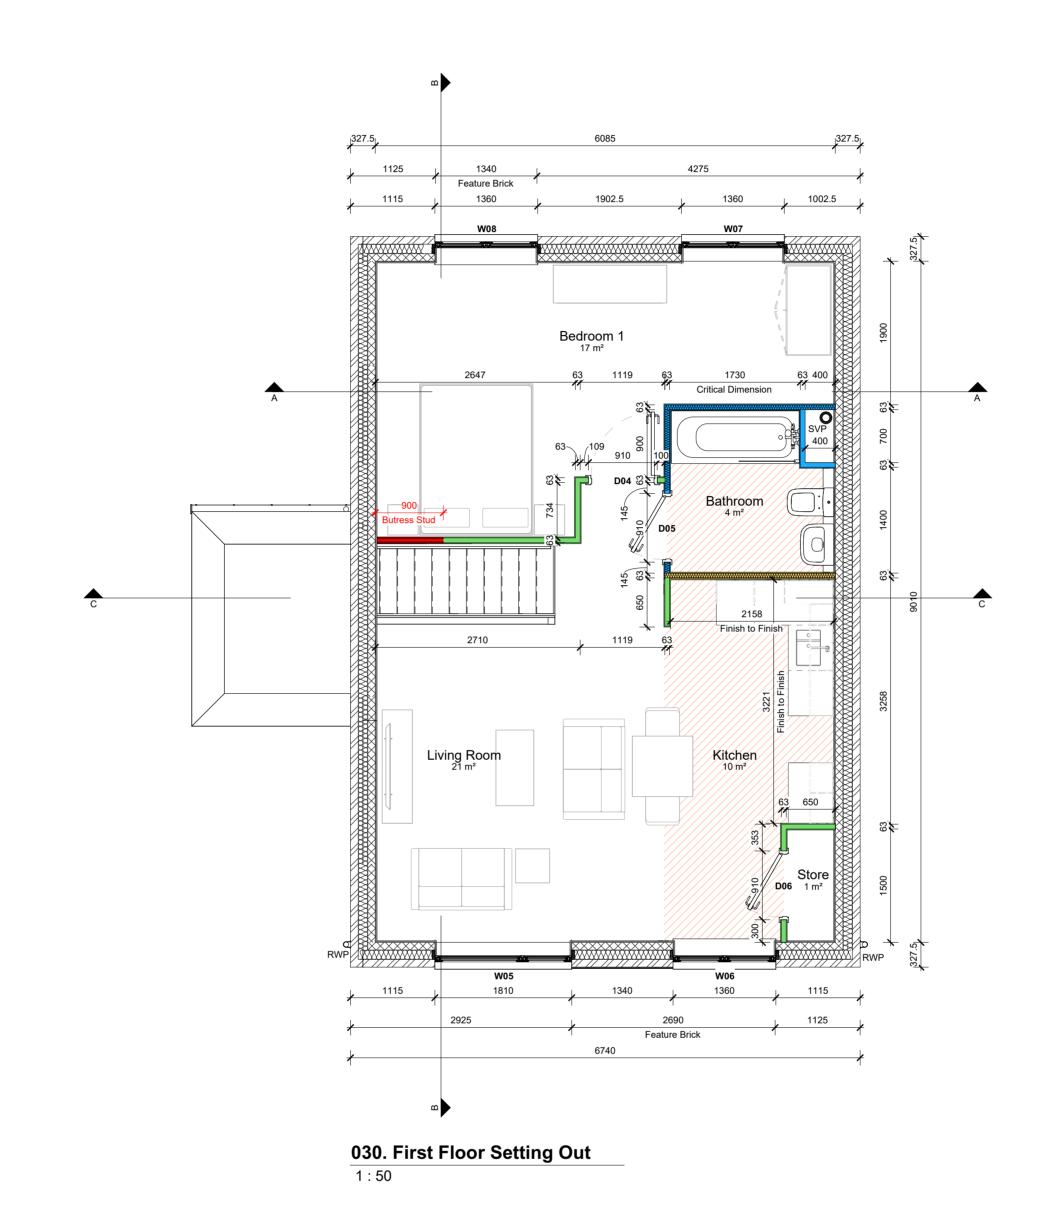

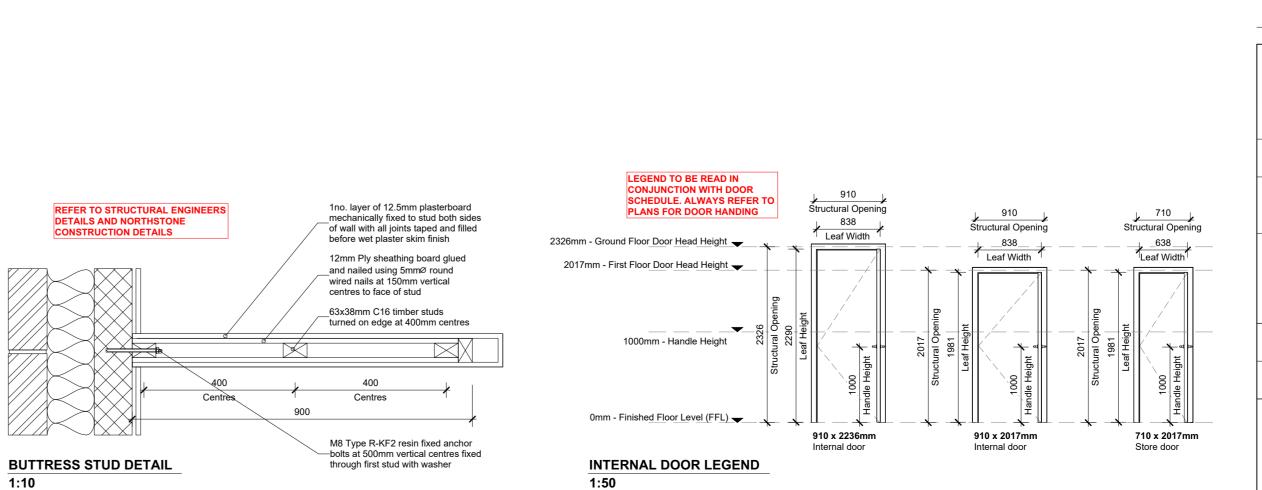

- 102.5mm clay facing brickwork to site specific materials plan - 125mm cavity fully filled with insulation as specification - 100mm block as specification - 12.5mm plasterboard on 10mm adhesive dabs, all joints taped and filled before wet plaster Timber Cladding External Wall - 19x150mm Timber Board on Board Cladding - 100mm block outer leaf as specification - 125mm cavity fully filled with insulation as specification - 100mm block as specification - 12.5mm plasterboard on 10mm adhesive dabs, all joints taped and filled before wet plaster NON LOADBEARING STUD PARTITIONS General Partition - 63x38mm C16 studwork at max 600mm centres - Pattress between stud with 12mm Ply where required for MEP fixtures and fittings Centres - 1no. layer of 12.5mm plasterboard mechanically fixed to stud both sides of wall with all joints taped and filled before wet plaster skim finish Patressed Partition Wall - 63x38mm C16 studwork at max 600mm centres 600 with suitable noggins
Centres - 12mm ply mechanical - 12mm ply mechanically fixed to stud on load-bearing side of wall, (Kitchens etc.) - 1no. layer of 12.5mm plasterboard mechanically fixed to stud both sides of wall with all joints taped and filled before wet plaster skim finish Acoustic & Fire Rated Partition 30 Min - 63x38mm C16 studwork at max 600mm centres with suitable noggins - Voids between studwork fully filled with 60mm Rockwool Flexi or similar approved mineral wool. - Pattress between stud with 12mm Ply where required for MEP fixtures and fittings - 1no. layer of 12.5mm plasterboard mechanically fixed to stud both sides of wall with all joints taped and filled before wet plaster skim finish - Achieves R_w40dB in accordance with AD:E - Achieves REI 30 fire resistance in accordance with British Gypsum White Book Wet-Room Partition (WC / Bathroom / En-suite) - 63x38mm C16 studwork at max 400mm centres with suitable noggins - Pattress between stud with 12mm Ply where required for MEP fixtures and fittings M N N - 12.5mm moisture resistant plasterboard mechanically fixed to stud onwet-room side of wall with all joints taped and filled prepared for tiling or wet plaster skim finish - 12.5mm standard plasterboard mechanically fixed to stud on **dry-room side** of wall where required with all joints taped and filled before wet Framing Wall - 63x38mm C16 studwork wide face out at max 400 400 400 400mm centres with suitable noggins - 1no. layer of 12.5mm plasterboard mechanically fixed to stud on room side of wall with all joints taped and filled before wet plaster skim finish Anchored/Buttress Stud Partition Refer to structural engineers details and 400 , 400 Northstone construction details.


Centres Centres Buttress Studs and Windposts not required on party walls. Insulation Between Studs - Voids between studwork fully filled with 60mm

As Above Wall Types

Rockwool Flexi or similar approved mineral wool where indicated on drawing for AD:E compliance - Achieves R_w40dB in accordance with AD:E Achieves REI 30 fire resistance in accordance with British Gypsum White Book Refer to engineers details and specification for all block strengths.
 Key to be read in conjunction with construction specification.
 Expansion and movement joints, bed reinforcement and wind posts to engineers details.
4. All dimensions are to structure unless otherwise noted. FLOORING LEGEND LVT Flooring - Vinyl flooring applied as Northstone finishes specification and relevant customer options

WALL TYPE LEGEND Brick Face External Wall

- Carpet per Northstone finishes specification

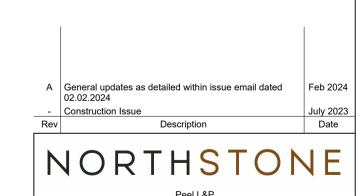

Peel L&P Salford M50 2TG

CONSTRUCTION

Gen2 House Type Portfolio


544/633-V0-AR (As) - Affordable Rented Floor Plans


DESIGNATION DRAWN BY


544/633-020	AR	Design					
DATE	SCALE (@ A1)		REV				
June 2023	As inc	Α					
Notes: • All dimensions to structure unless otherwise stated. • Drawing to be read in conjunction with Northstone specification & all							


other project related design information and drawings.


Any discrepancies to be reported to Northstone Technical prior to commencement of works. All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations. DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.

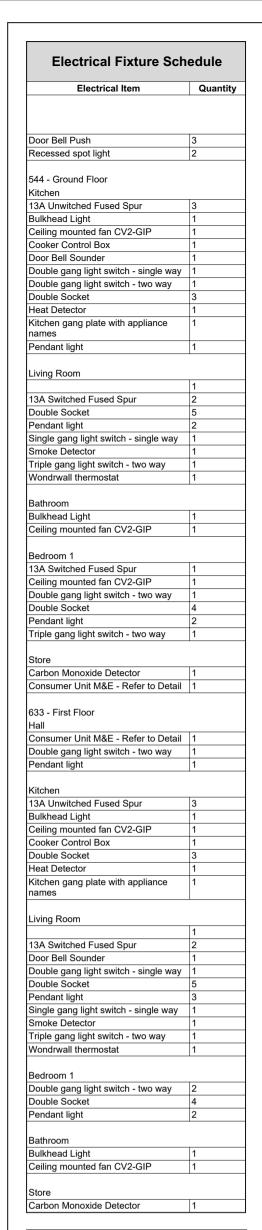




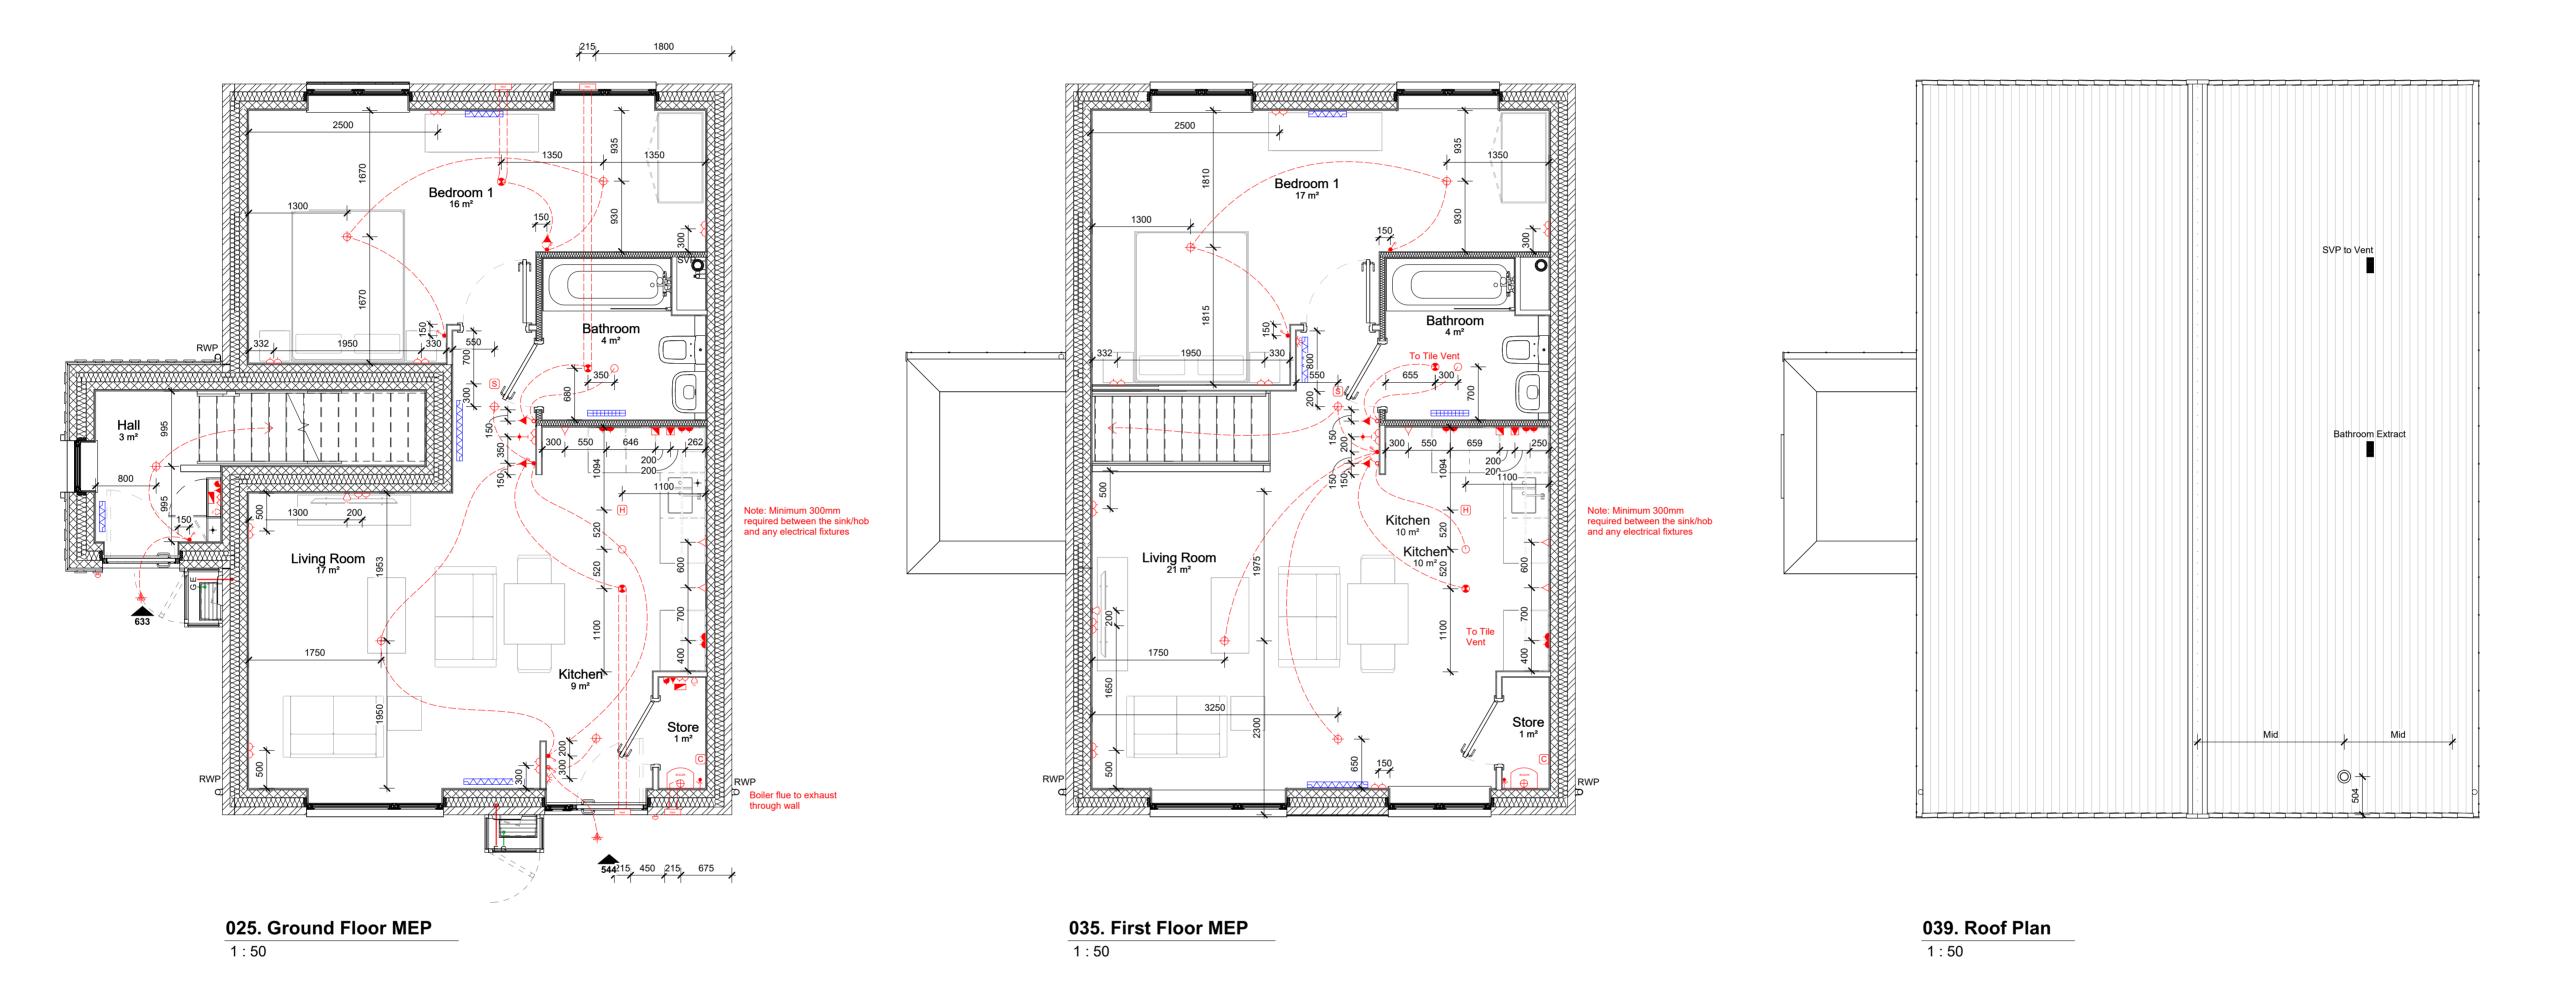

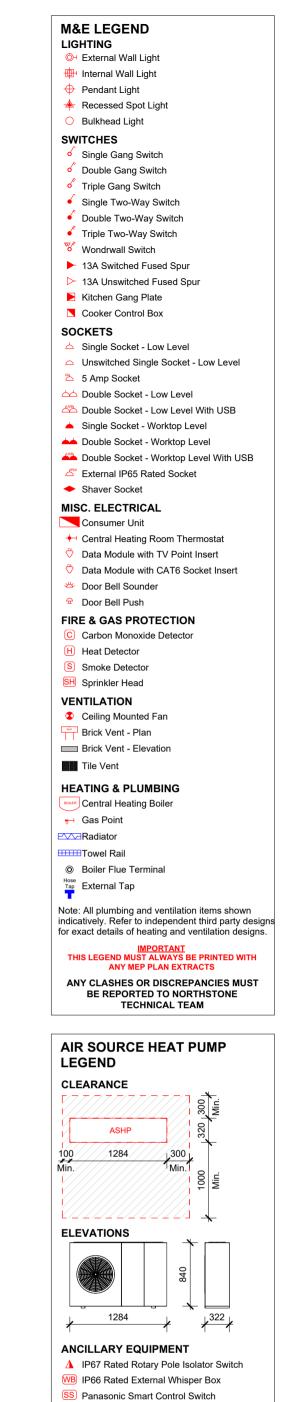


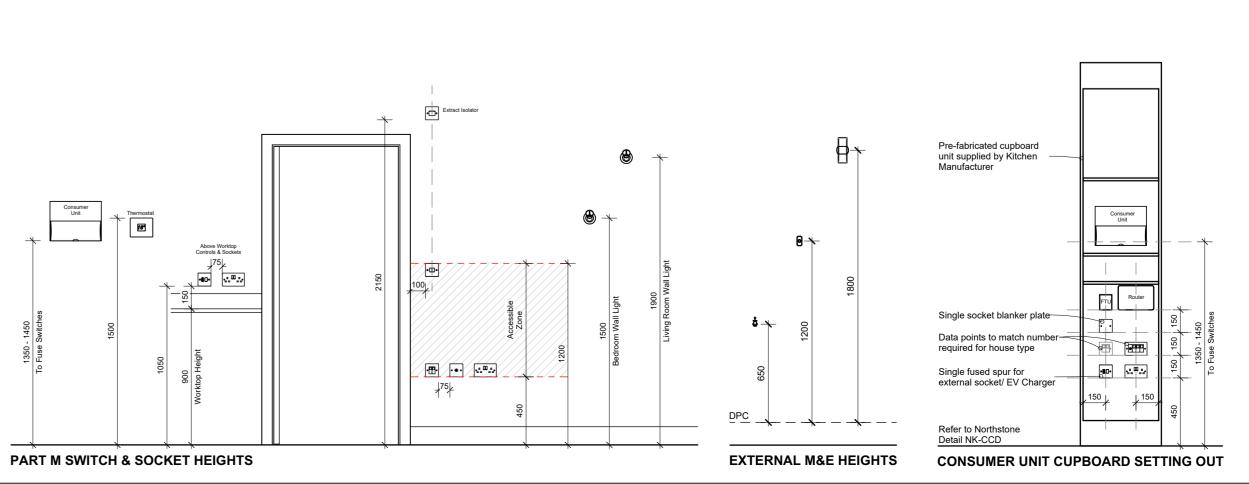

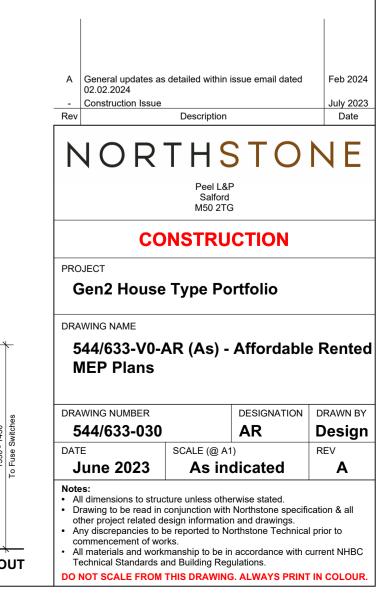

Note: Air Source Heat Pump, (ASHP), and ancillary equipment shown indicatively. Refer to independent third party designs for exact details of ASHP System



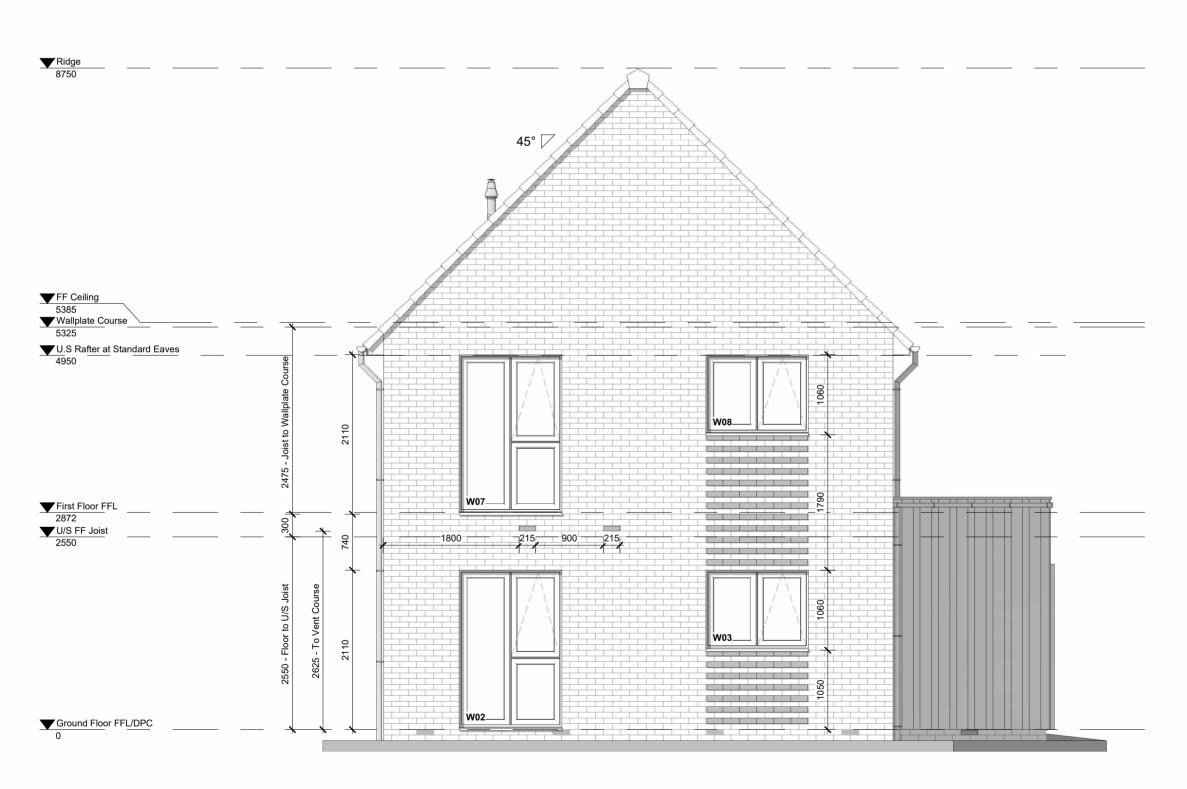

042. Rear Elevation 1:50

CRITICAL GLAZING DIAGRAM CRITICAL GLAZING DIAGRAM

Critical glazing locations in internal and external walls for windows, doors and side lights in accordance with BS 6206 and all currents building regulations. Shaded area in located critical locations to which the requirements of Approved Document K(4)

Unobstructed opening casement area to be at least 0.33M² and at least 450mm high and 450mm wide. Bottom of windows to be not more than 1100mm and not less than 800mm above the floor. Escape windows to have non lockable fasteners and hinged to achieve the minimum required opening. current building regulations. Shaded area indicates critical locations to which the requirements of Approved Document K(4) applies, (i.e. glazing falling within zones 1, 2, 3, 4, 5, 6 & 8).

All glazing in critical locations should:
a) If broken, will break safely.
b) Be sufficiently robust to resist breaking.


EXTERNAL M&E HEIGHTS

Schedules to be read in conjunction with all project specification documents, floor plans and elevations
Structural opening size includes any sidelights
Frame set back is taken from front face of brick
Refer to manufactures information for detailed lintel schedules
All accessible windows and doors to be PAS24 tested to comply with Part Q of building regulations
All dimensions to be checked on site prior to manufacture


Escape from upper storey a maximum of 4.5m above ground level: ALL inner rooms where applicable and all first floor habitable rooms (excluding kitchens) to be provided with an escape window (or external door) which complies with Approved Document B1 Section 2 Paragraph 2.2. Dwellings with one storey more than 4.5m above ground level: A protected stairway should be provided with minimum 30 minute fire resisting construction at all storey's to comply with Approved Document B1 Section 2 Paragraphs 2.5.




041. LHS Elevation 1:50

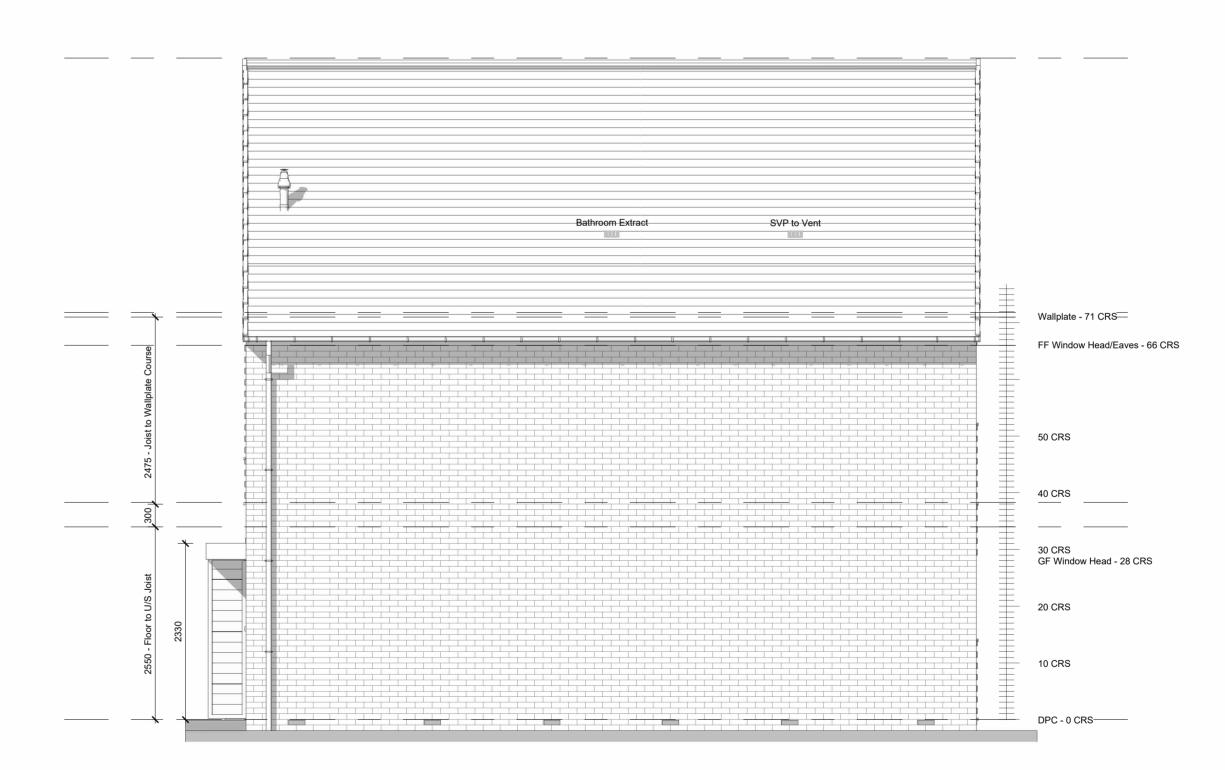



043. RHS Elevation 1:50

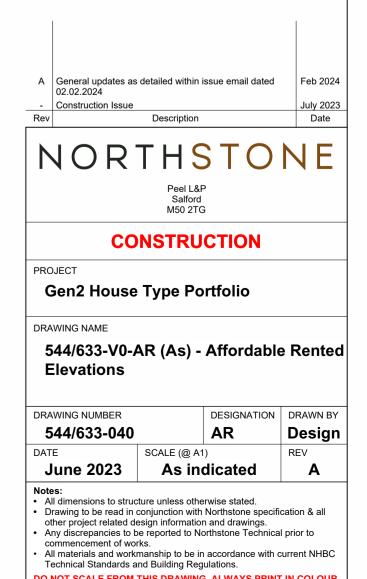

DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.



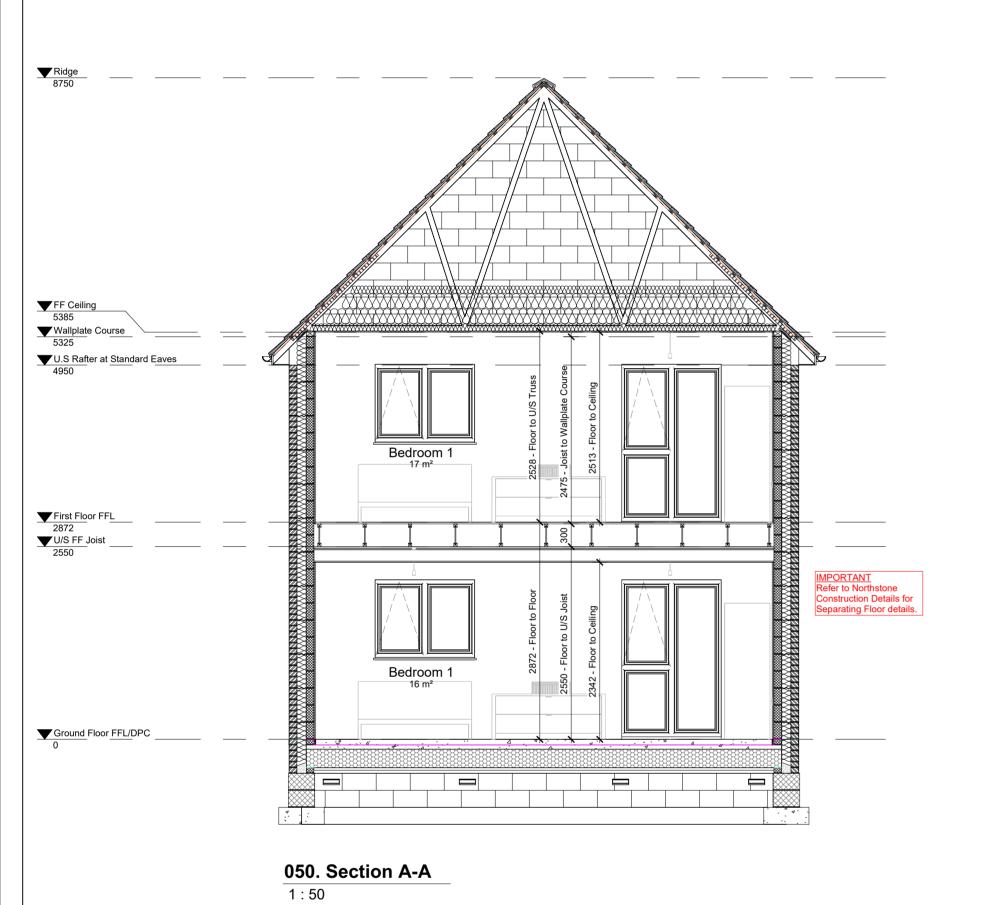

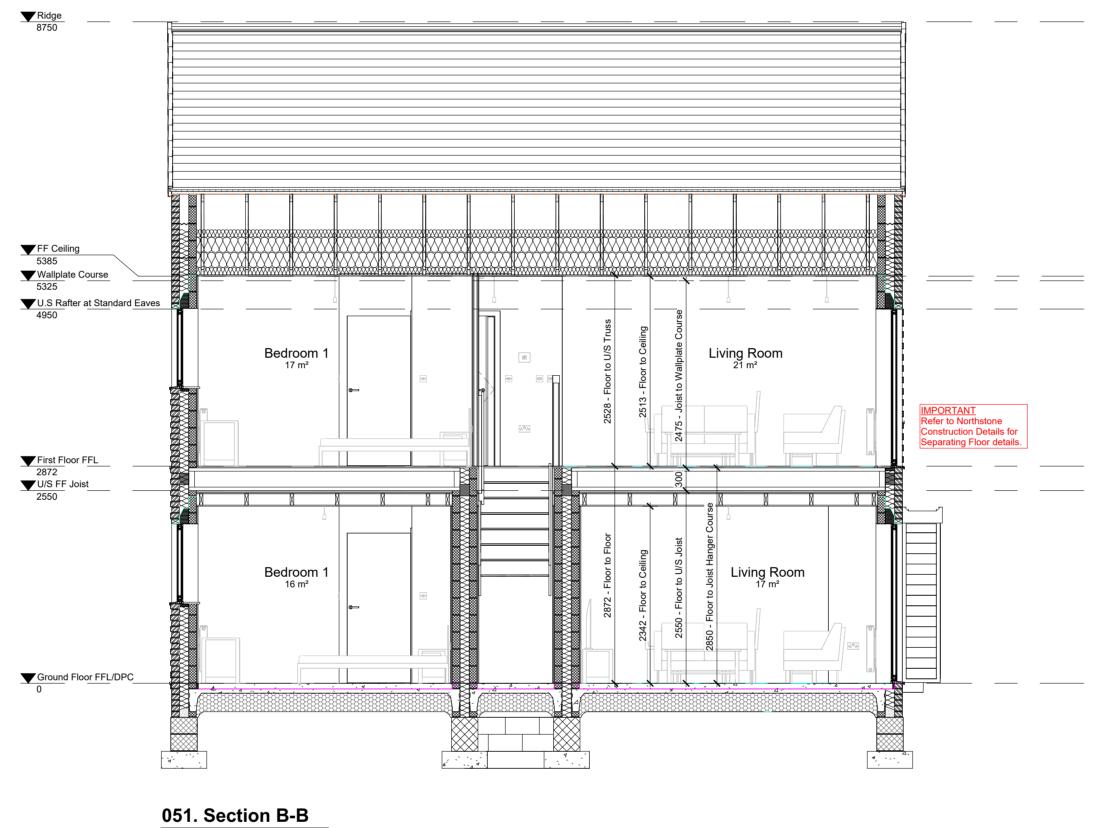

1:50

