V5 Drawing Register								
Sheet Number	Sheet Name	Rev	Revision Date					
1164-500	Cover Page & Design Risk Register							
1164-510	Foundation & Sub-Floor Plans							
1164-520	Floor Plans							
1164-530	MEP Plans							
1164-540	Elevations							
1164-550	Sections							



Design Risk Register						
Element	Comments					
Lifting Operations	To avoid injury when handling heavy components, specialist handling equipment is to be utilised for the positioning of heavy objects/materials. Large glazing to be installed with specialist lifting equipment by trained personnel. Protection barriers to be provided to prevent mechanical damage following installation.					
Craneage	Crane supplier to be satisfied of adequate support to outriggers, correct lifting positions to be established to avoid slippage of sheet materials during lifting and placement. Sub-contractors and suppliers to 'design in' lifting eyes and identify weights of heavy items at drawing approval stage. All RAMS to be obtained and approved prior to any lifting operations being carried out.					
Ground Floor Construction	Mechanical Lifting equipment to be utilised to position pre-cast concrete floor planks. Manual handling assessment to be carried out.					
Working at Height	Install temporary scaffolding barrier to exposed edges of upper floors including toe boards throughout the build period. Provide scaffolding to all areas requiring placement of materials and finishing to all areas above ground level. Scaffolding to be positioned to avoid the need to overreach causing strain injury when placing materials. Protect areas below high level working from falling debris. Ensure space required for crane is achievable and suitable hard standing is provided. Ensure maximum fall height when fixing trusses into position is 2 metres by utilising appropriate safety measures and equipment.					
Stairs	To prevent falls provide temporary guarding and edge protection to open well areas and keep clear during construction, eliminating the possibility of trip hazards. Stairs to be erected as early as possible during the construction process to provide vertical circulation and means of escape in case of fire.					
Masonry Construction	When working at height mechanical lifting measures required to lift brick and block packs into position to reduce manual handling.					
Lintels	Manual Handling Assessments to be carried out for all lintels, light craneage to be utilised for lintels considered too heavy for manual handling.					
Structural Steelwork	Mechanical lifting measures required to reduce manual handling. Ensure required space for crane is achievable and suitable hard standing is provided.					
Windows / Structural Openings	Any structural apertures below 800mm to be fitted with temporary guarding to prevent falls. Any structural apertures below 800mm and extending to floor level to be fitted with temporary guarding and edge protection to prevent falls. Mechanical lifting measures and frame and glazing fitted separately to be considered for installation of large windows and combination door & window frames. Window manufacturer to be consulted regarding best means of installation.					
Window Cleaning & Maintanence	'Easy Clean' hinges are not an option due to the top hung design to a majority of the windows, as such windows should be cleaned from ground level using a telescopic 'reach & wash' system. All windows used to be Aluminium or UPVC frames to eliminate the need for future decoration.					
Roof Construction	Ensure space required for crane is achievable and suitable hard standing is provided. Ensure maximum fall height when fixing trusses into position is 2 metres by utilising appropriate safety measures and equipment.					

1164-V5-N (As)

Description NORTHSTONE

Peel L&P Salford M50 2TG

CONSTRUCTION

Gen2 House Type Portfolio

DRAWING NAME

1164-V5-N (As) Cover Page & Design Risk Register

DRAWING NUMBER		DESIGNATION	DRAWN BY
1164-500		N	Design
DATE	SCALE (@ A3	3)	REV
Jan 2024			

- · All dimensions to structure unless otherwise stated.
- Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.
 Any discrepancies to be reported to Northstone Technical prior to commencement of works.
- All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.

DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.


FOUNDATION & SUB-FLOOR LEGEND Brick Face External Wall OUTSIDE - 102.5mm clay facing brickwork as site specific - 125mm clear cavity - 100mm block as specification INSIDE 100mm Sleeper Wall - 100mm concrete block as engineers details 215mm Sleeper Wall - 100mm concrete block as engineers details - 15mm cavity fully filled with mortar - 100mm concrete block as engineers details Trench Block - 350mm concrete trench block as engineers details Services & Ventilation O^{SVP} 110mm Soil and Vent Pipe ORWP Rainwater pipe as specification OGULLY Sealed floor gully for level access shower → Water Entry Point Data Lead In _____ Data Entry Point E ── Electric Entry Point G — Gas Entry Point Sub-Floor Telescopic Vent Floor Finish & Span Extent of Floor Screed Span of Ground Floor Construction

1. Refer to engineers details and specification for all block strengths. Key to be read in conjunction with construction specification. Expansion and movement joints, bed reinforcement and wind posts to engineers details.

Sub-Floor Void Ventilation Schedule


Always refer to site investigation report and engineers details for any gas membrane requirements.


Building Building Ventilation Minimum Number of Vents Required of Vents Required Vents Provided 63.70 m² | 32.41 | 48617 mm² | 10 * Based on 500mm2/m2 of Floor Area

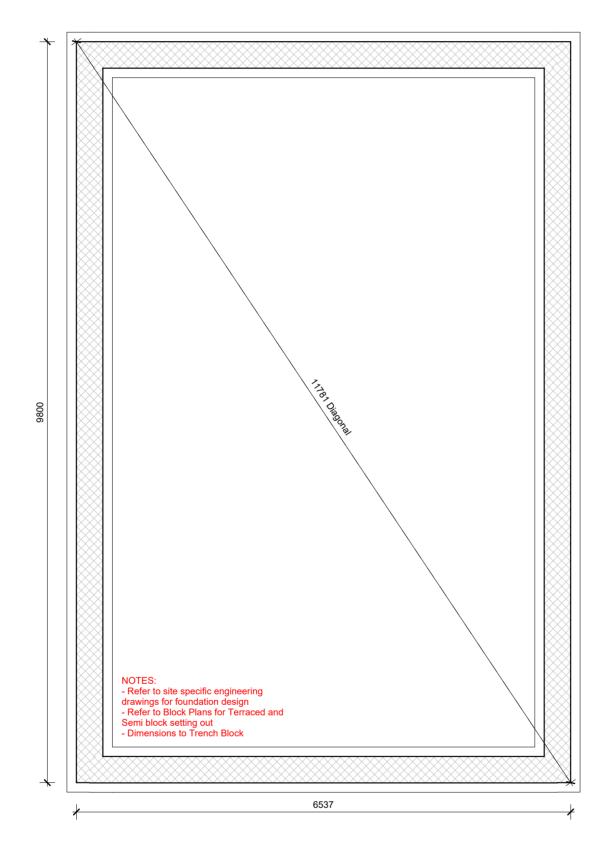

510. Foundation Plan

1:50

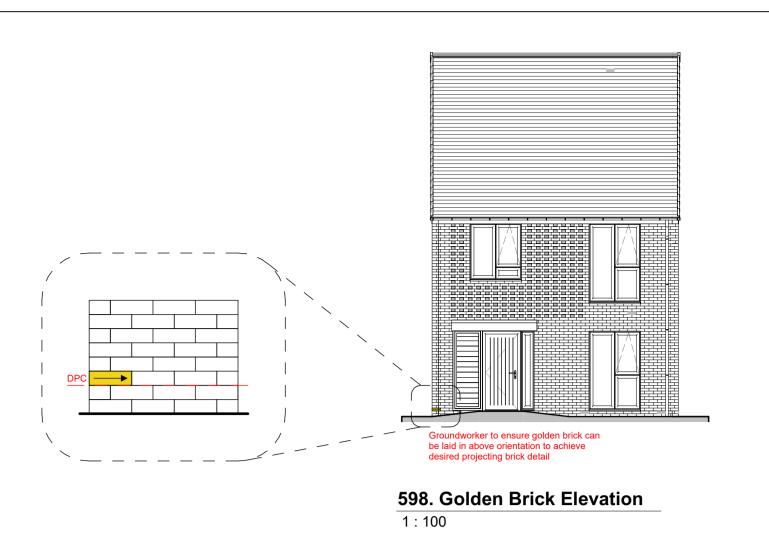

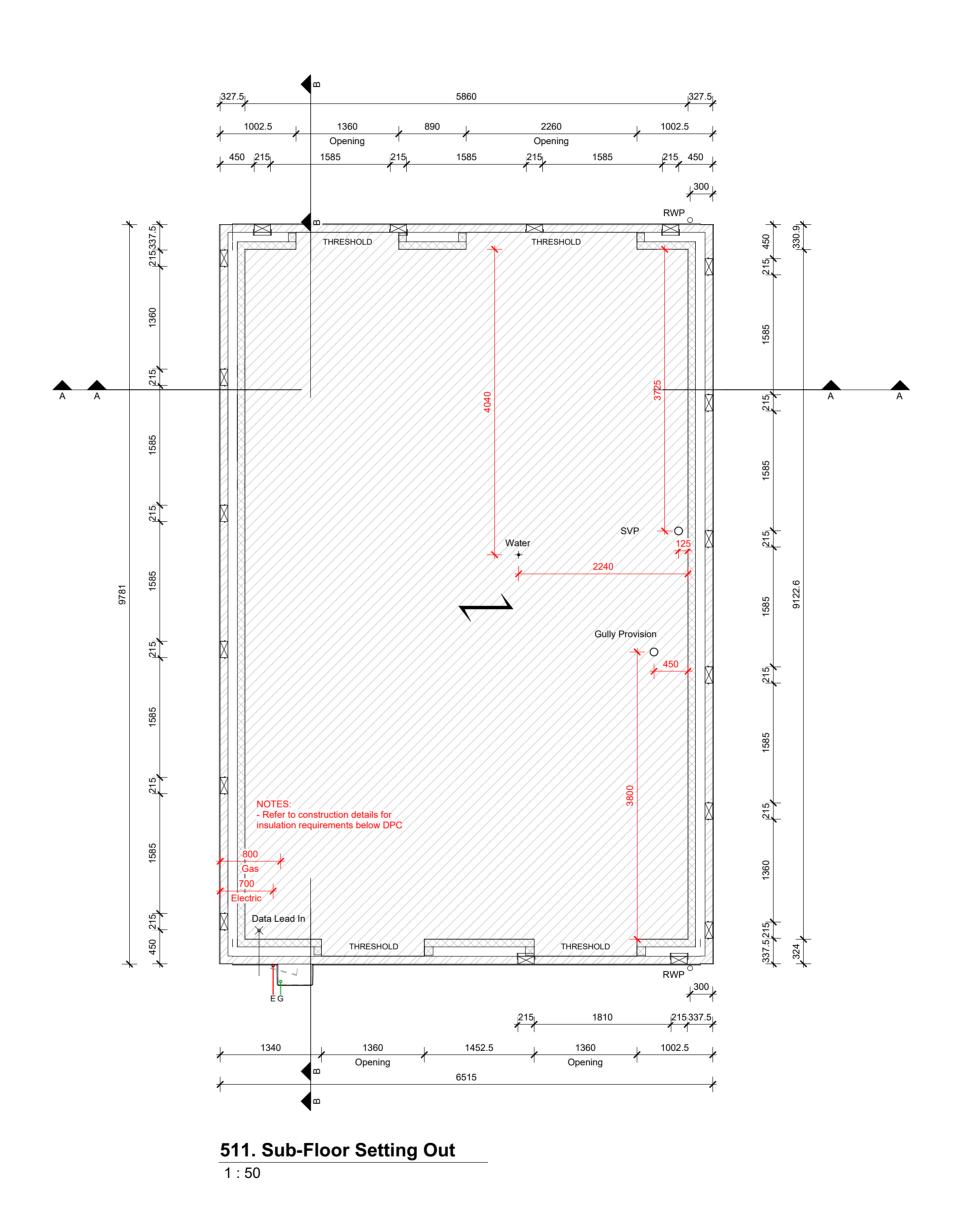

NORTHSTONE Peel L&P Salford M50 2TG CONSTRUCTION Gen2 House Type Portfolio DRAWING NAME 1164-V5-N (As) Foundation & Sub-Floor Plans DESIGNATION DRAWN BY DRAWING NUMBER Design 1164-510 SCALE (@ A1) Jan 2024 As indicated Notes:


• All dimensions to structure unless otherwise stated.

• Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.

• Any discrepancies to be reported to Northstone Technical prior to commencement of works.


• All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.


DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.

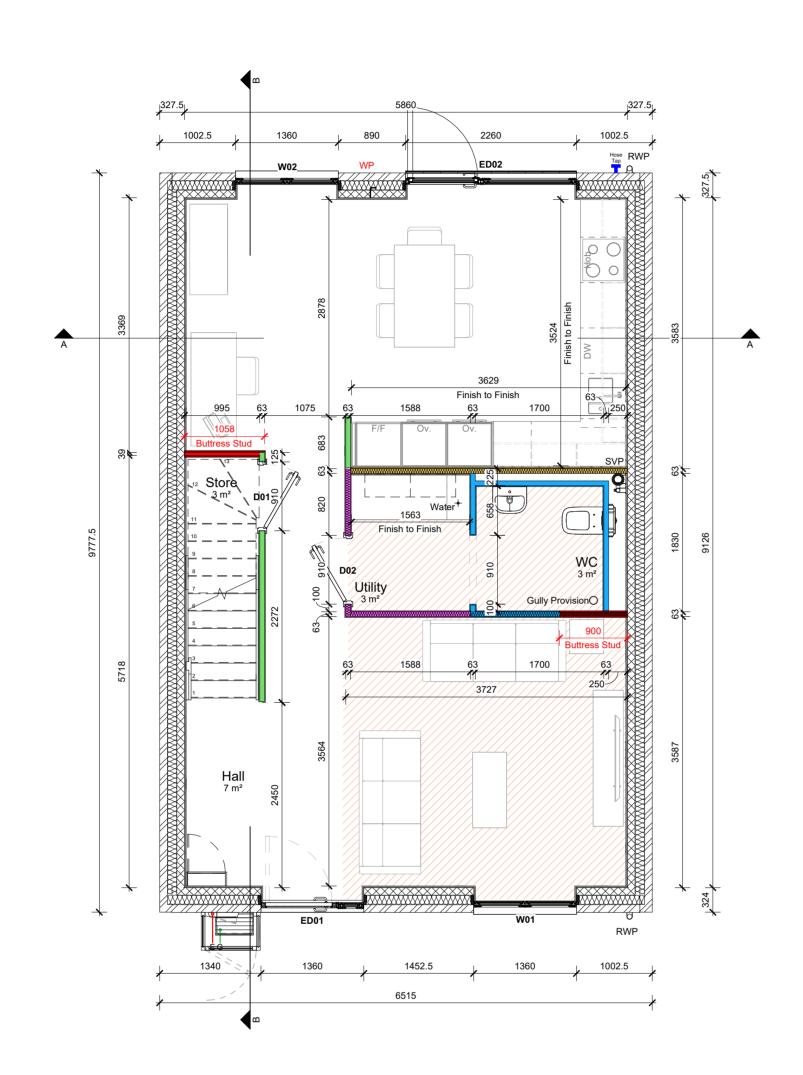

520. Ground Floor Setting Out

							External	Door Schee	aule					
Floor	Door Ref	Width	Height	Door Width	Reveal Depth	U-Value (Door / S	Sidelight) Tou	ghened Glass	Glazing Specification	n MF Width	Sidelight MF Width	MF Height	Area of Glazing	Note
Ground Floor FFL/DPC	ED01	1360	2110	1000	50	0.45W/m²K / 0.55W	//m²K Yes		Tripple Glazed	984	344	2061	0.451 m²	
Ground Floor FFL/DPC	ED02	2260	2110			0.90W/m ² K / 0.55W	//m²K Yes		Tripple Glazed	984	1244	2061	3.508 m ²	
						Wine	dow Sched	ule						
Floor	Window Ref	Width	Height	Toughened Gla	ss U-Value	Reveal Depth	Obscure Glazing	Escape Wind	low Trickle Vents	Glazing Spe	cification Area of	Glazing	Notes	
Ground Floor FFL/DPC	W01	1360	2110	Yes	0.55W/m²K	70	No	No	Yes	Tripple Glazed	2.096 m²			_
Ground Floor FFL/DPC	W01	1360	2110	Yes	0.55W/m²K		No	No	Yes	Tripple Glazed	2.096 m ²			\dashv
First Floor FFL	W03	1360	1510	Yes	0.55W/m²K		No	Yes	Yes	Tripple Glazed	1.438 m²			\dashv
First Floor FFL	W04	1360	2110	Yes	0.55W/m²K		No	Yes	Yes	Tripple Glazed	2.096 m²			\dashv
First Floor FFL	W05	1360	1510	Yes	0.55W/m²K		No	Yes	Yes	Tripple Glazed	1.438 m²			\dashv
First Floor FFL	W06	1360	1510	Yes	0.55W/m²K		No	Yes	Yes	Tripple Glazed	1.438 m²			\dashv
					Interna	al Door Sche	dule							
Floor	Door Ref	From Room	To Roor	n Structura	l Width Struc	tural Height	Leaf Width (Casing Depth	Fire Rating	Self Closer	Notes			
Ground Floor FFL/DPC	D01	Living Room	Store	910	2326	83	8 96		Not Fire Rated No)				
Ground Floor FFL/DPC	D02	Hall	Utility	910	2326	83	8 96		Not Fire Rated No)				
First Floor FFL	D03	Bedroom 4	Landing	910	2017	83	8 96		Not Fire Rated No)				
First Floor FFL	D04	Bedroom 2	Bedroom 2	910	2017	83	8 96		Not Fire Rated No)				
First Floor FFL	D05	Bedroom 2	Bedroom 2	910	2017	83			Not Fire Rated No)				
First Floor FFL	D06	Room	Landing	910	2017	83			Not Fire Rated No)				
First Floor FFL	D07	Room	Bathroom	910	2017	83			Not Fire Rated No					
First Floor FFL	D08	Bedroom 4	Store	710	2017	63			Not Fire Rated No)				
First Floor FFI	D08	Room	Landing	910	2017	83	8 96		Not Fire Rated No)				

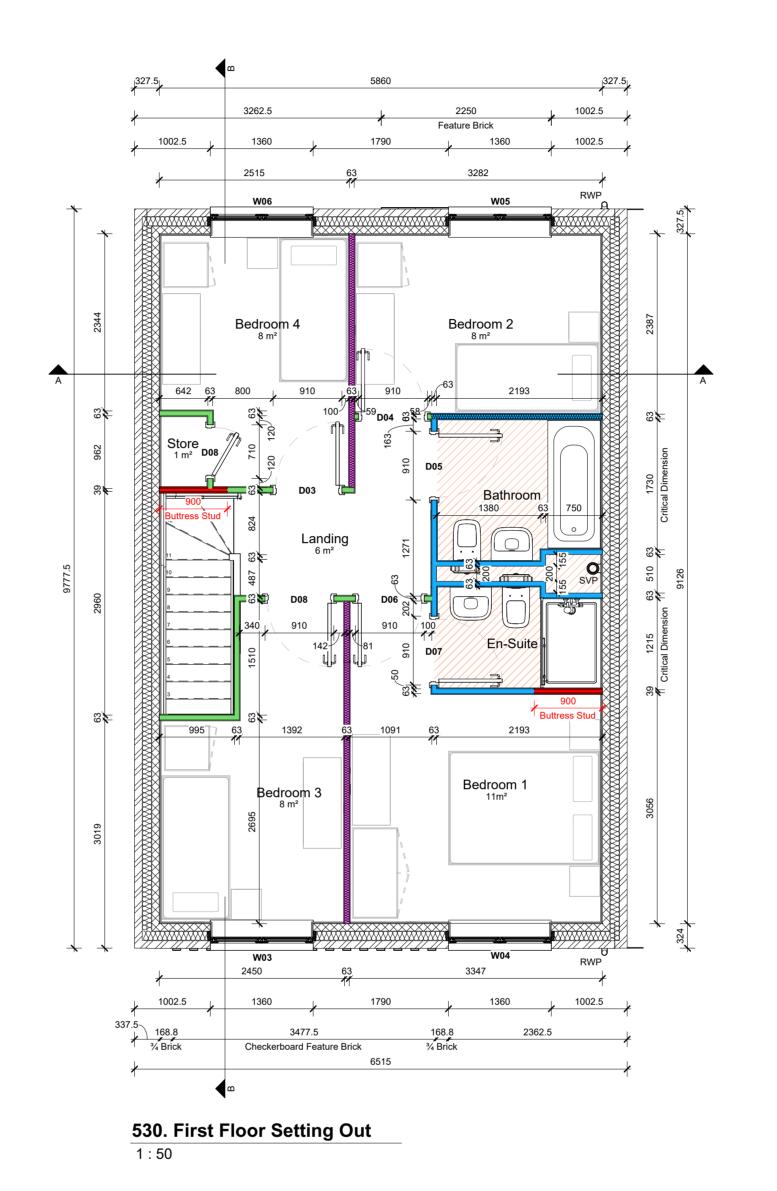

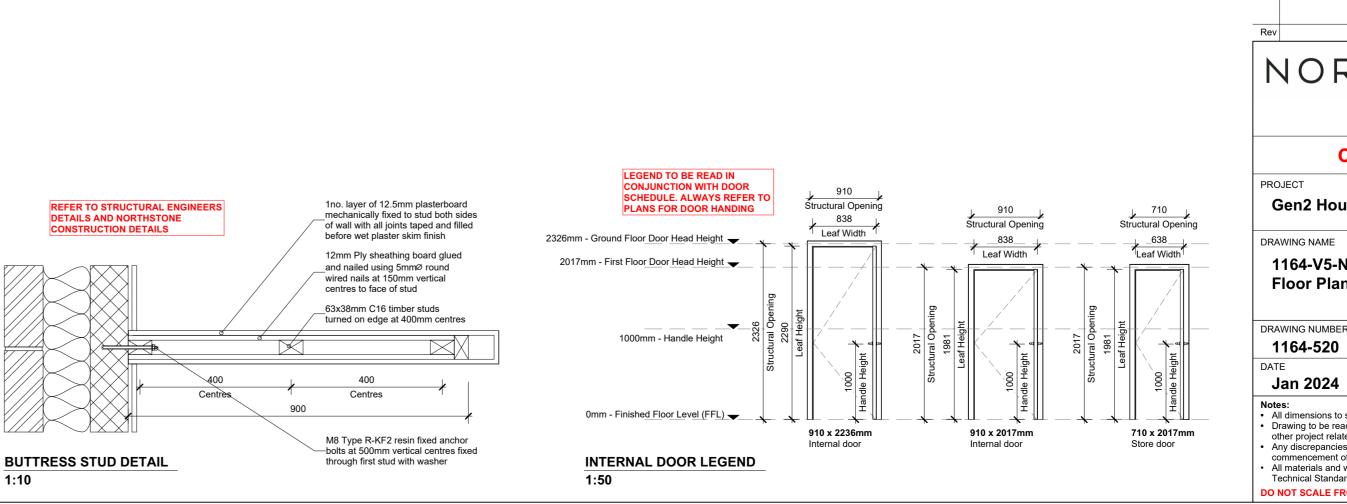

- 125mm cavity fully filled with insulation as specification
- 100mm block as specification - 100mm block as specification - 12.5mm plasterboard on 10mm adhesive dabs, all joints taped and filled before wet plaster skim finish NON LOADBEARING STUD PARTITIONS General Partition - 63x38mm C16 studwork at max 600mm centres with suitable noggins - Pattress between stud with 12mm Ply where required for MEP fixtures and fittings - 1no. layer of 12.5mm plasterboard mechanically fixed to stud both sides of wall with all joints taped and filled before wet plaster skim finish Patressed Partition Wall - 63x38mm C16 studwork at max 600mm centres 600 with suitable noggins - 12mm ply mechanically fixed to stud on loadbearing side of wall, (Kitchens etc.) - 1no. layer of 12.5mm plasterboard mechanically fixed to stud both sides of wall with all joints taped and filled before wet plaster skim finish Acoustic & Fire Rated Partition 30 Min
- 63x38mm C16 studwork at max 600mm centres with suitable noggins - Voids between studwork fully filled with 60mm Rockwool Flexi or similar approved mineral wool. - Pattress between stud with 12mm Ply where required for MEP fixtures and fittings - 1no. layer of 12.5mm plasterboard mechanically fixed to stud both sides of wall with all joints taped and filled before wet plaster skim finish - Achieves R_w40dB in accordance with AD:E - Achieves REI 30 fire resistance in accordance with British Gypsum White Book Wet-Room Partition (WC / Bathroom / En-suite) - 63x38mm C16 studwork at max 400mm centres with suitable noggins - Pattress between stud with 12mm Ply where required for MEP fixtures and fittings - 12.5mm moisture resistant plasterboard mechanically fixed to stud onwet-room side of wall with all joints taped and filled prepared for - 12.5mm standard plasterboard mechanically fixed to stud on **dry-room side** of wall where required with all joints taped and filled before wet Framing Wall - 63x38mm C16 studwork wide face out at max 400 400 400 400 400 400 With a centres with suitable noggins - 1no. layer of 12.5mm plasterboard mechanically fixed to stud on room side of wall with all joints taped and filled before wet plaster skim finish Anchored/Buttress Stud Partition Refer to structural engineers details and , 400 , 400 , Northstone construction details.

Buttress Studs and Windposts not required on party walls. Insulation Between Studs As Above Wall Types Rockwool Flexi or similar approved mineral wool where indicated on drawing for AD:E compliance - Achieves R_w40dB in accordance with AD:E - Achieves REI 30 fire resistance in accordance with British Gypsum White Book Refer to engineers details and specification for all block strengths.
 Key to be read in conjunction with construction specification.
 Expansion and movement joints, bed reinforcement and wind posts to engineers details.
4. All dimensions are to structure unless otherwise noted. **FLOORING LEGEND** LVT Flooring

WALL TYPE LEGEND Brick Face External Wall

materials plan

- 102.5mm clay facing brickwork to site specific

- Vinyl flooring applied as Northstone finishes specification and relevant customer options



NORTHSTONE

Peel L&P Salford M50 2TG

CONSTRUCTION

Gen2 House Type Portfolio

DRAWING NAME 1164-V5-N (As)

Floor Plans DRAWING NUMBER DESIGNATION DRAWN BY


SCALE (@ A1) Jan 2024 As indicated

Design

Notes:
All dimensions to structure unless otherwise stated.
Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.
Any discrepancies to be reported to Northstone Technical prior to

commencement of works.

All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations. DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.

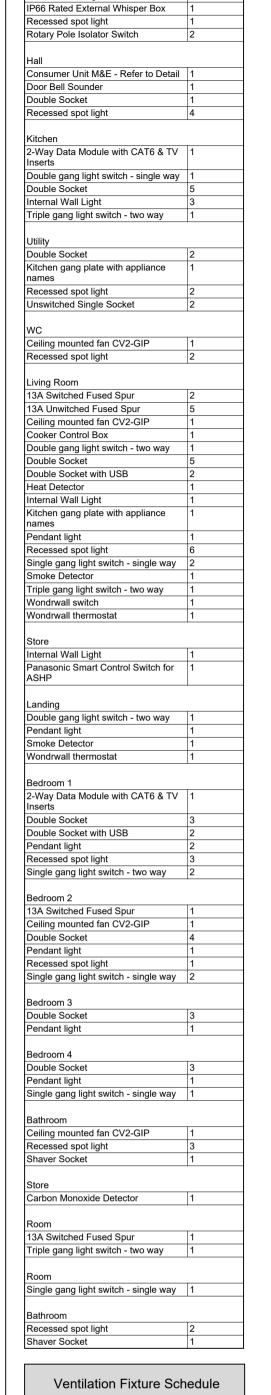

Kitchen Rear Electrical Fixture

Schedule

Electrical Item

Door Bell Push

External Wall Light


Ventilation Fixture Schedule

1:50

Single air brick for CV2.GIP fan

Flat Edge Tile Vent for Concrete Tiles 3

Boiler Flue Terminal and Flashing Kit 1

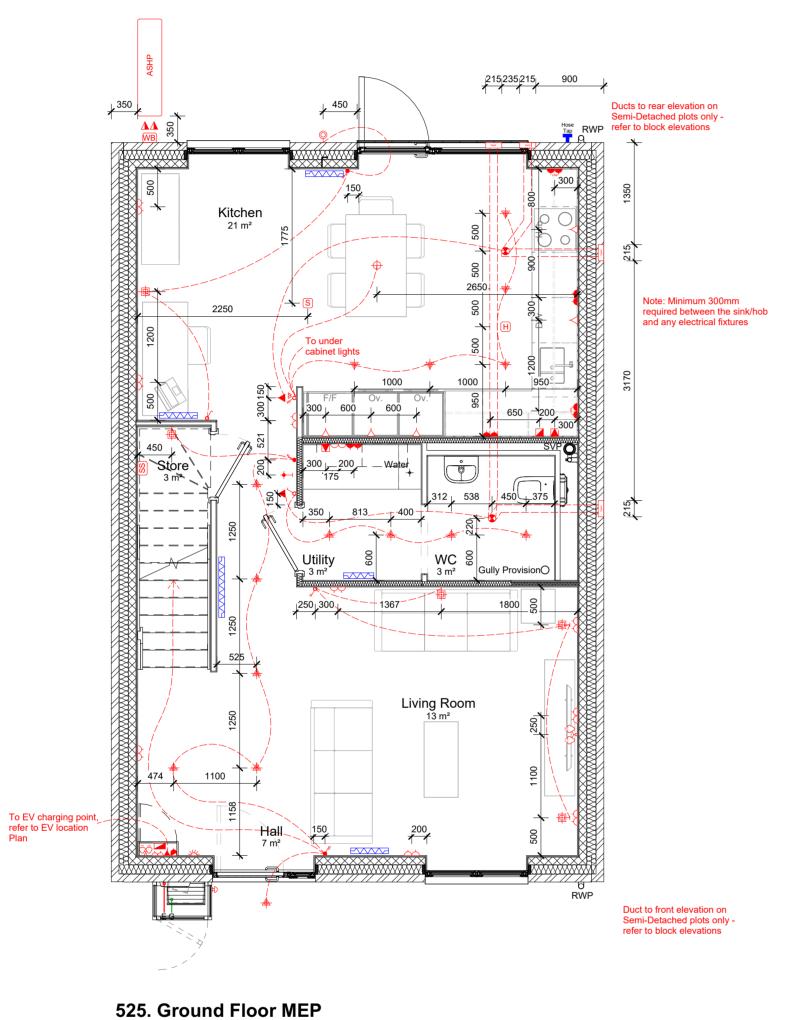

535. First Floor MEP 1 : 50

1400


Bedroom 4

Landing

1240

Bedroom 2

En-Suite

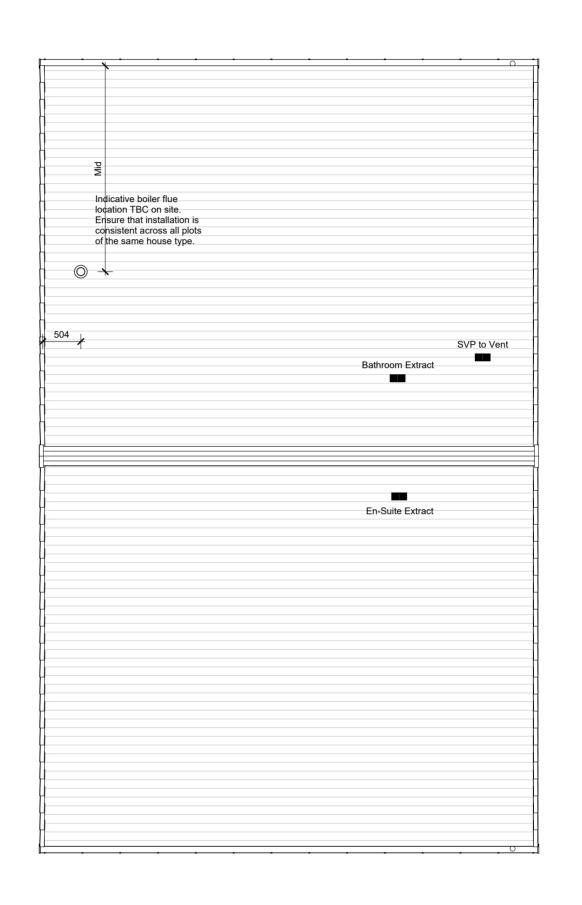

Recessed Spot Light Bulkhead Light SWITCHES Single Gang Switch Double Gang Switch Triple Gang Switch Single Two-Way Switch Double Two-Way Switch Triple Two-Way Switch Wondrwall Switch 13A Switched Fused Spur 13A Unswitched Fused Spur Kitchen Gang Plate Cooker Control Box SOCKETS △ Single Socket - Low Level Unswitched Single Socket - Low Level 5 Amp Socket Double Socket - Low Level With USB Single Socket - Worktop Level ▲ Double Socket - Worktop Level Double Socket - Worktop Level With USB External IP65 Rated Socket Shaver Socket MISC. ELECTRICAL Consumer Unit ← Central Heating Room Thermostat Data Module with TV Point Insert Data Module with CAT6 Socket Insert Door Bell Sounder Door Bell Push FIRE & GAS PROTECTION C Carbon Monoxide Detector Heat Detector S Smoke Detector SH Sprinkler Head **VENTILATION** Ceiling Mounted Fan Brick Vent - Plan Brick Vent - Elevation Tile Vent **HEATING & PLUMBING** Central Heating Boiler Gas Point Radiator ──Towel Rail Boiler Flue Terminal Tap External Tap Note: All plumbing and ventilation items shown indicatively. Refer to independent third party designs for exact details of heating and ventilation designs. IMPORTANT
THIS LEGEND MUST ALWAYS BE PRINTED WITH
ANY MEP PLAN EXTRACTS ANY CLASHES OR DISCREPANCIES MUST BE REPORTED TO NORTHSTONE **TECHNICAL TEAM** AIR SOURCE HEAT PUMP LEGEND CLEARANCE ASHP 1284

ELEVATIONS

ANCILLARY EQUIPMENT

▲ IP67 Rated Rotary Pole Isolator Switch


Note: กัเพอิตมายะ Heat Pump, (ASHP), and ancillary equipment shown indicatively. Refer to independent third party designs for exact details of ASHP System

WB IP66 Rated External Whisper Box

SS Panasonic Smart Control Switch


M&E LEGEND


LIGHTING○H External Wall Light

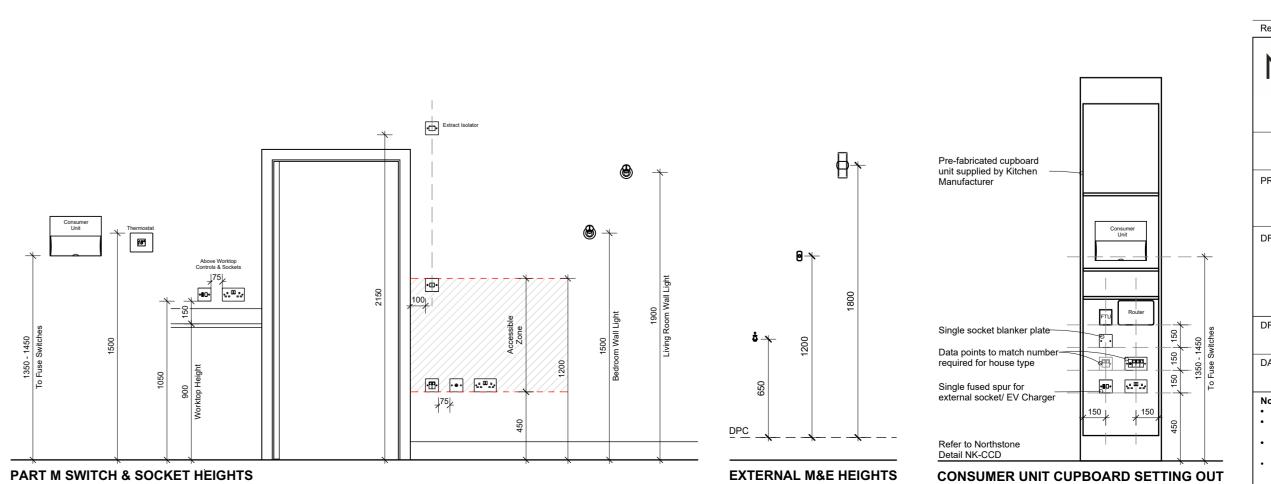


539. Roof Plan

1:50

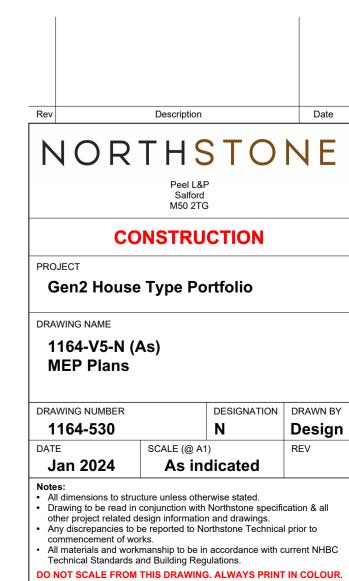


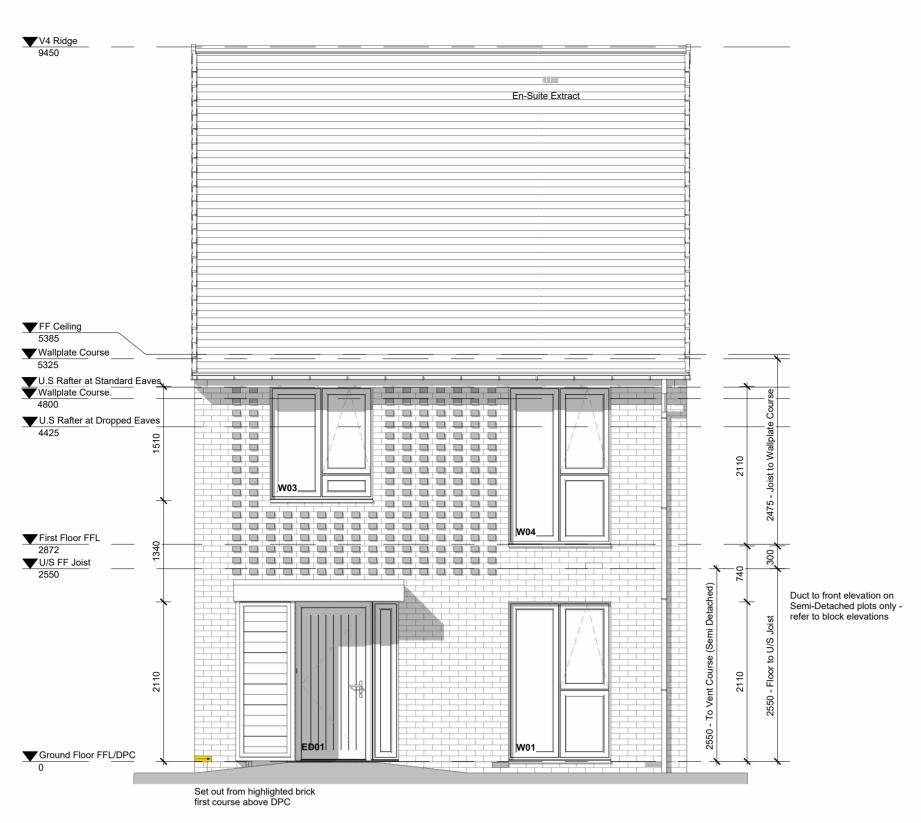

540. Front Elevation 1:50

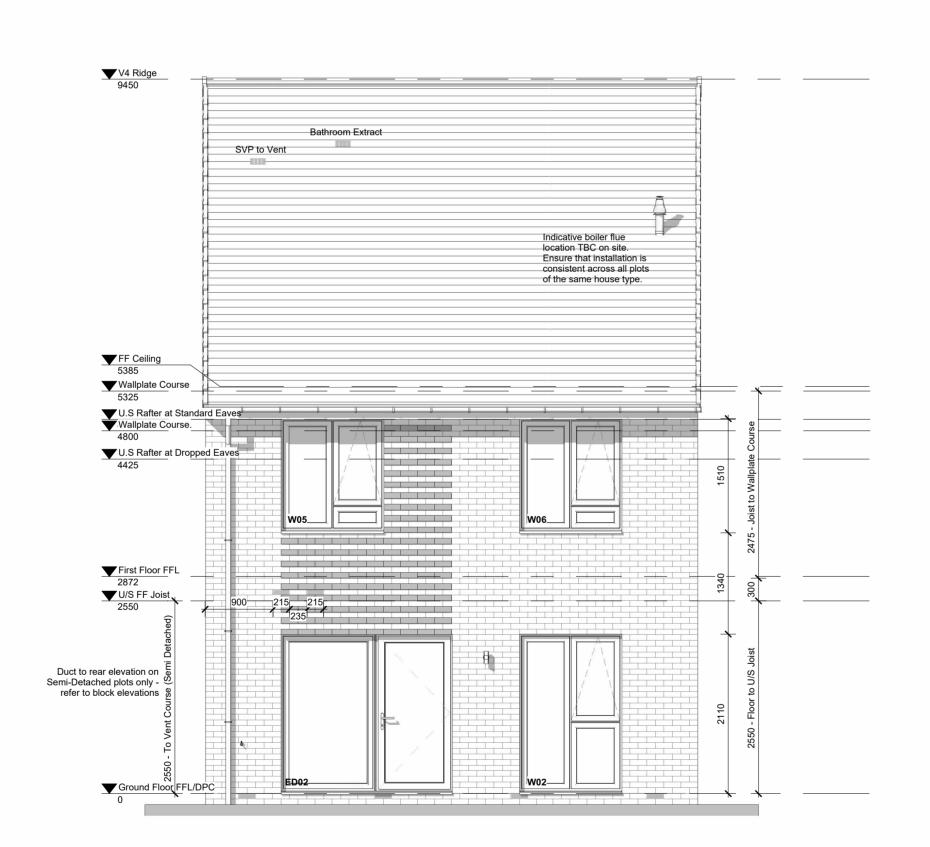

542. Rear Elevation 1:50

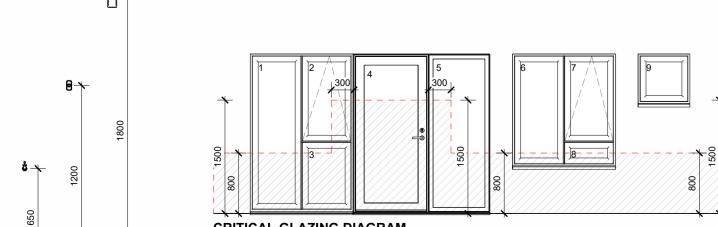

Critical glazing locations in internal and external walls for windows, doors and side lights in accordance with BS 6206 and all current building regulations. Shaded area indicates critical locations to which the requirements of Approved Document K(4) applies, (i.e. glazing falling within zones 1, 2, 3, 4, 5, 6 & 8).


Unobstructed opening casement area to be at least 0.33M² and at least 450mm high and 450mm wide. Bottom of windows to be not more than 1100mm and not less than 800mm above the floor. Escape windows to have non lockable fasteners and hinged to achieve the minimum required opening.

All glazing in critical locations should:
a) If broken, will break safely.
b) Be sufficiently robust to resist breaking.

EXTERNAL M&E HEIGHTS


tes:
Schedules to be read in conjunction with all project specification documents, floor plans and elevations
Structural opening size includes any sidelights
Frame set back is taken from front face of brick
Refer to manufactures information for detailed lintel schedules
All accessible windows and doors to be PAS24 tested to comply with Part Q of building regulations
All dimensions to be checked on site prior to manufacture

Escape from upper storey a maximum of 4.5m above ground level: ALL inner rooms where applicable and all first floor habitable rooms (excluding kitchens) to be provided with an escape window (or external door) which complies with Approved Document B1 Section 2 Paragraph 2.2. Dwellings with one storey more than 4.5m above ground level: A protected stairway should be provided with minimum 30 minute fire resisting construction at all storey's to comply with Approved Document B1 Section 2 Paragraphs 2.5.

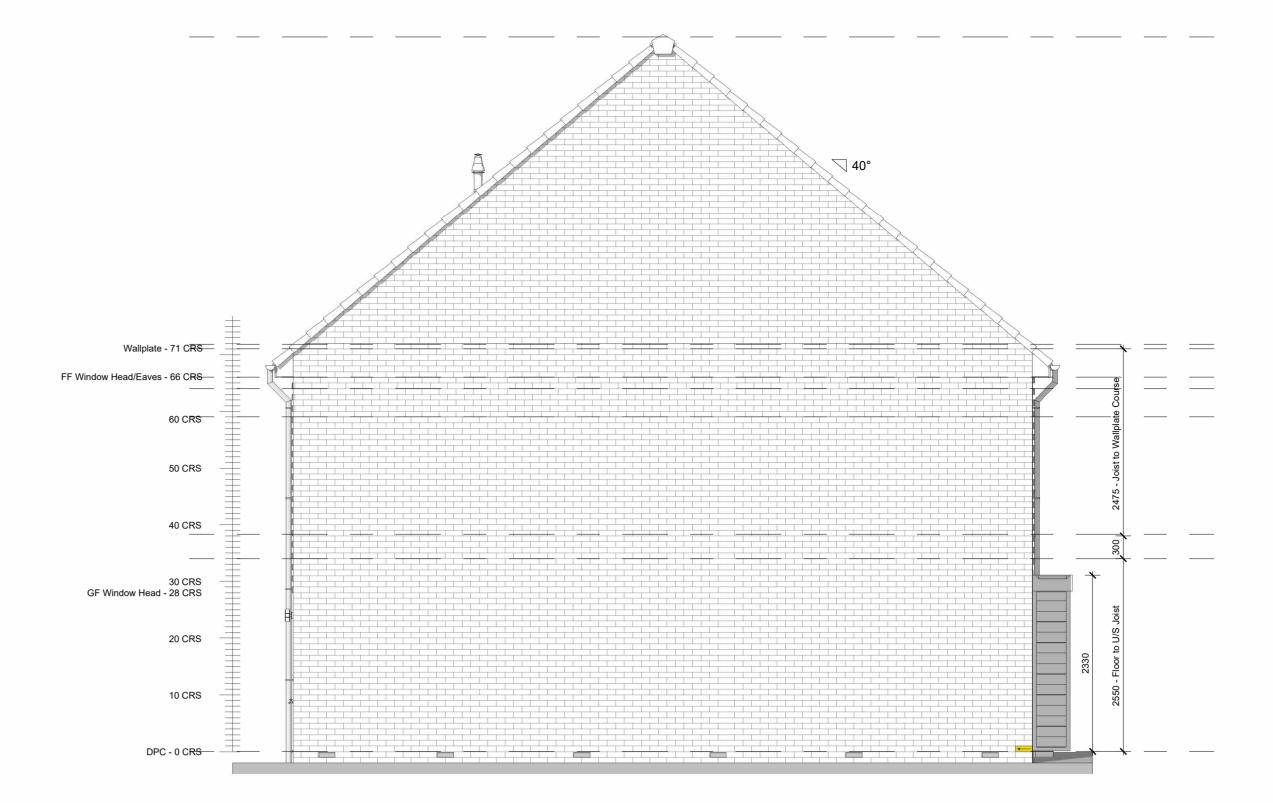


541. LHS Elevation

1:50

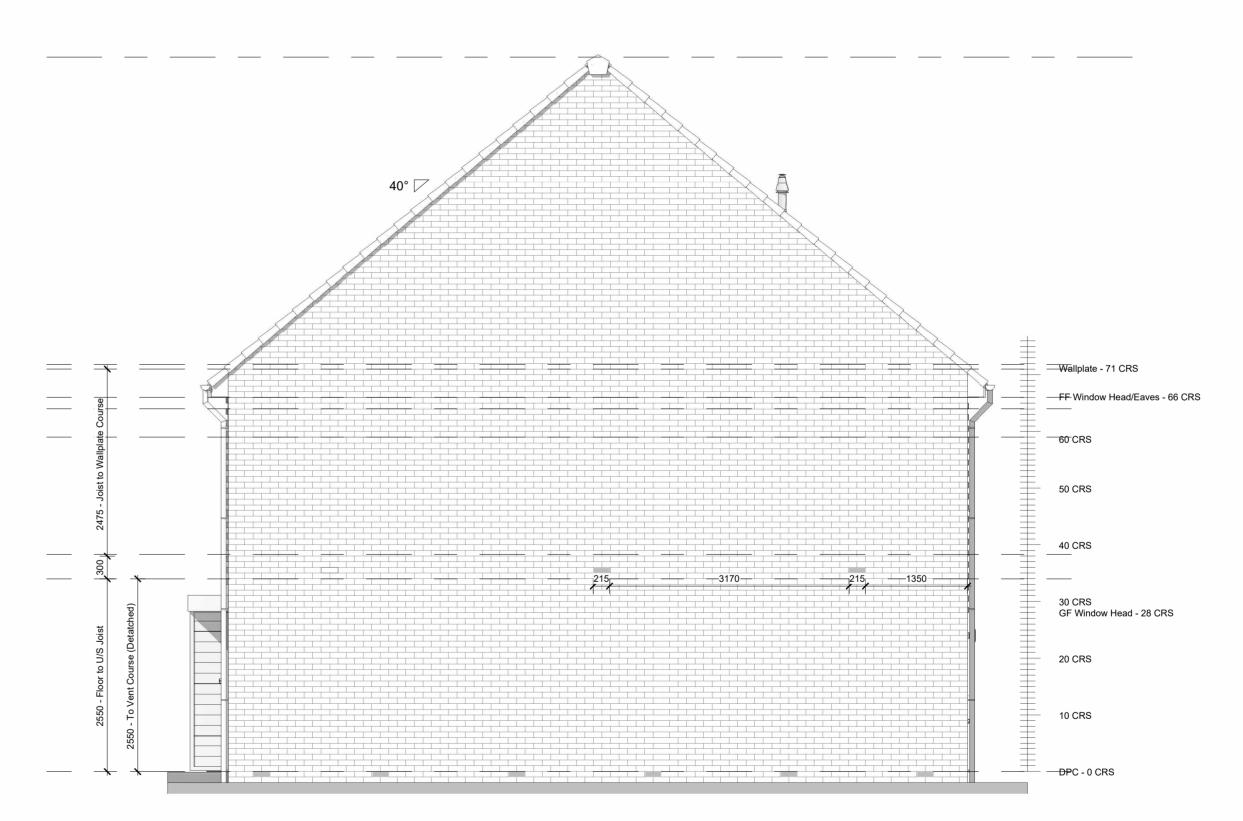


543. RHS Elevation 1:50

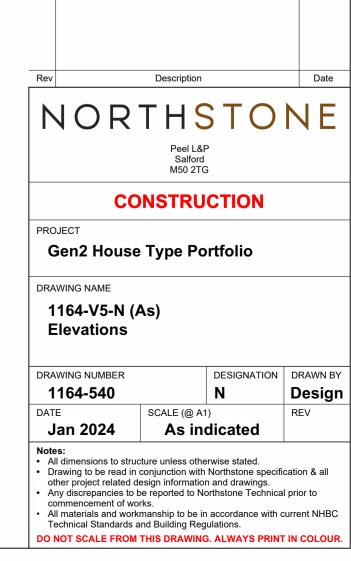




Breather Membrane

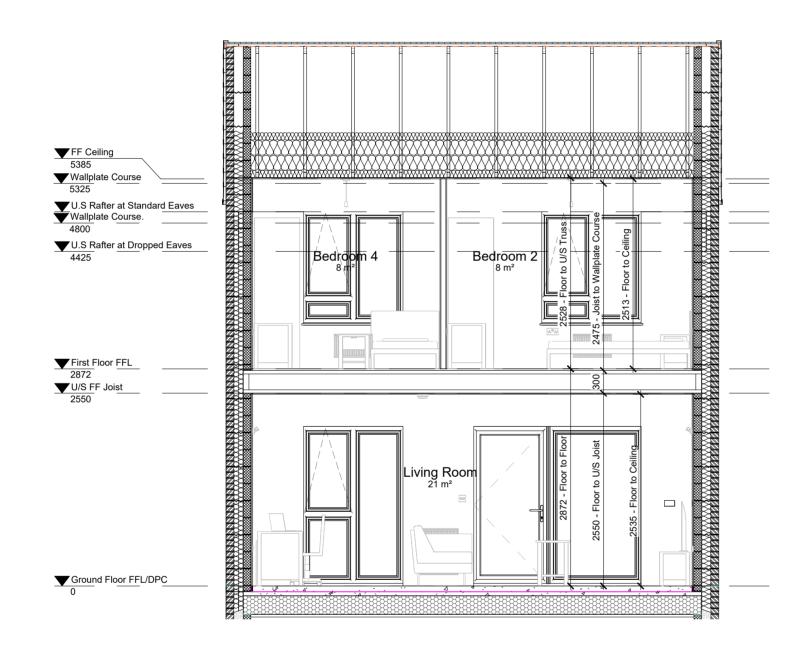

550. Section A-A
1:50

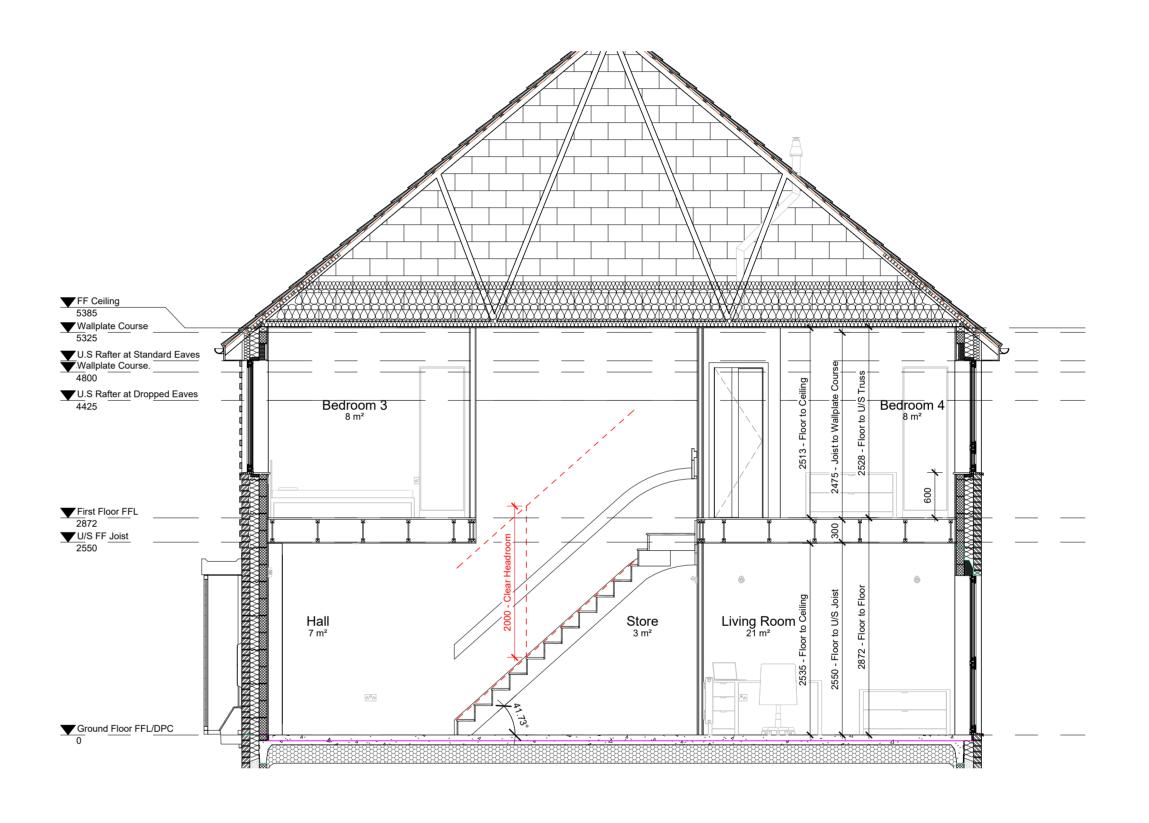

551. Section B-B

