V0 Drawing Register								
Sheet Number	Sheet Name	Rev	Revision Date					
1047-000	Cover Page & Design Risk Register	Α	Feb 2024					
1047-010	Foundation & Sub-Floor Plans	Α	Feb 2024					
1047-020	Floor Plans	Α	Feb 2024					
1047-030	MEP Plans	Α	Feb 2024					
1047-040	Elevations	Α	Feb 2024					
1047-050	Sections	Α	Feb 2024					



Design Risk Register									
Element	Comments								
Lifting Operations	To avoid injury when handling heavy components, specialist handling equipment is to be utilised for the positioning of heavy objects/materials. Large glazing to be installed with specialist lifting equipment by trained personnel. Protection barriers to be provided to prevent mechanical damage following installation.								
Craneage	Crane supplier to be satisfied of adequate support to outriggers, correct lifting positions to be established to avoid slippage of sheet materials during lifting and placement. Sub-contractors and suppliers to 'design in' lifting eyes and identify weights of heavy items at drawing approval stage. All RAMS to be obtained and approved prior to any lifting operations being carried out.								
Ground Floor Construction	Mechanical Lifting equipment to be utilised to position pre-cast concrete floor planks. Manual handling assessment to be carried out.								
Working at Height	Install temporary scaffolding barrier to exposed edges of upper floors including toe boards throughout the build period. Provide scaffolding to all areas requiring placement of materials and finishing to all areas above ground level. Scaffolding to be positioned to avoid the need to overreach causing strain injury when placing materials. Protect areas below high level working from falling debris. Ensure space required for crane is achievable and suitable hard standing is provided. Ensure maximum fall height when fixing trusses into position is 2 metres by utilising appropriate safety measures and equipment.								
Stairs	To prevent falls provide temporary guarding and edge protection to open well areas and keep clear during construction, eliminating the possibility of trip hazards. Stairs to be erected as early as possible during the construction process to provide vertical circulation and means of escape in case of fire.								
Masonry Construction	When working at height mechanical lifting measures required to lift brick and block packs into position to reduce manual handling.								
Lintels	Manual Handling Assessments to be carried out for all lintels, light craneage to be utilised for lintels considered too heavy for manual handling.								
Structural Steelwork	Mechanical lifting measures required to reduce manual handling. Ensure required space for crane is achievable and suitable hard standing is provided.								
Windows / Structural Openings	Any structural apertures below 800mm to be fitted with temporary guarding to prevent falls. Any structural apertures below 800mm and extending to floor level to be fitted with temporary guarding and edge protection to prevent falls. Mechanical lifting measures and frame and glazing fitted separately to be considered for installation of large windows and combination door & window frames. Window manufacturer to be consulted regarding best means of installation.								
Window Cleaning & Maintanence	'Easy Clean' hinges are not an option due to the top hung design to a majority of the windows, as such windows should be cleaned from ground level using a telescopic 'reach & wash' system. All windows used to be Aluminium or UPVC frames to eliminate the need for future decoration.								
Roof Construction	Ensure space required for crane is achievable and suitable hard standing is provided. Ensure maximum fall height when fixing trusses into position is 2 metres by utilising appropriate safety measures and equipment.								

1047-V0-N (As)

General updates as detailed within issue email dated 02.02.2024	Feb 2024	
Construction Issue	July 2023	
Description	Doto	

NORTHSTONE

Peel L&P Salford M50 2TG

CONSTRUCTION

Gen2 House Type Portfolio

DRAWING NAME

1047-V0-N (As) Cover Page & Design Risk Register

DRAWING NUMBER		DESIGNATION	DRAWN BY
1047-000		N	Design
DATE	SCALE (@ A3	3)	REV
June 2023			Α

- · All dimensions to structure unless otherwise stated.
- Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.
 Any discrepancies to be reported to Northstone Technical prior to commencement of works.
- All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.

DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.

FOUNDATION & SUB-FLOOR LEGEND Brick Face External Wall OUTSIDE - 102.5mm clay facing brickwork as site specific - 125mm clear cavity INSIDE - 100mm block as specification 100mm Sleeper Wall - 100mm concrete block as engineers details 215mm Sleeper Wall - 100mm concrete block as engineers details - 15mm cavity fully filled with mortar - 100mm concrete block as engineers details Trench Block - 350mm concrete trench block as engineers details Services & Ventilation O^{SVP} 110mm Soil and Vent Pipe ORWP Rainwater pipe as specification OGULLY Sealed floor gully for level access shower → Water Entry Point Data Lead In _____ Data Entry Point E —— € Electric Entry Point G — Gas Entry Point Sub-Floor Telescopic Vent Floor Finish & Span Extent of Floor Screed Span of Ground Floor Construction

4. Always refer to site investigation report and engineers details for any gas membrane requirements. Sub-Floor Void Ventilation Schedule Building Building Ventilation Minimum Number of Vents Required of Vents Required Vents Provided


59.30 m² | 31.51 | 47267 mm² | 10 * Based on 500mm2/m2 of Floor Area

1. Refer to engineers details and specification for all block


strengths.


Key to be read in conjunction with construction specification.


Expansion and movement joints, bed reinforcement and wind posts to engineers details.

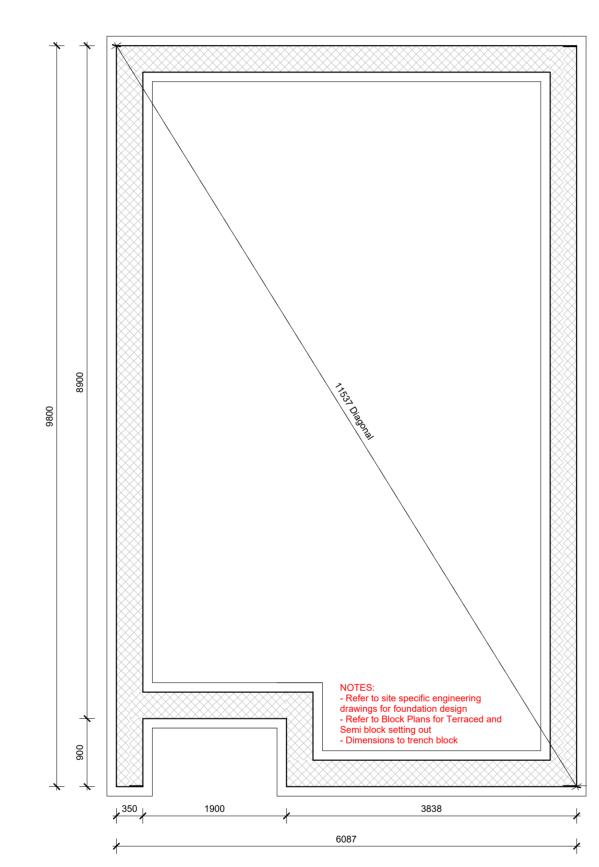



010. Foundation Plan
1:50

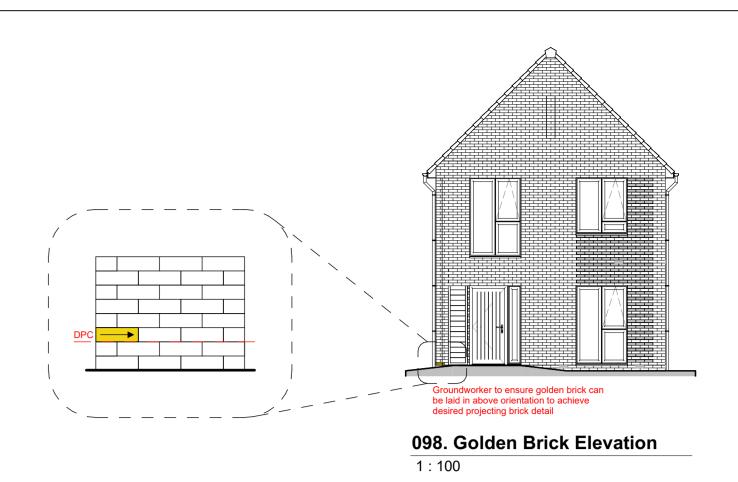

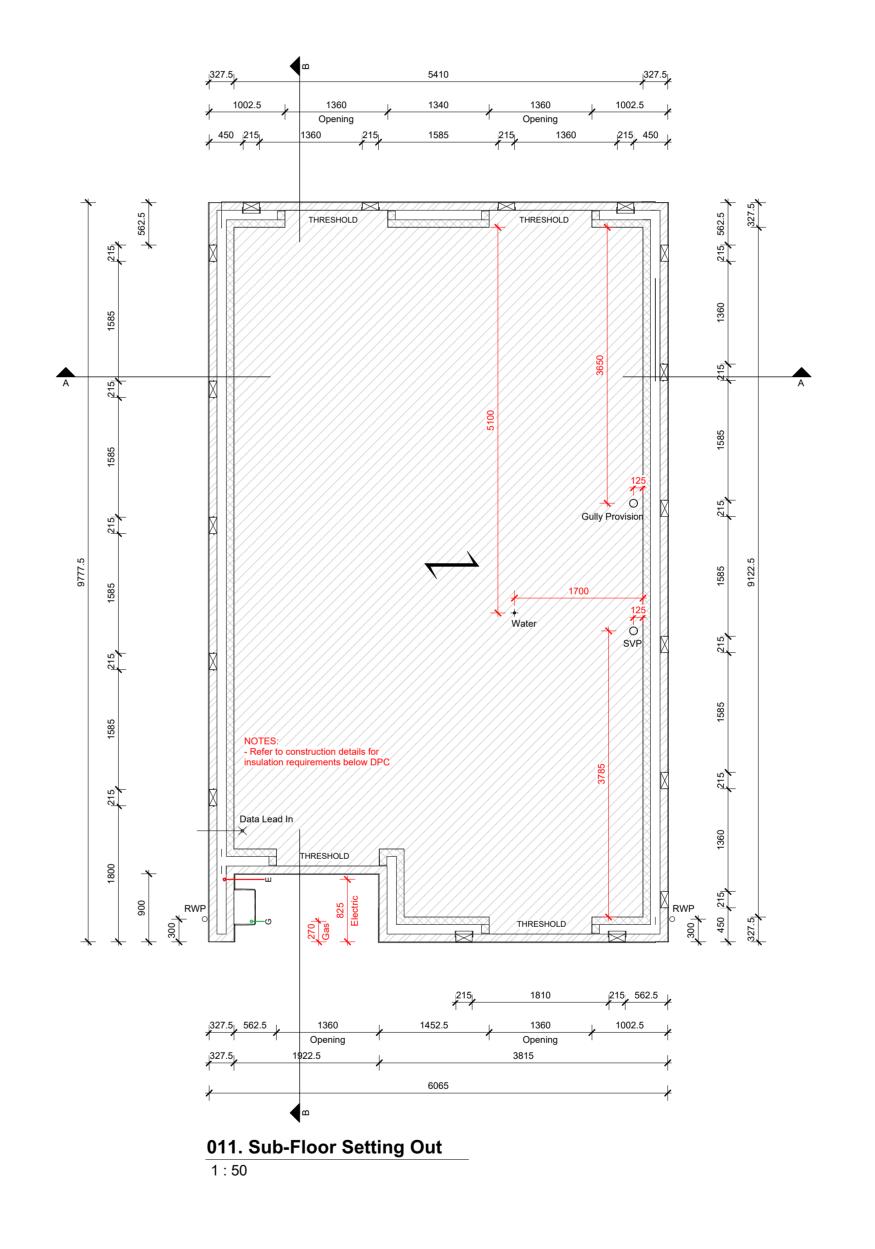

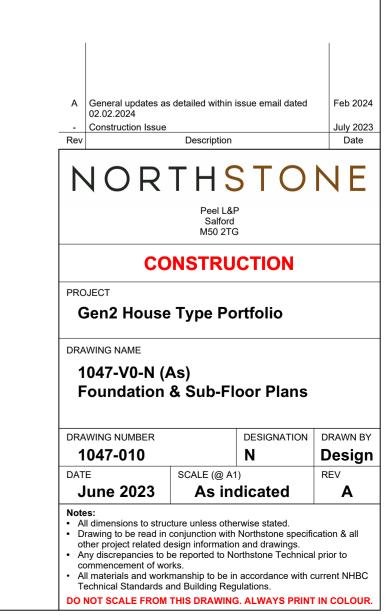


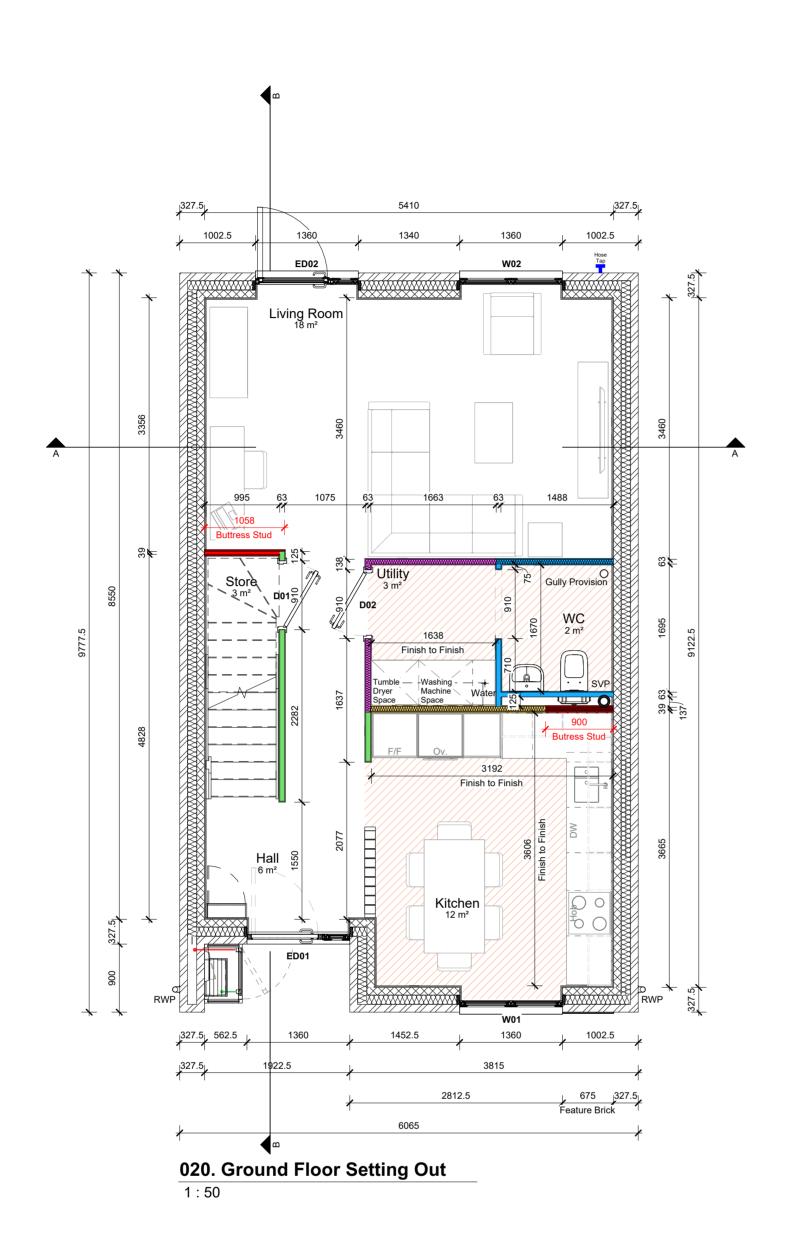




Window Schedule												
Floor	Window Ref	Width	Height	Toughened Glass	U-Value	Reveal Depth	Obscure Glazing	Escape Window	Trickle Vents	Glazing Specification	Area of Glazing	Notes
Ground Floor FFL/DPC	W01	1360	2110	Yes	0.55W/m²K	70	No	No	Yes	Tripple Glazed	2.096 m ²	
Ground Floor FFL/DPC	W02	1360	2110	Yes	0.55W/m²K	70	No	No	Yes	Tripple Glazed	2.096 m ²	
First Floor FFL	W03	1360	2110	Yes	0.55W/m²K	70	No	Yes	Yes	Tripple Glazed	2.096 m ²	
First Floor FFL	W04	1360	1510	Yes	0.55W/m²K	70	No	Yes	Yes	Tripple Glazed	1.438 m²	
First Floor FFL	W05	1360	2110	Yes	0.55W/m²K	70	No	Yes	Yes	Tripple Glazed	2.096 m ²	
First Floor FFL	W06	1360	1510	Yes	0.55W/m²K	70	No	Yes	Yes	Tripple Glazed	1.438 m²	


Internal Door Schedule										
Floor	Door Ref	From Room	To Room	Structural Width	Structural Height	Leaf Width	Casing Depth	Fire Rating	Self Closer	Notes
			•							
Ground Floor FFL/DPC	D01	Hall	Store	910	2326	838	96	Not Fire Rated	No	
Ground Floor FFL/DPC	D02	Hall	Utility	910	2326	838	96	Not Fire Rated	No	
First Floor FFL	D03	Bedroom 1	Landing	910	2017	838	96	Not Fire Rated	No	
First Floor FFL	D04	Bathroom	Landing	910	2017	838	96	Not Fire Rated	No	
First Floor FFL	D05	Bedroom 3	Landing	910	2017	838	96	Not Fire Rated	No	
First Floor FFL	D06	Bedroom 2	Landing	910	2017	838	96	Not Fire Rated	No	
First Floor FFL	D07	Landing	St.	710	2017	638	96	Not Fire Rated	No	

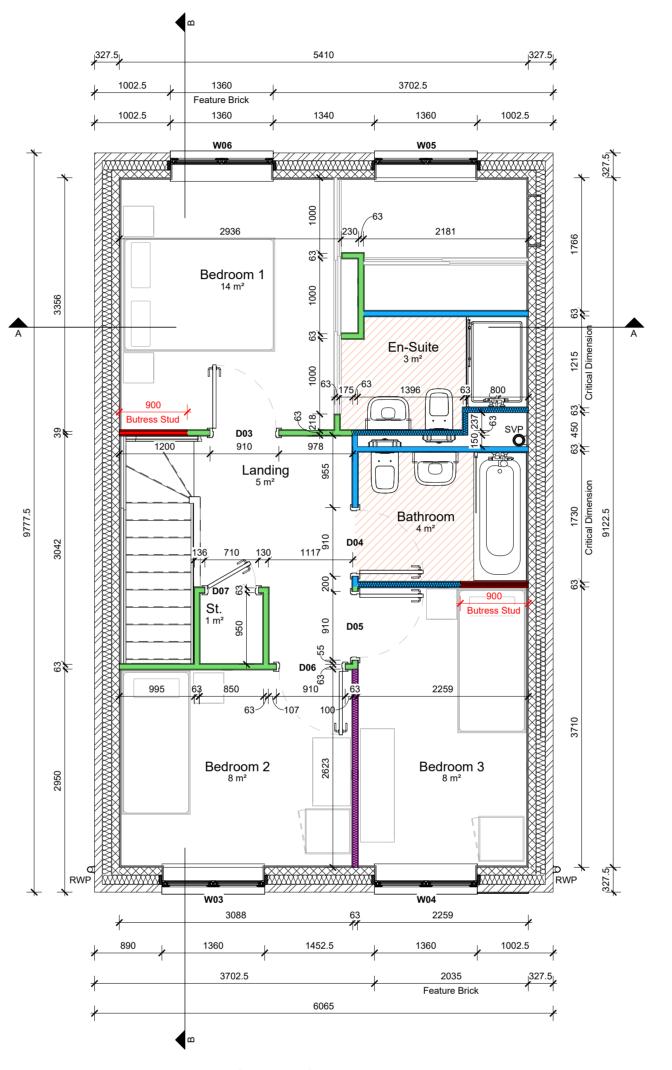


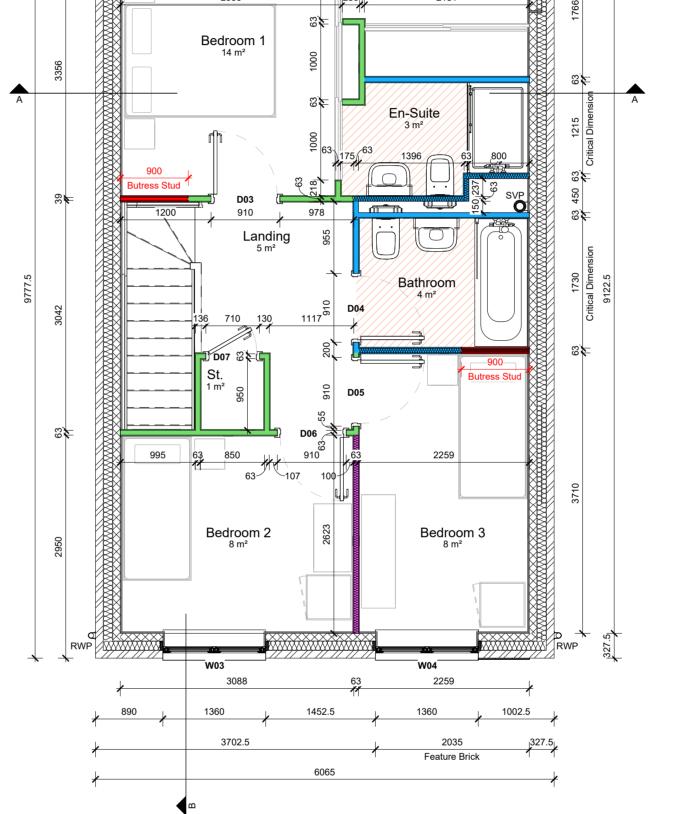

030. First Floor Setting Out

1:50

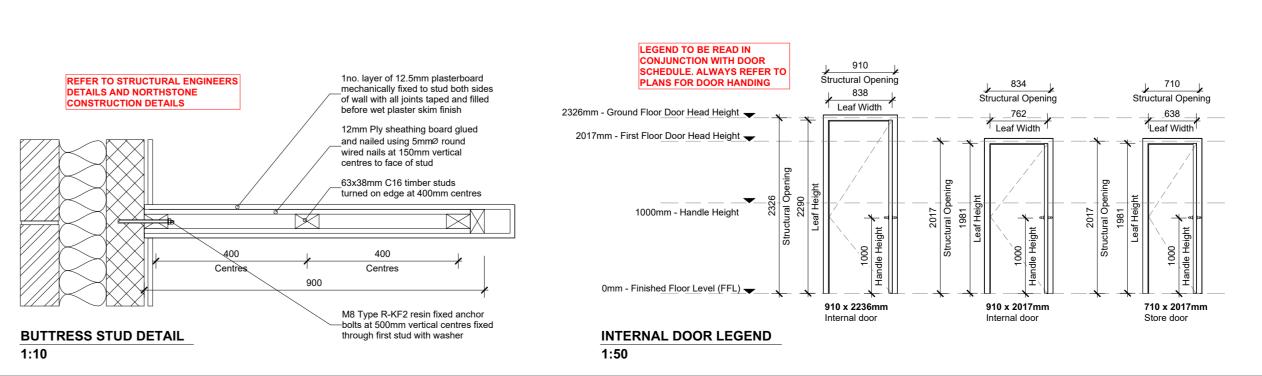

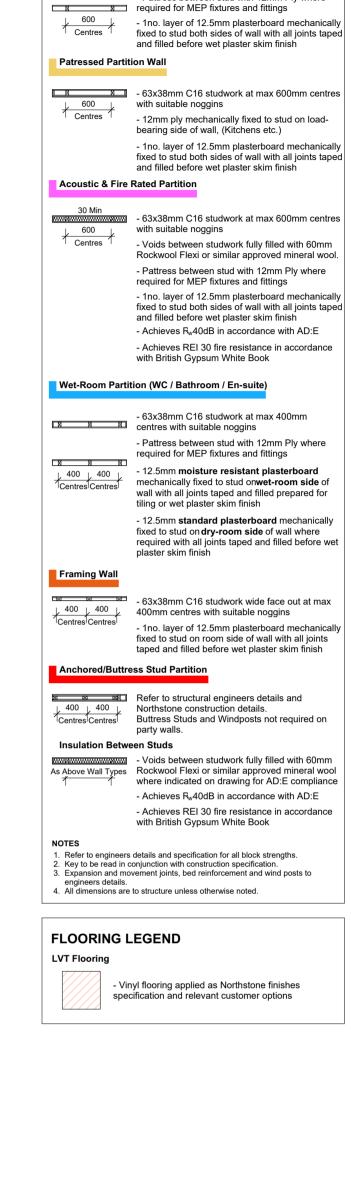

WALL TYPE LEGEND Brick Face External Wall

General Partition

materials plan

skim finish NON LOADBEARING STUD PARTITIONS

- 125mm cavity fully filled with insulation as specification
- 100mm block as specification - 100mm block as specification - 12.5mm plasterboard on 10mm adhesive dabs, all joints taped and filled before wet plaster

- 63x38mm C16 studwork at max 600mm centres with suitable noggins

- 102.5mm clay facing brickwork to site specific

- Pattress between stud with 12mm Ply where




commencement of works.

Technical Standards and Building Regulations.

All materials and workmanship to be in accordance with current NHBC


DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.

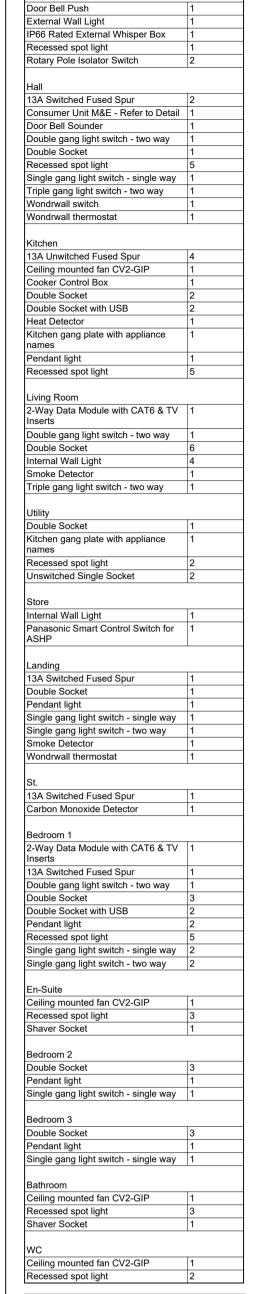

Electrical Fixture Schedule

Electrical Item

Ventilation Fixture Schedule								
Ventilation Item	Quantity							
Single air brick for CV2.GIP fan	2							
Single air brick for CV2.GIP fan Boiler Flue Terminal and Flashing Kit	2							

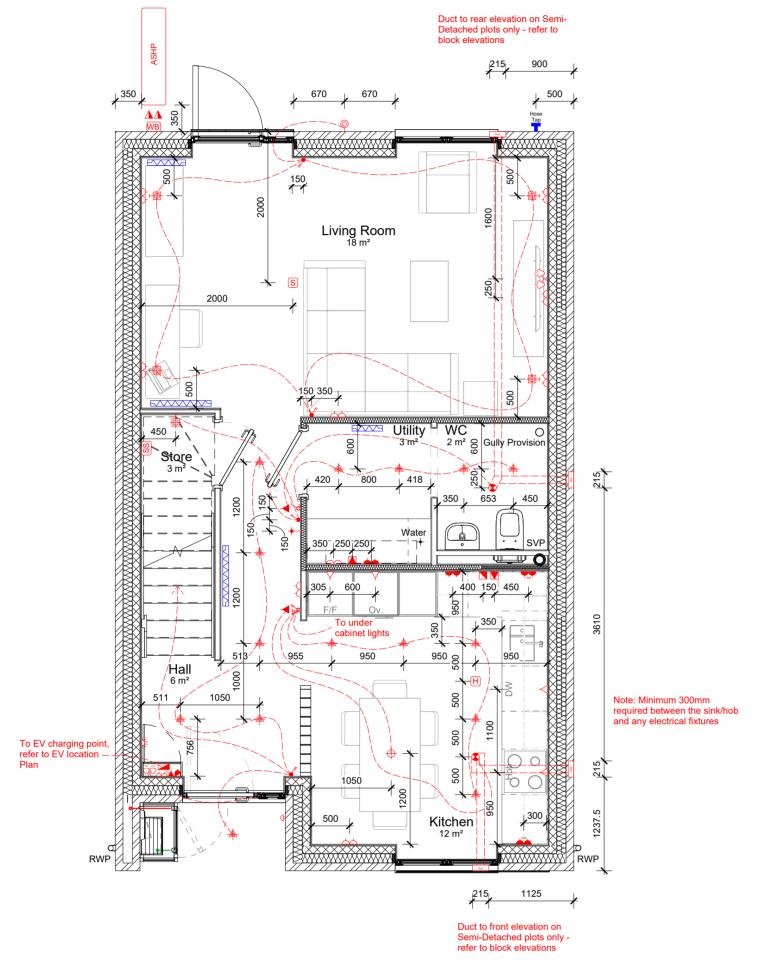

Bedroom 2
8 m²


Bedroom 2
8 m²


Bedroom 2
8 m²

Bedroom 3
8 m²

RWP


1:50

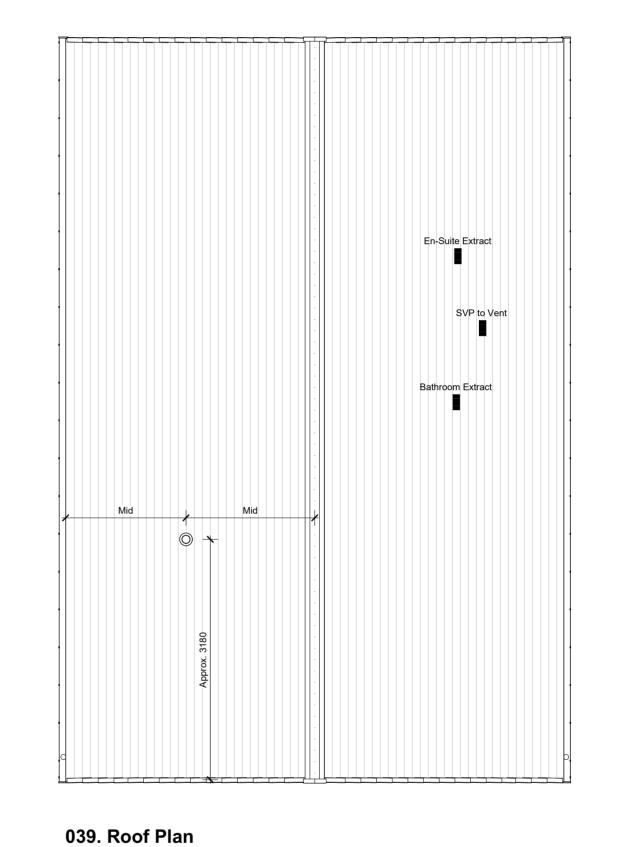

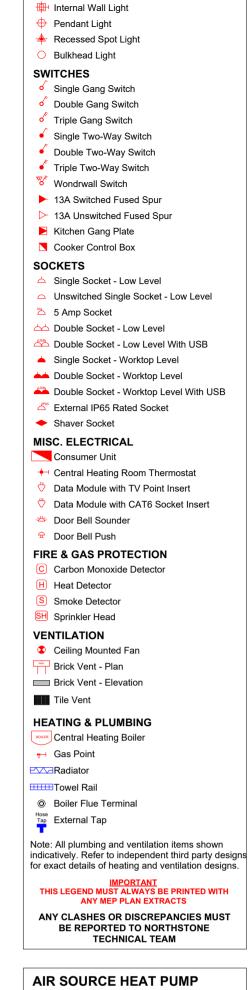


M&E LEGEND


LIGHTING○H External Wall Light

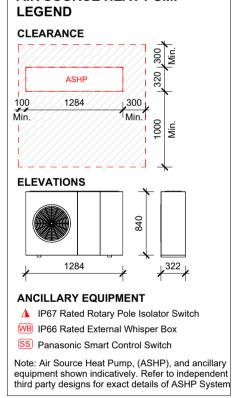




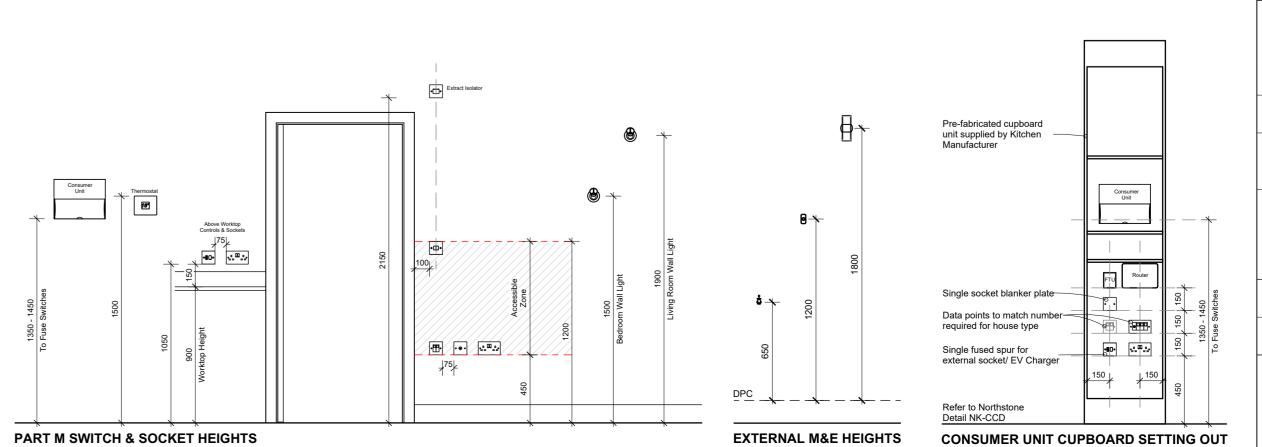


1:50

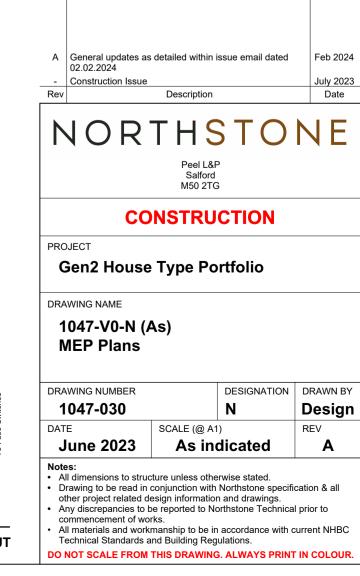



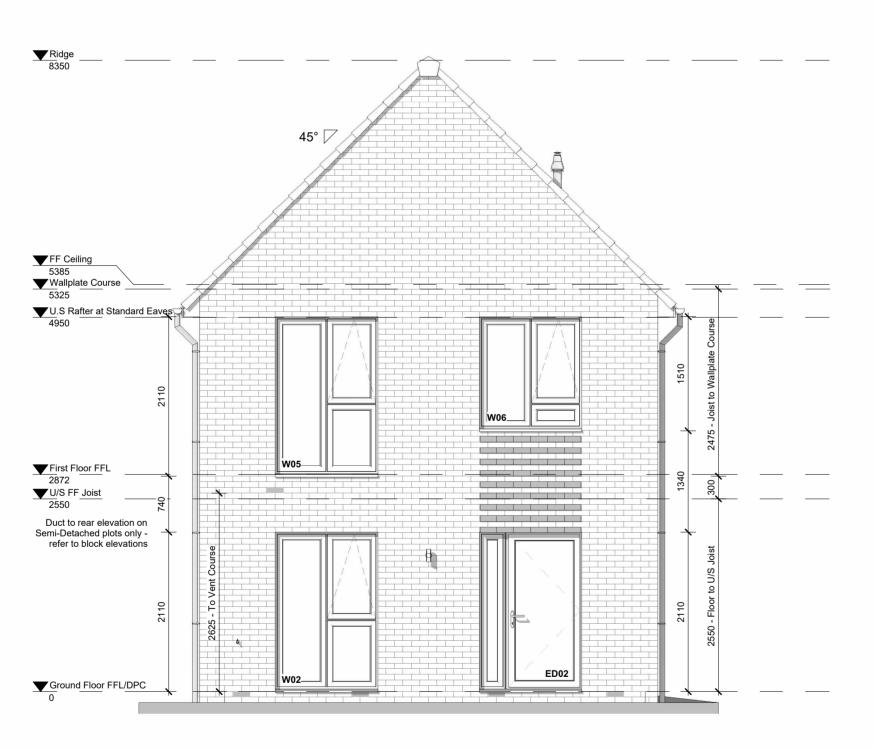



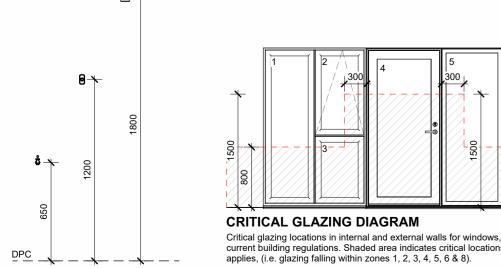

EXTERNAL M&E HEIGHTS

CRITICAL GLAZING DIAGRAM

Critical glazing locations in internal and external walls for windows, doors and side lights in accordance with BS 6206 and all currents building regulations. Shaded area in located critical locations to which the requirements of Approved Document K(4)

Unobstructed opening casement area to be at least 0.33M² and at least 450mm high and 450mm wide. Bottom of windows to be not more than 1100mm and not less than 800mm above the floor. Escape windows to have non lockable fasteners and hinged to achieve the minimum required opening. current building regulations. Shaded area indicates critical locations to which the requirements of Approved Document K(4) applies, (i.e. glazing falling within zones 1, 2, 3, 4, 5, 6 & 8).

All glazing in critical locations should:
a) If broken, will break safely.
b) Be sufficiently robust to resist breaking.


Schedules to be read in conjunction with all project specification documents, floor plans and elevations Structural opening size includes any sidelights

Frame set back is taken from front face of brick


Refer to manufactures information for detailed lintel schedules
All accessible windows and doors to be PAS24 tested to comply with Part Q of building regulations
All dimensions to be checked on site prior to manufacture

Escape from upper storey a maximum of 4.5m above ground level: ALL inner rooms where applicable and all first floor habitable rooms (excluding kitchens) to be provided with an escape window (or external door) which complies with Approved Document B1 Section 2 Paragraph 2.2.


Dwellings with one storey more than 4.5m above ground level: A protected stairway should be provided with minimum 30 minute fire resisting construction at all storey's to comply with Approved Document B1 Section 2 Paragraphs 2.5.

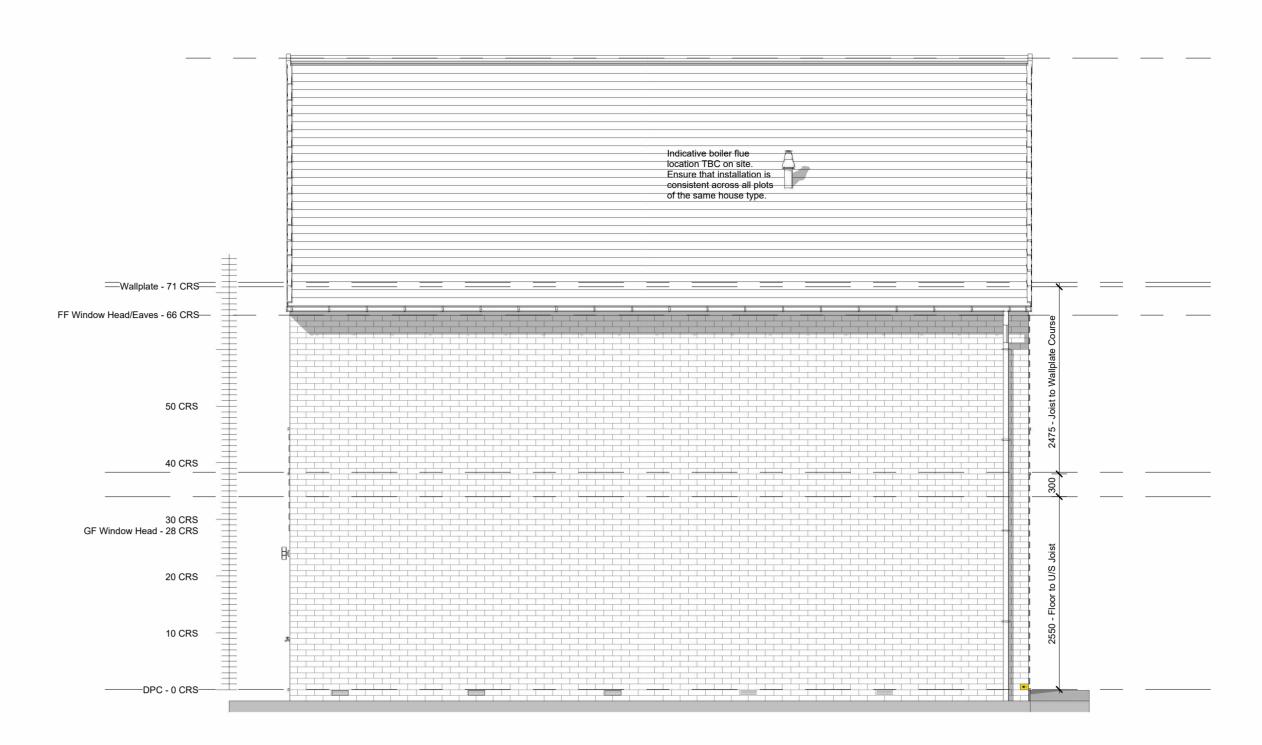

041. LHS Elevation 1:50

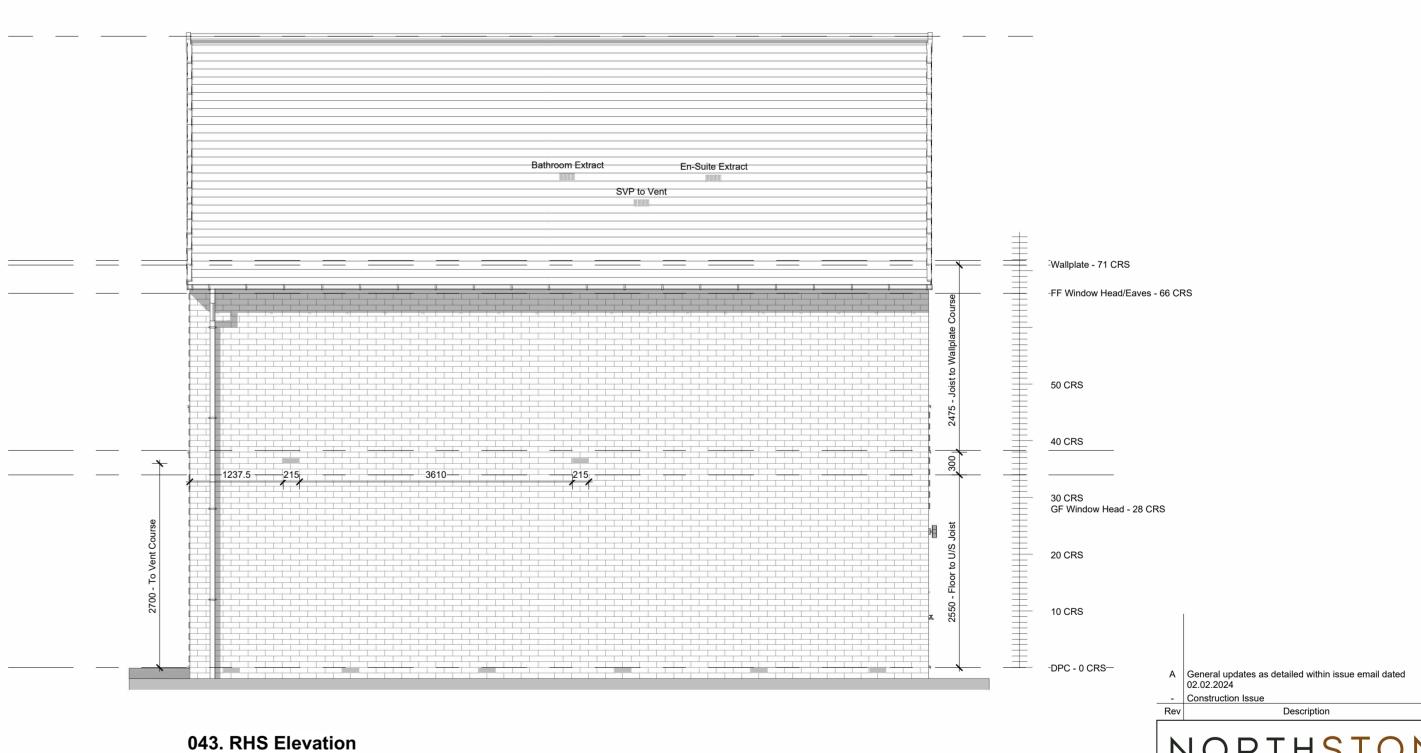


043. RHS Elevation 1:50

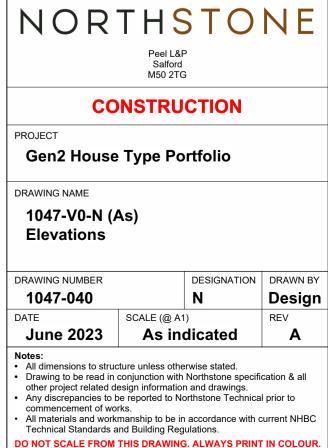

MEMBRANE KEY

Damp Proof Course (DPC)
Damp Proof Membrane (DPM)
Roof Underlay
Breather Membrane

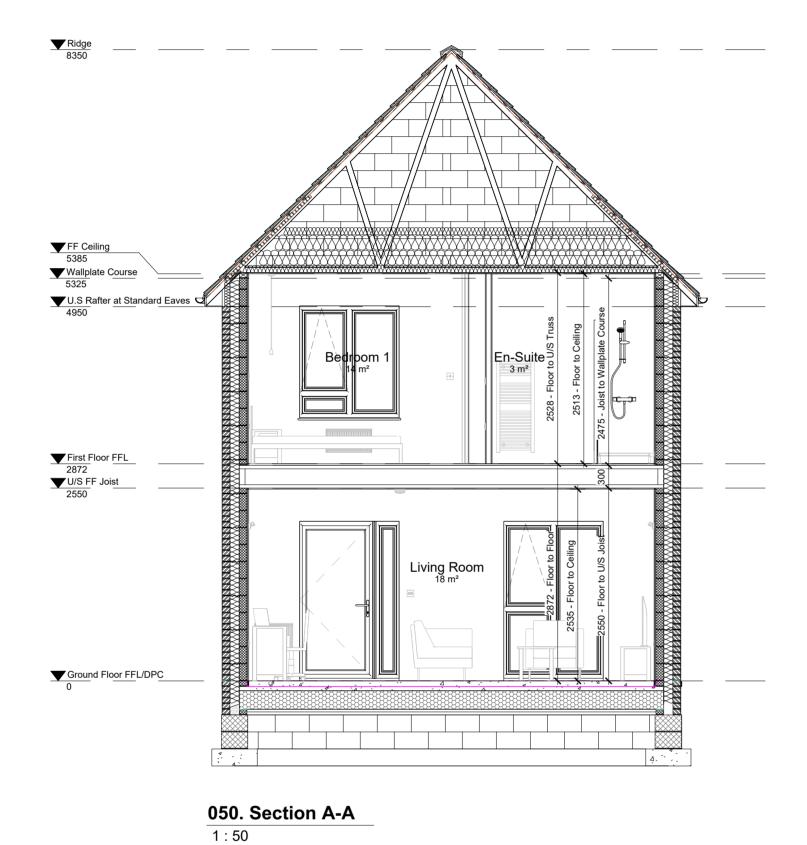

Find Floor FT-UPC

Ground Ploy FT-UPC

O51. Section B-B

1:50

A General updates as detailed within issue email dated 02.02.2024 - Construction Issue
Rev NORTHSTONE Peel L&P Salford M50 2TG CONSTRUCTION Gen2 House Type Portfolio DRAWING NAME 1047-V0-N (As) Sections DESIGNATION DRAWN BY DRAWING NUMBER Design 1047-050 SCALE (@ A1) June 2023 1:50 Α Notes:

• All dimensions to structure unless otherwise stated.

• Drawing to be read in conjunction with Northstone specification & all other project related design information and drawings.

• Any discrepancies to be reported to Northstone Technical prior to commencement of works.

• All materials and workmanship to be in accordance with current NHBC Technical Standards and Building Regulations.

DO NOT SCALE FROM THIS DRAWING. ALWAYS PRINT IN COLOUR.